


PEAK LET- THRU IN AMPERES

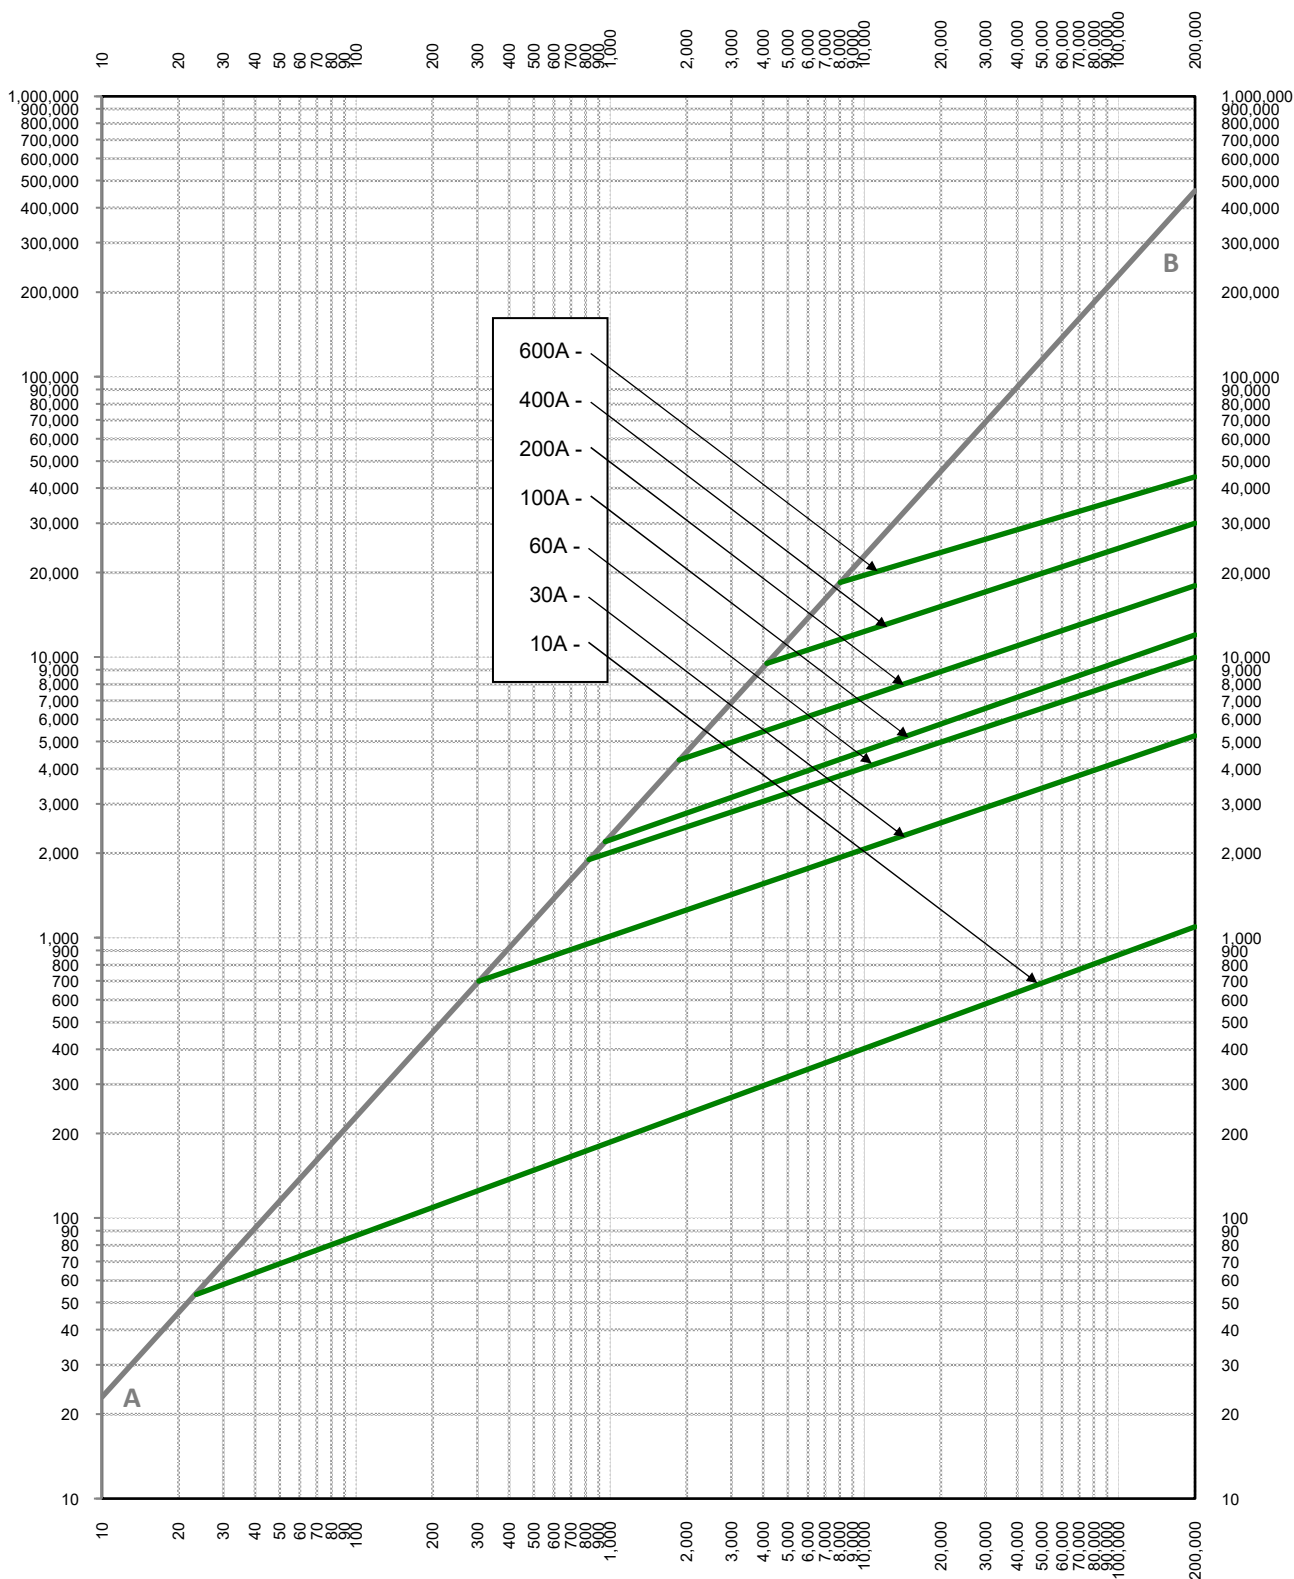

AVAILABLE FAULT CURRENT
SYMMETRICAL R.M.S. AMPERES

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor		JLS 10A - 600A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 08/05/2022 REVISION: A
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: FCC05-JLS SHEET 2 OF 2