



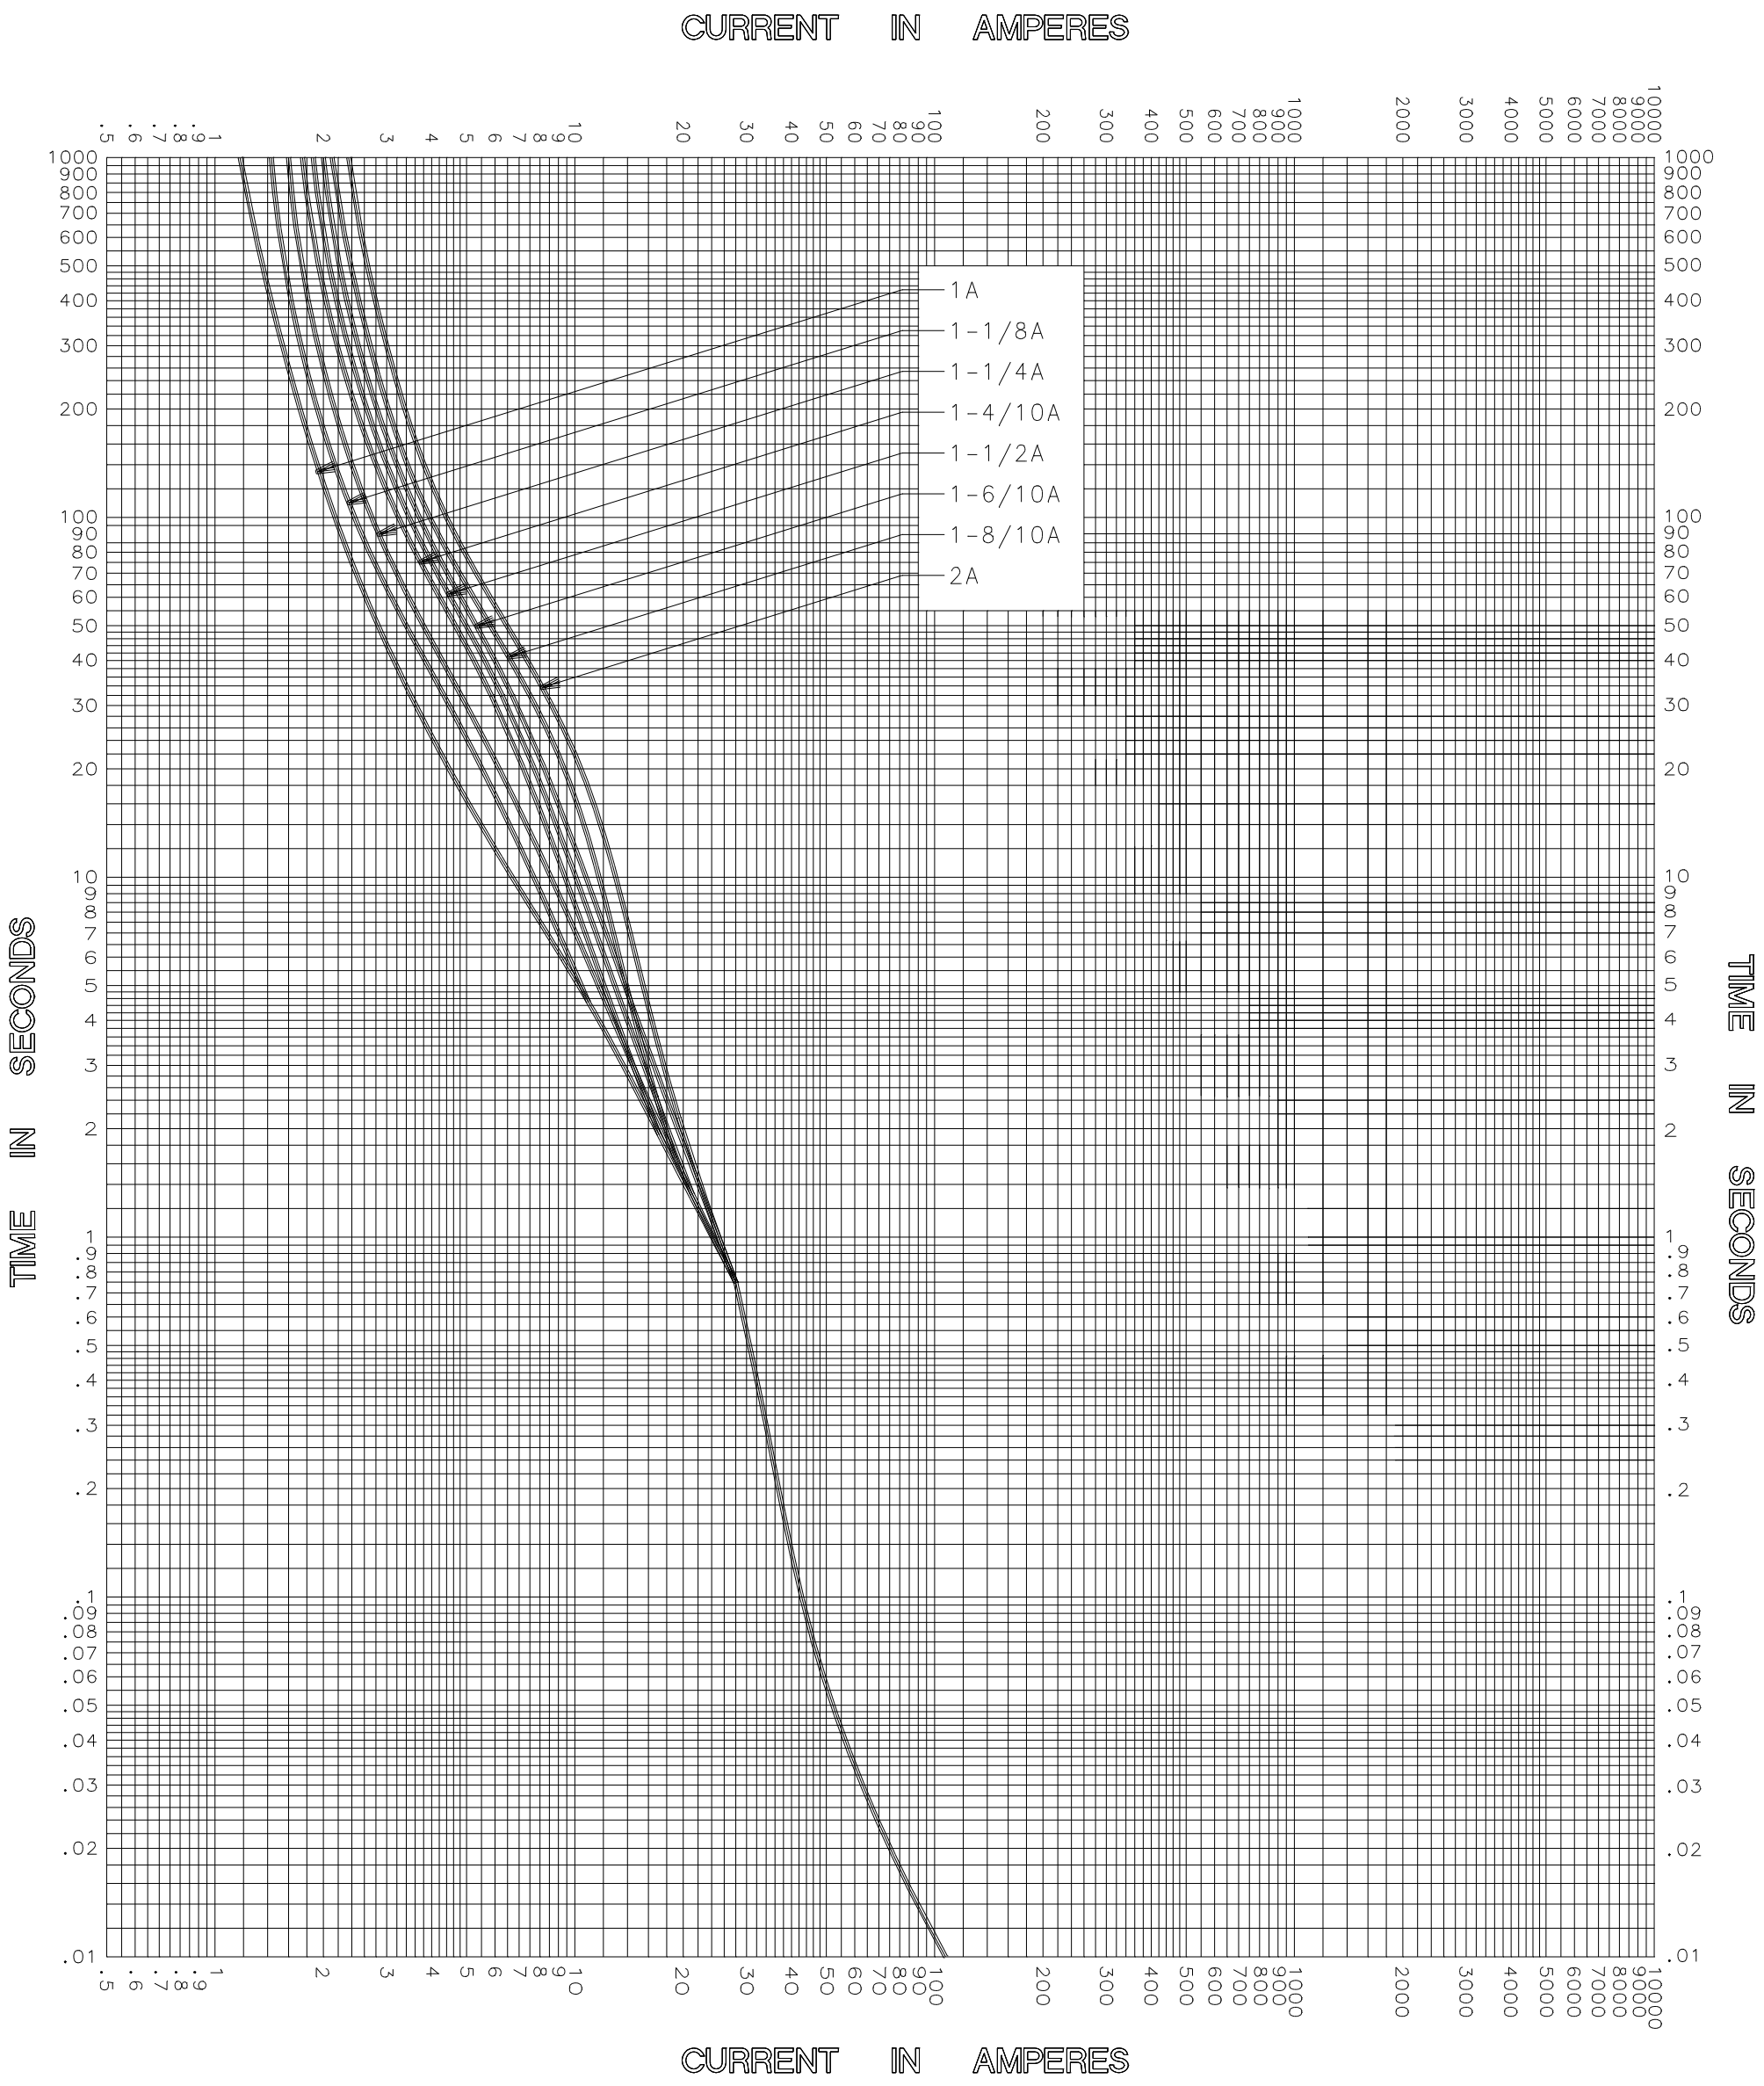

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER FLSR (1A - 2A) ID	
LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>01/07/05</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO. A-FCC01-FLSRID-002

TIME IN SECONDS

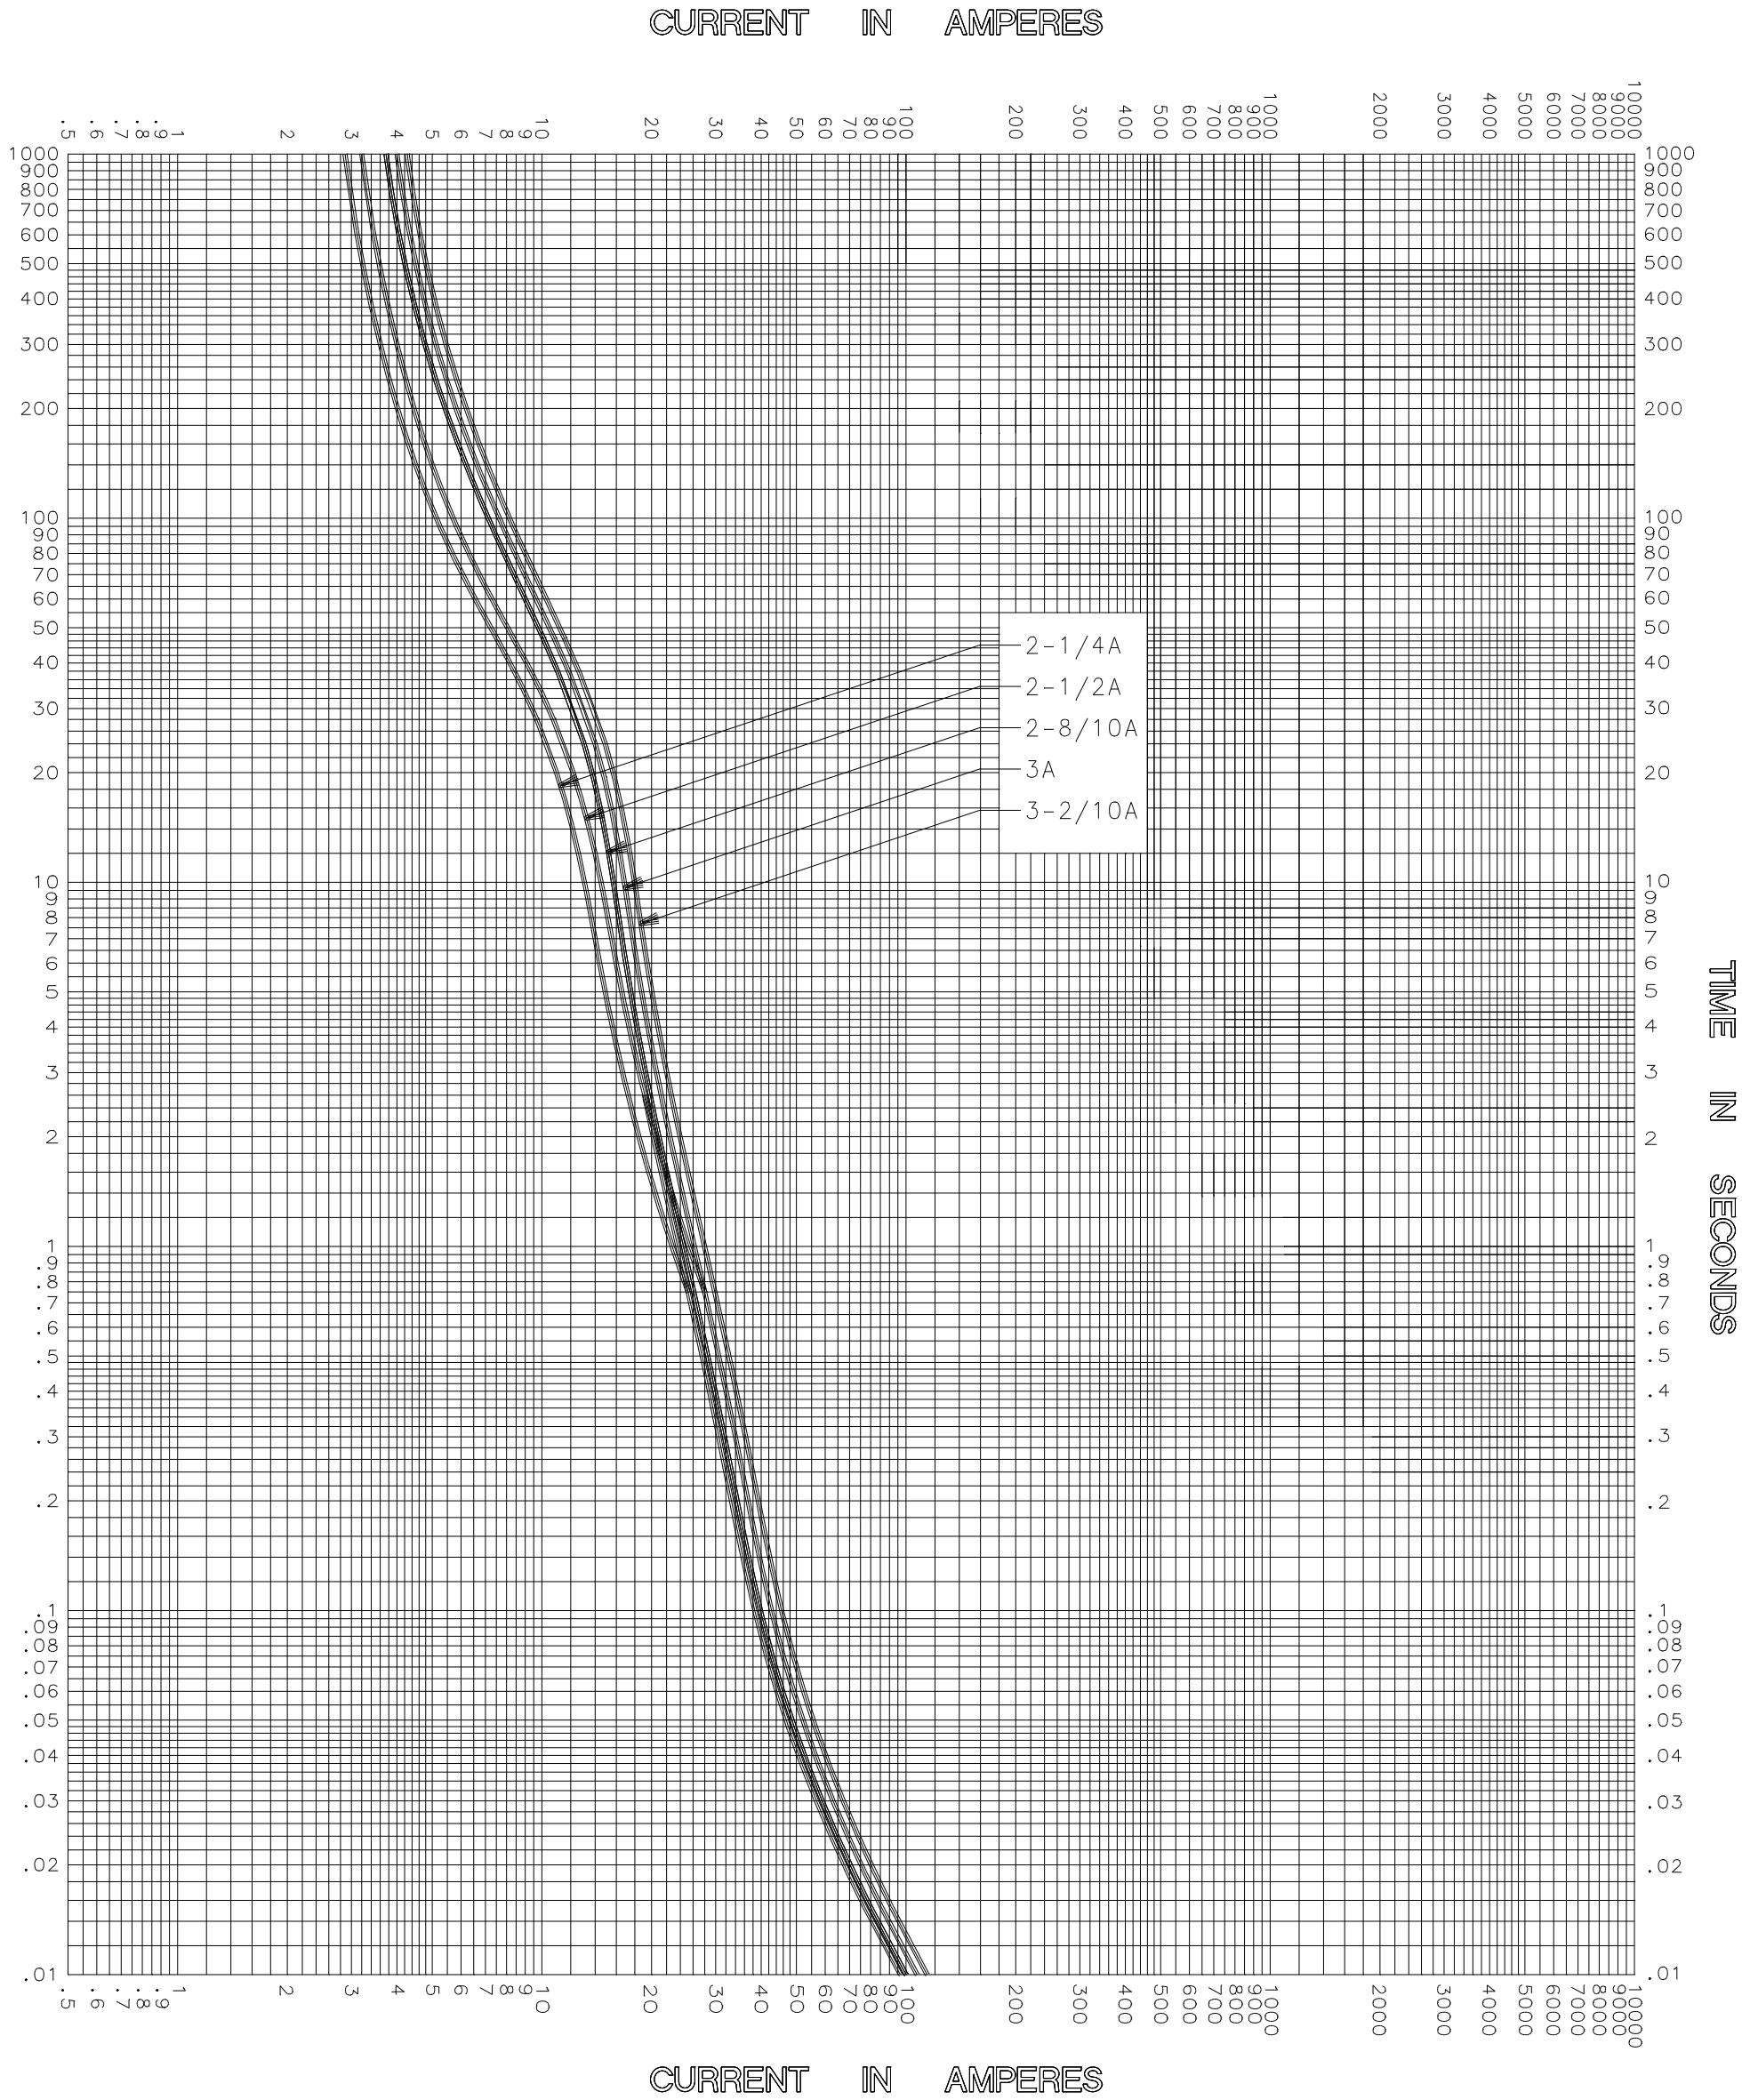

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (2-1/4A - 3-2/10A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-FLSRID-003

-THIS DATA GENERATED ON CAD-

TIME IN SECONDS

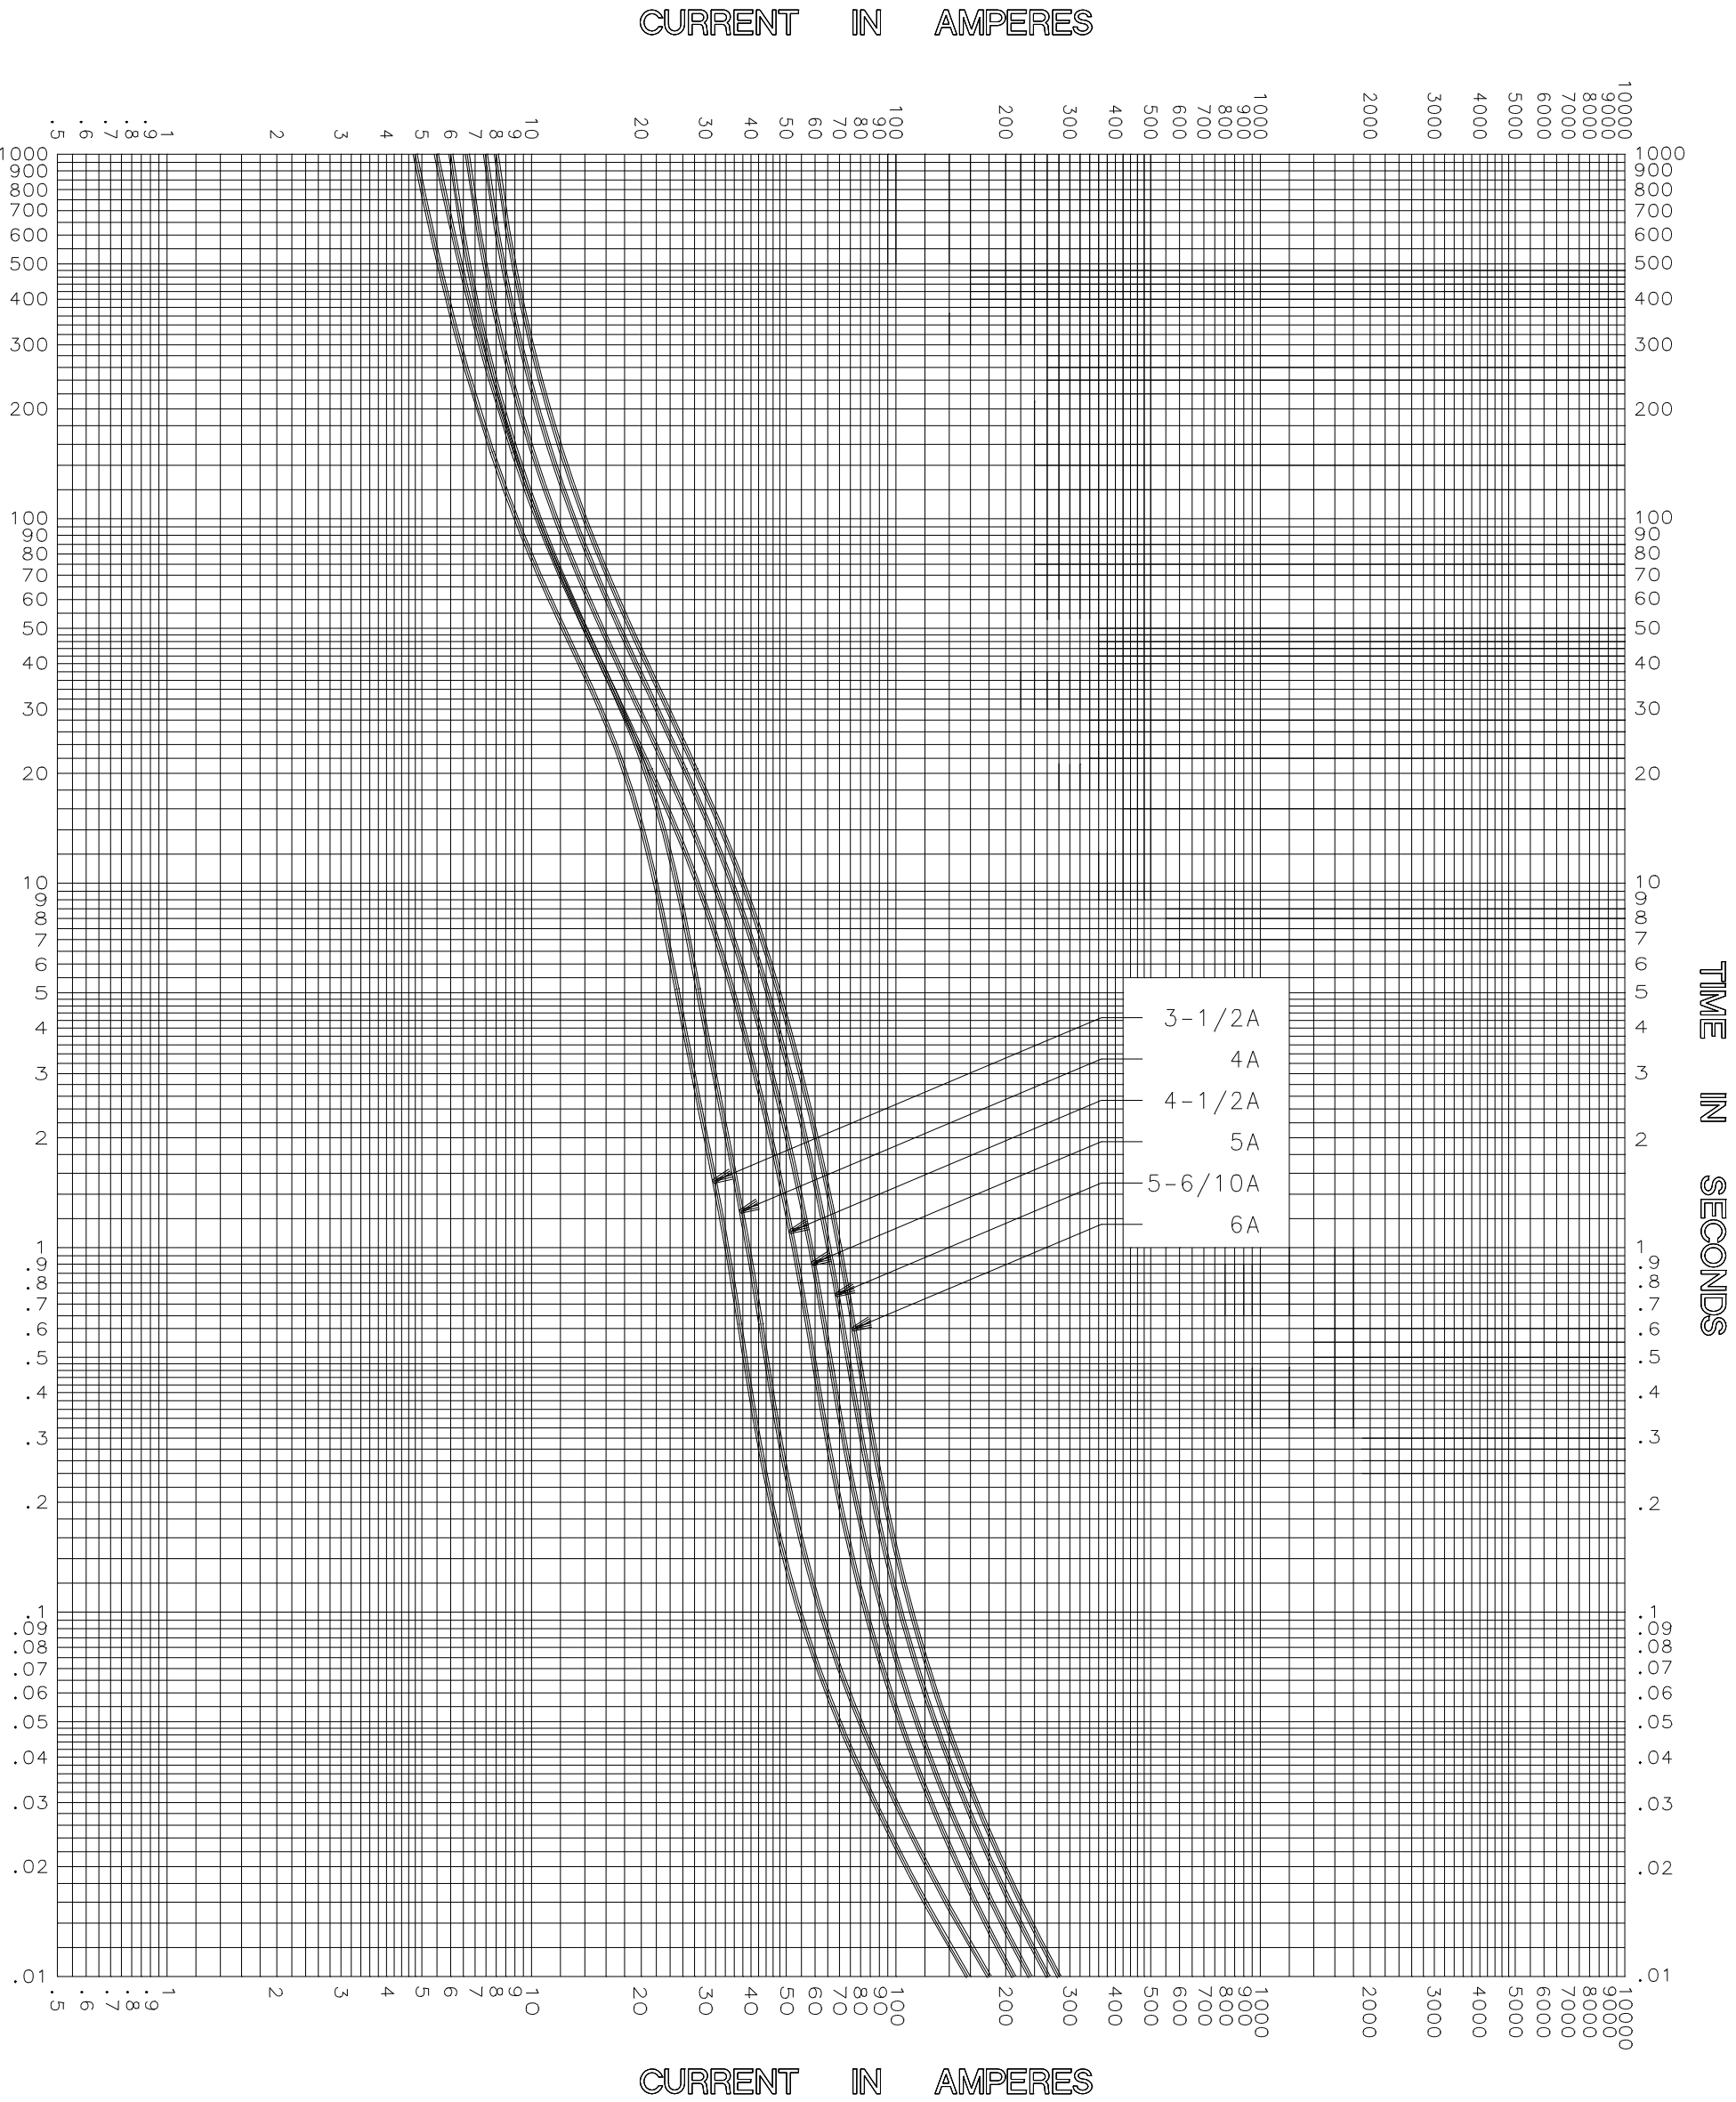

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (3-1/2A - 6A) ID




LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES


DRAWING NO.
A-FCC01-FLSRID-004

-THIS DATA GENERATED ON CAD-

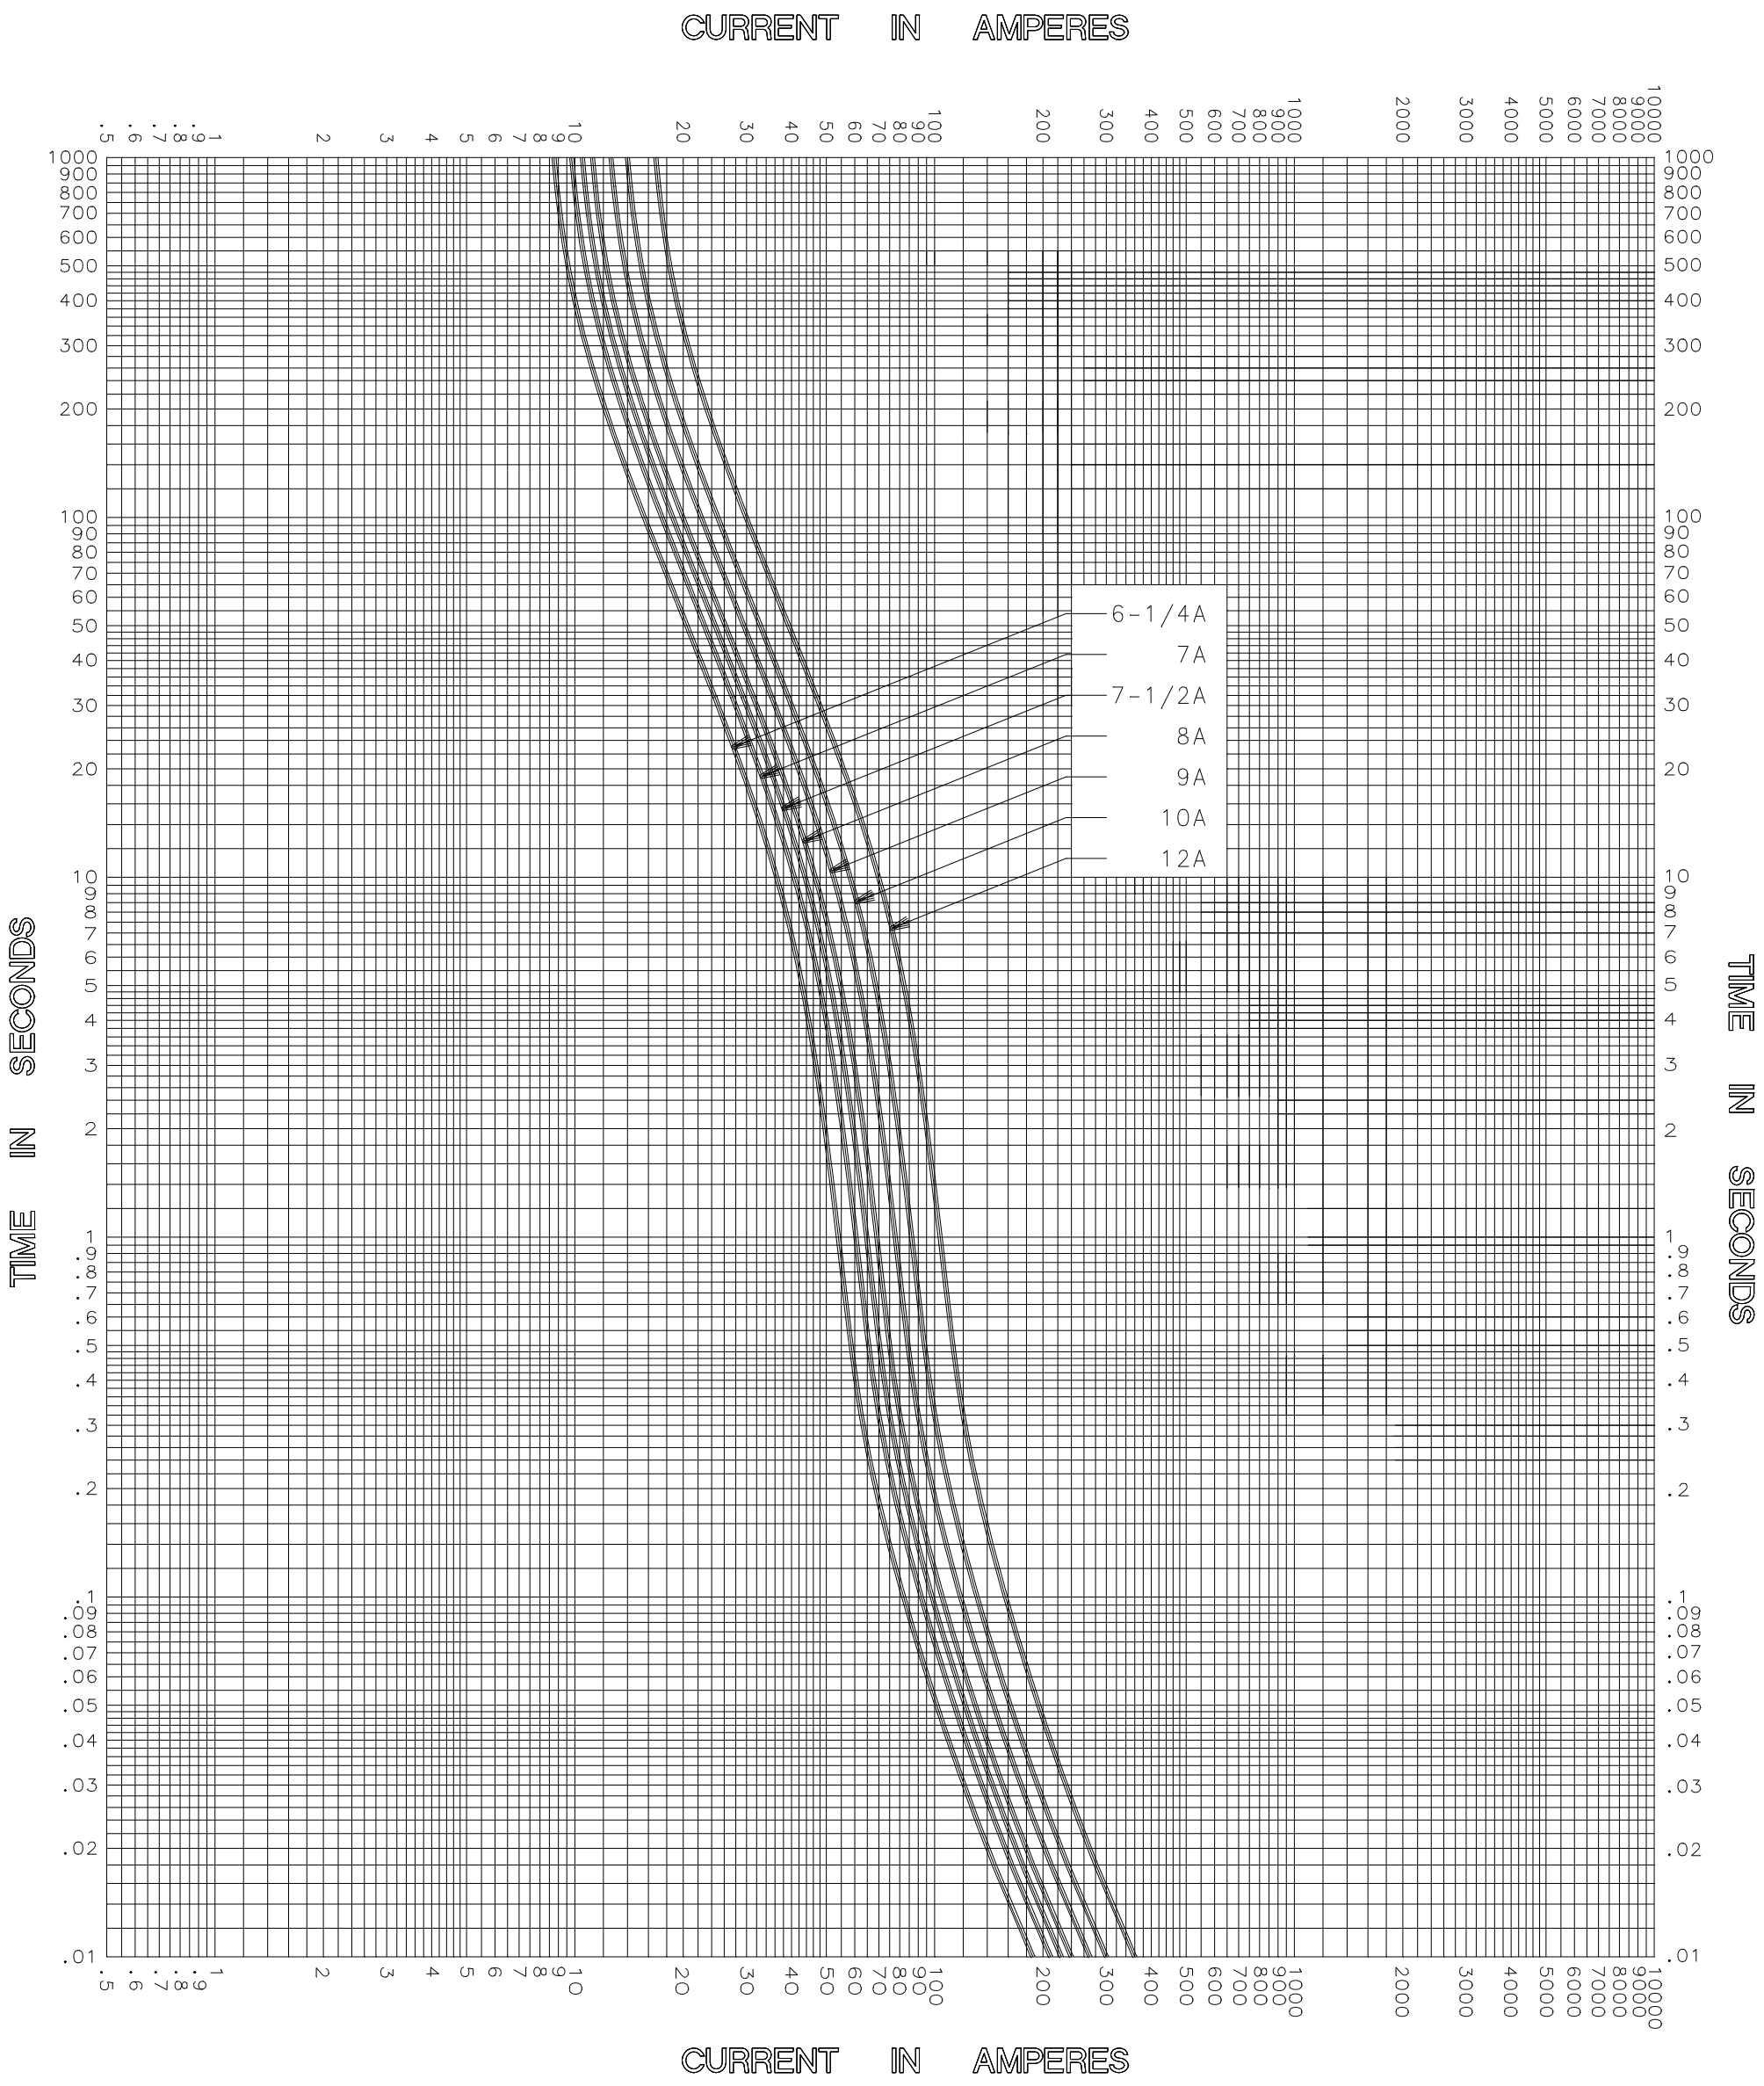

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER FLSR (6-1/4A - 12A) ID _____
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>01/07/05</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-FLSRID-005

TIME IN SECONDS

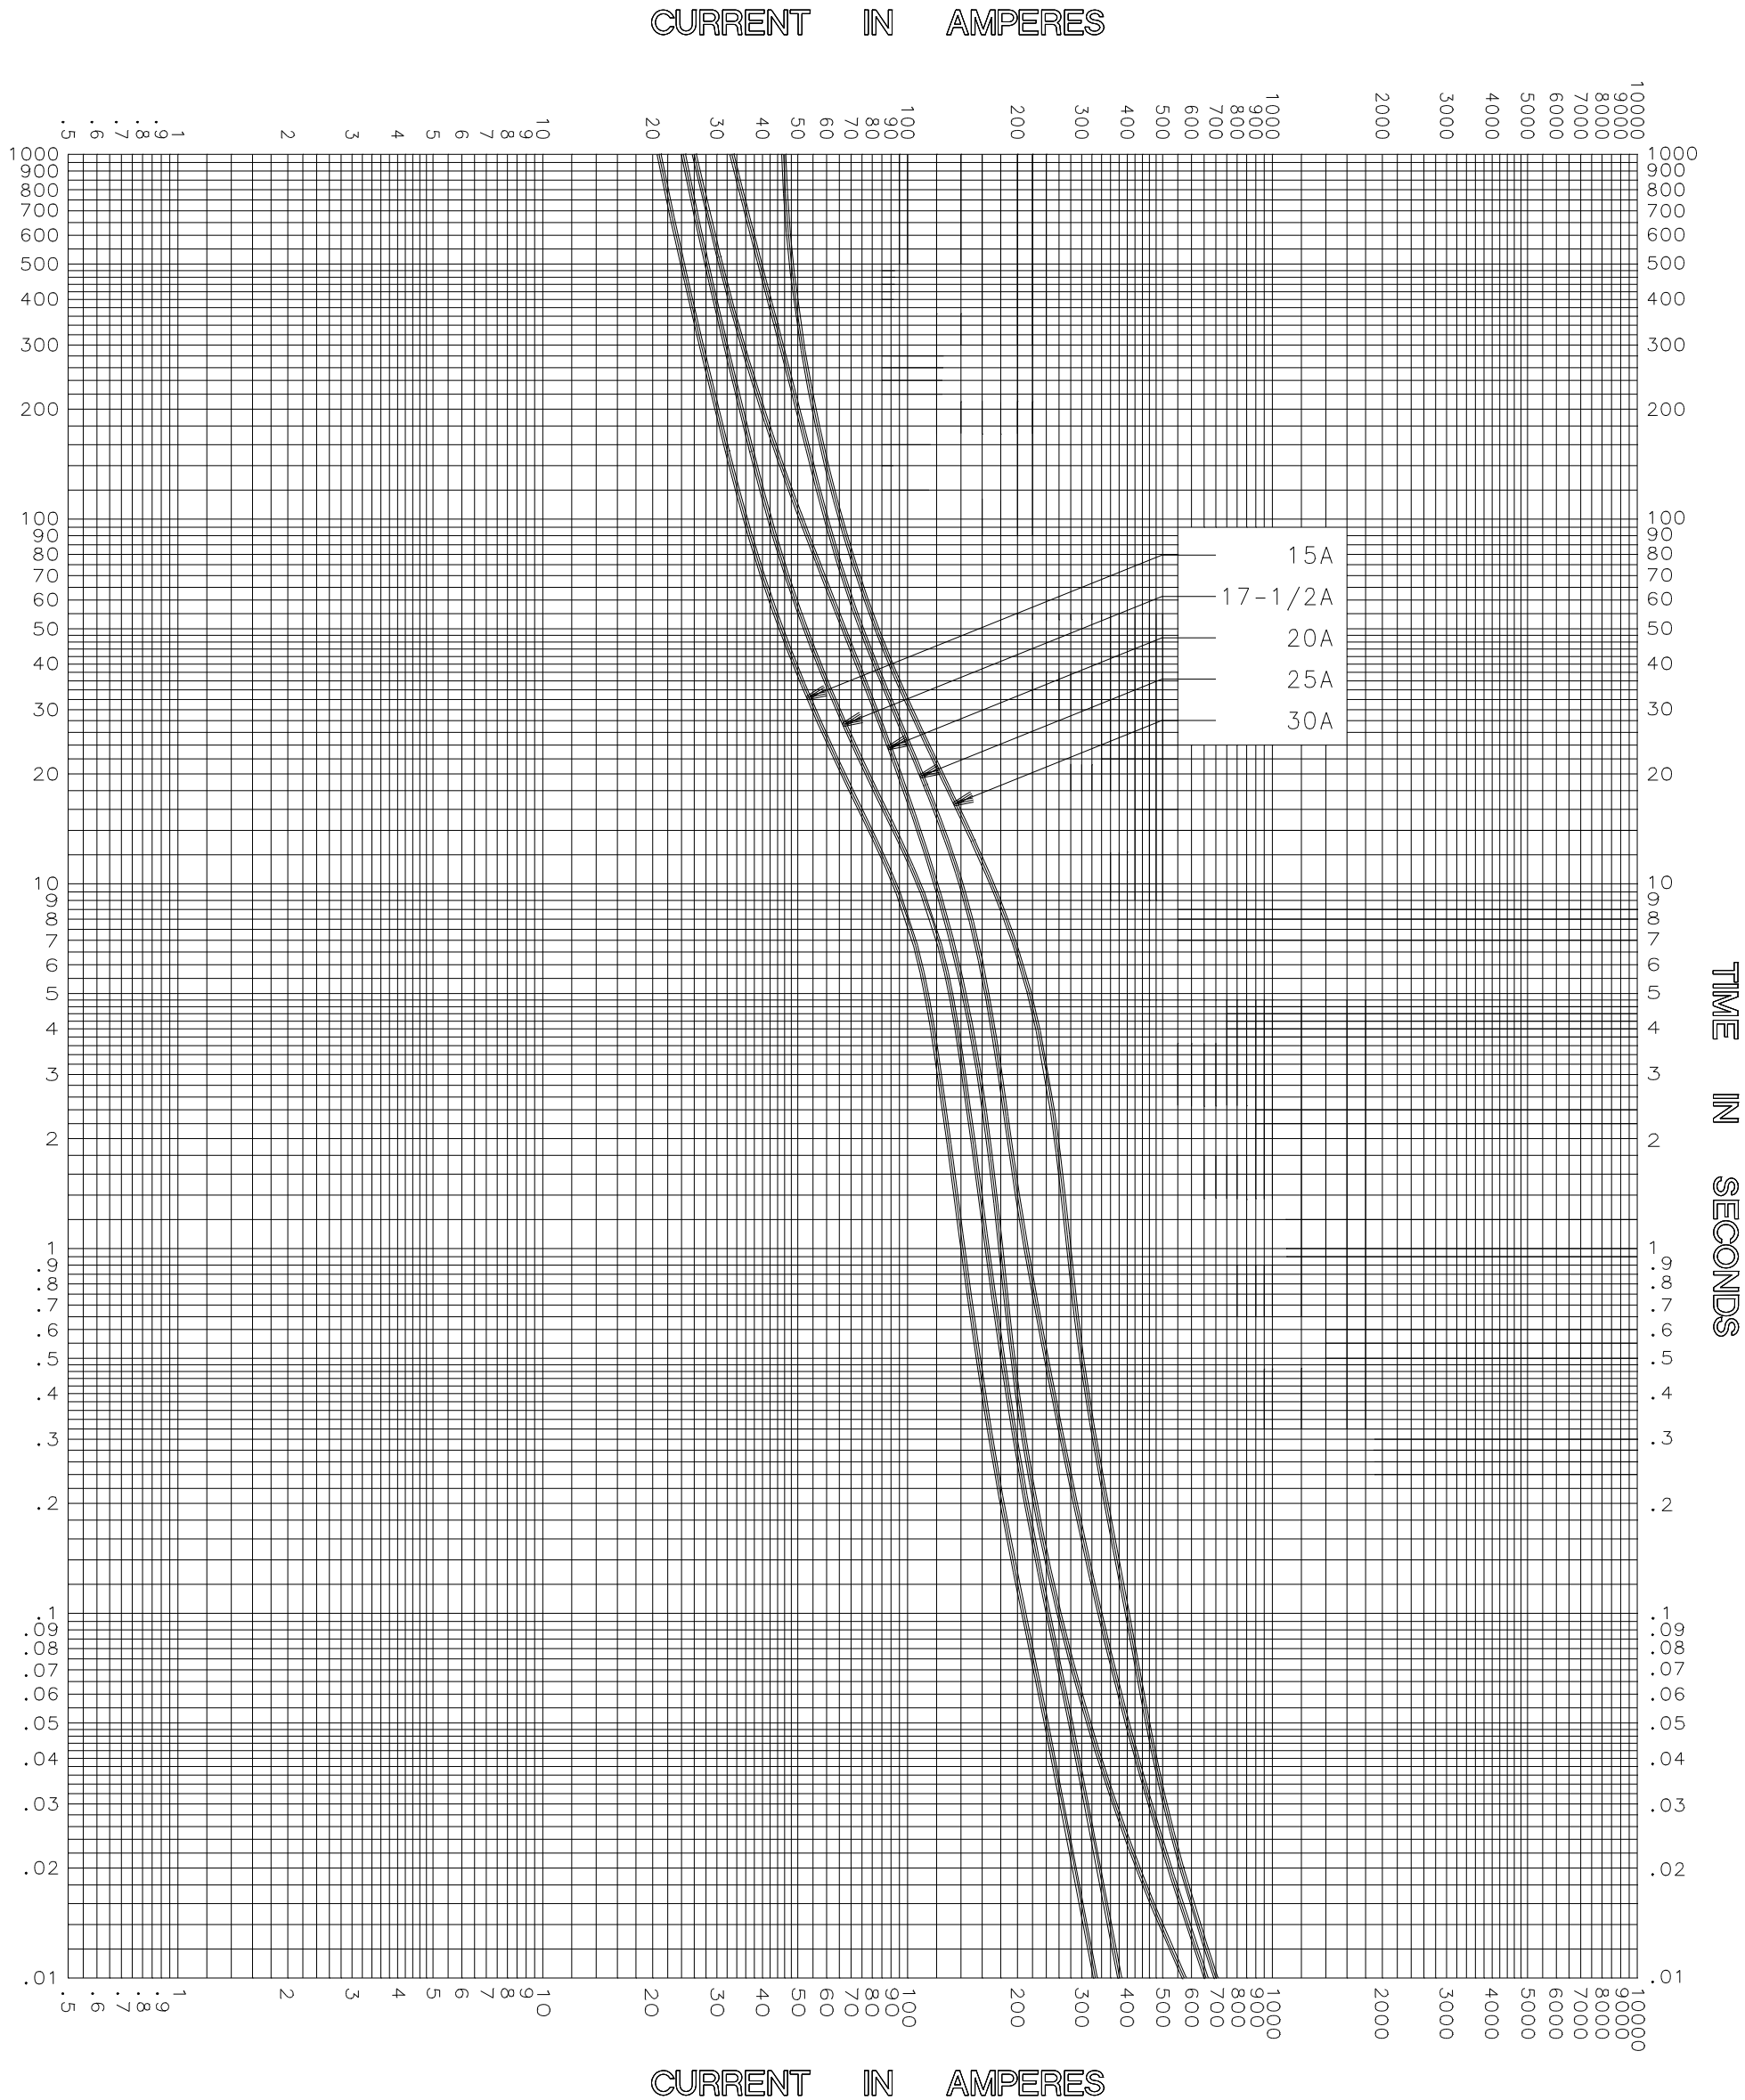

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (15A - 30A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-FLSRID-006

-THIS DATA GENERATED ON CAD-

SECONDS IN TIME

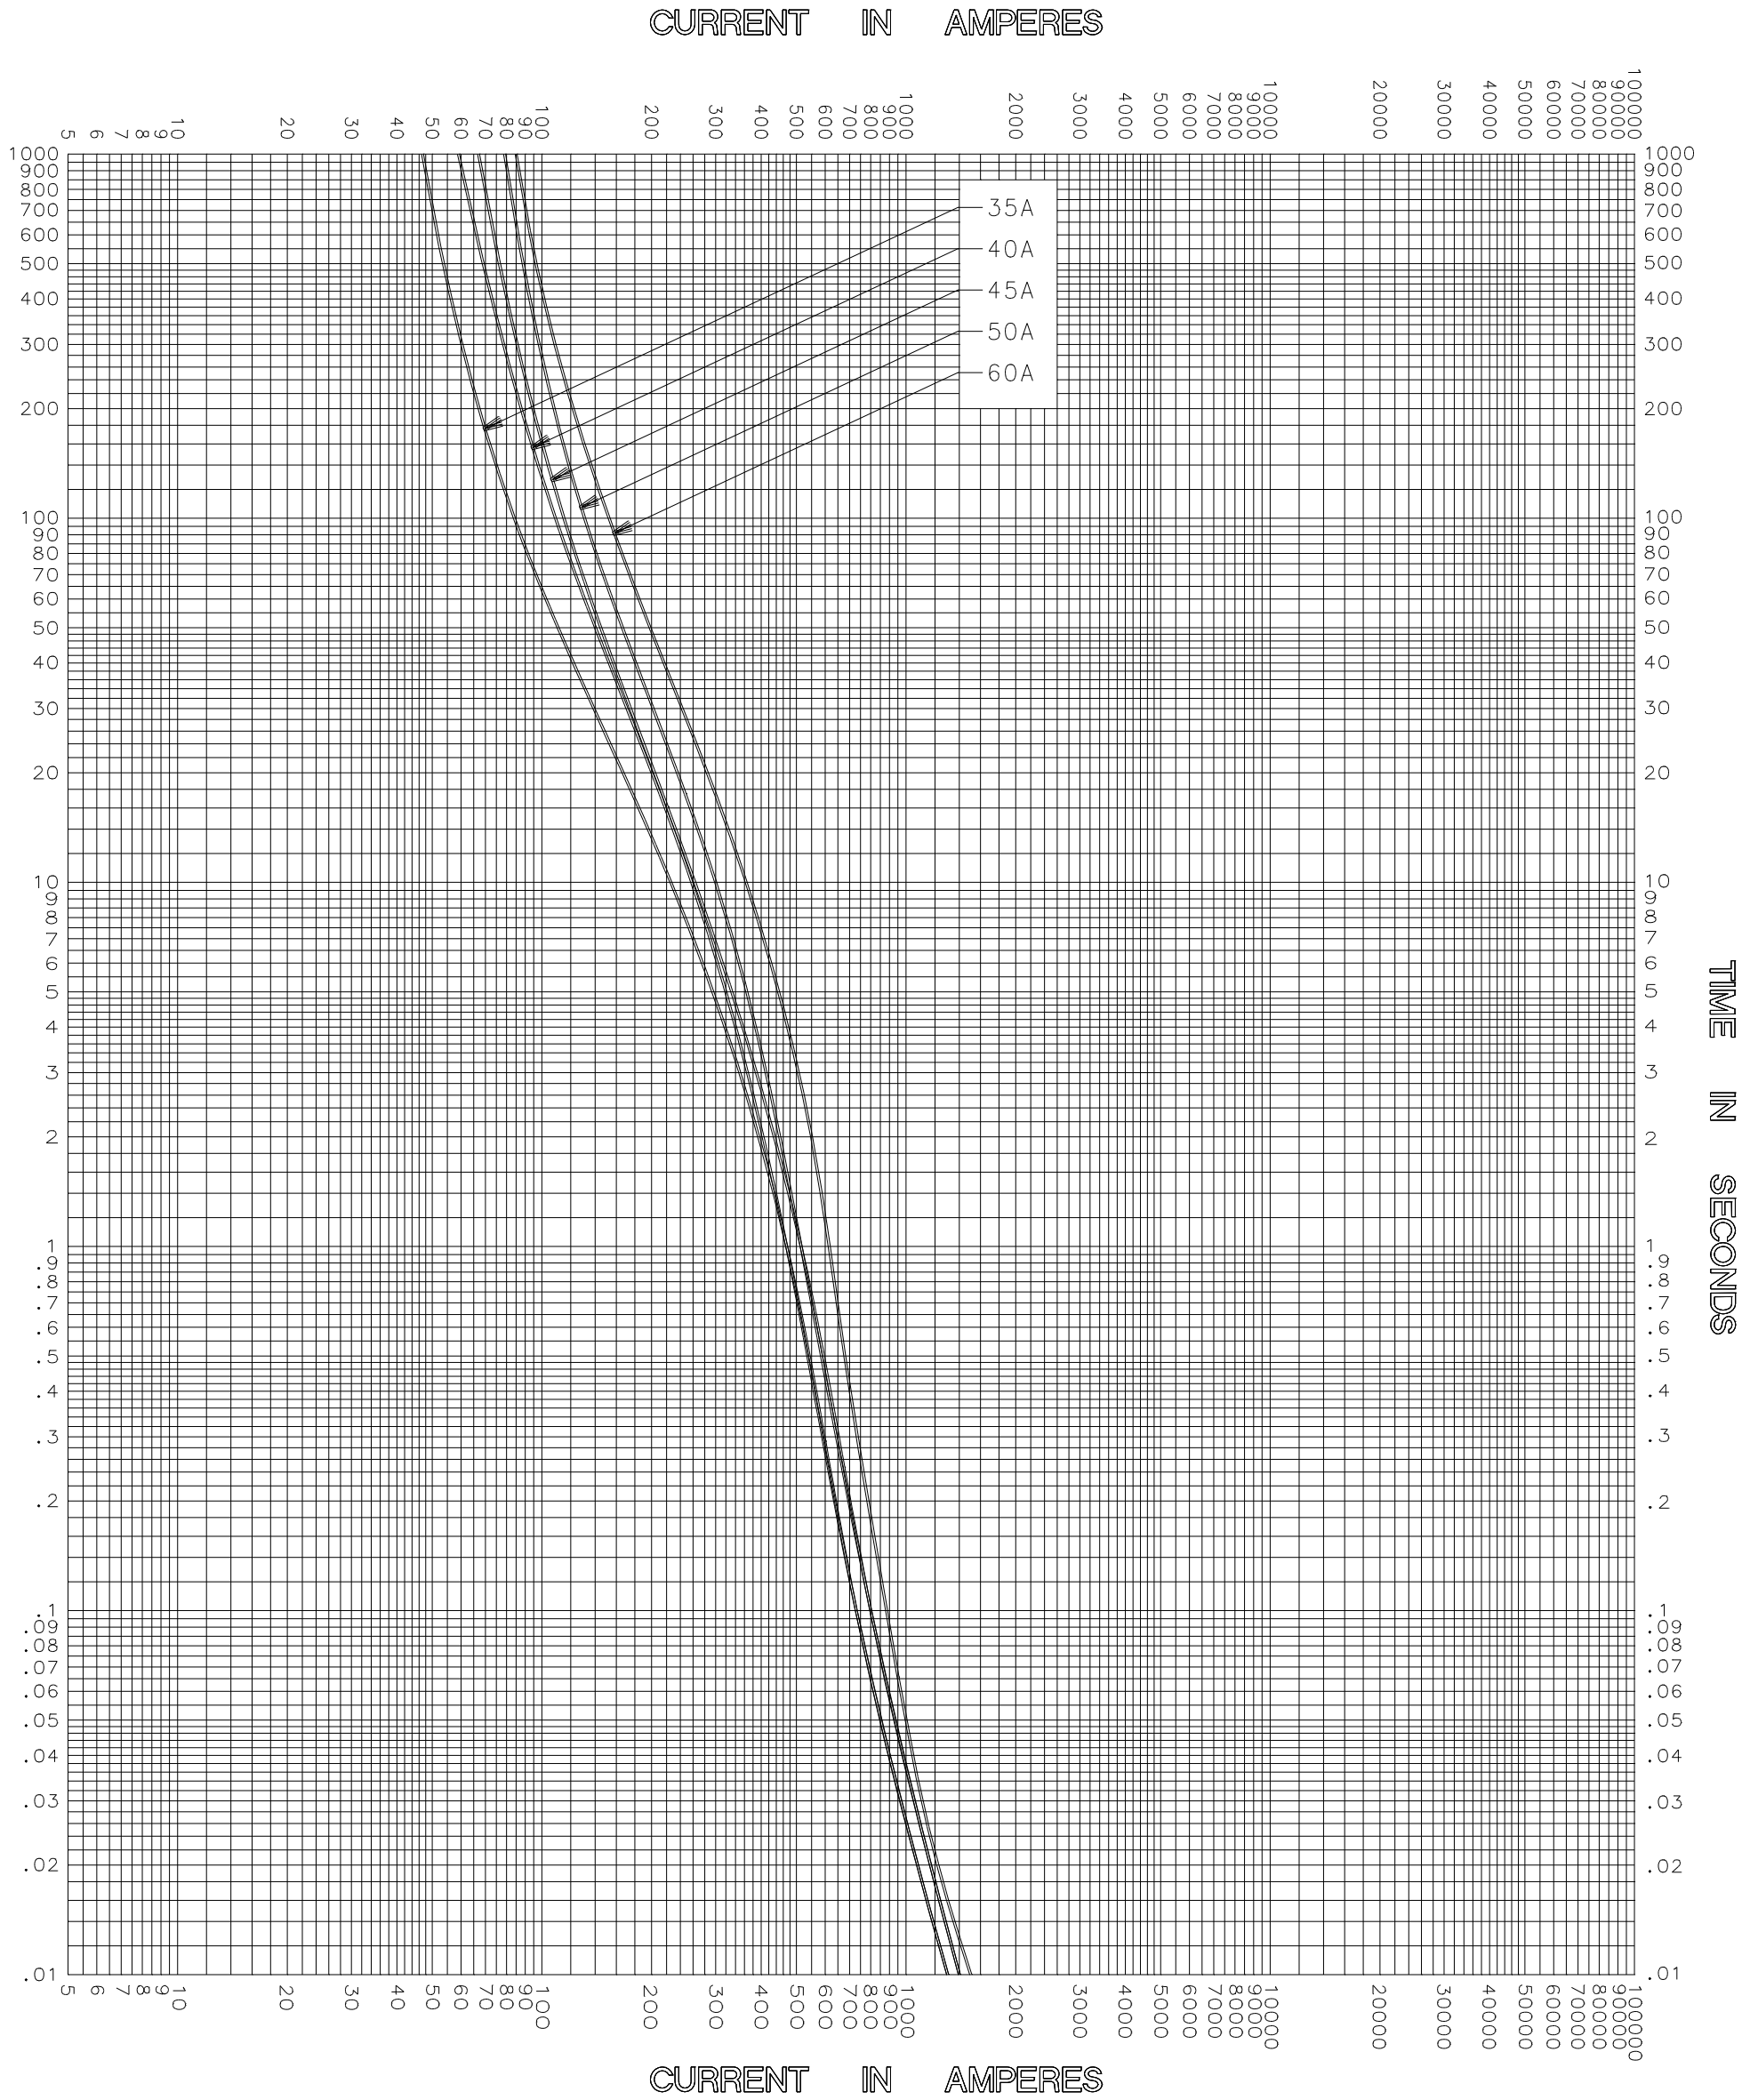

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (35A - 60A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-FLSR-0007

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT

SECONDS IN TIME

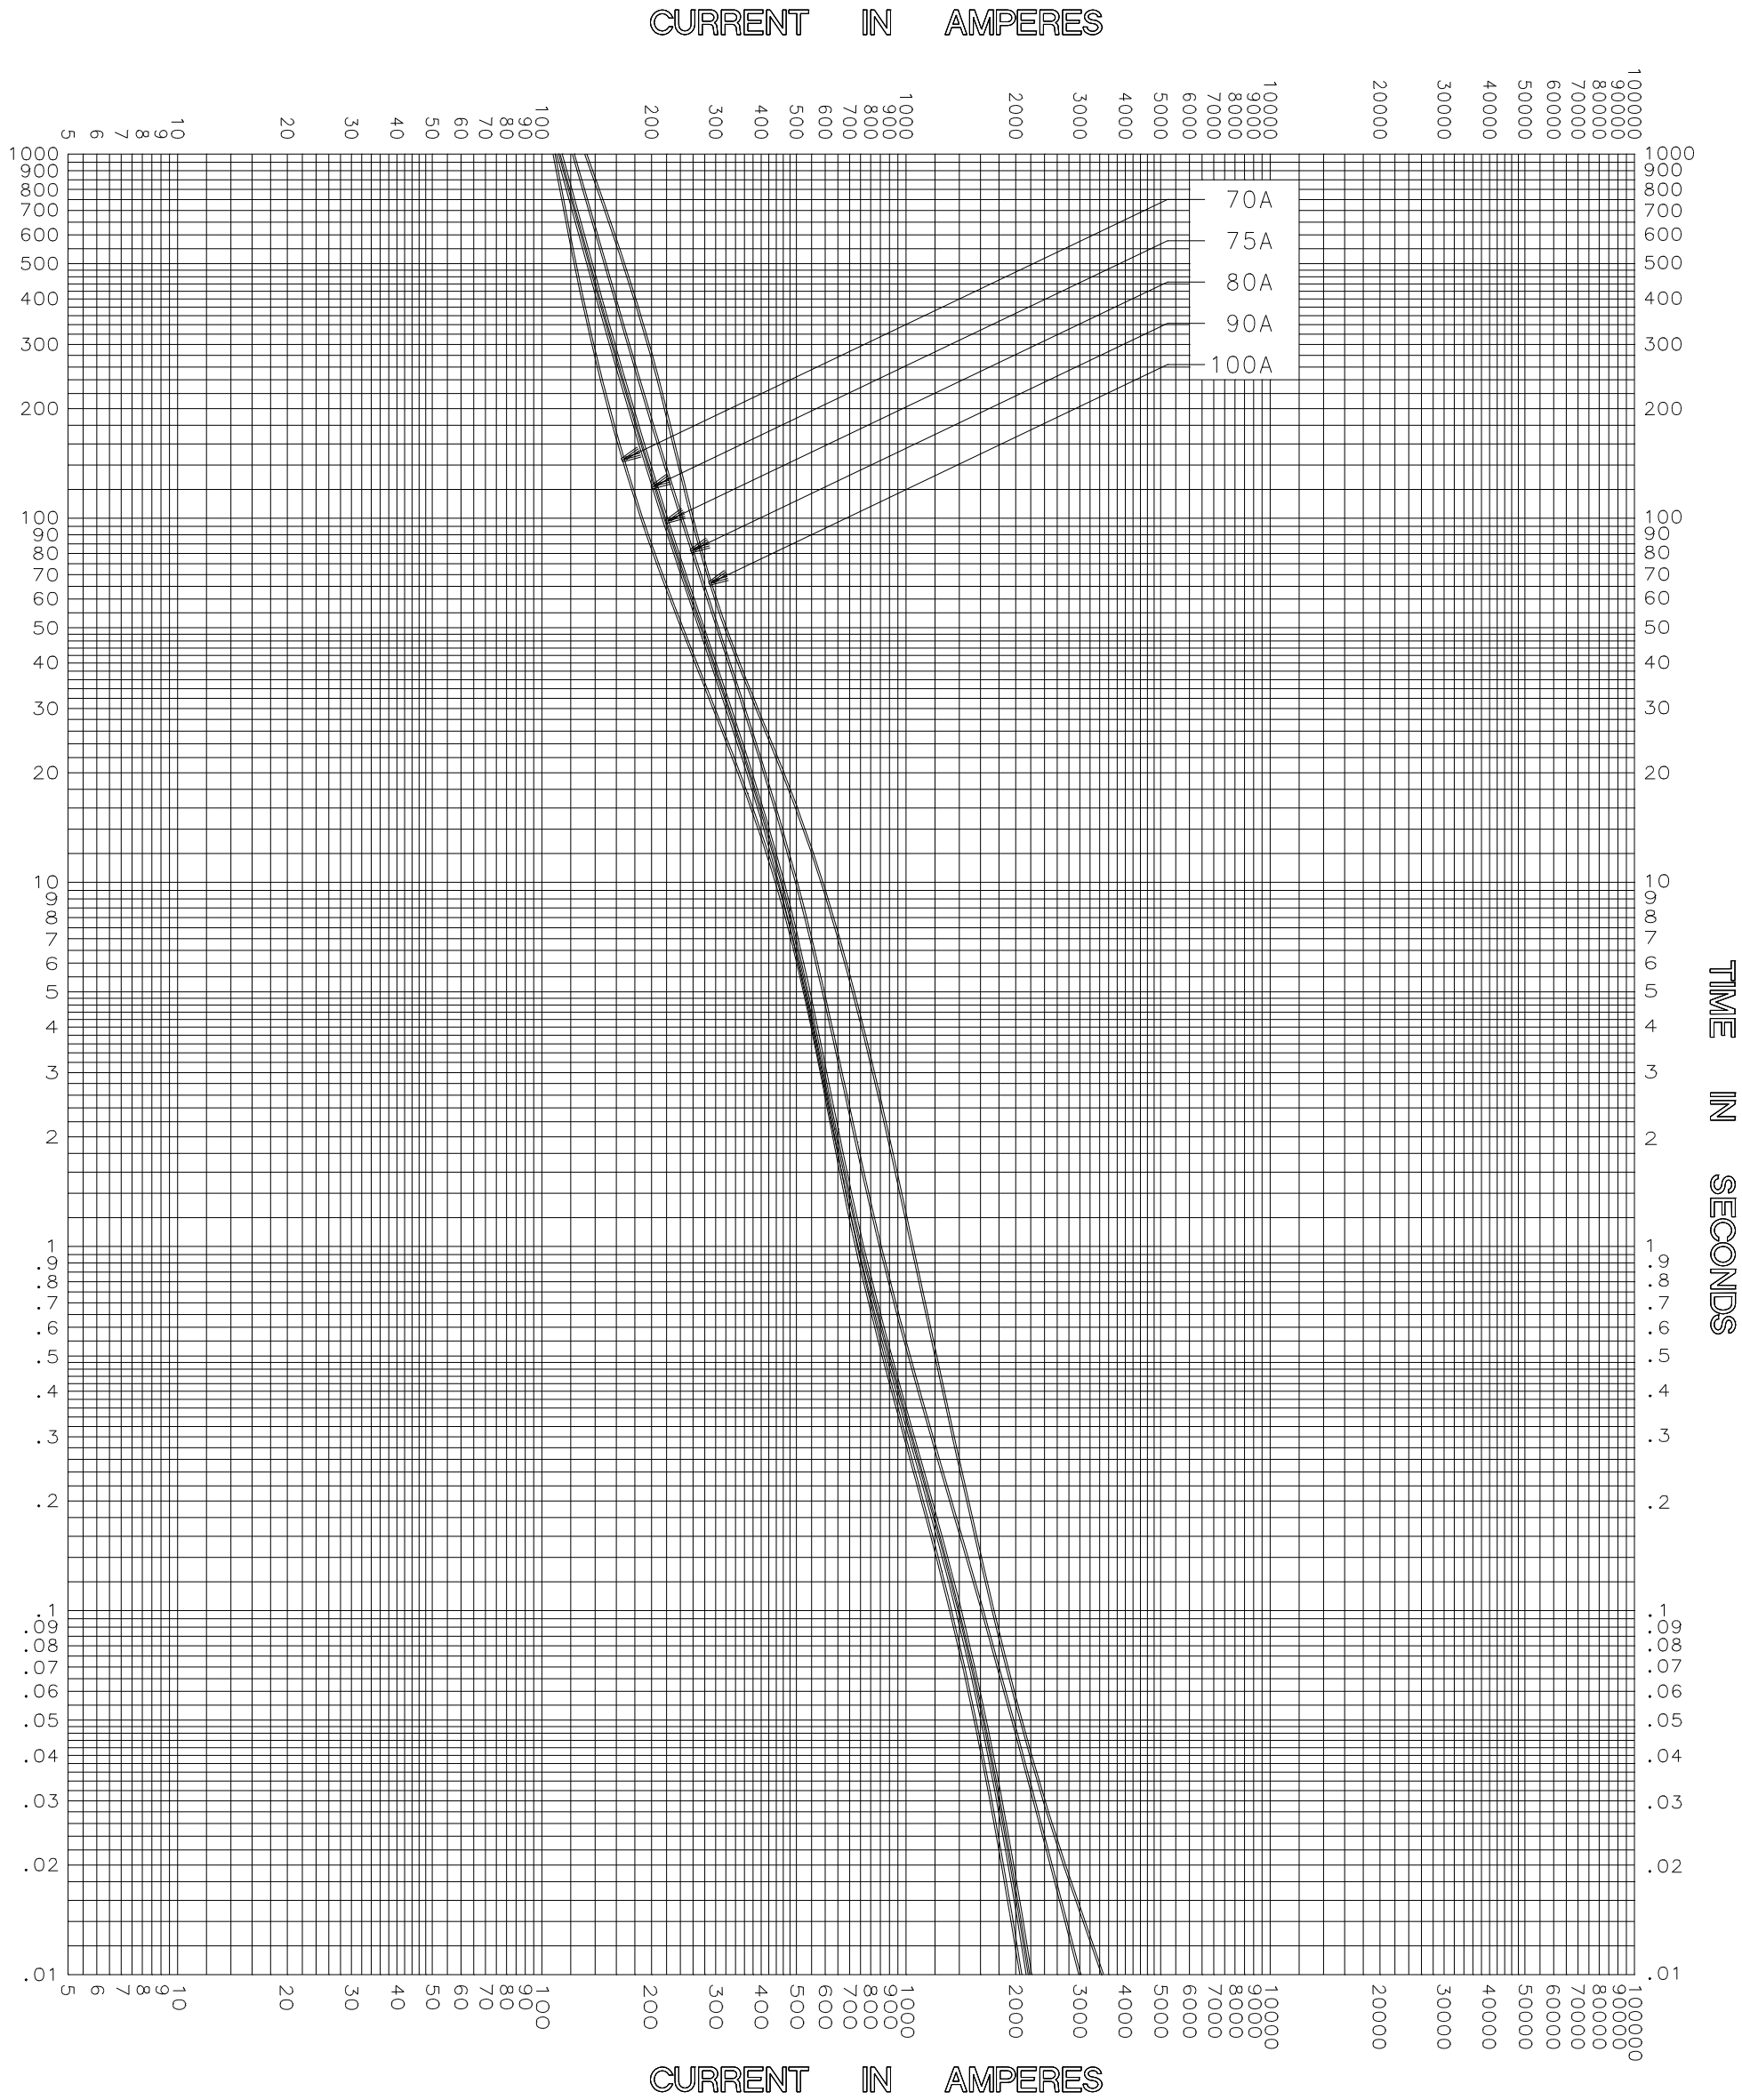

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (70A - 100A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-FLSRID-008

-THIS DATA GENERATED ON CAD-

SECONDS IN TIME

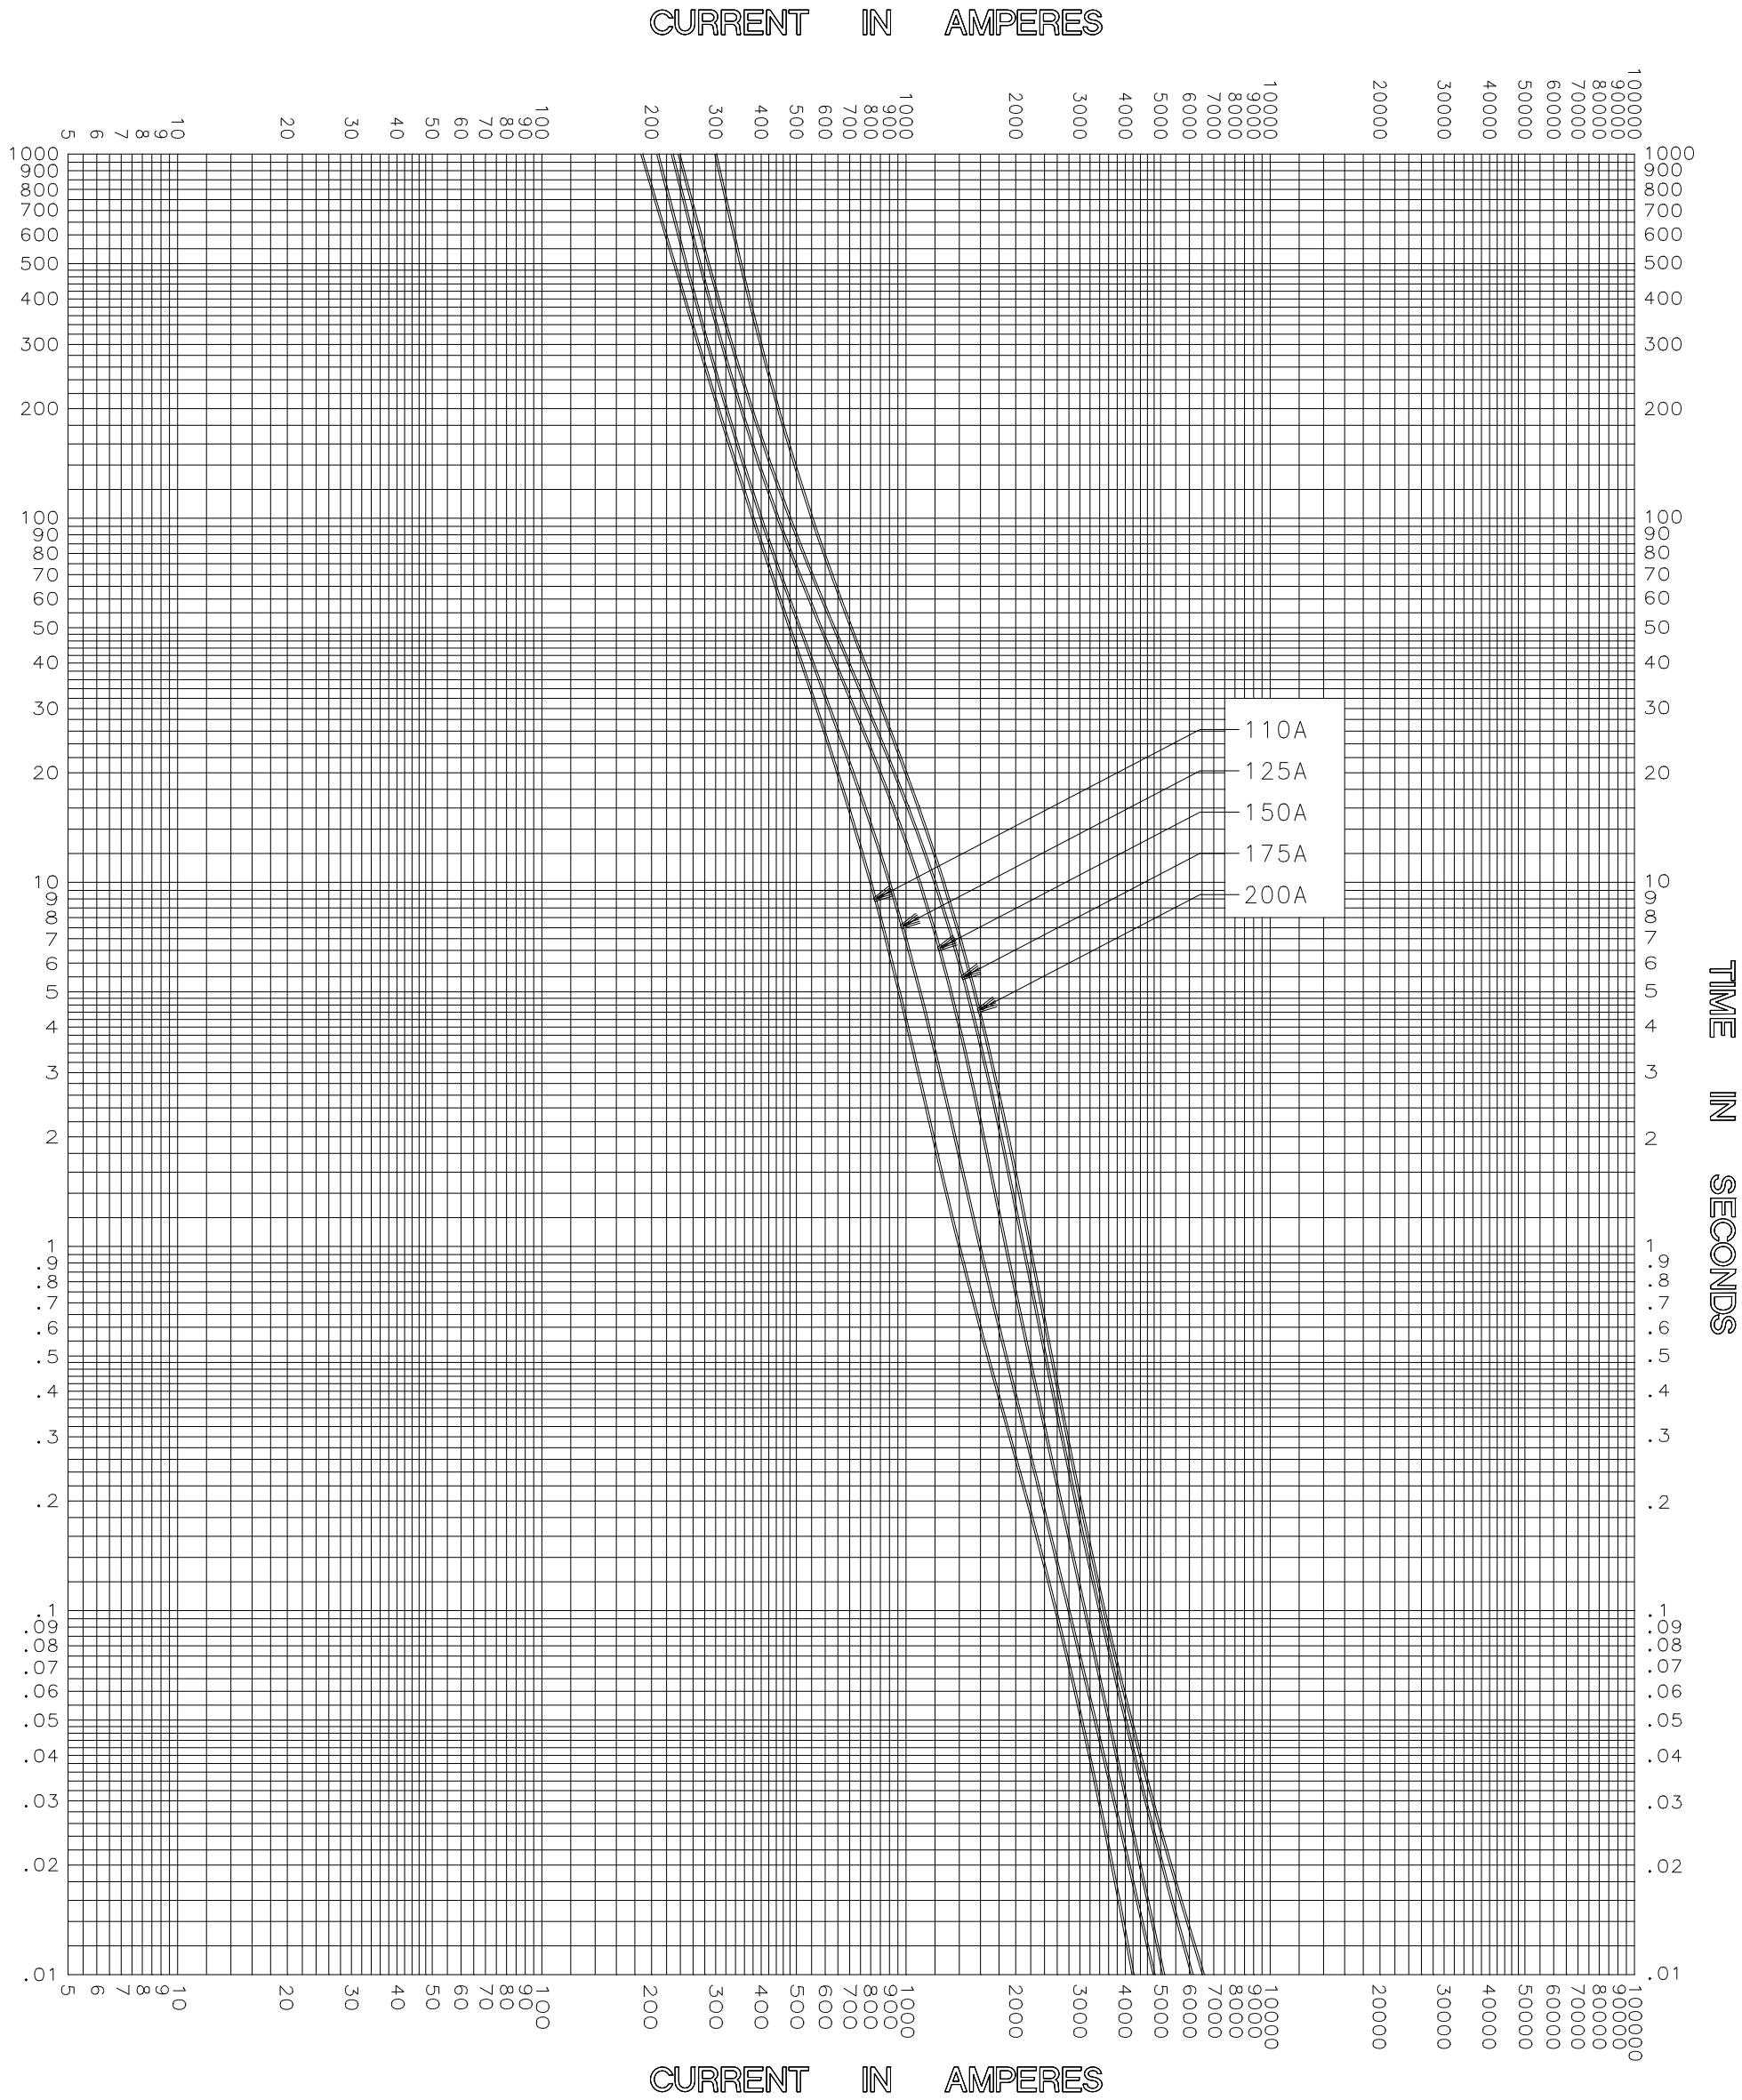

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (110A - 200A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-FLSRID-009

-THIS DATA GENERATED ON CAD-

SECONDS IN TIME

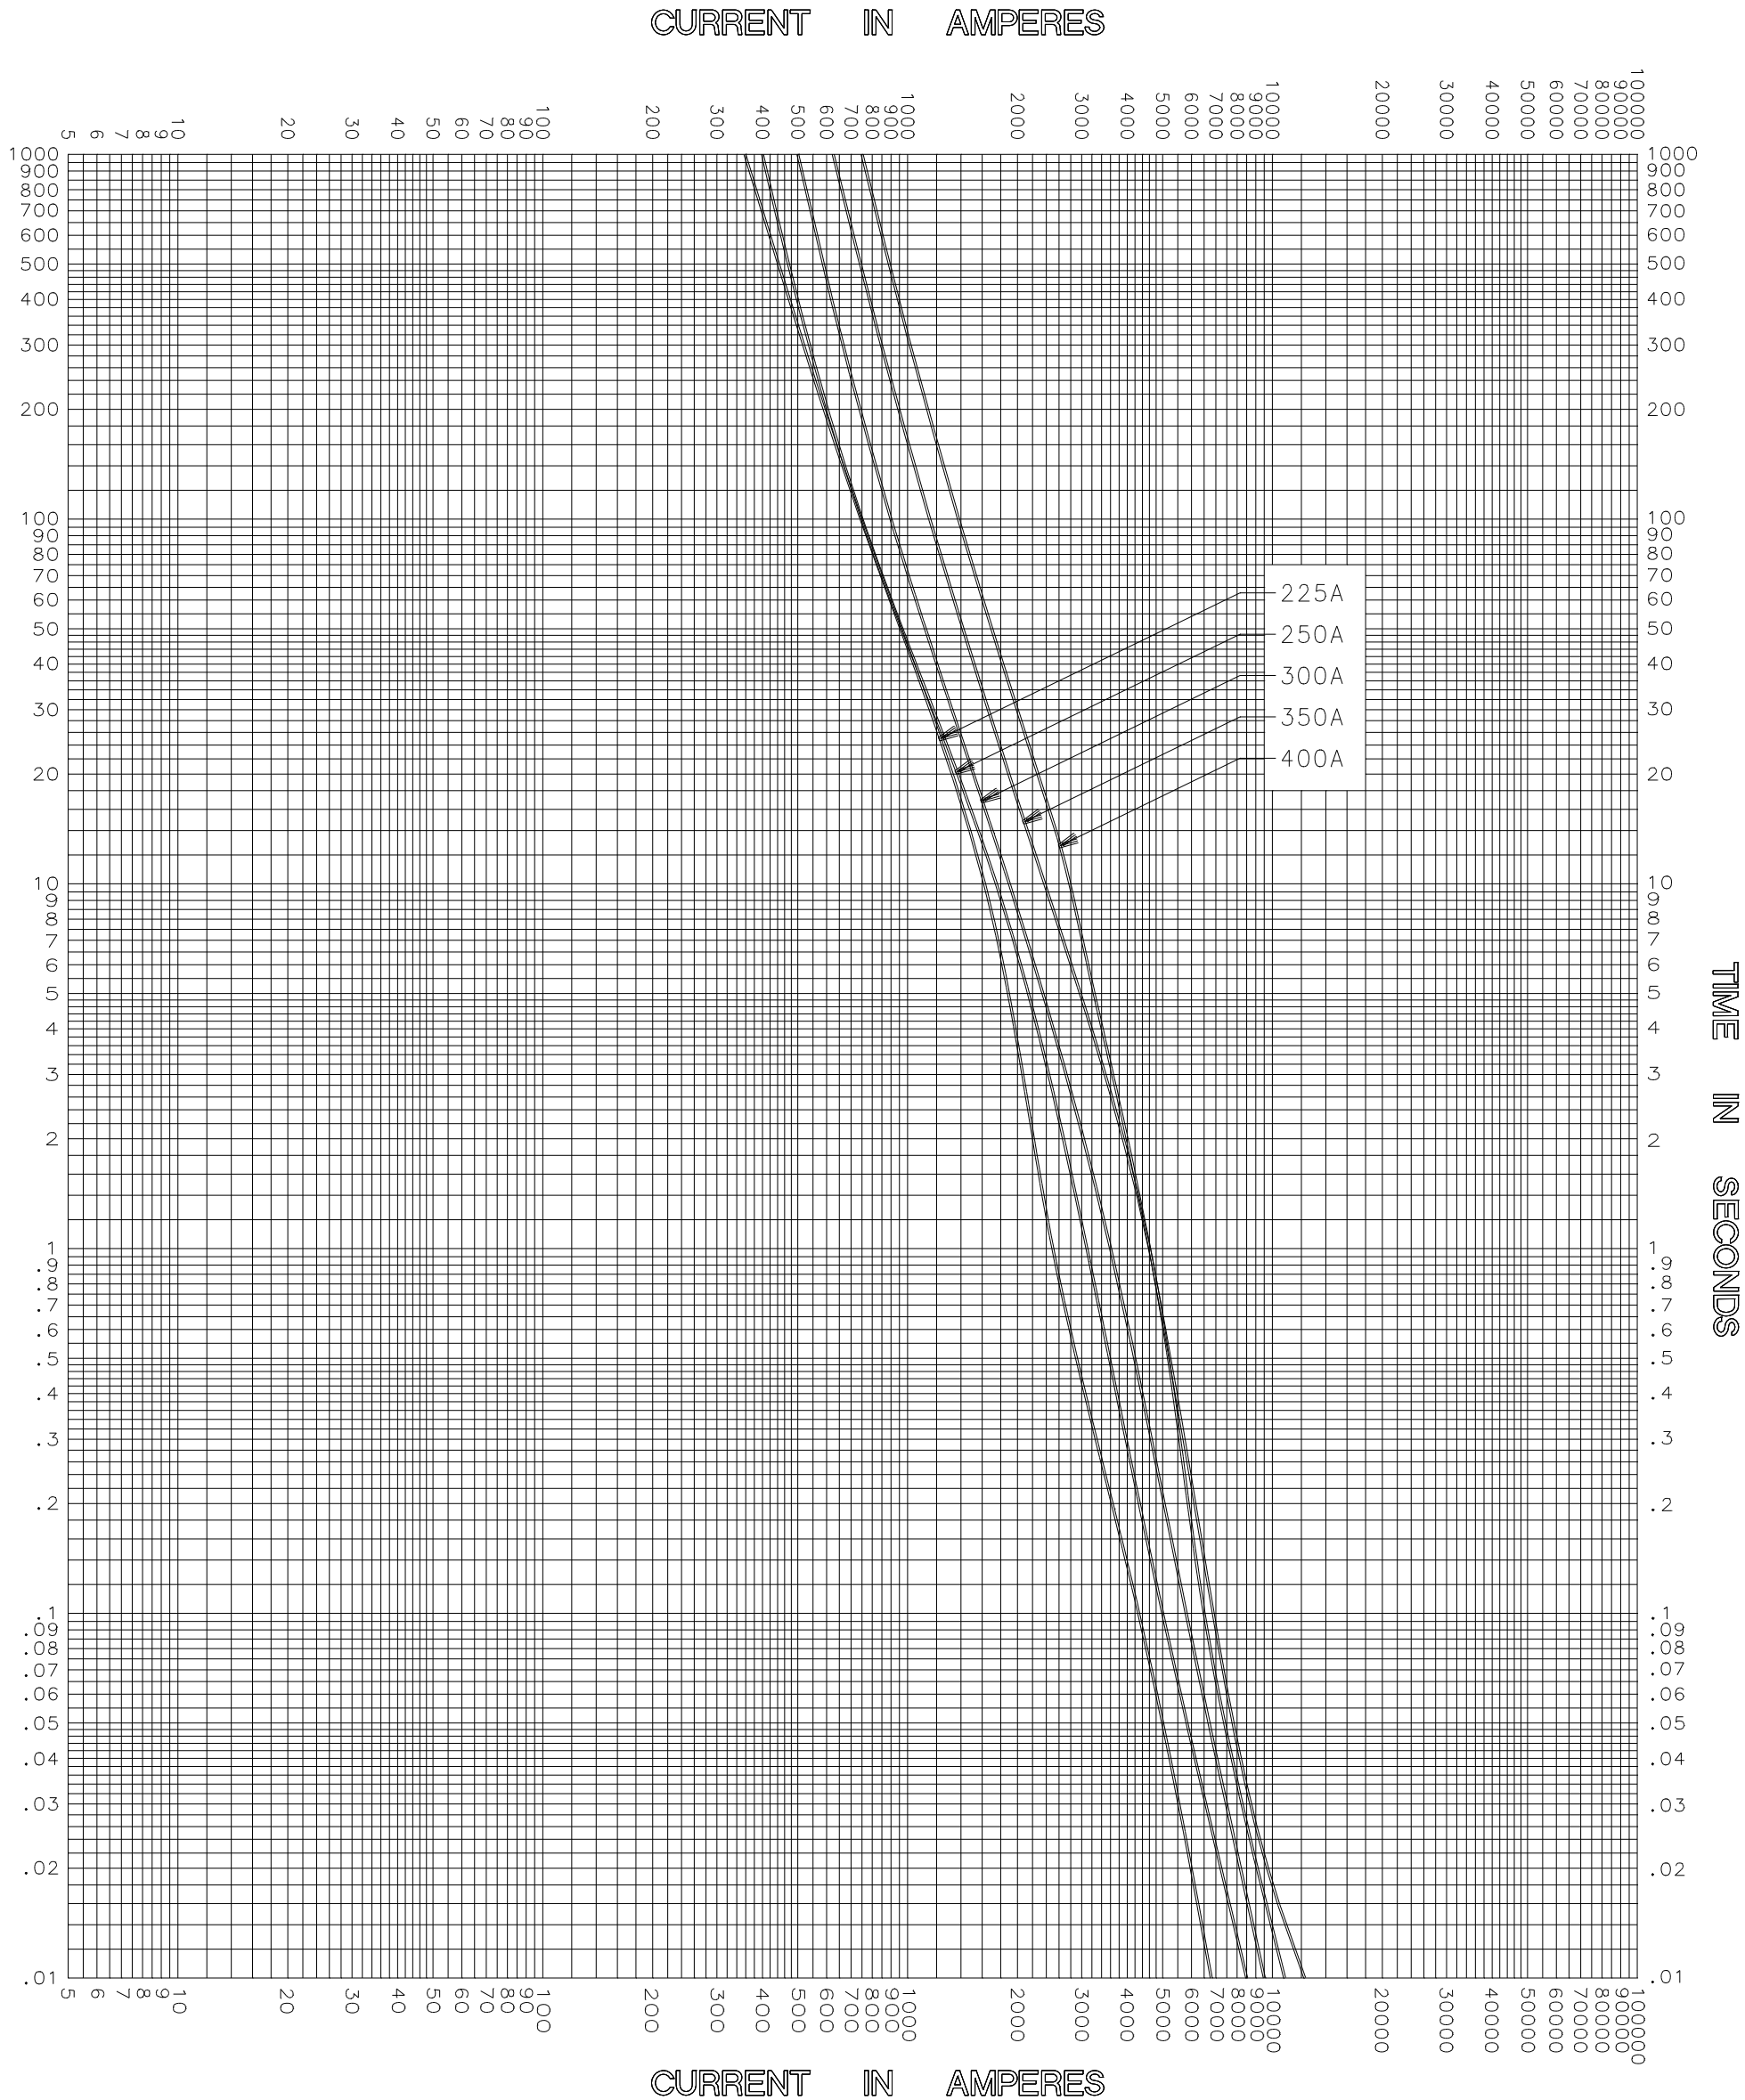

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (225A - 400A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-FLSRID-010

-THIS DATA GENERATED ON CAD-

SECONDS IN TIME

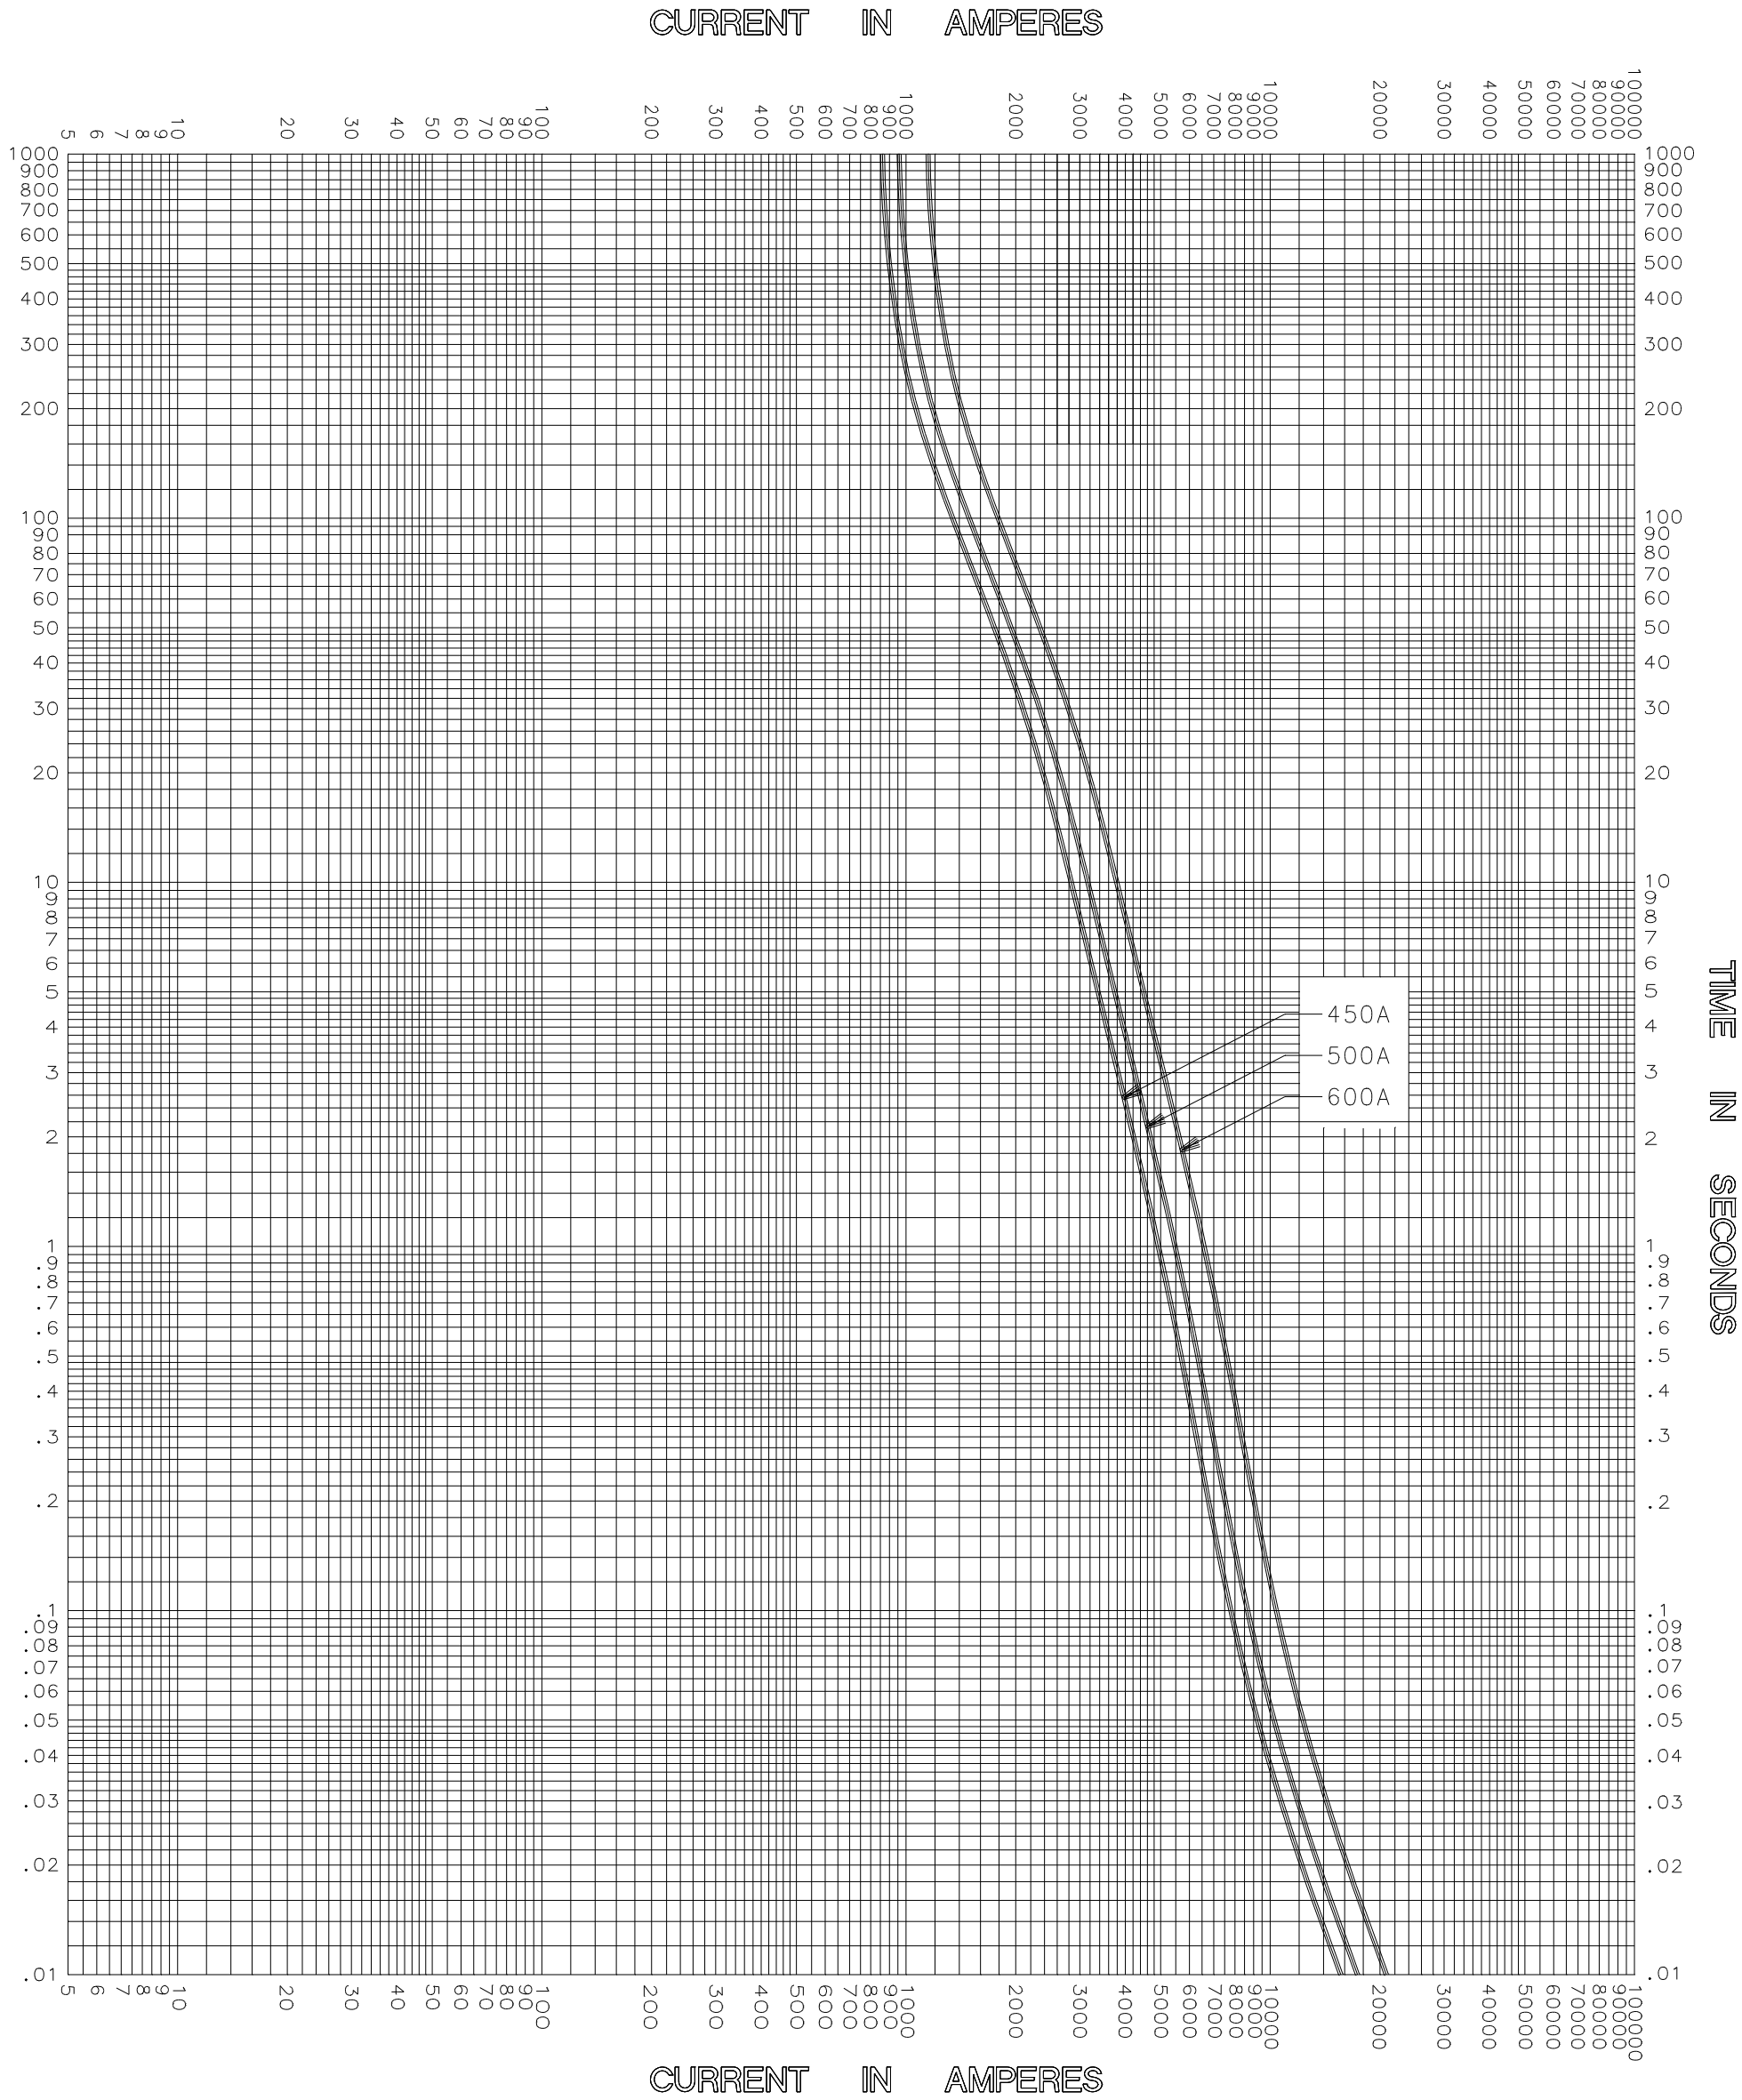

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____
BASIS FOR DATA _____

FUSE CATALOG NUMBER
FLSR (450A - 600A) ID _____



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 01/07/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.
A-FCC01-FLSR (450A - 600A) 011

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT