


CURRENT IN AMPERES

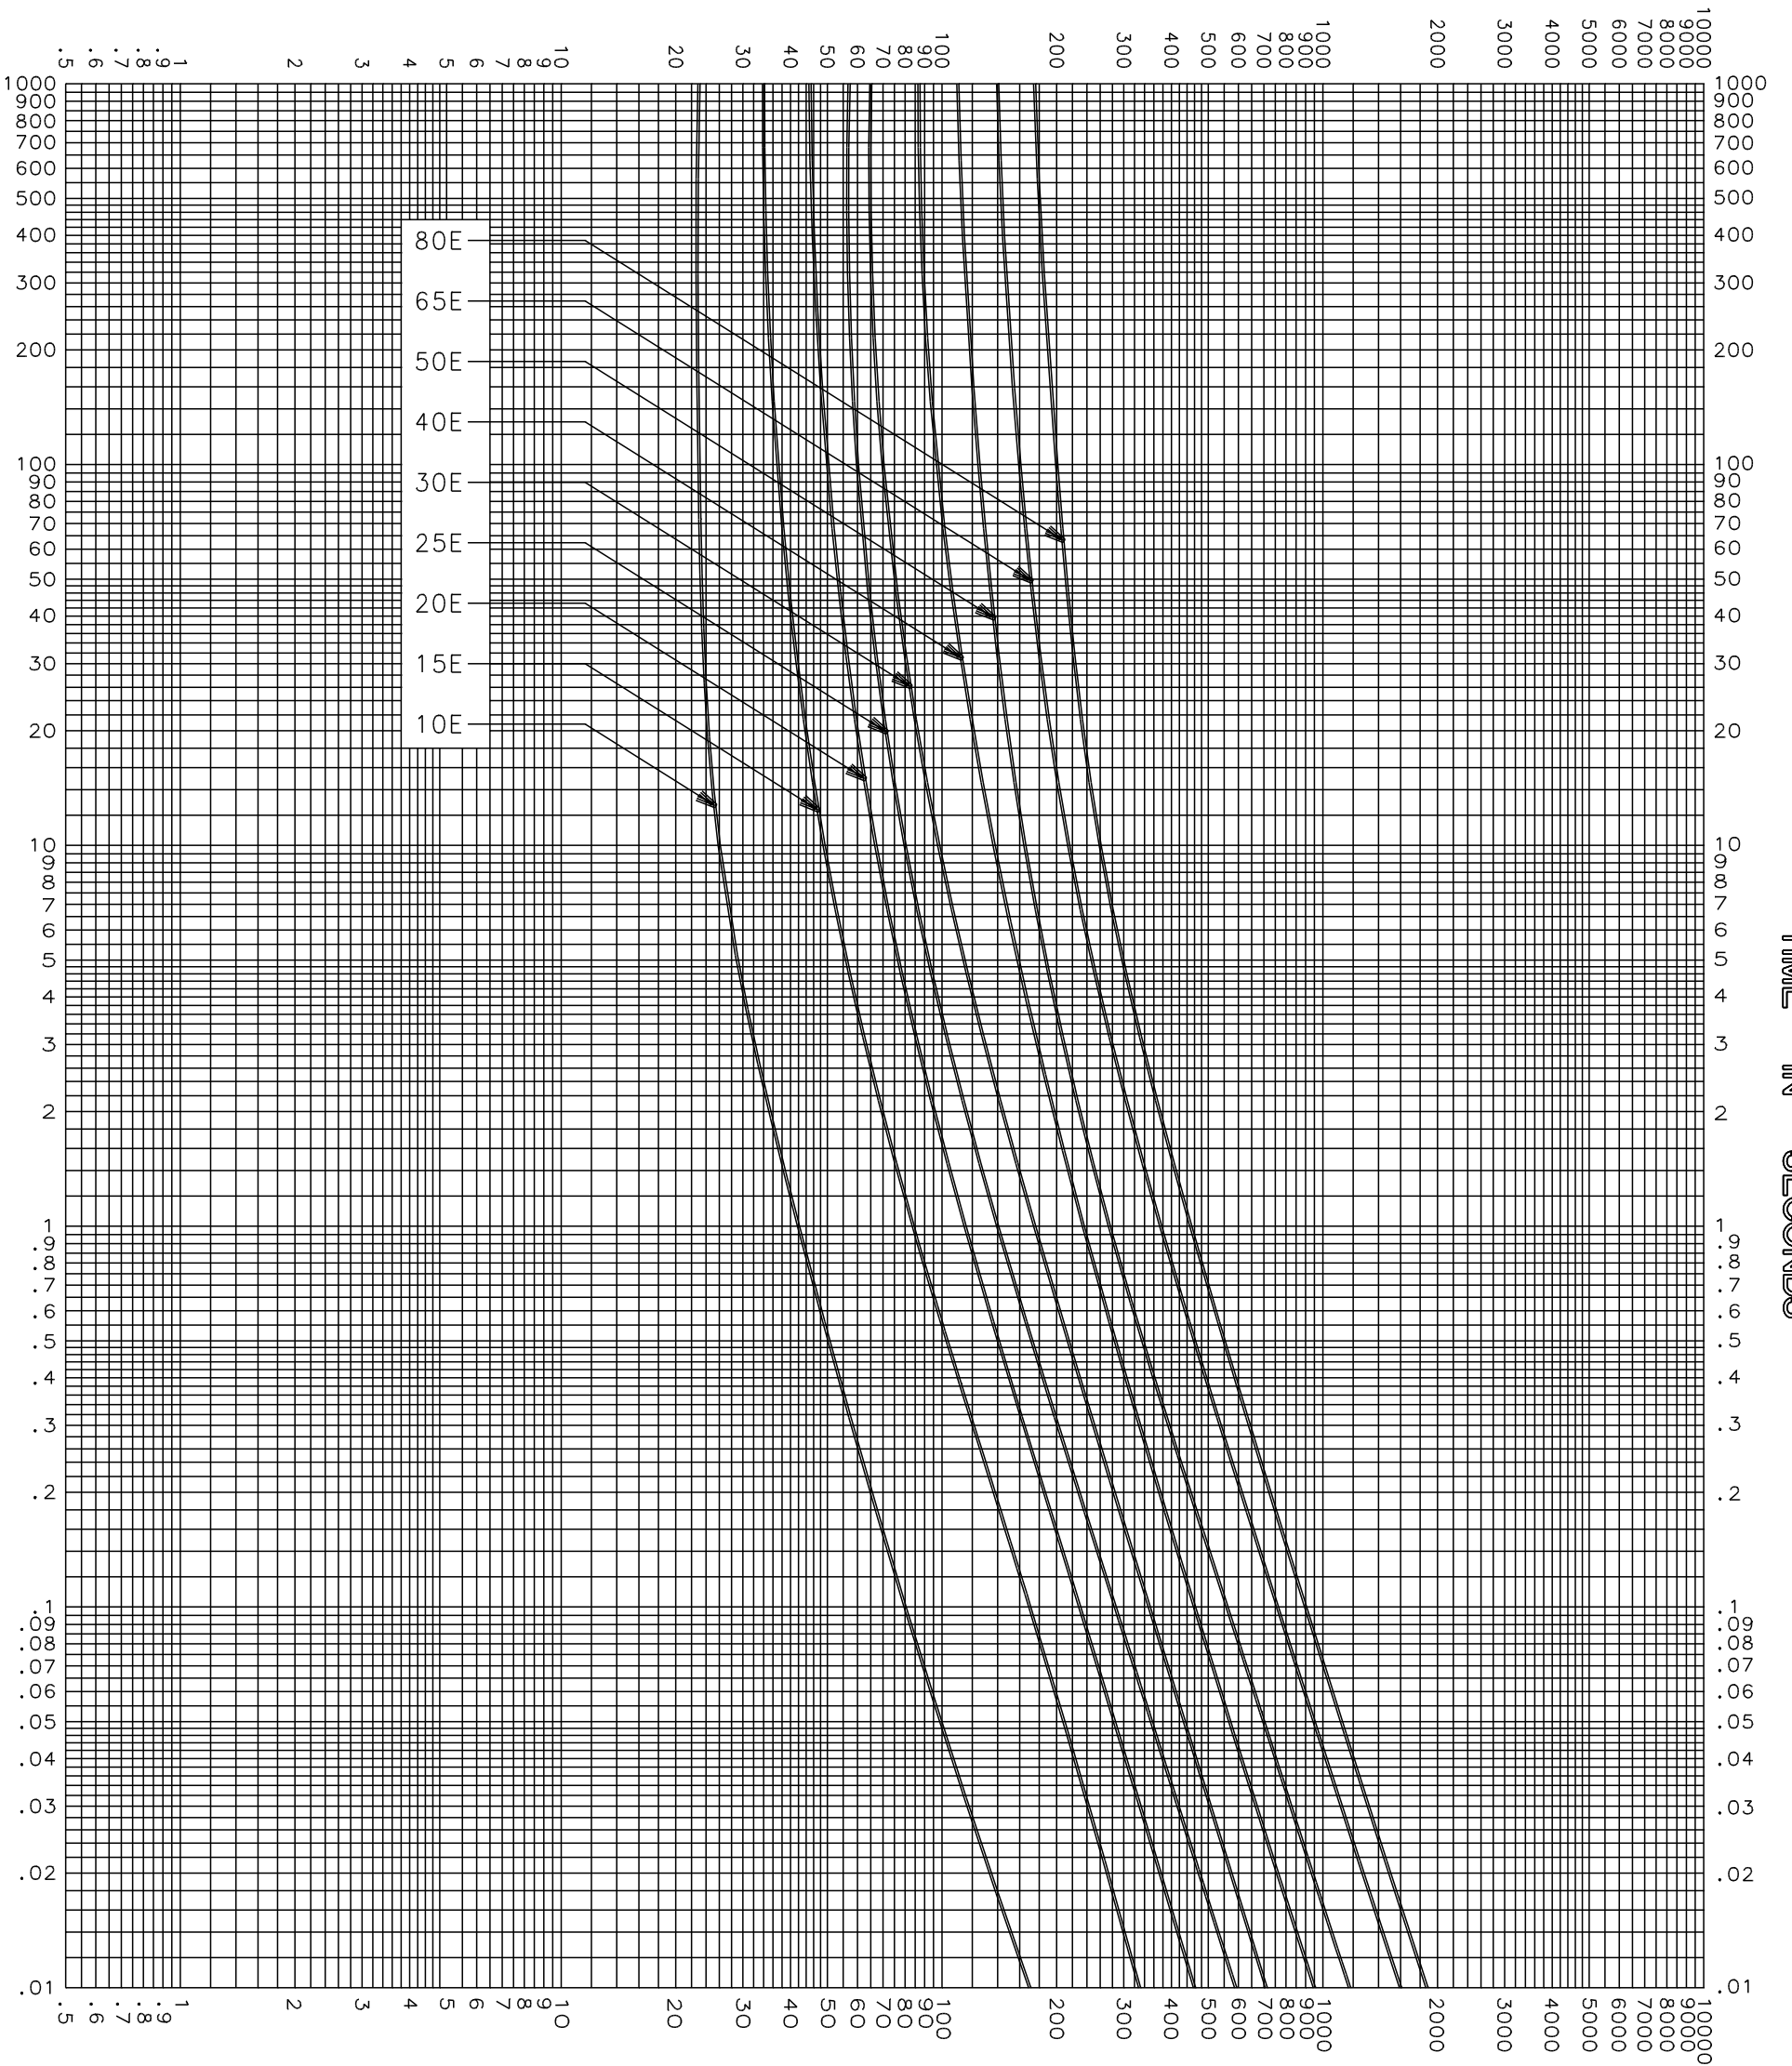

CURRENT IN AMPERES

CLEARING TIME CHARACTERISTICS

TEST VOLTAGE <u>XXXXXXXX</u>	TIME CONSTANT / POWER FACTOR <u>XXXXXXXX</u>	FUSE CATALOG NUMBER
BASIS FOR DATA <u>XXXXXXXXXXXXXXXXXXXX</u>		<u>2.75kV E-RATED 10E-80E</u>

 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u>
	DATE <u>04/26/04</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>A-FCC04 250001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT