


CURRENT IN AMPERES



CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLNR (1A - 15A)
BASIS FOR DATA _____		

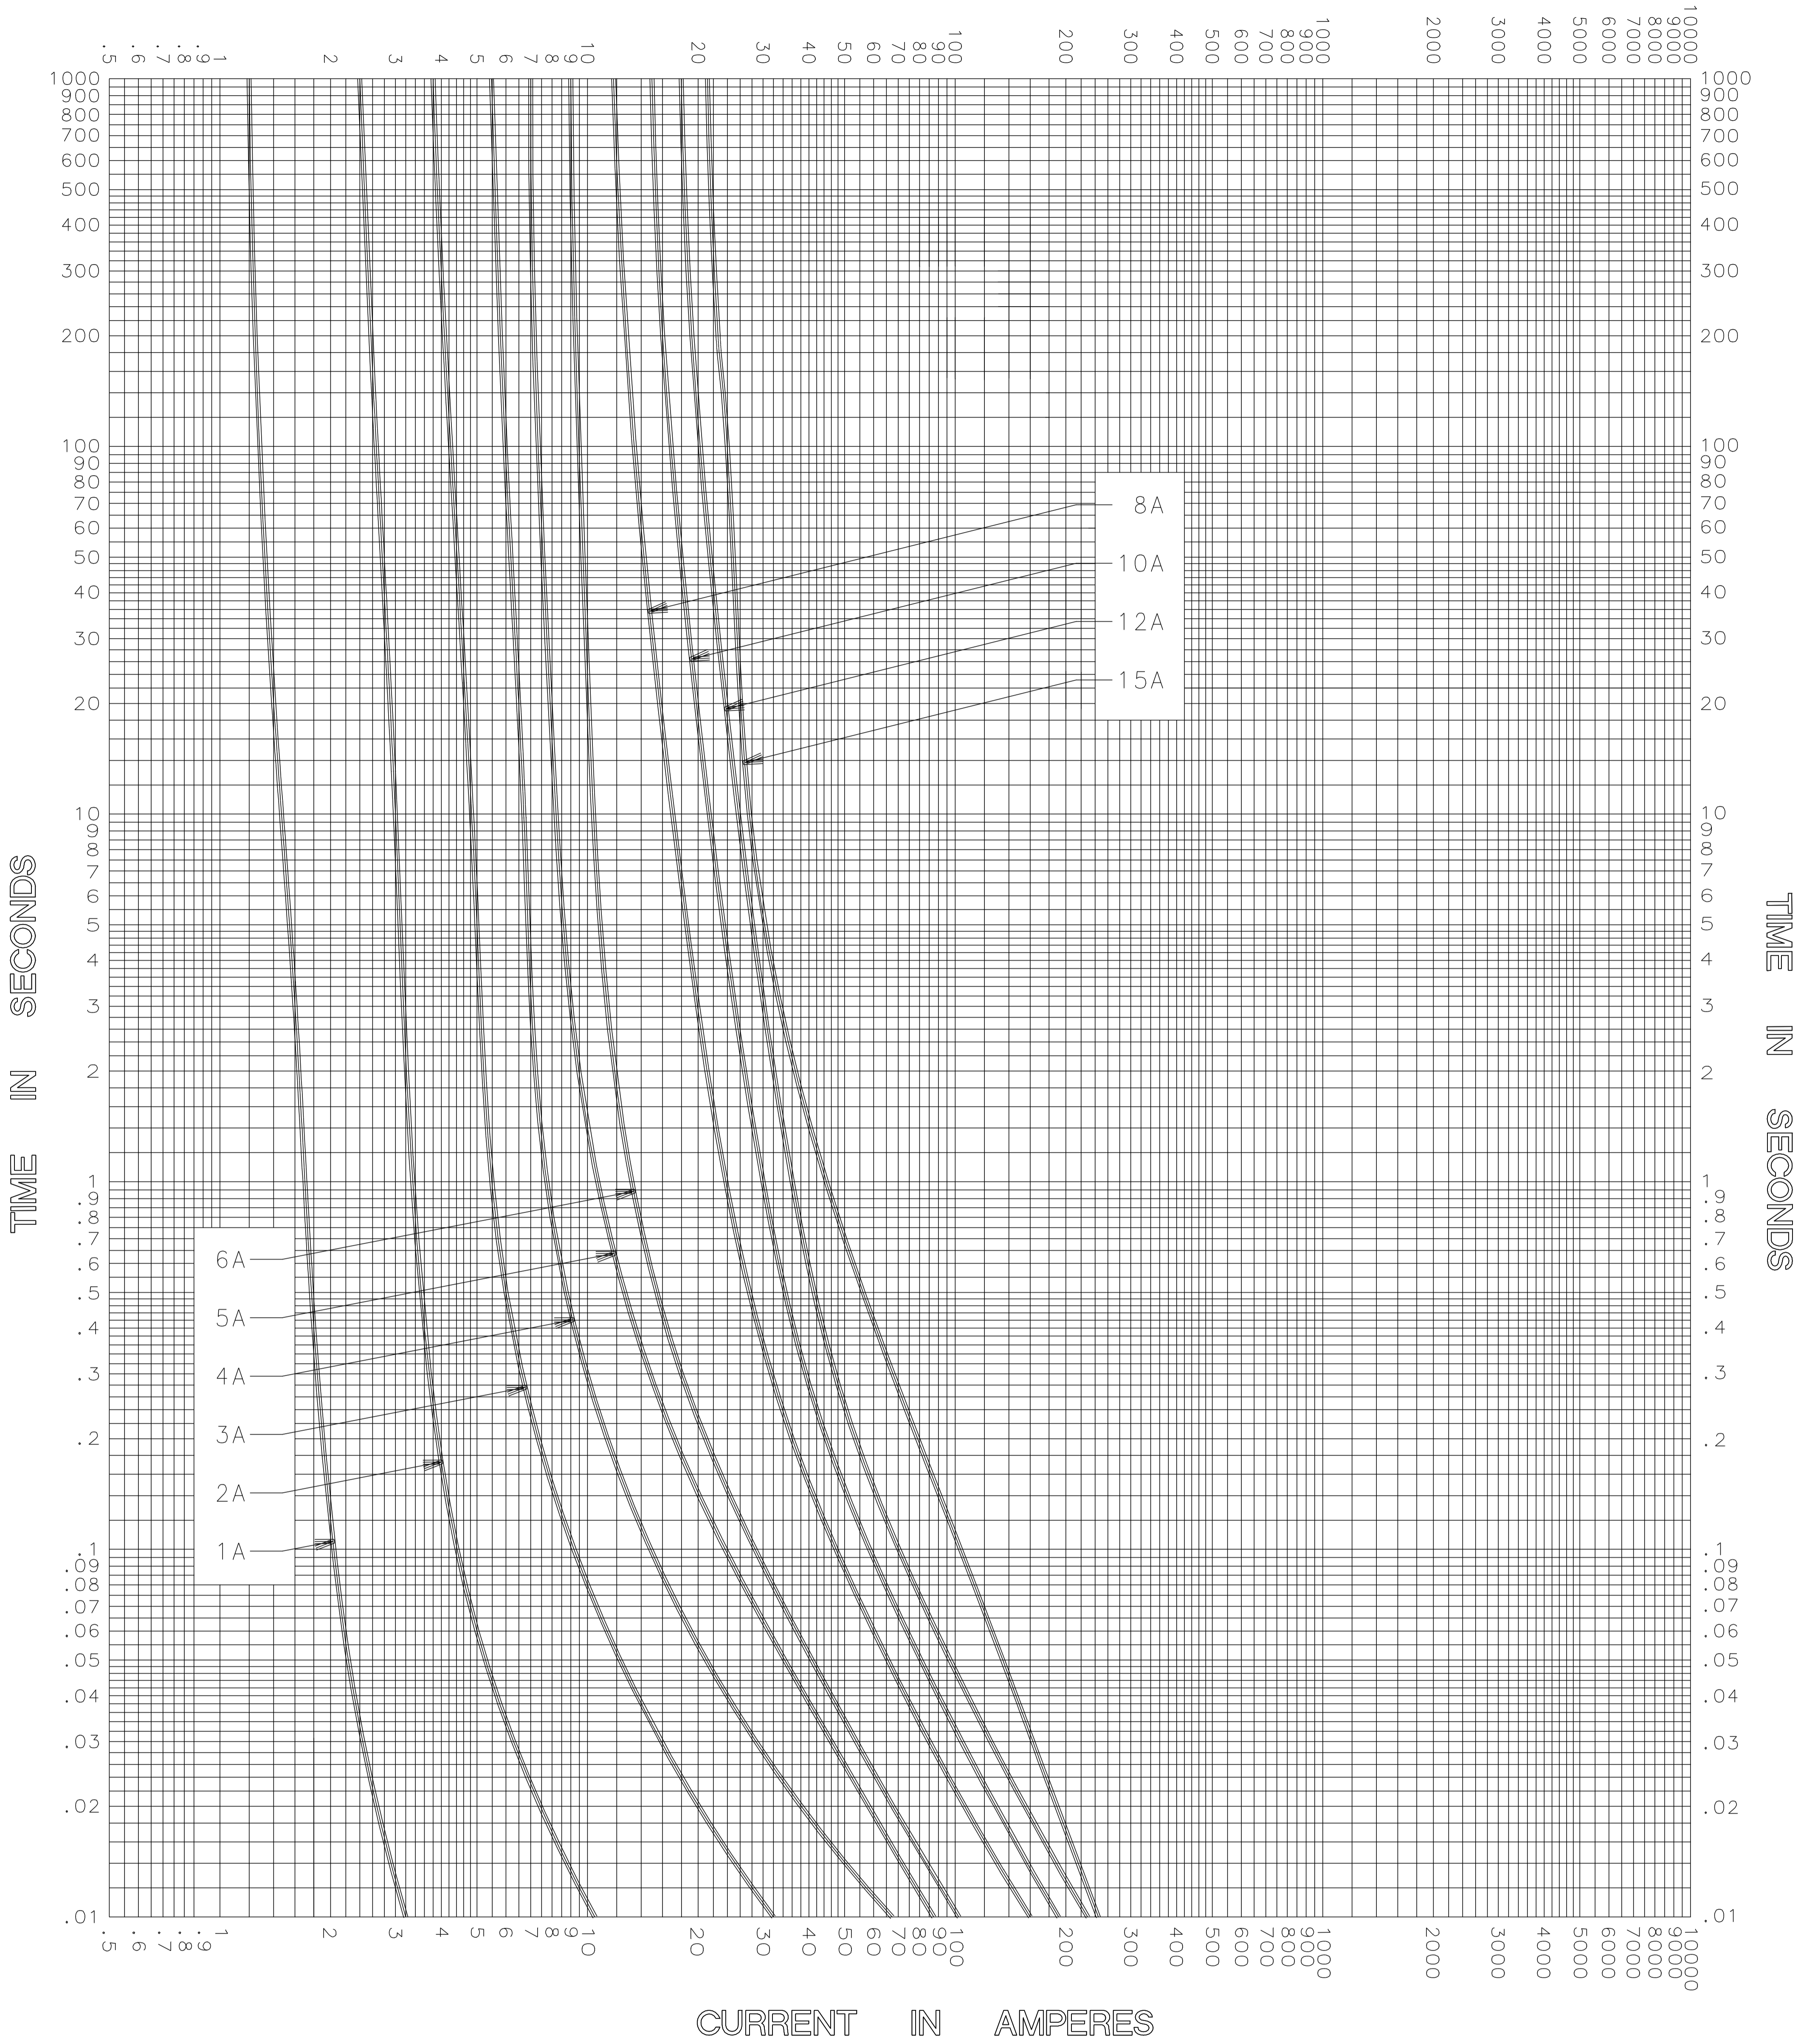

LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	MRD
DATE	02/19/03
CHECKED BY	TN
DRAWING NO.	B-FCCO-KLNR-001

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

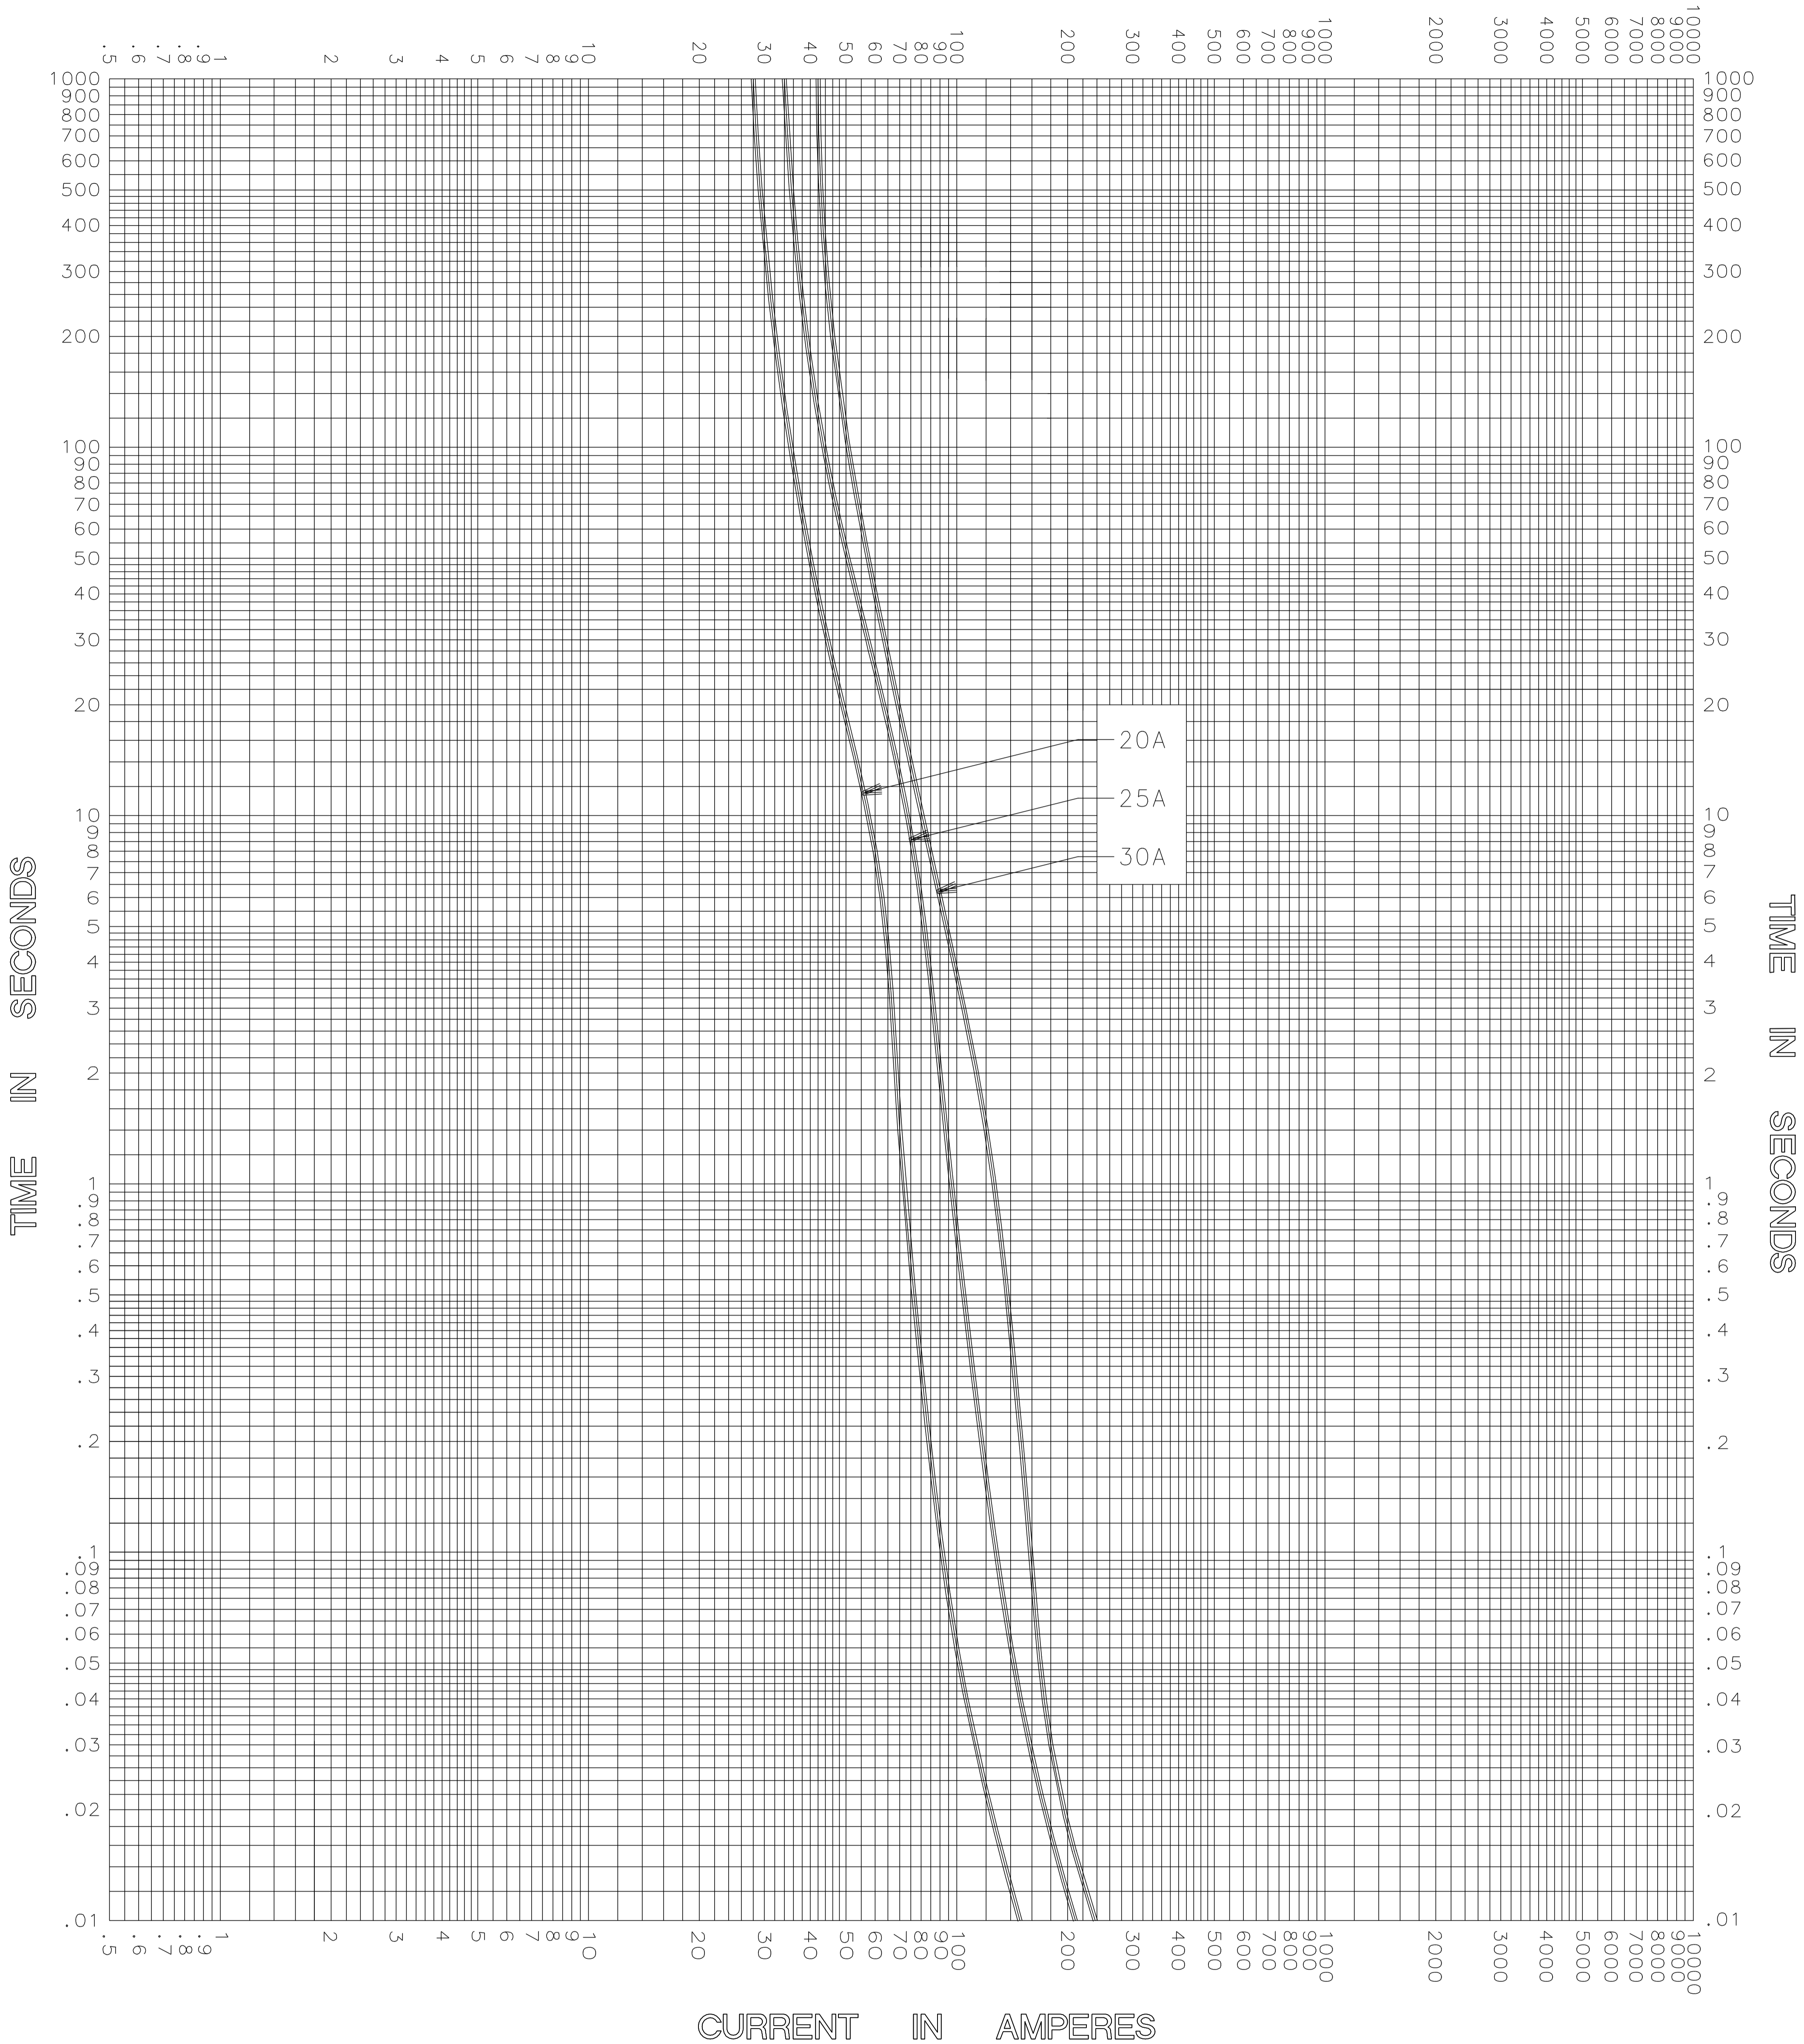

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLNR (20A - 30A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	MRD
DATE	02/19/03
CHECKED BY	TN
DRAWING NO.	B-FCC01 KLNR 1002

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

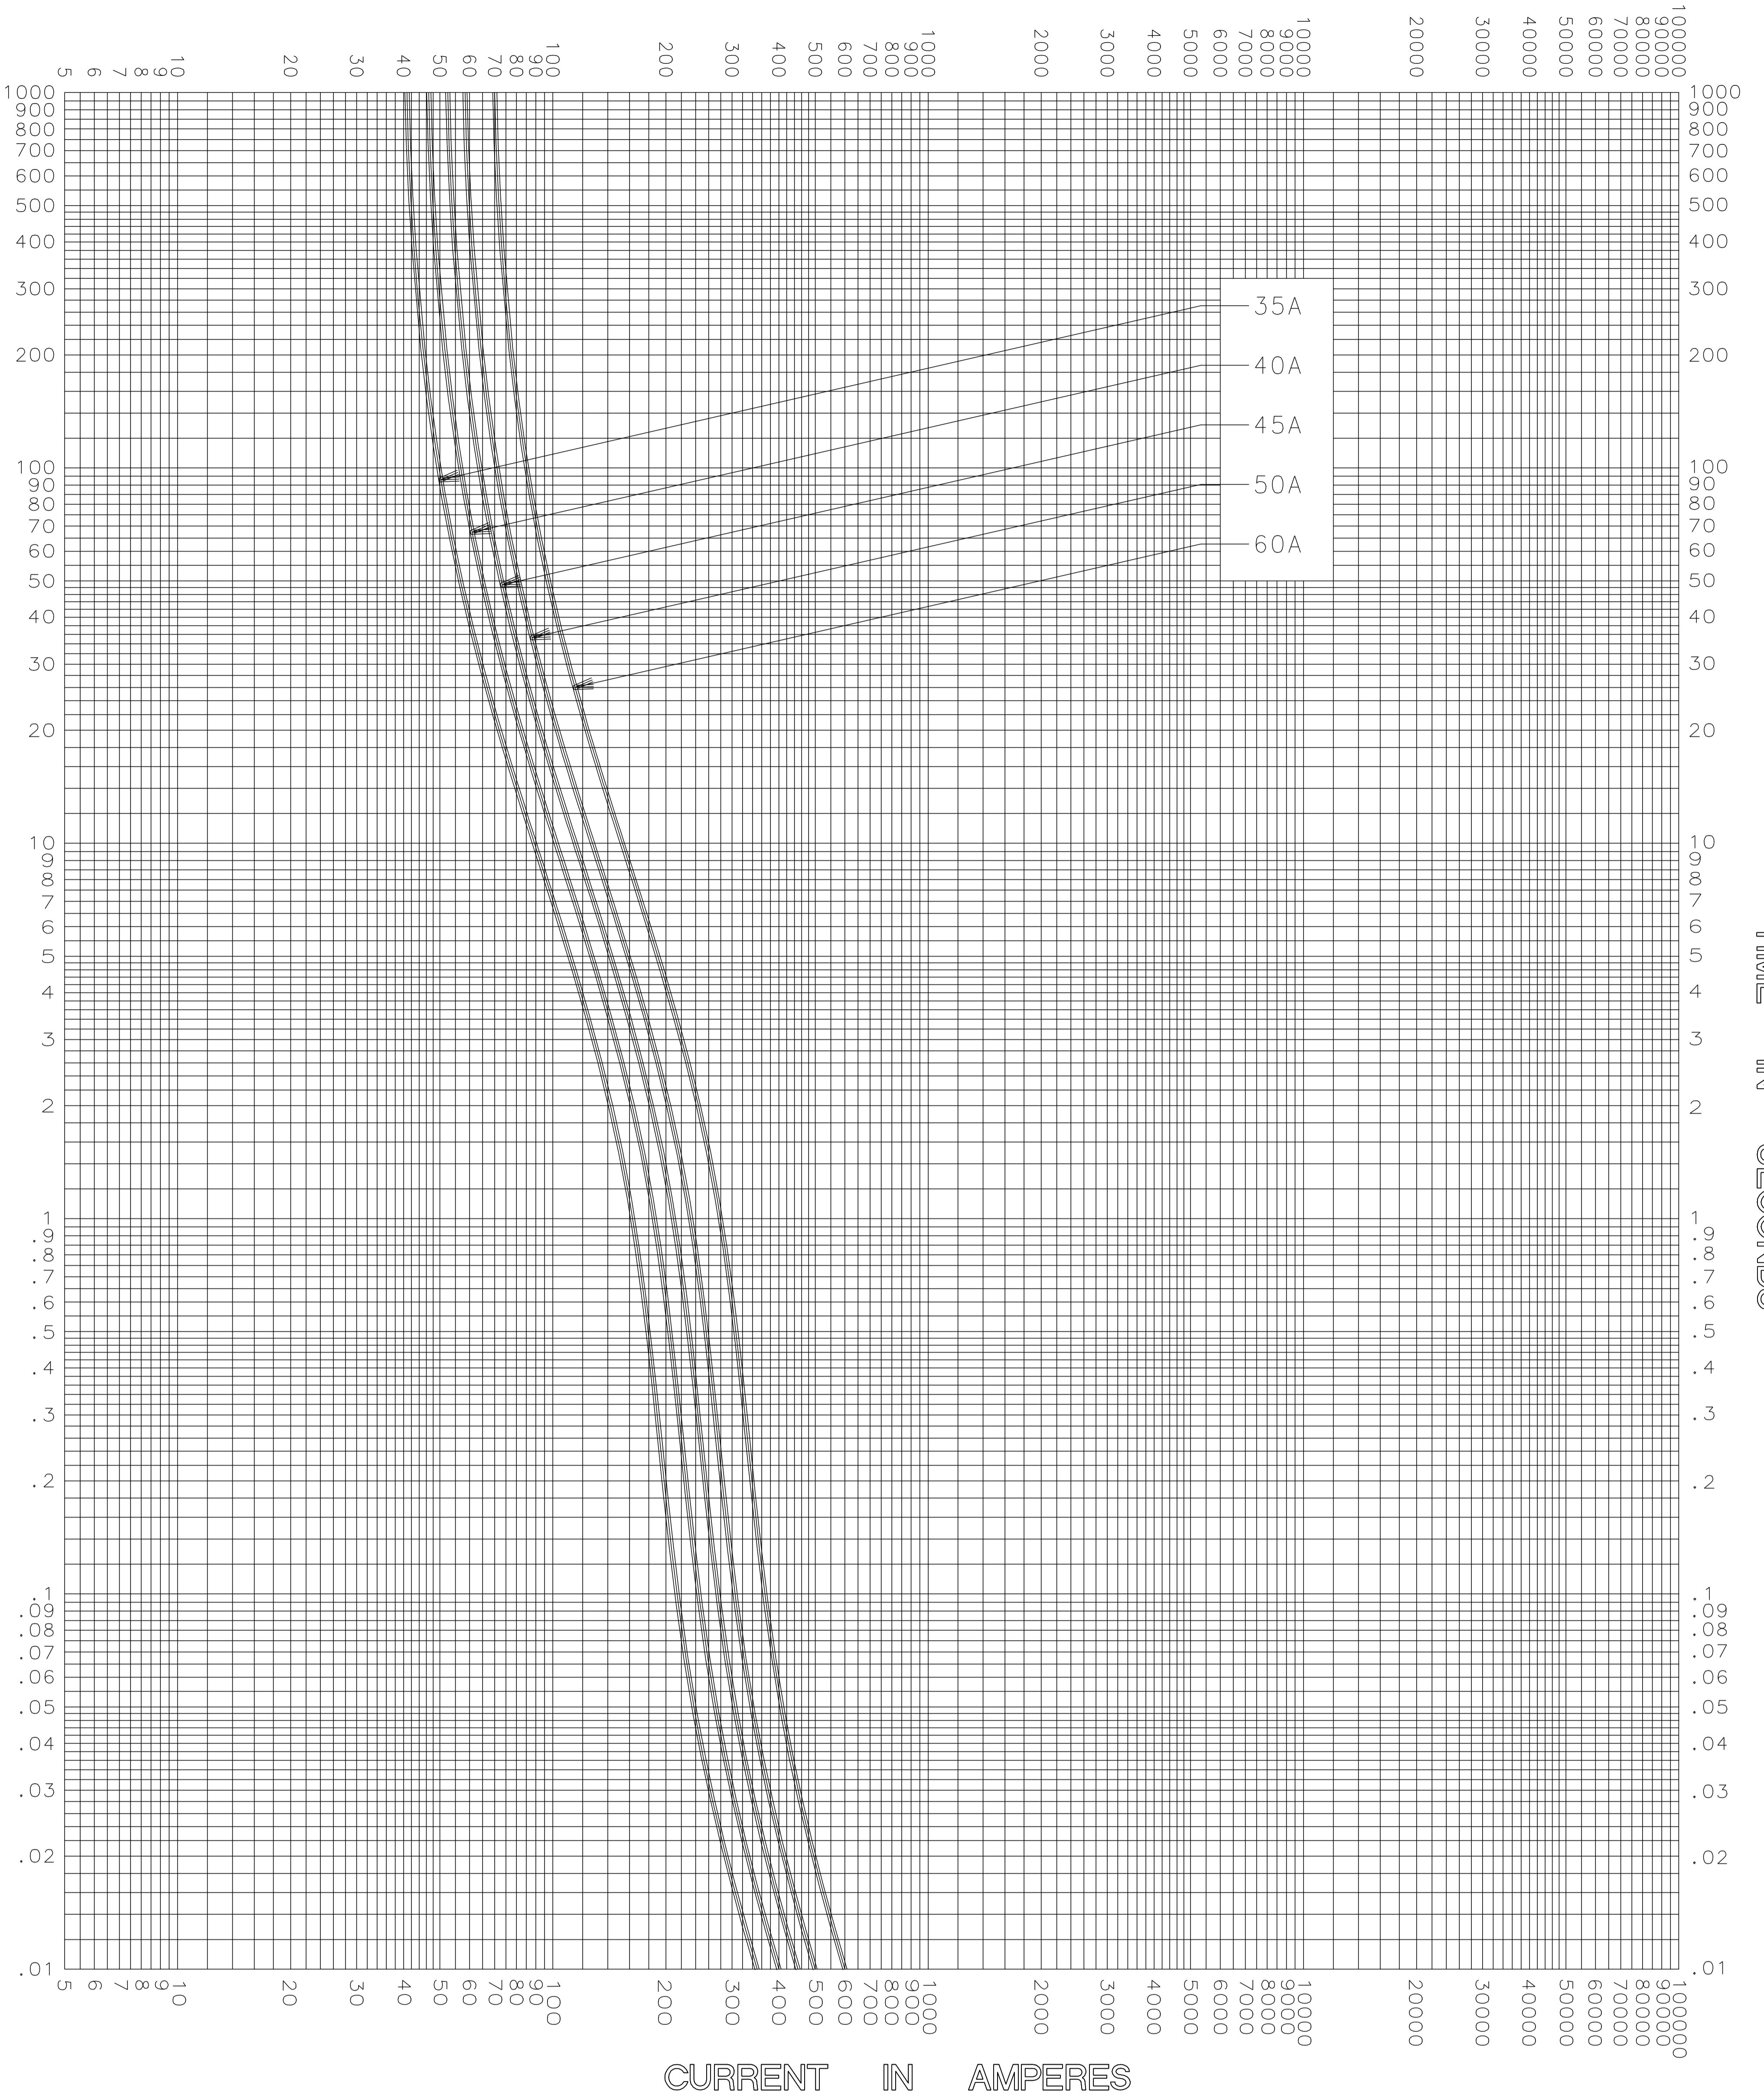

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLNR (35A - 60A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	01/14/05
CHECKED BY	MP
DRAWING NO.	A-FCC01/14/05-003

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

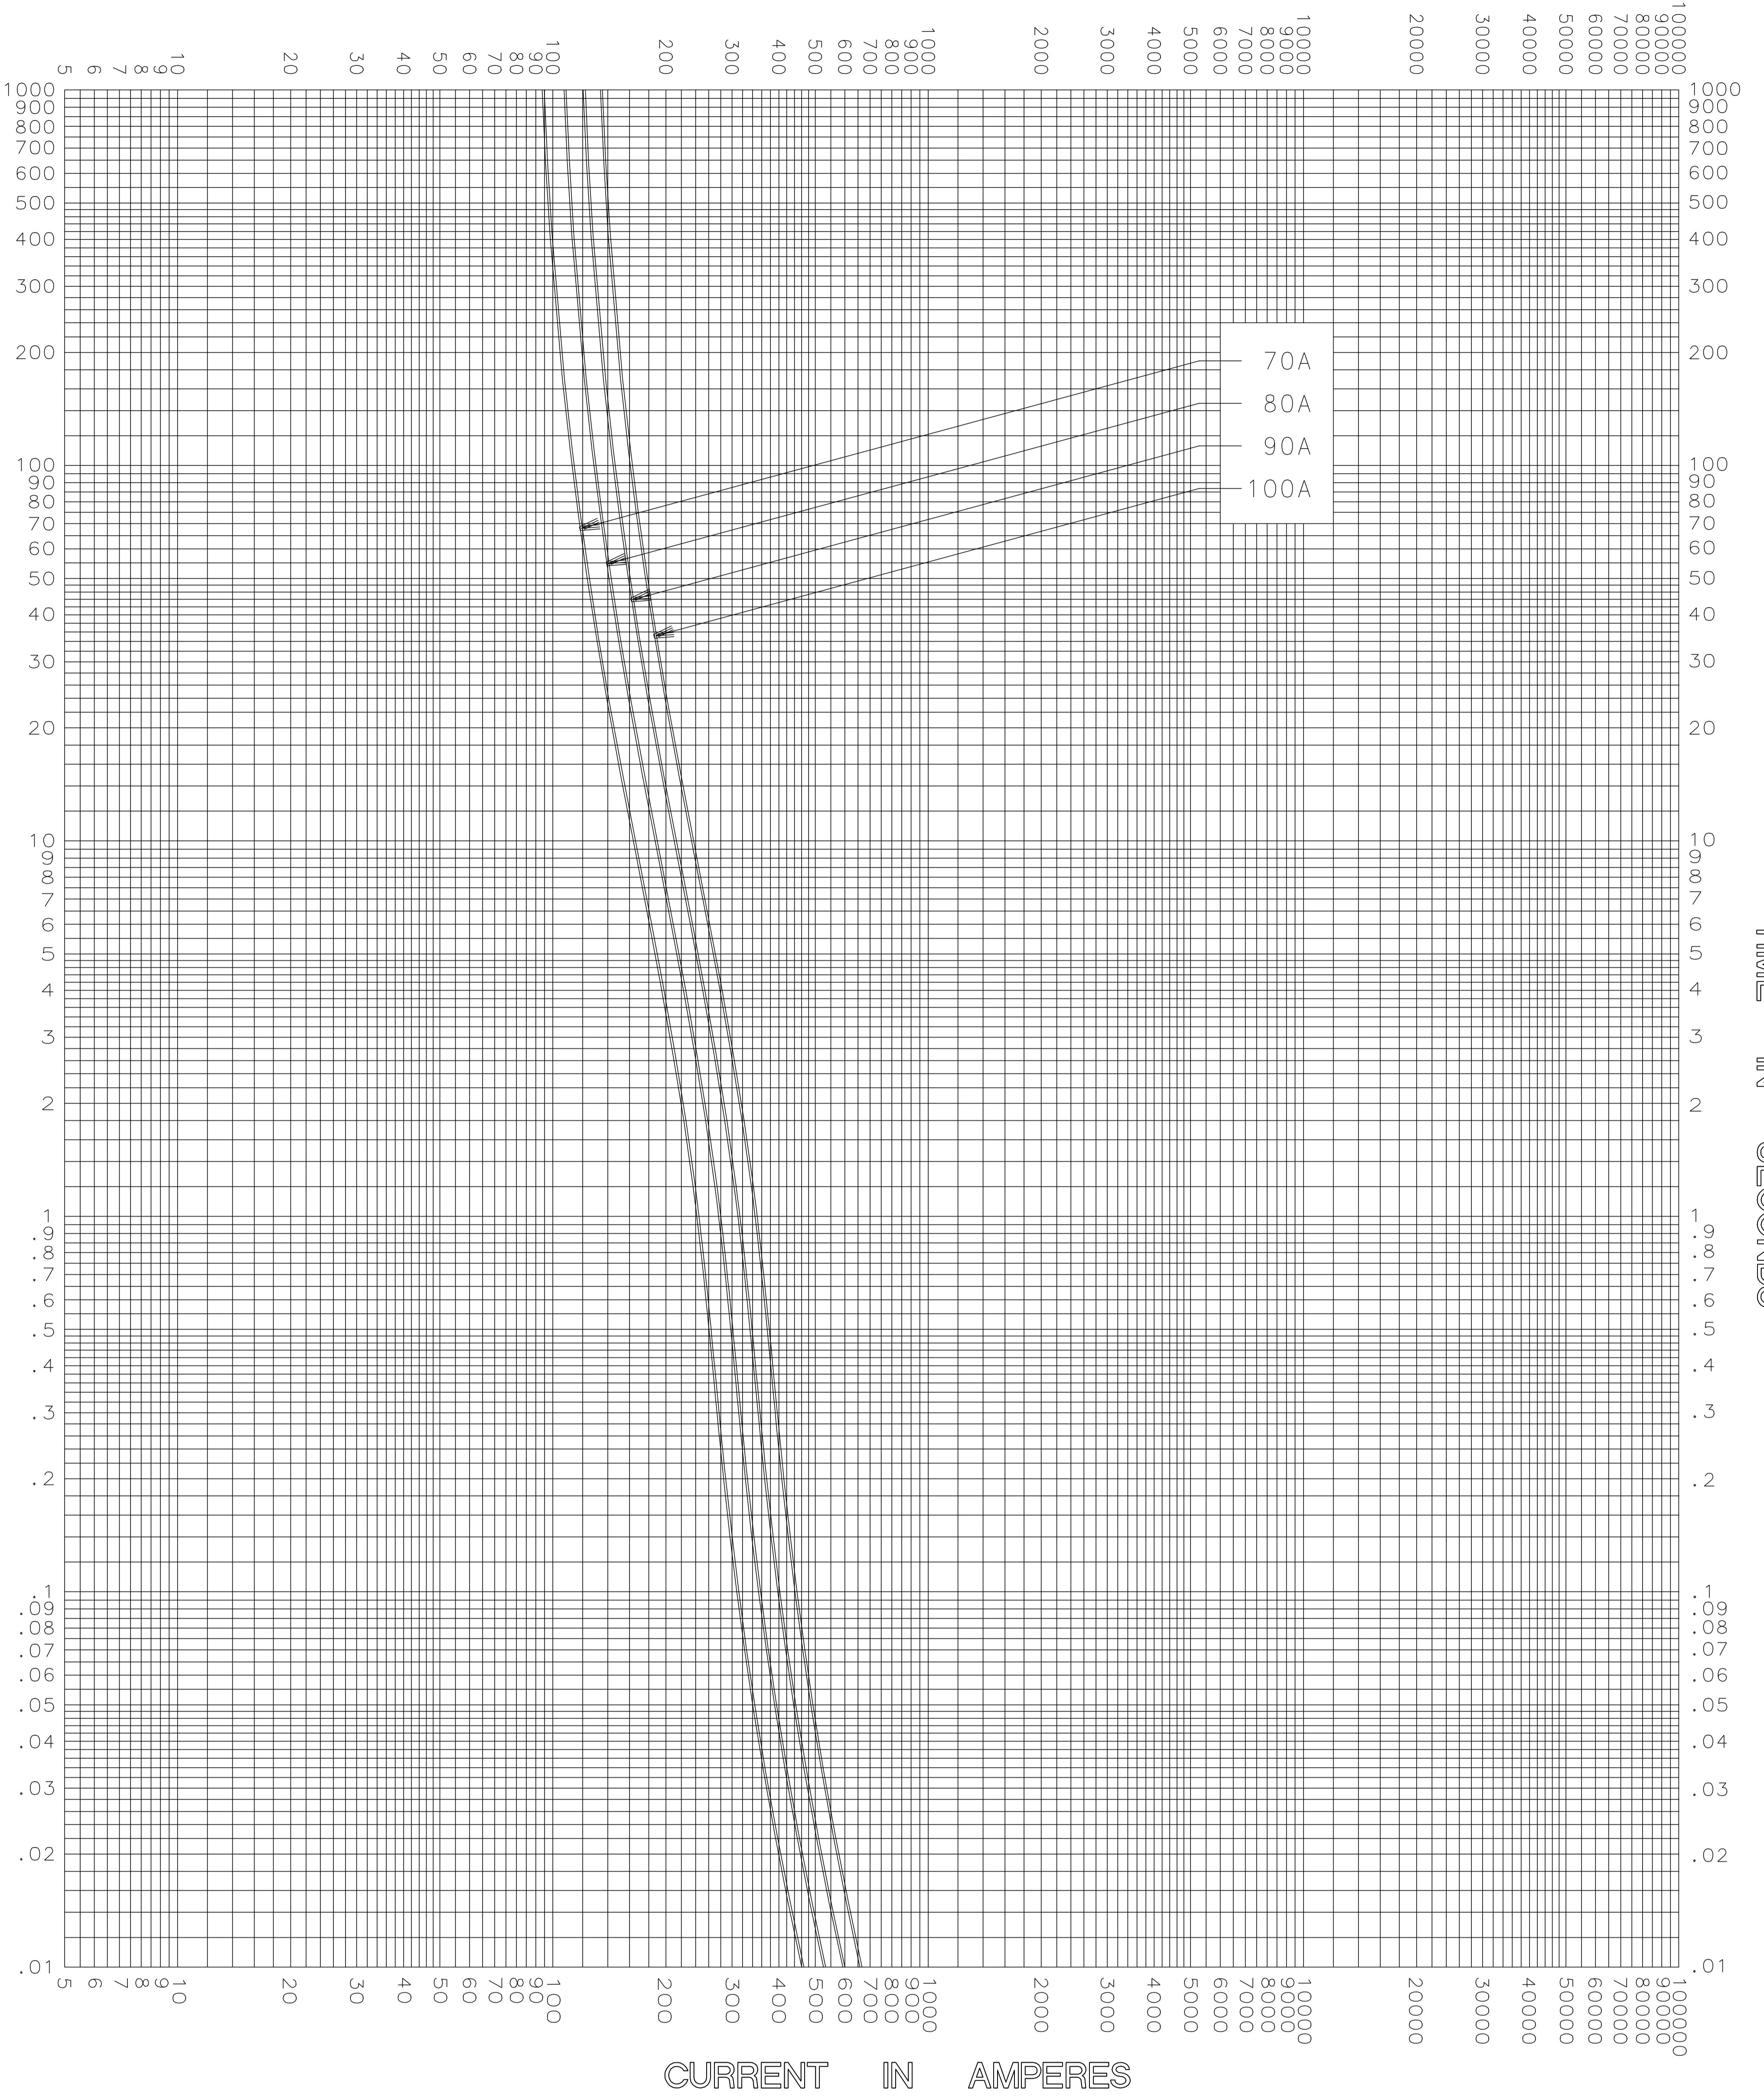

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLNR (70A - 100A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/14/05
CHECKED BY MP
DRAWING NO. A-FCC0114R-004

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

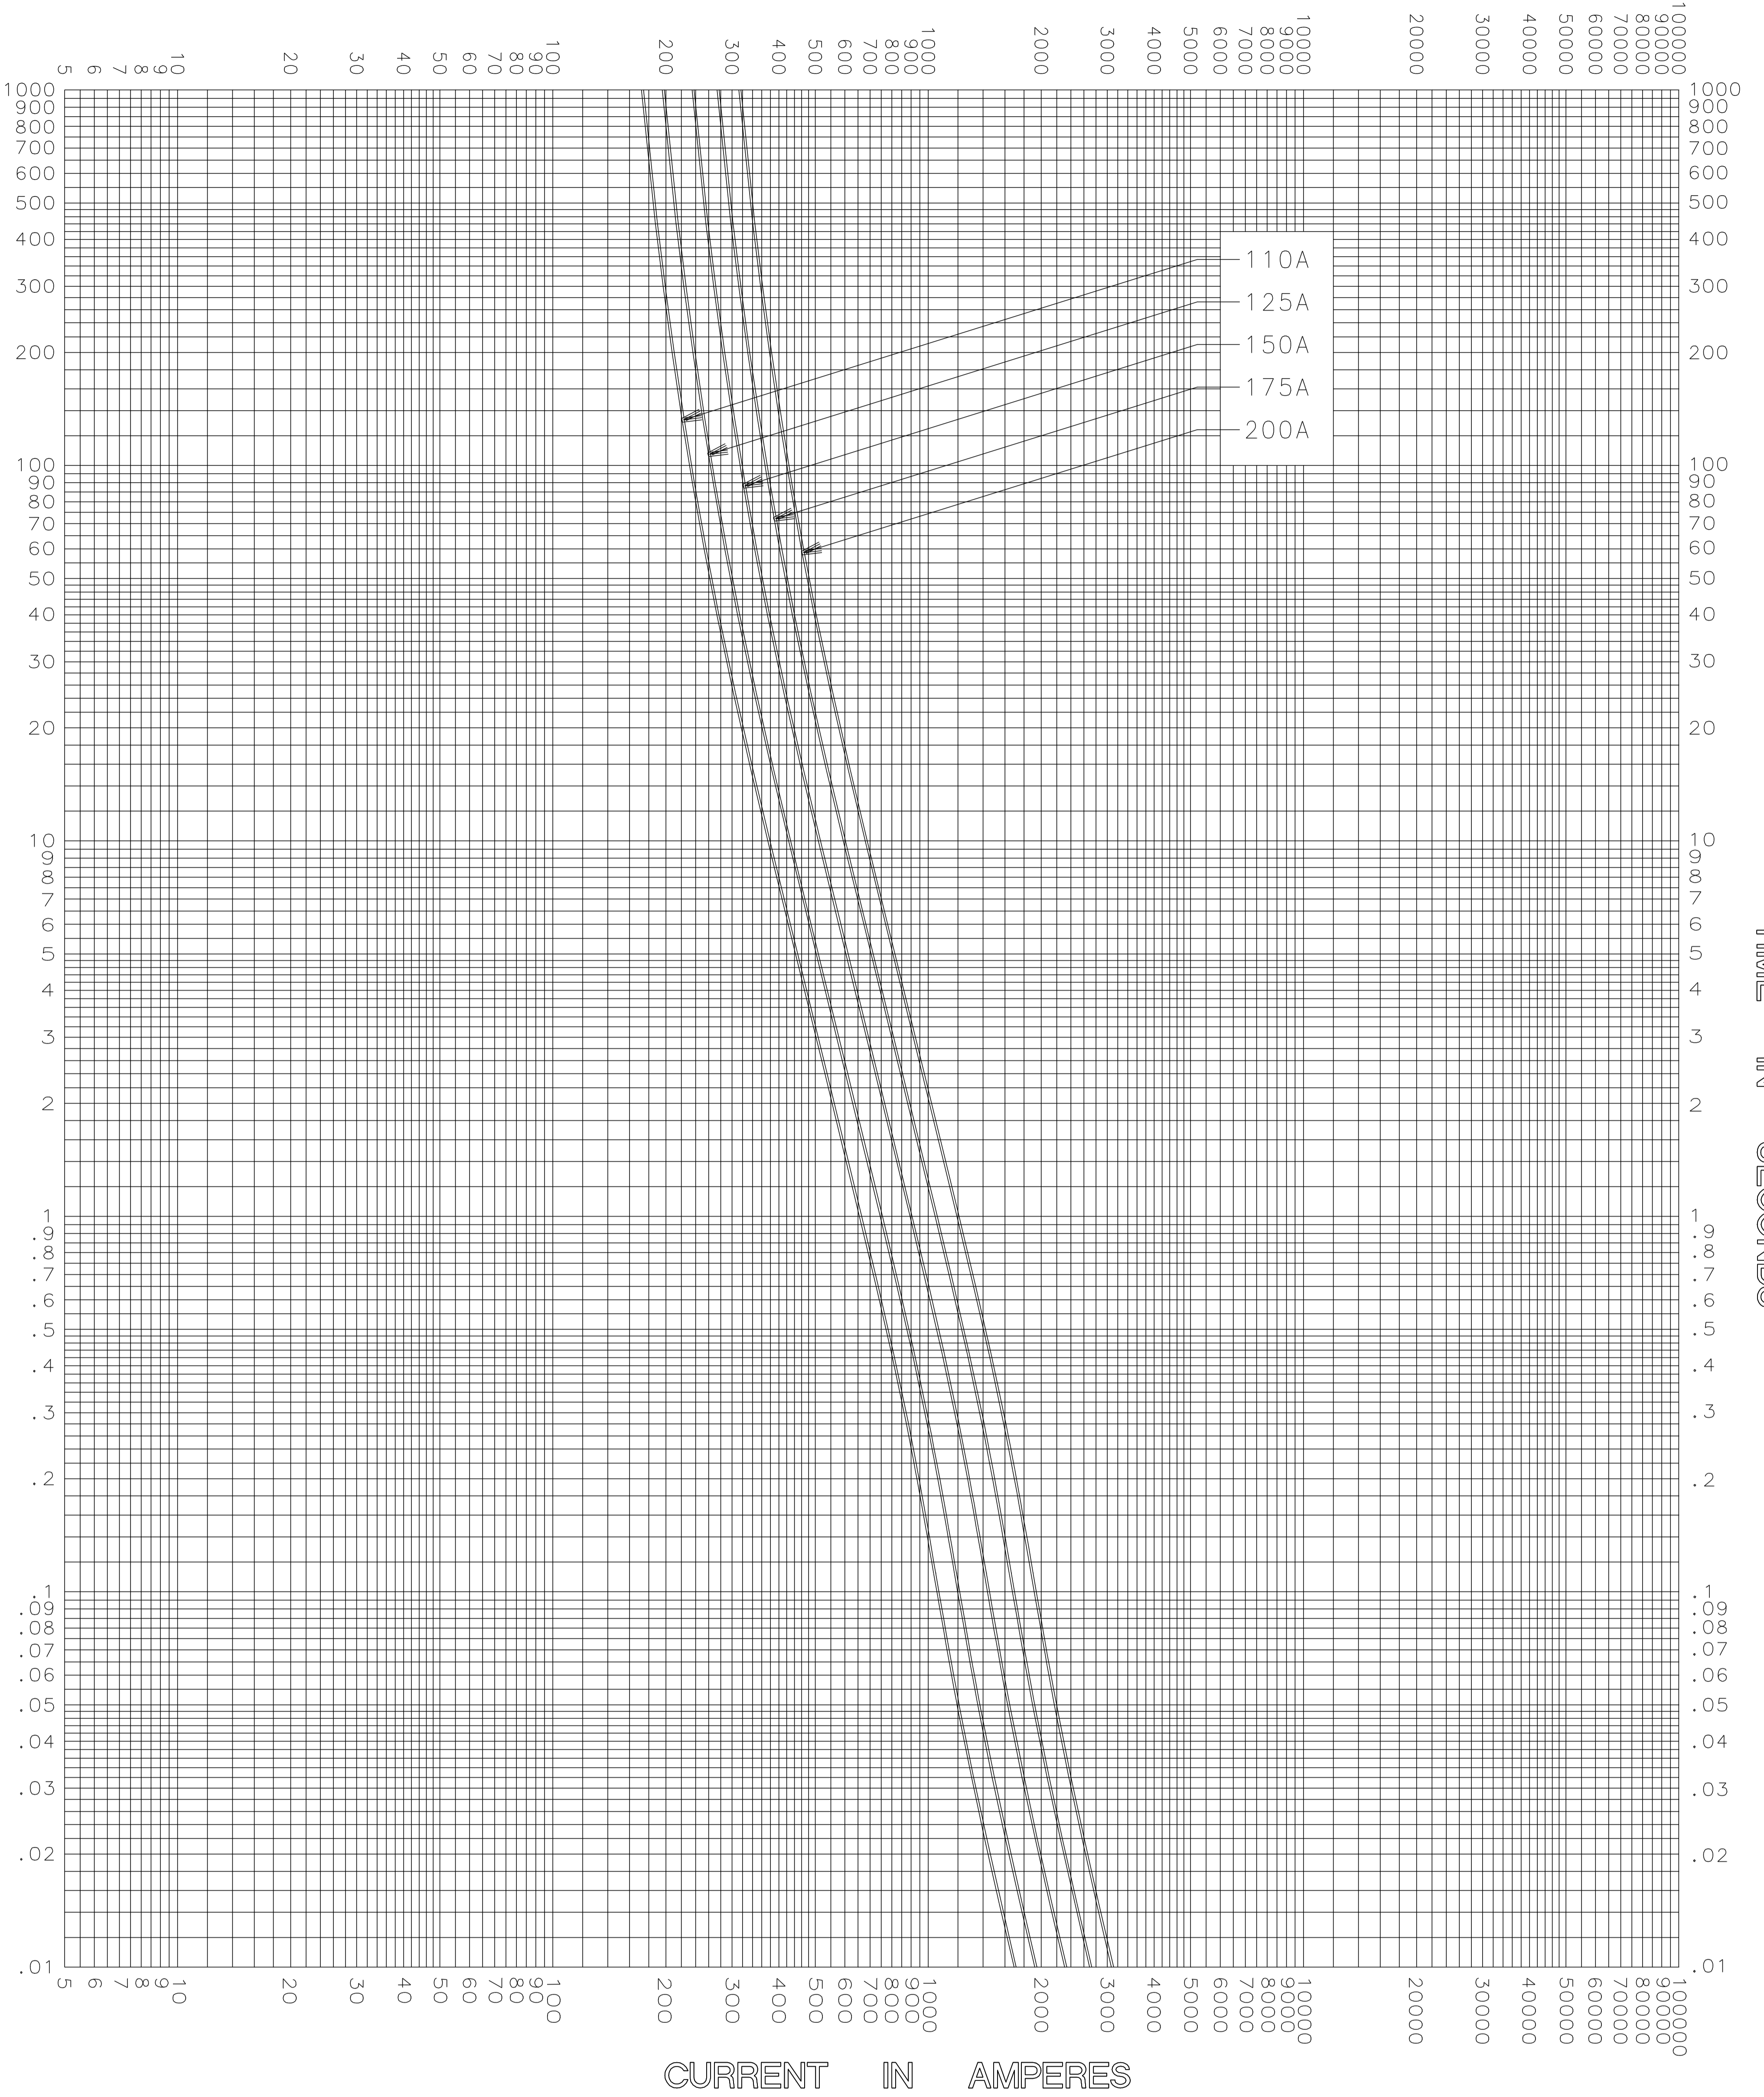

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLNR (110A - 200A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	01/14/05
CHECKED BY	MP
DRAWING NO.	A-FCC01/14/05

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

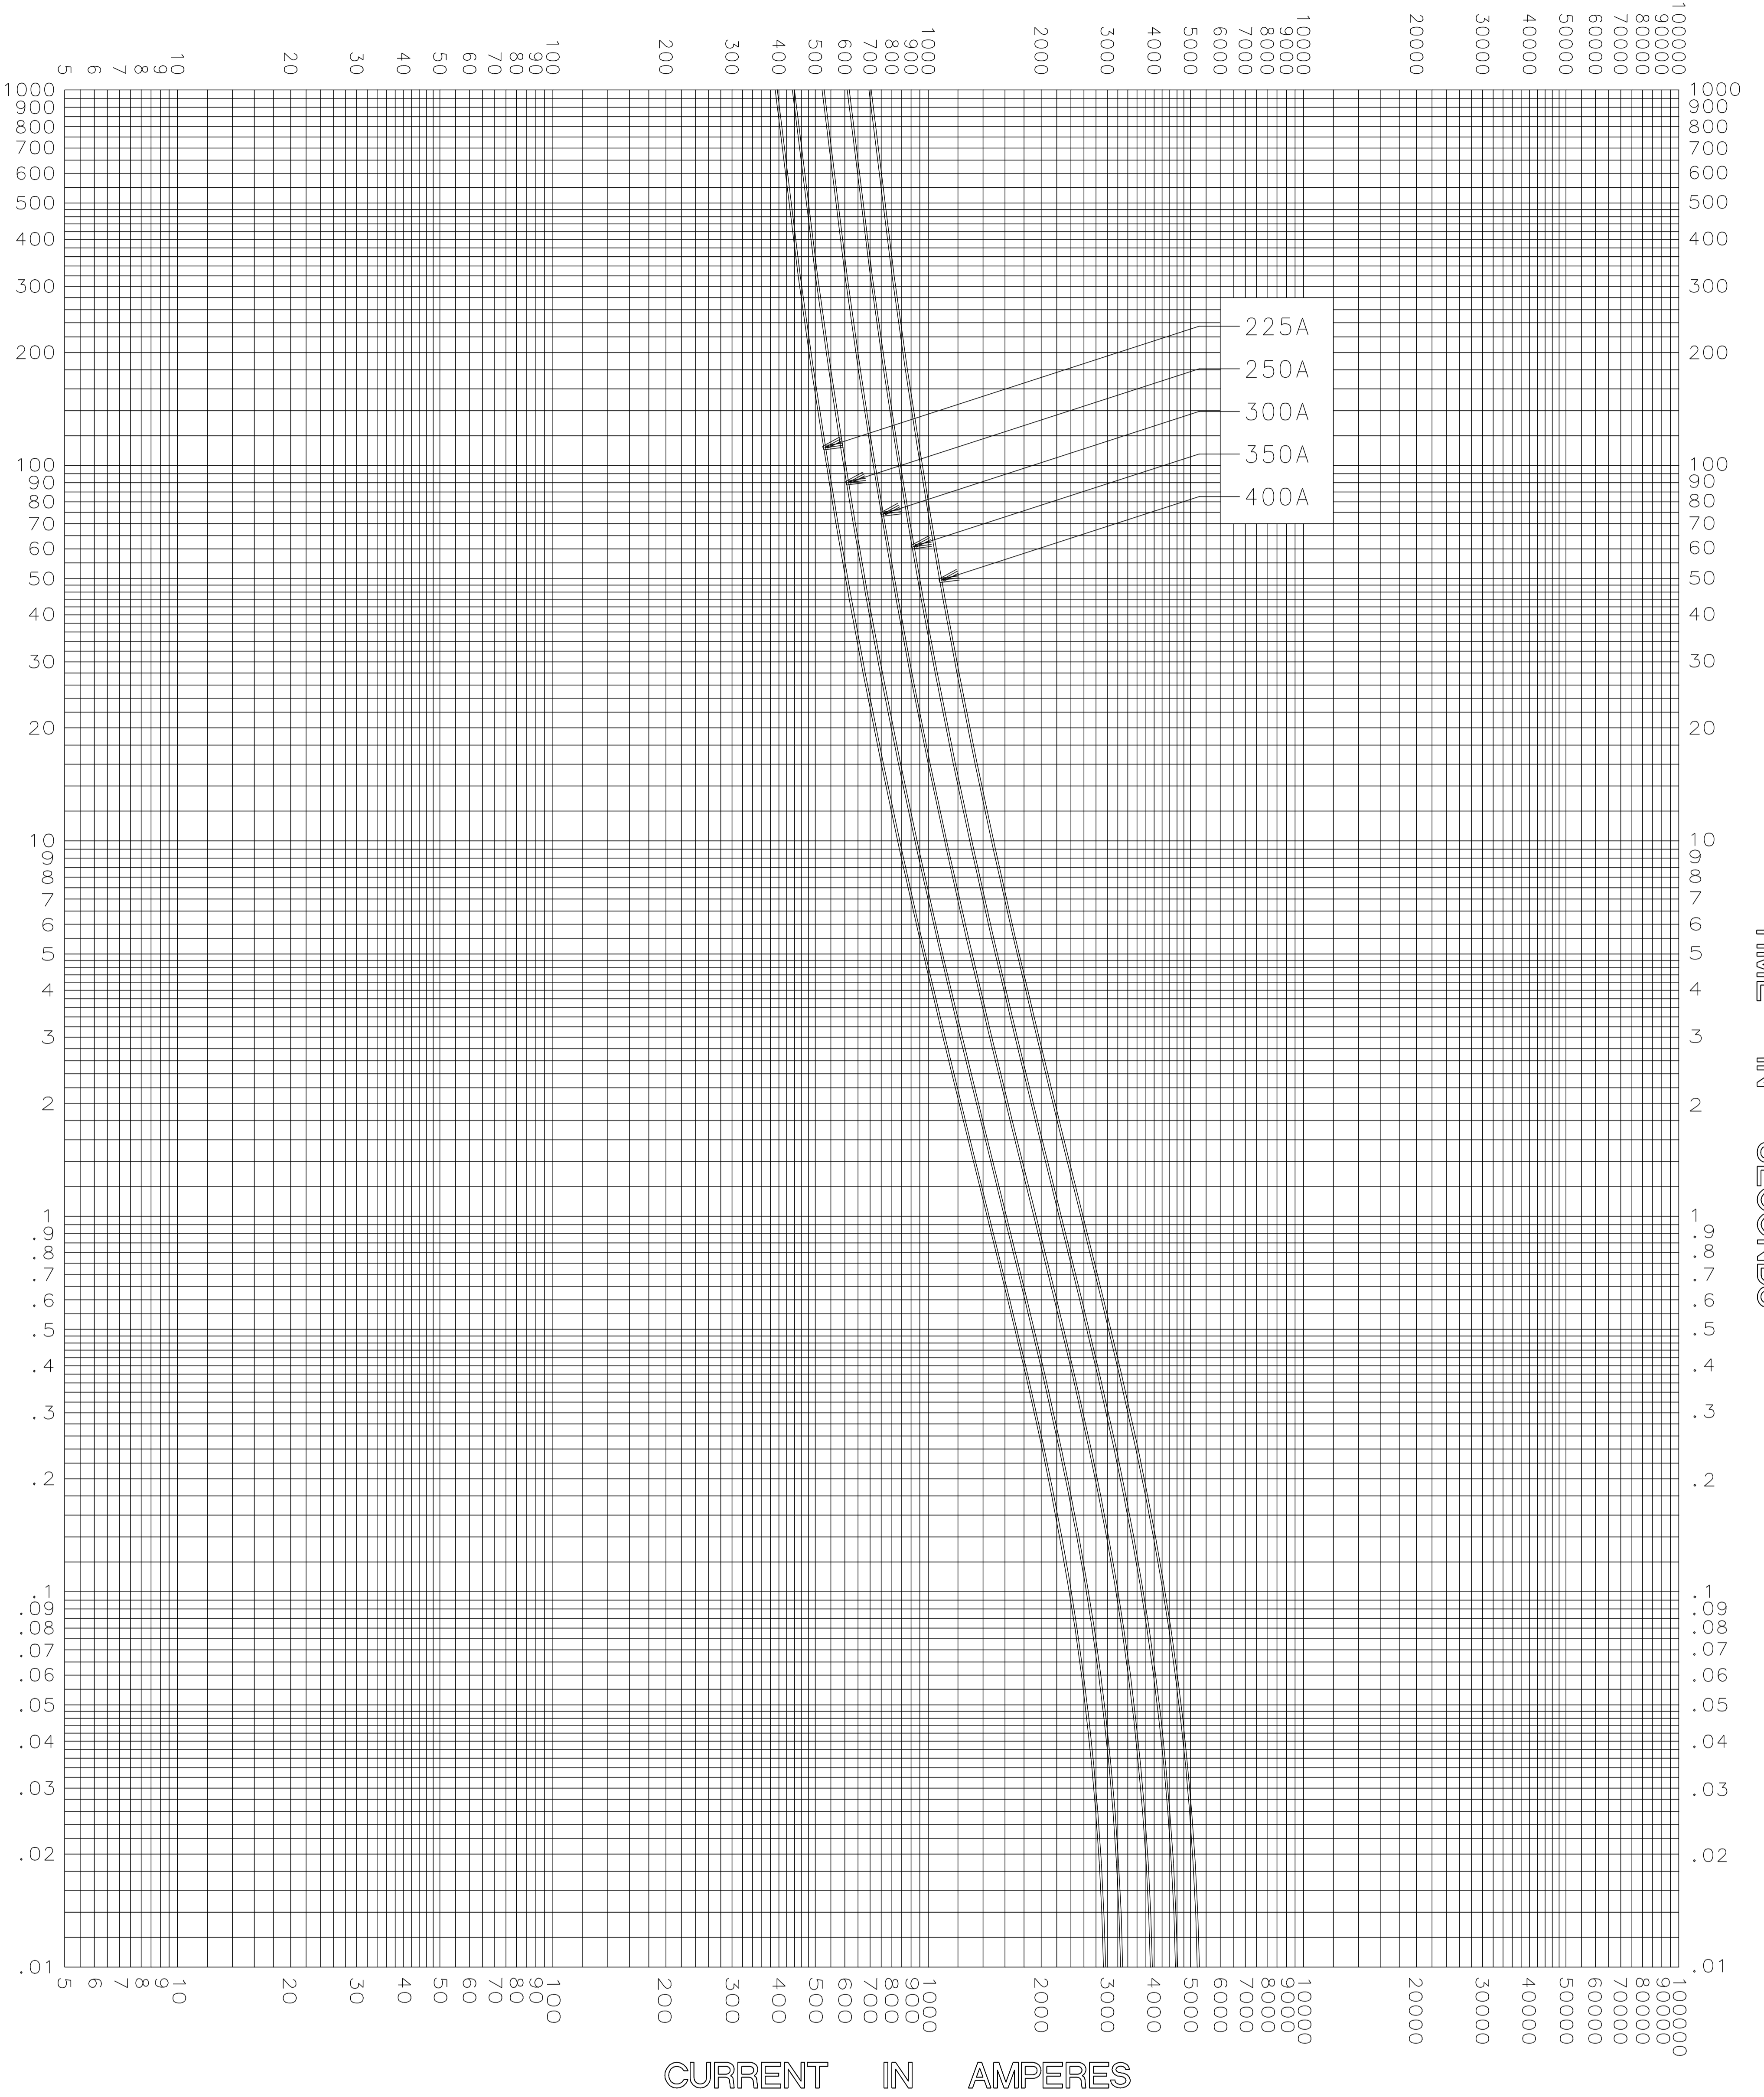

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLNR (225A - 400A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 01/14/05
CHECKED BY MP
DRAWING NO. A-FCC014R-006

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

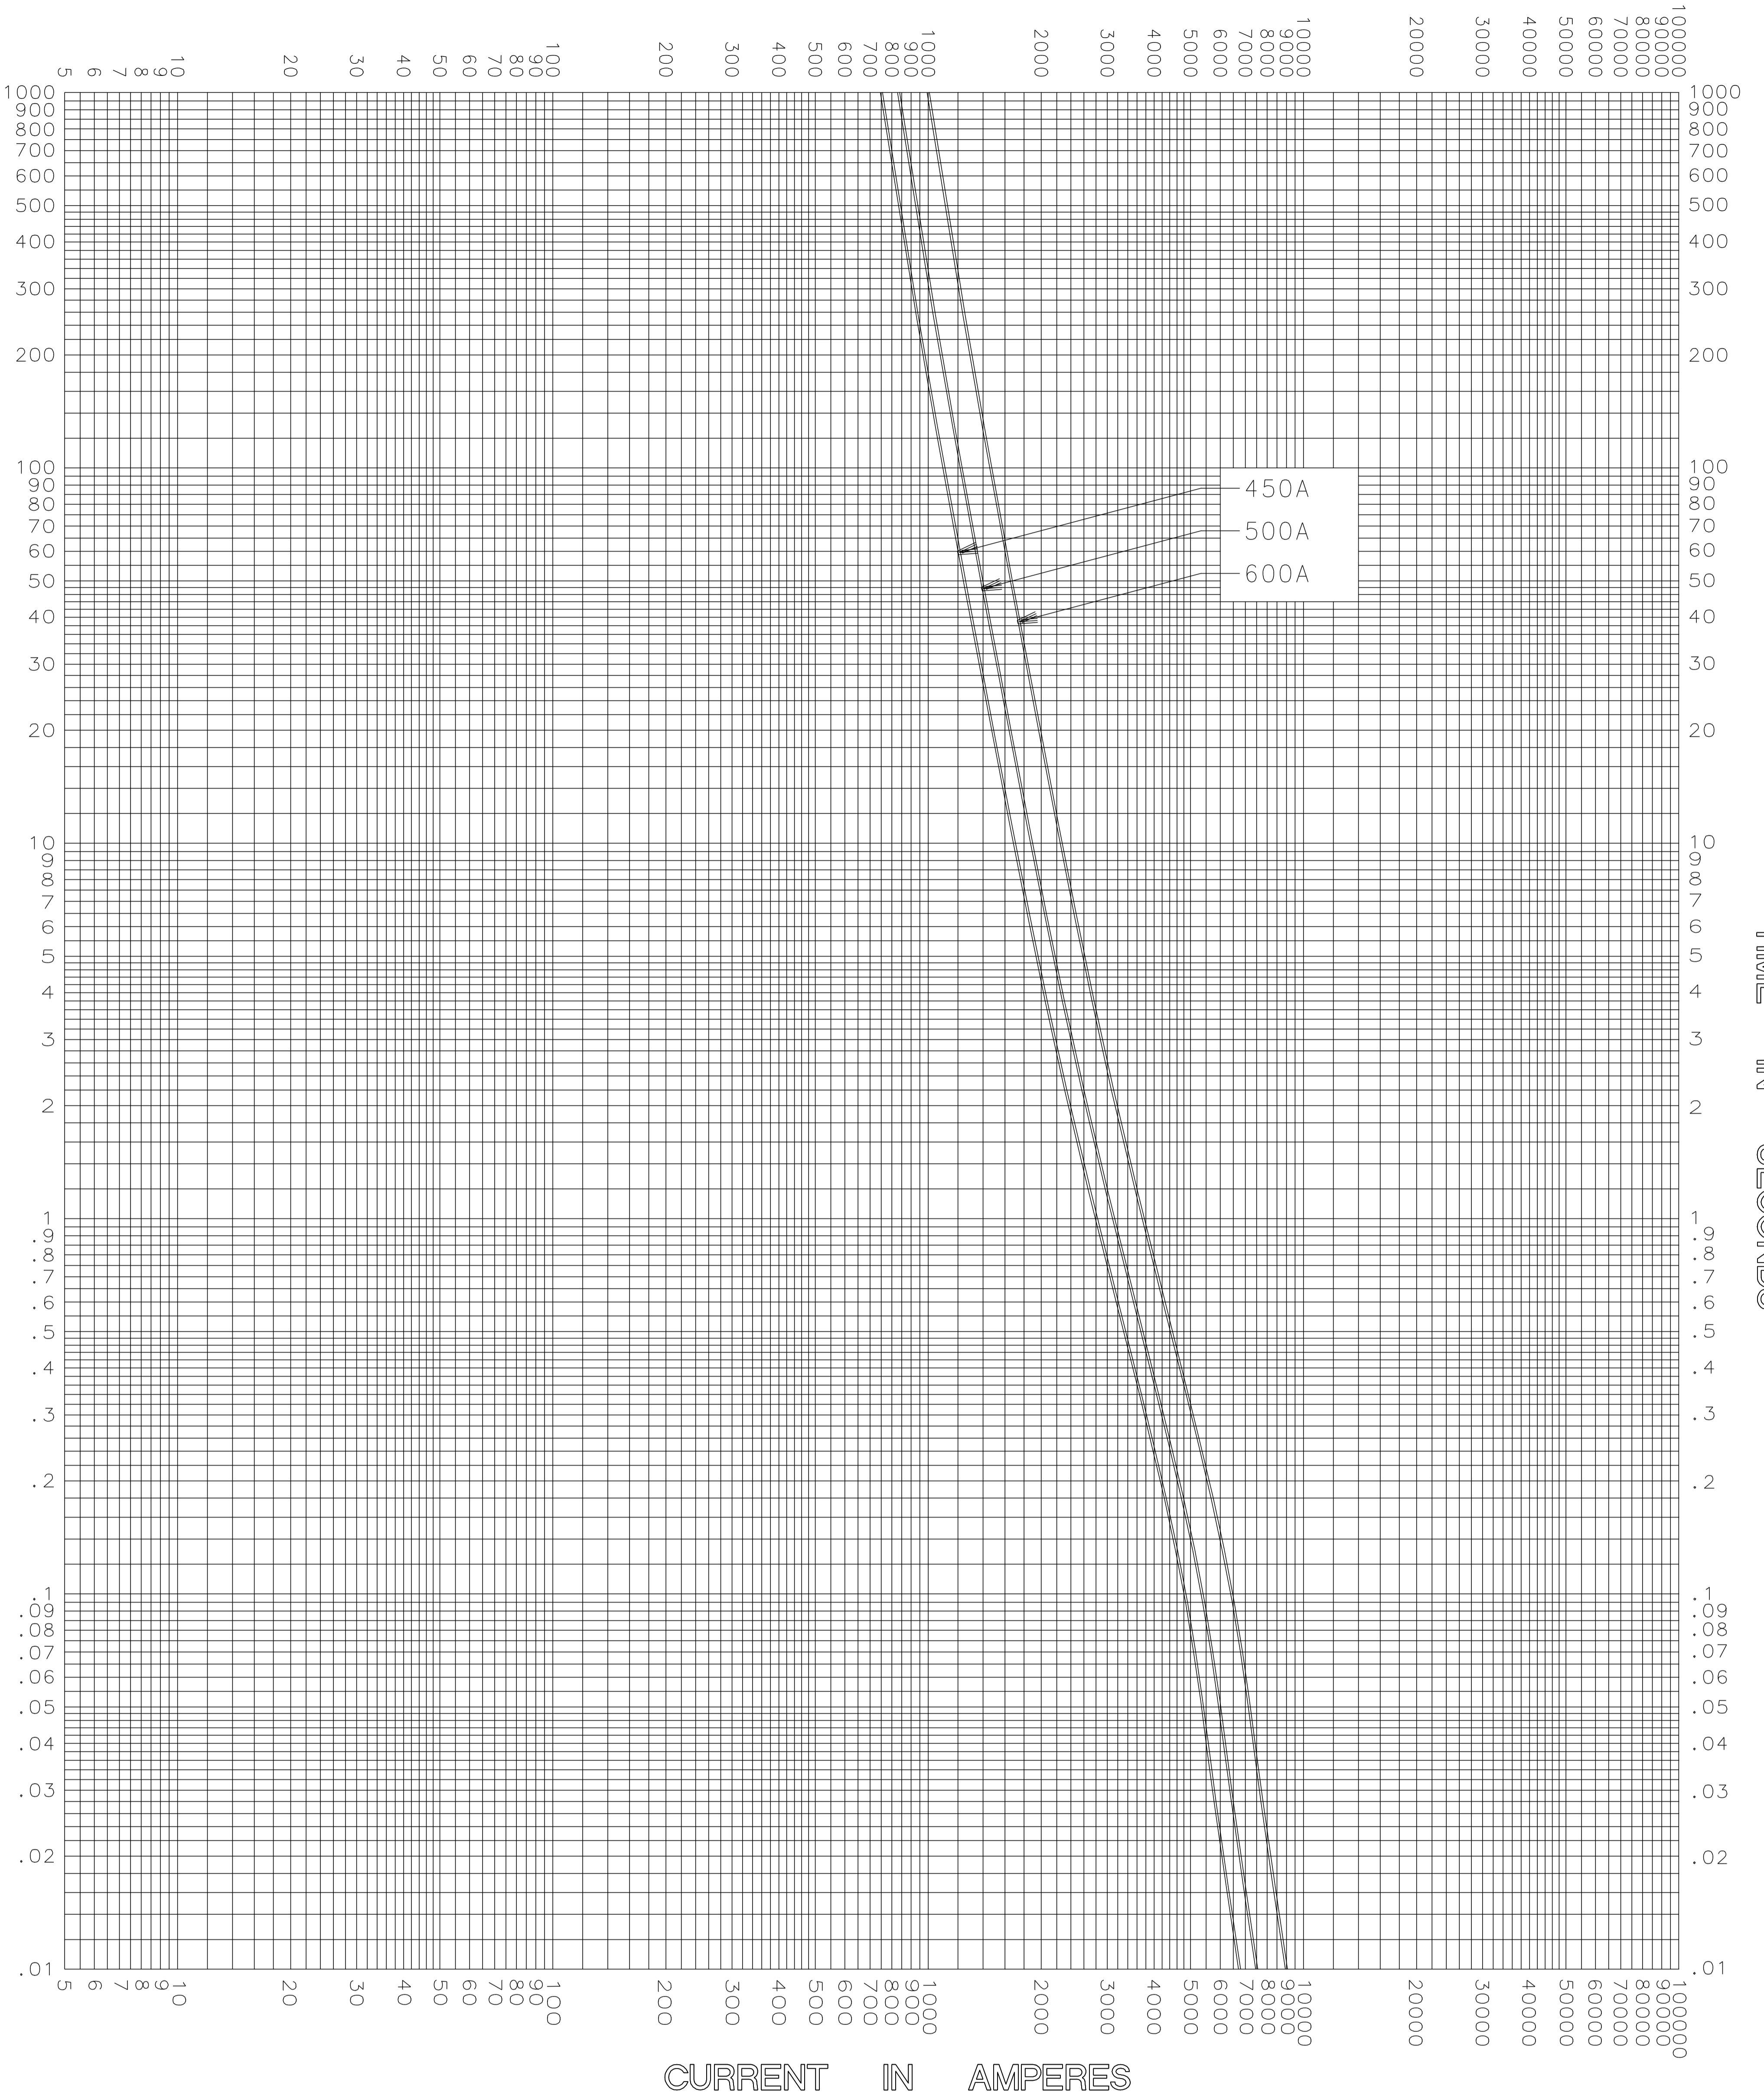

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLNR (450A - 600A)
BASIS FOR DATA _____		



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	01/14/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01/14/05-007
------------------------------------	----------------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

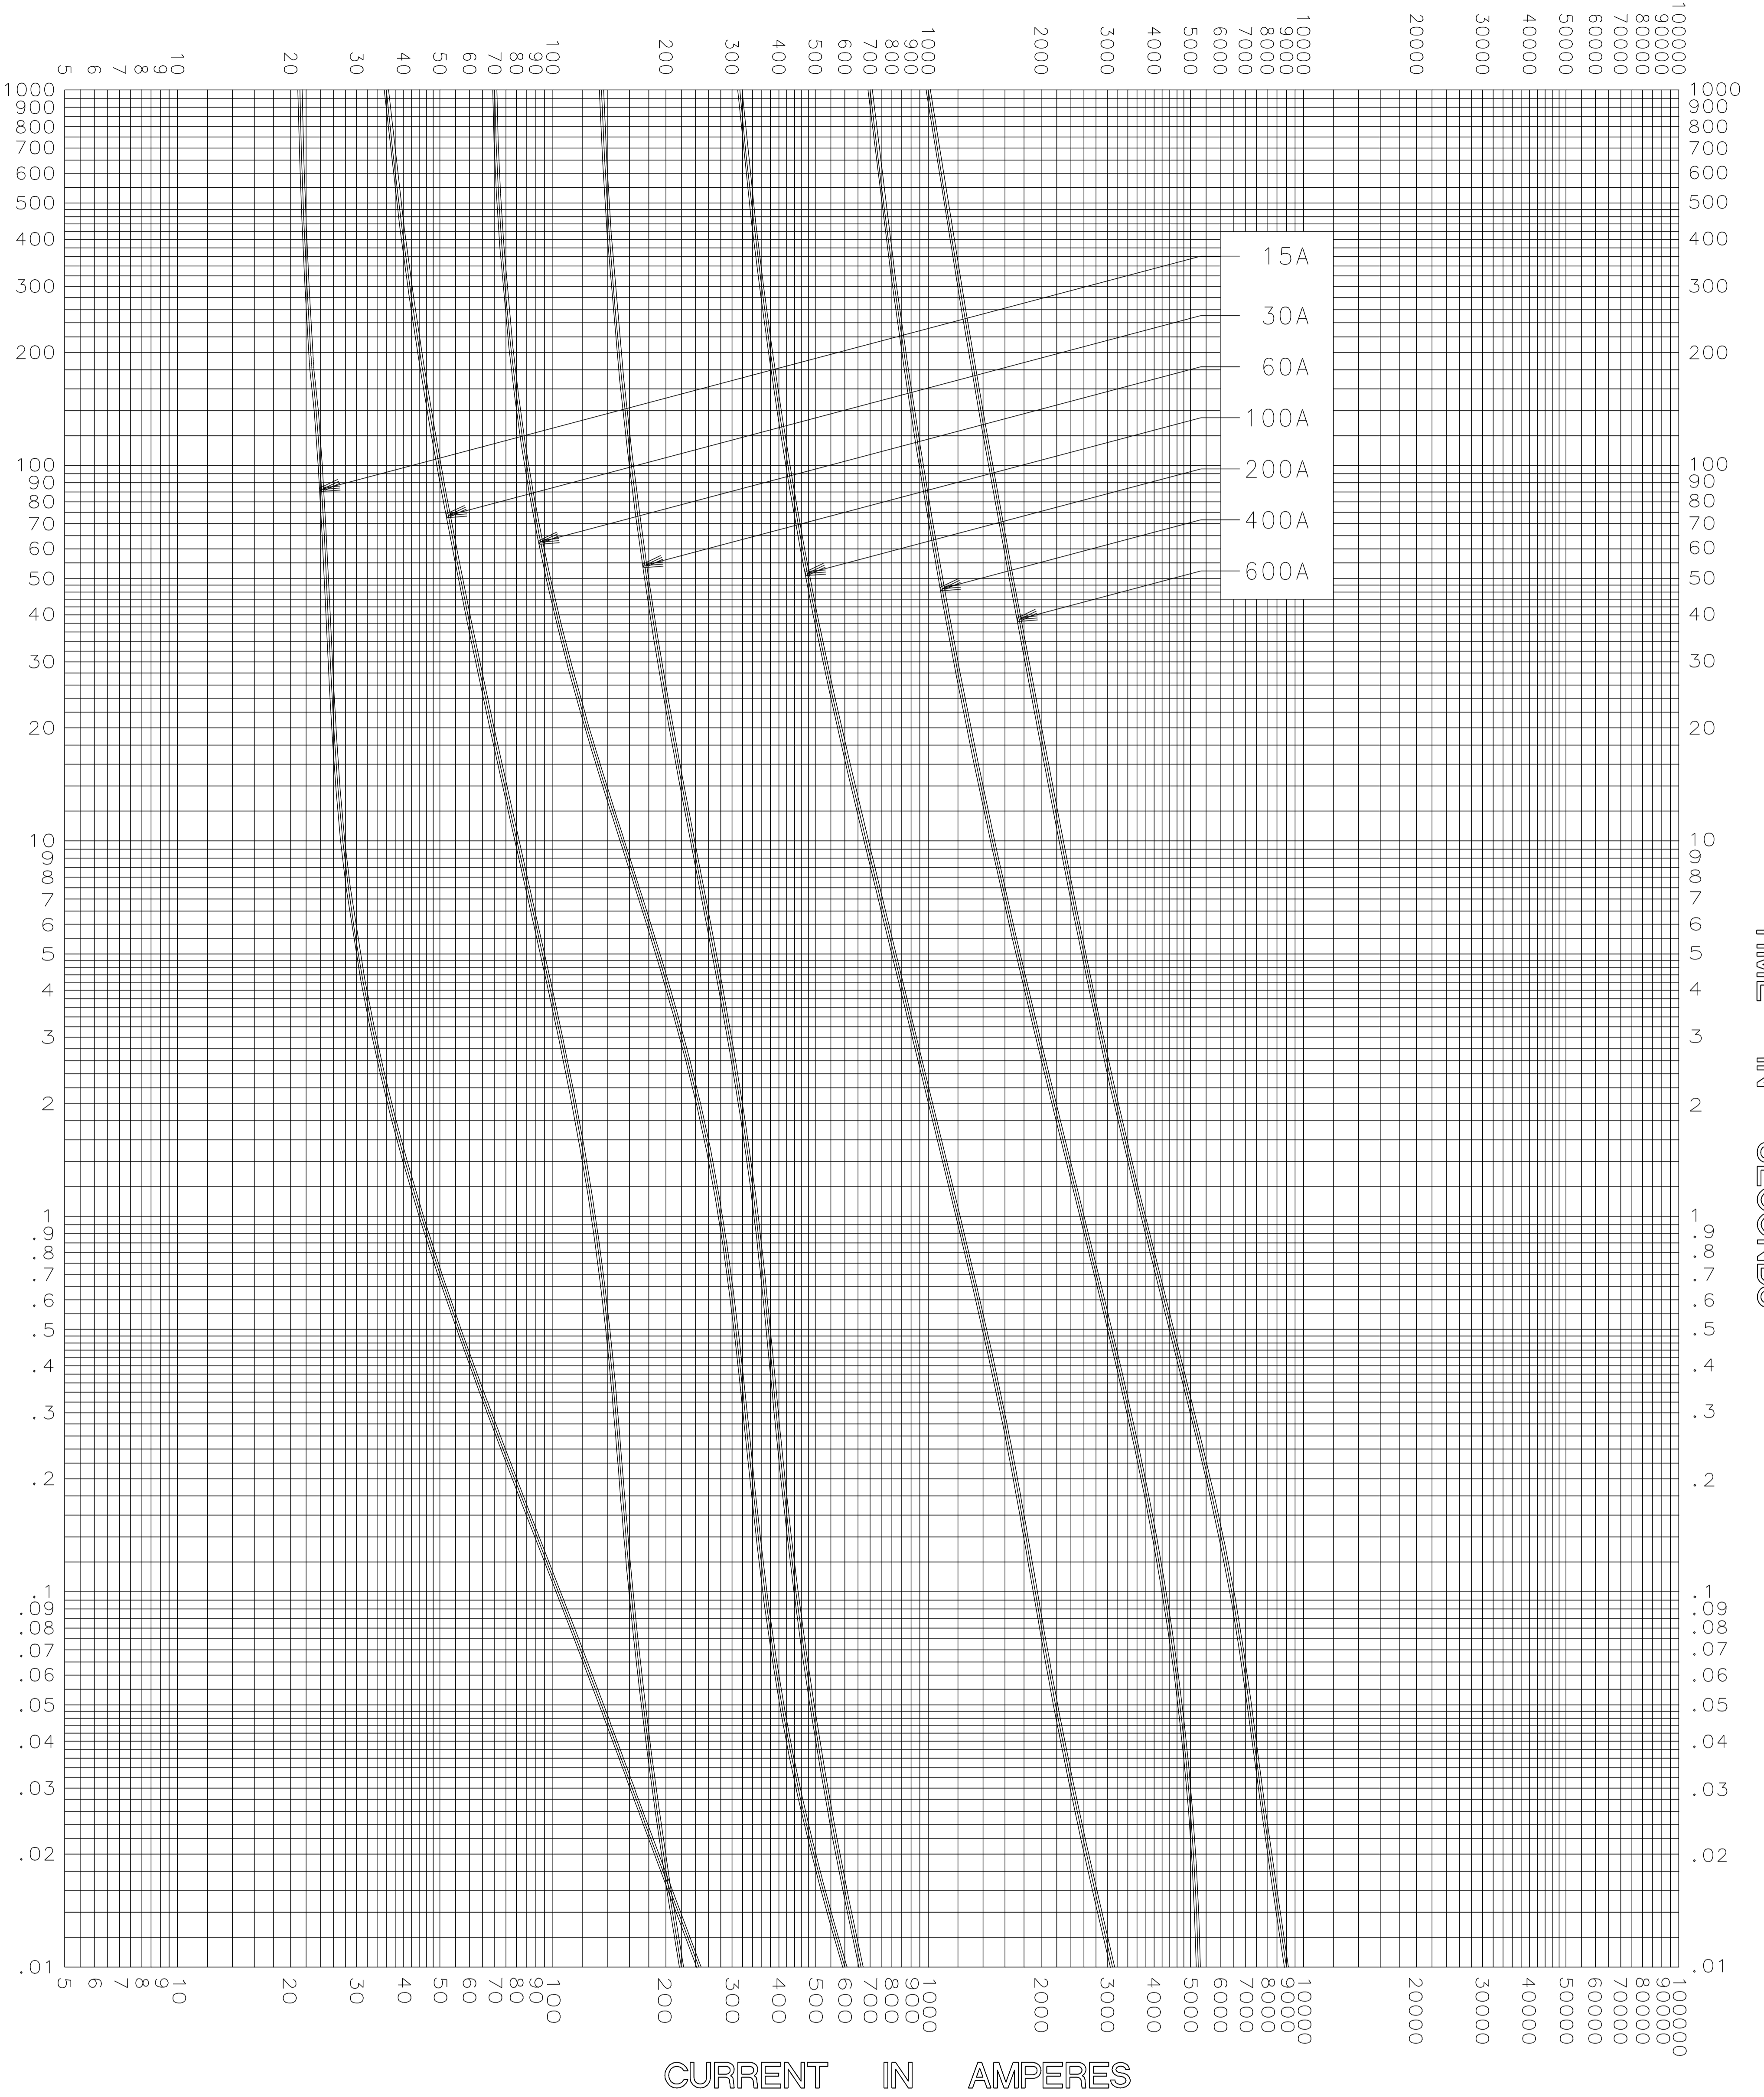

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLNR (15A - 600A)
BASIS FOR DATA _____		

 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY <u>LLL</u> DATE <u>01/14/05</u> CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC014R-008</u>

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT