
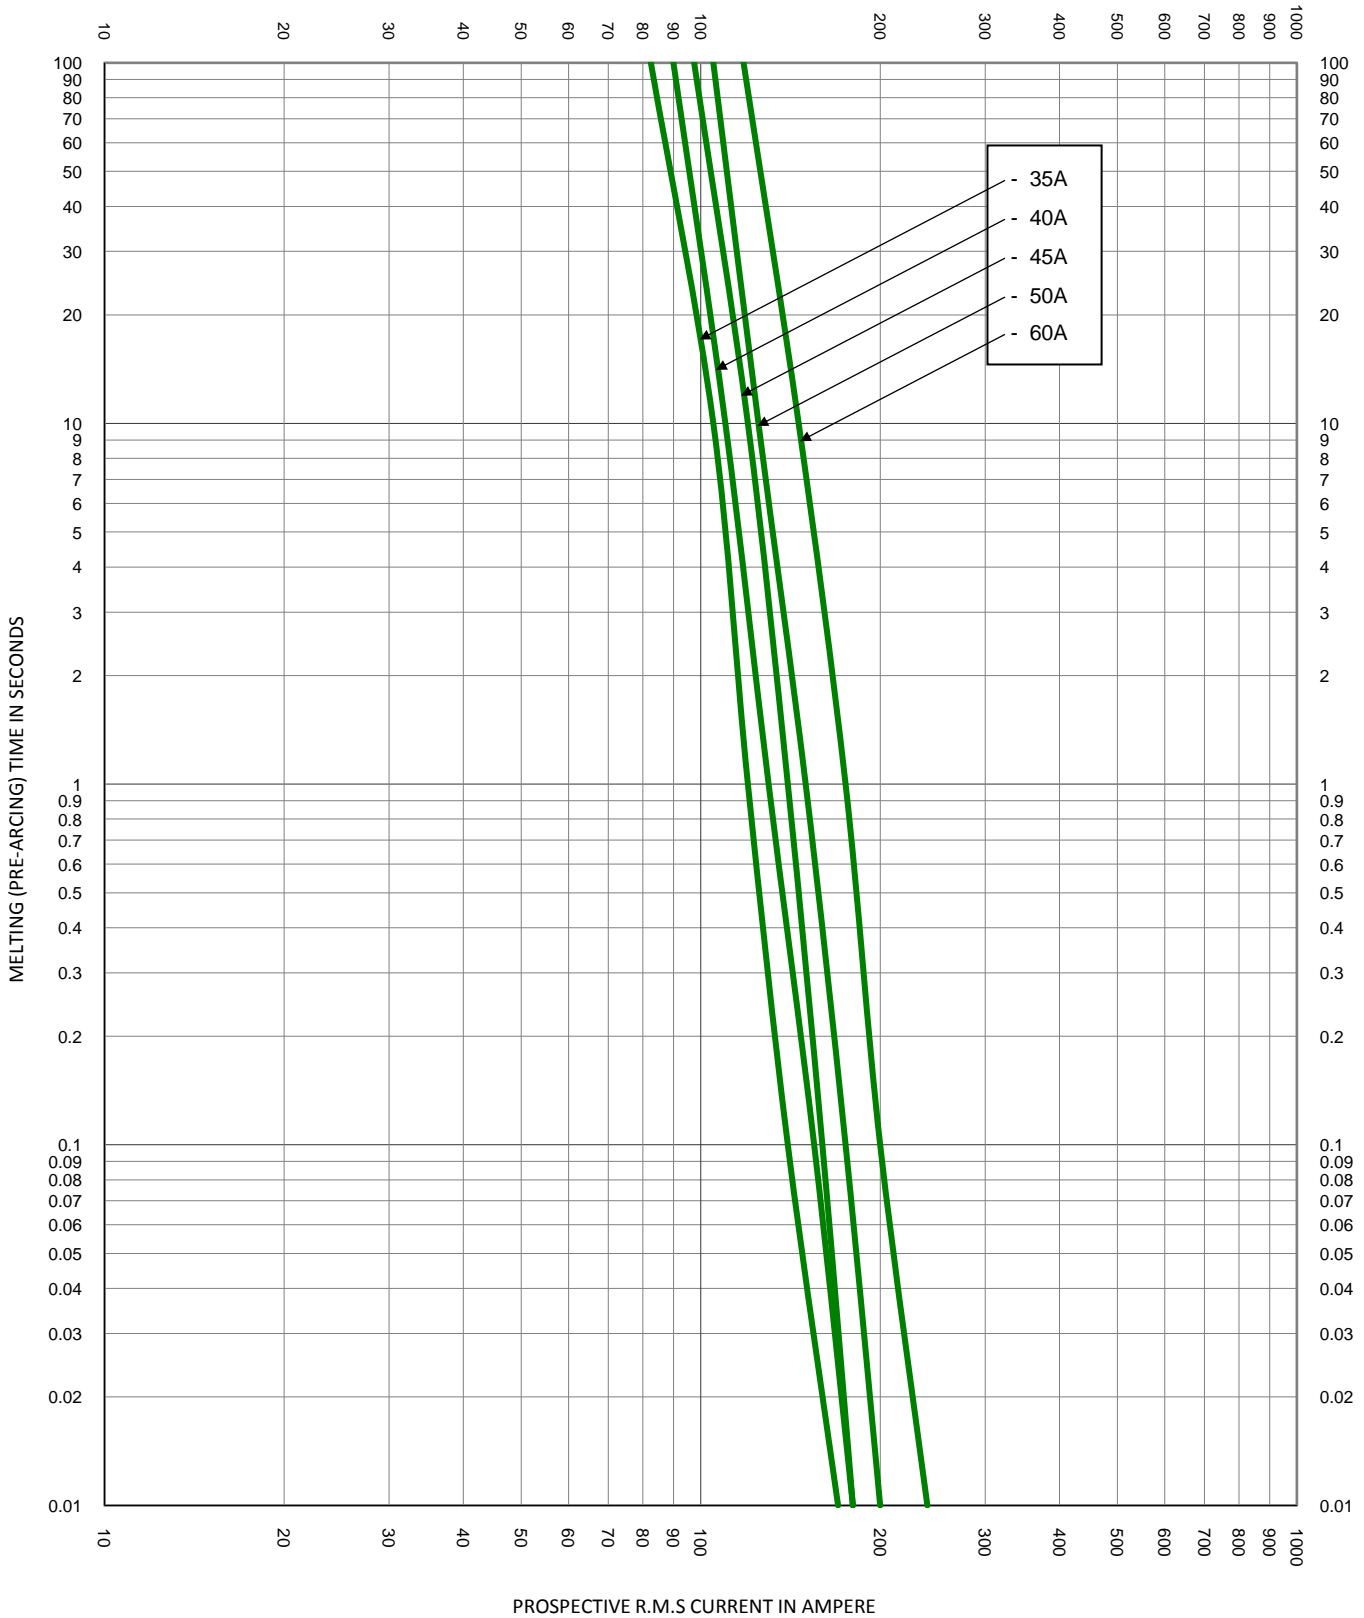

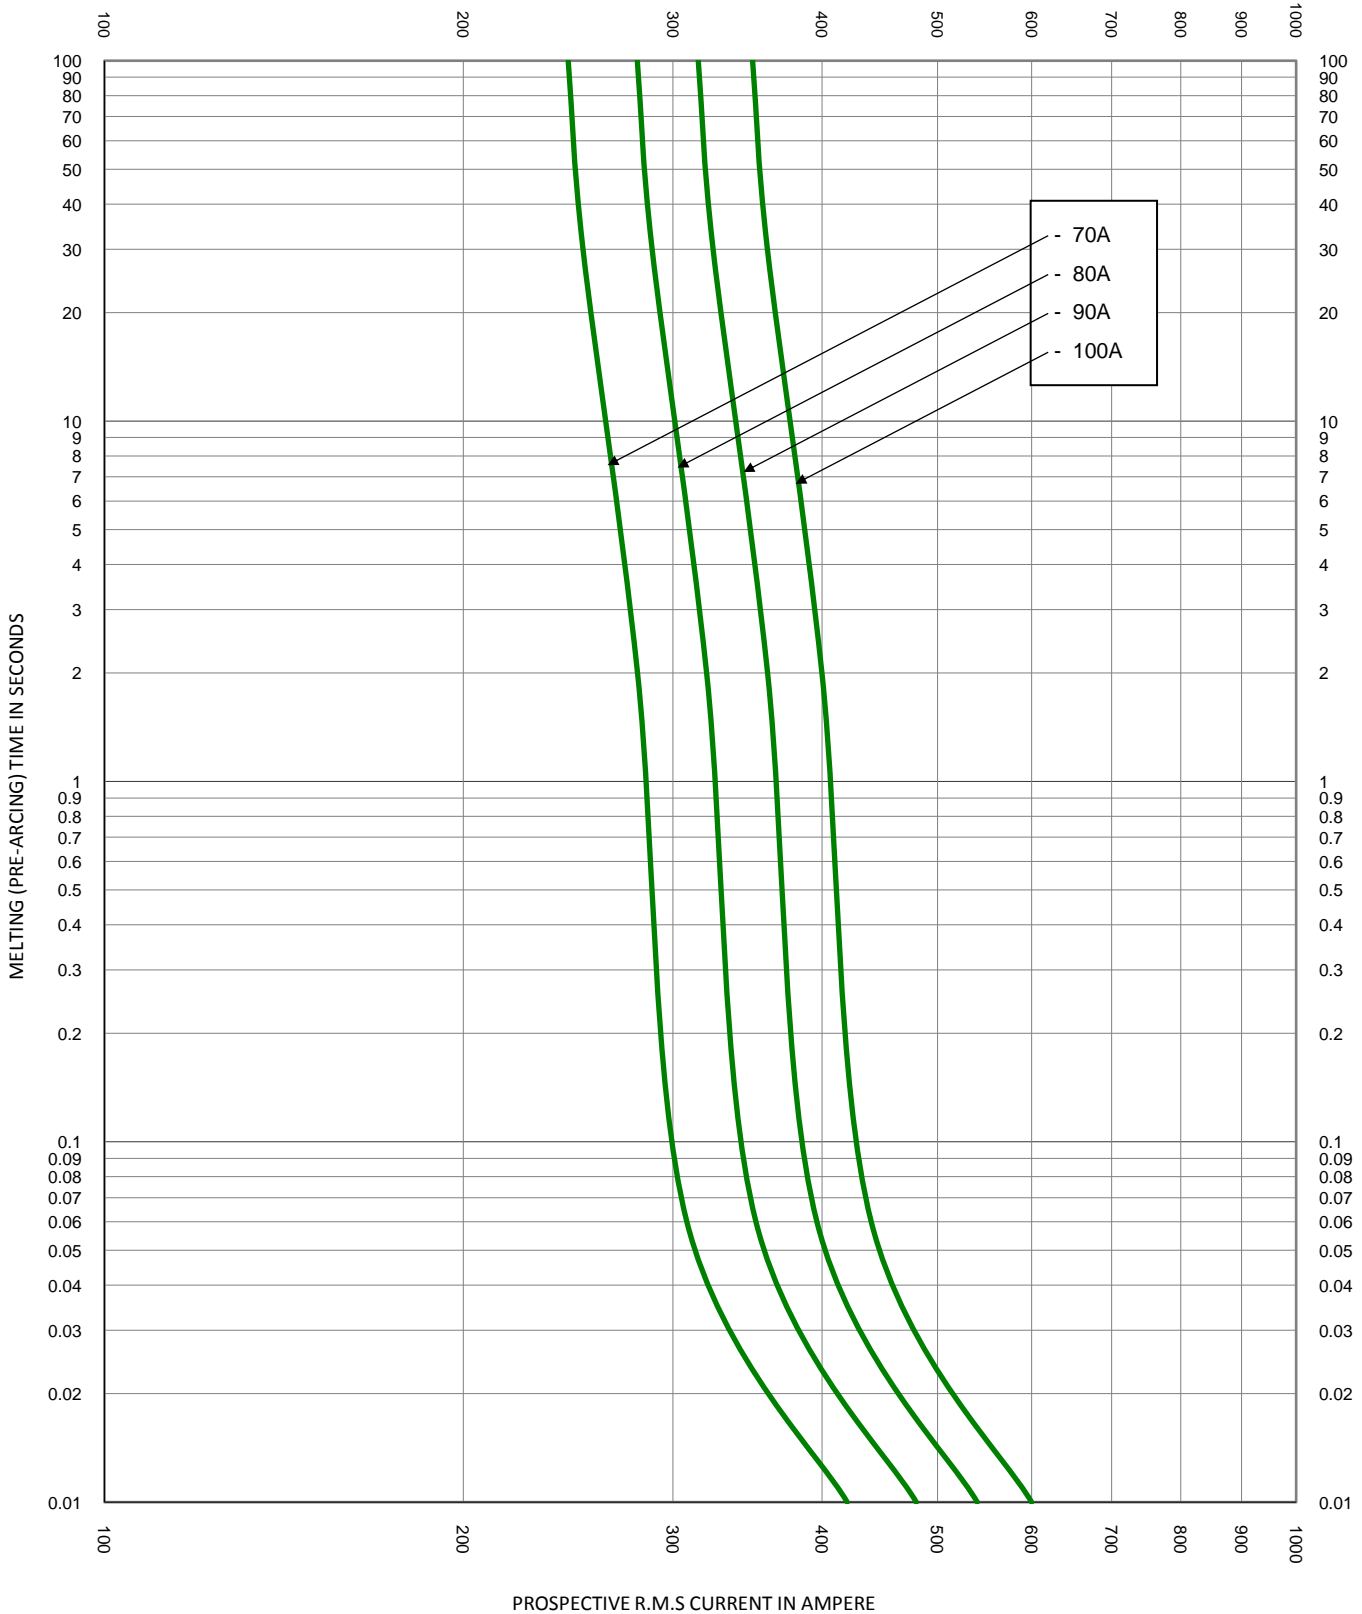



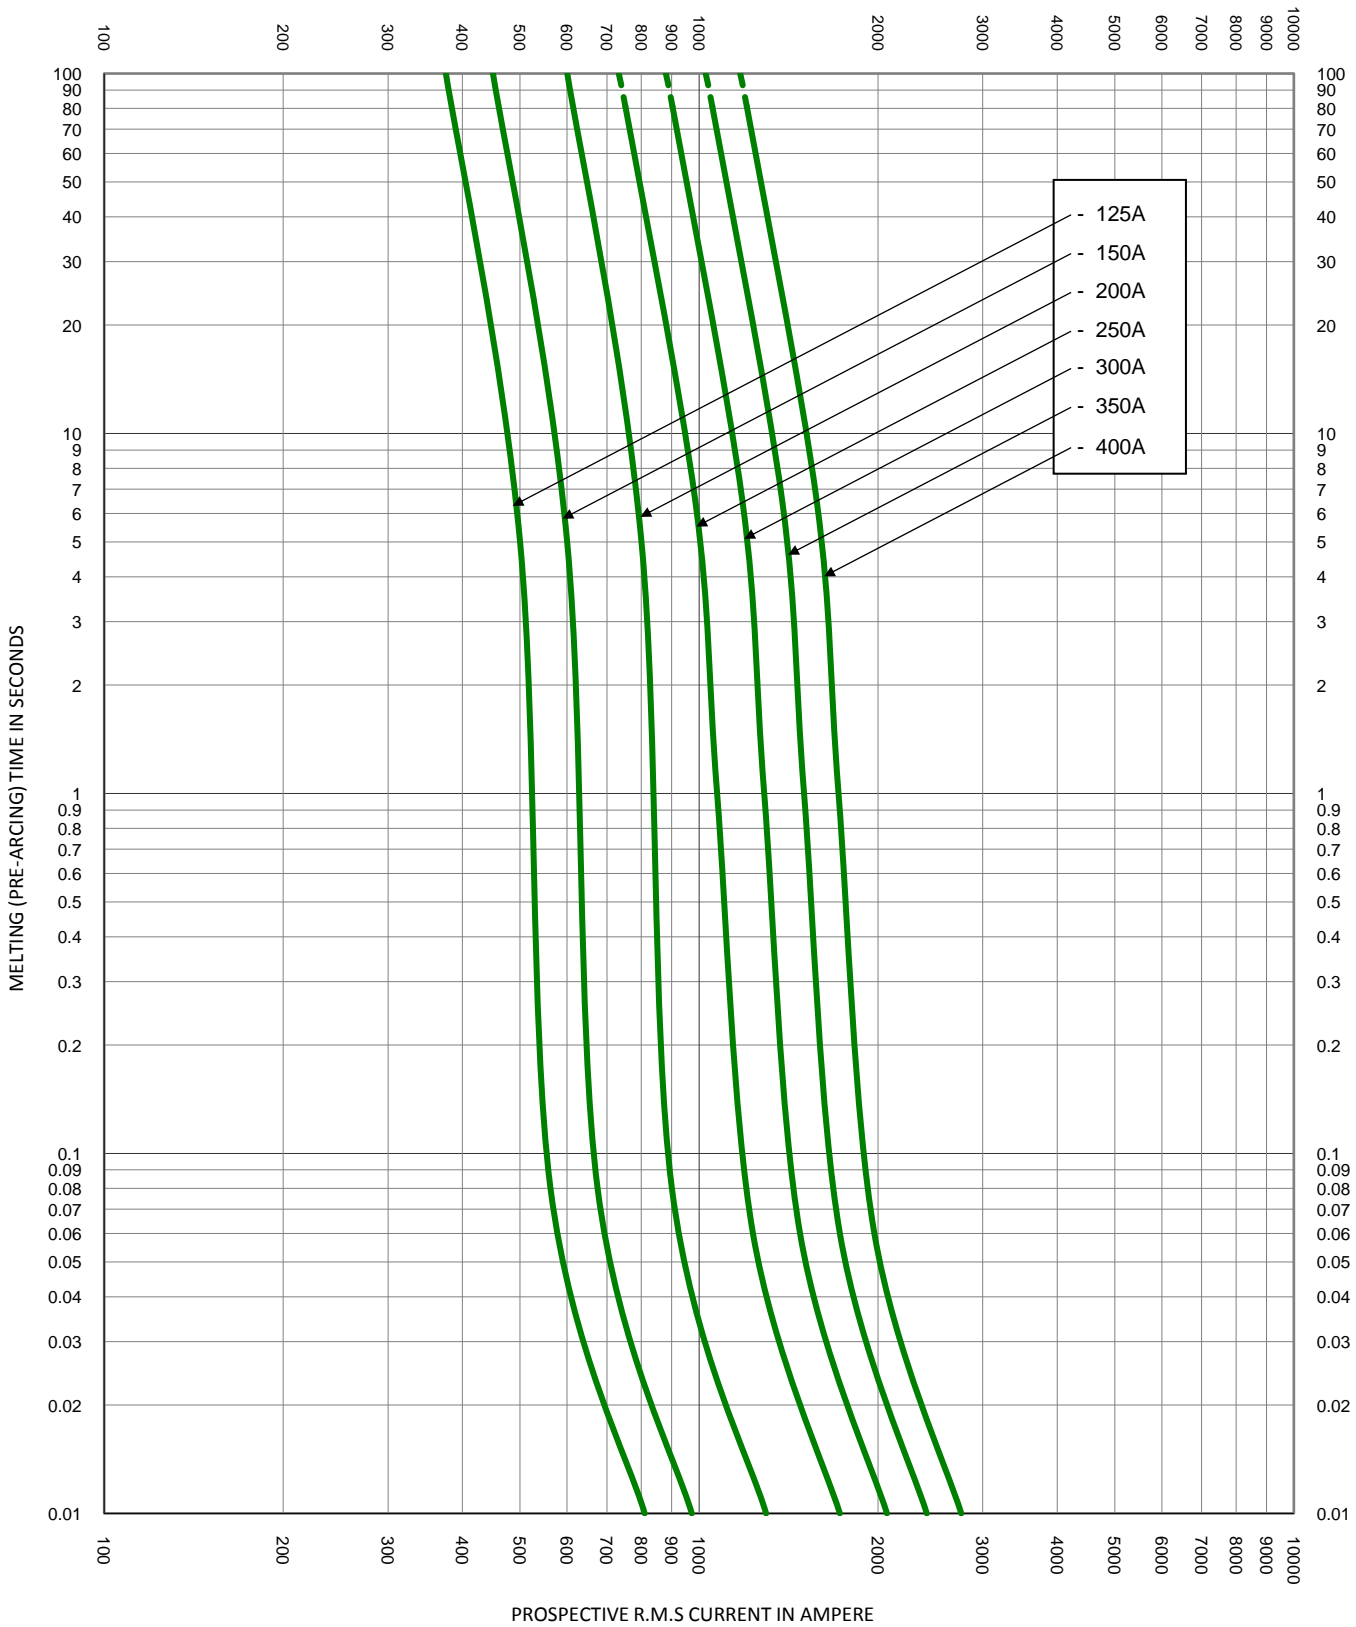
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L15S 1A - 1000A
		DRAWN BY: LLL
		DATE: 04/22/2016
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		REVISION: B
		DRAWING NO.: FCC01-L15S SHEET 2 OF 6




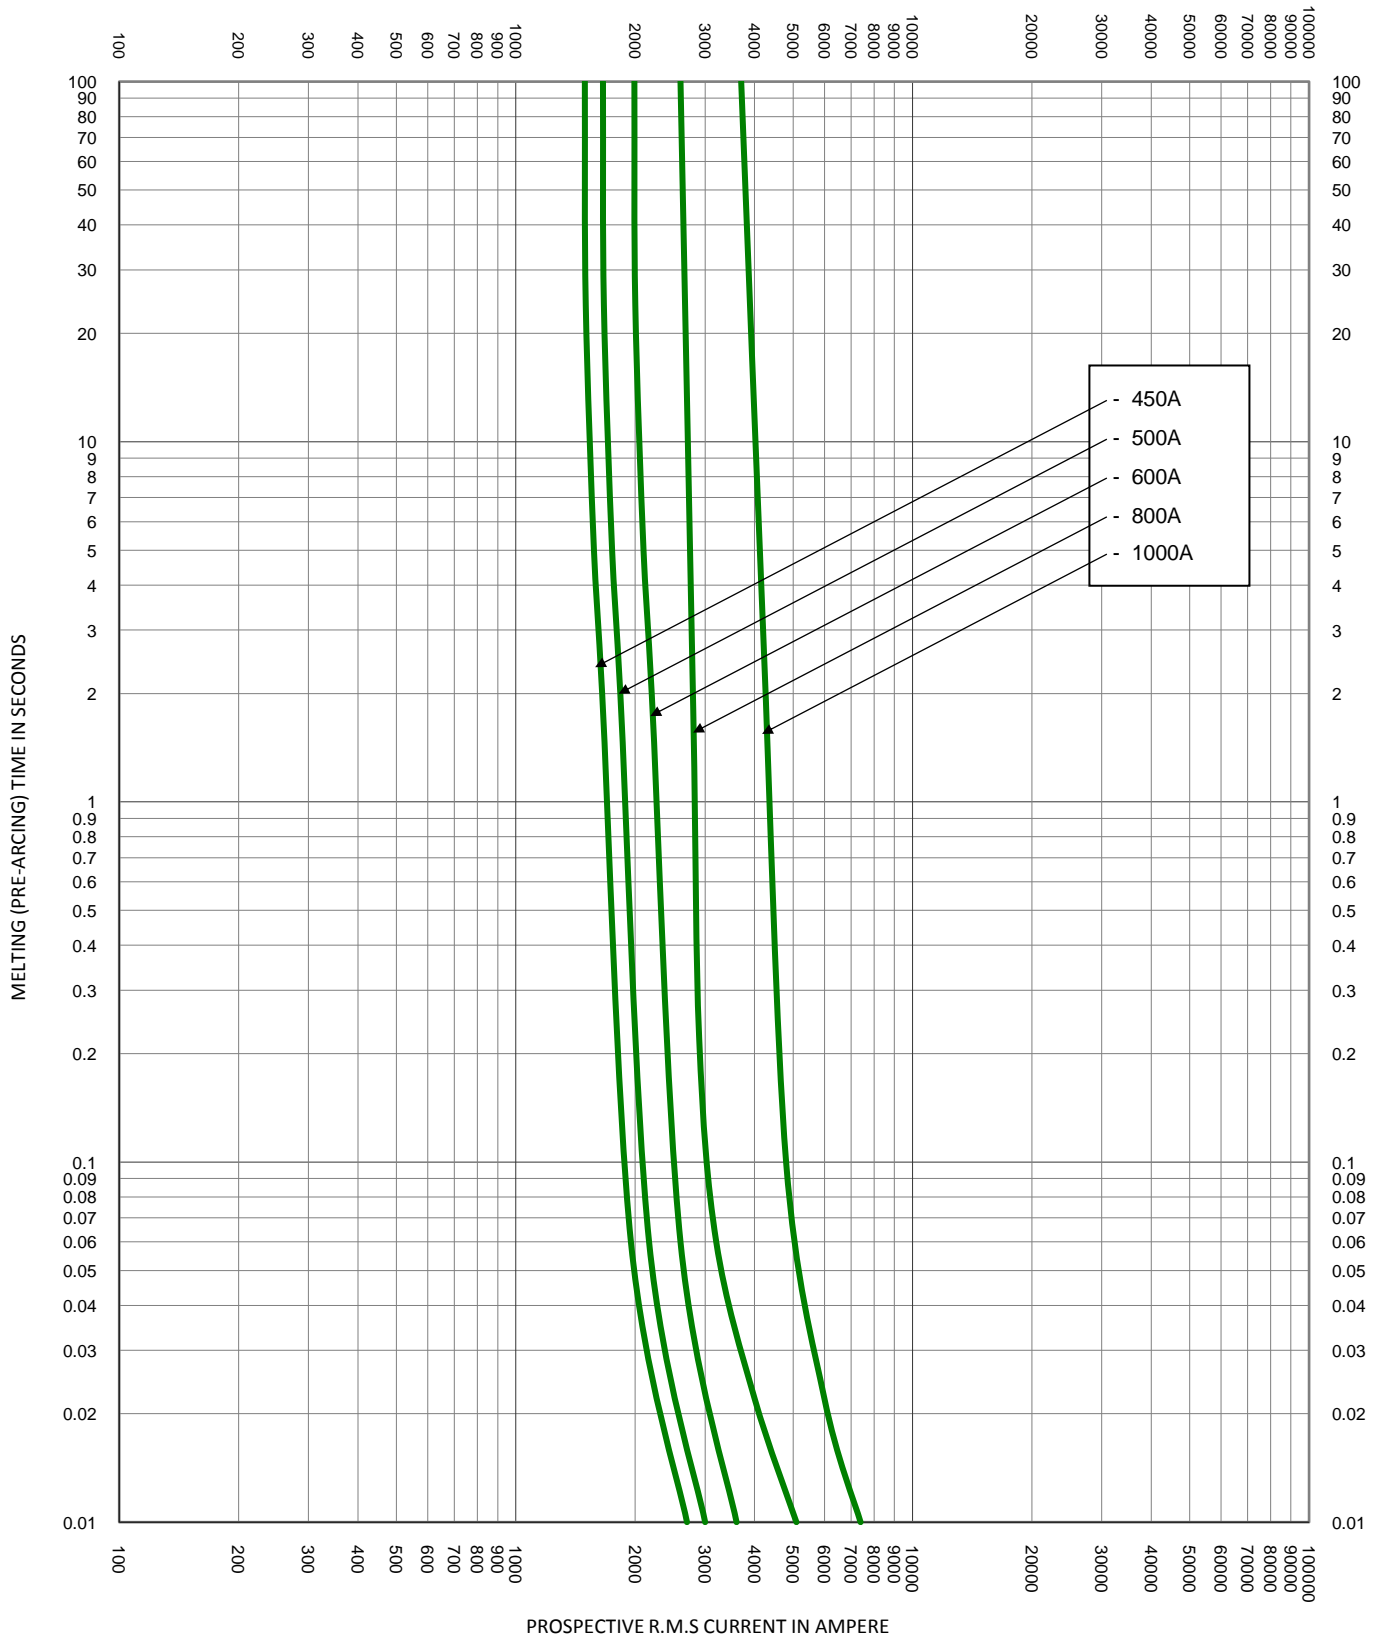
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L15S 1A - 1000A
		DRAWN BY: LLL DATE: 04/22/2016 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L15S SHEET 3 OF 6




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L15S 1A - 1000A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/22/2016 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L15S SHEET 4 OF 6



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L15S 1A - 1000A
		DRAWN BY: LLL DATE: 04/22/2016 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L15S SHEET 5 OF 6



TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L15S 1A - 1000A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 04/22/2016 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC01-L15S SHEET 6 OF 6