
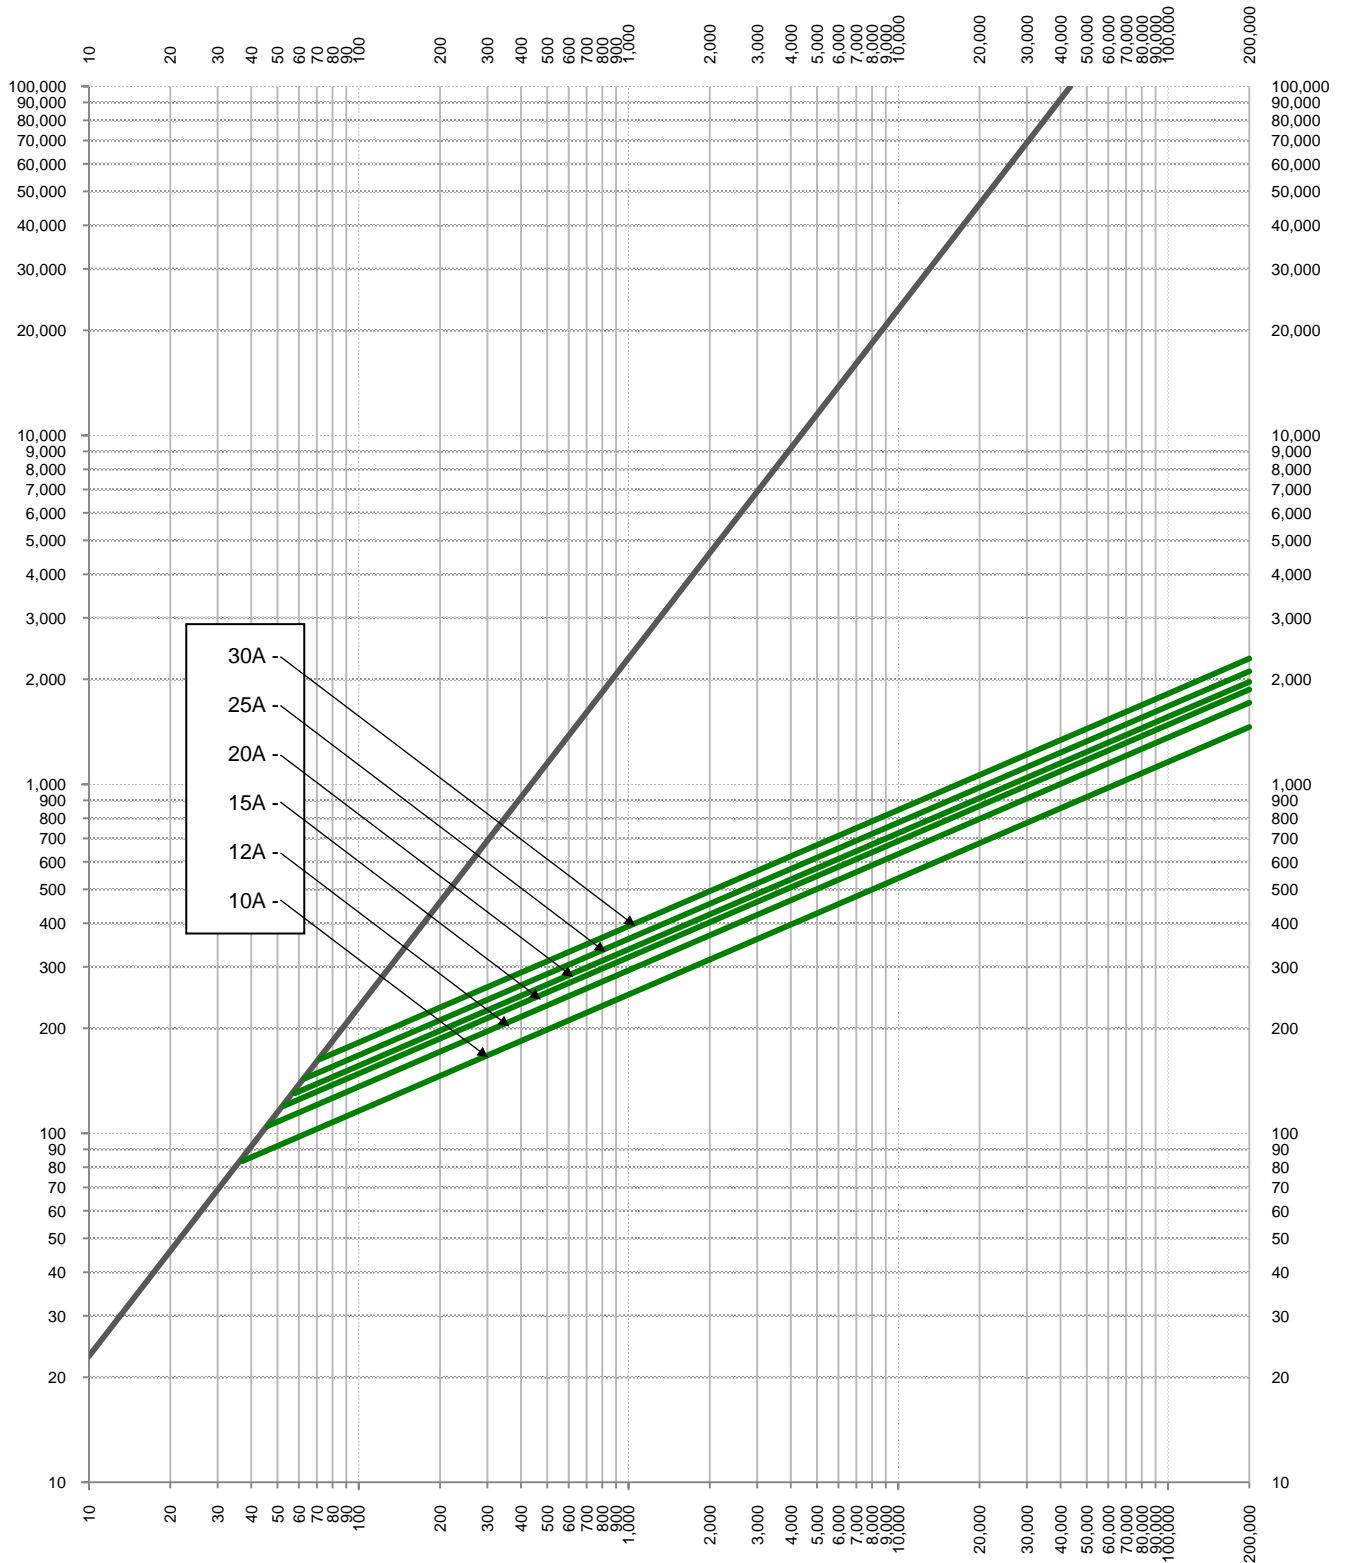



TEST VOLTAGE: 500V	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L50S 10A-800A


 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA	DRAWN BY: LLL
	DATE: 02/10/2015
	REVISION: A
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>	DRAWING NO.: FCC05-L50S SHEET 2 OF 9


PEAK LET- THRU IN AMPERES





AVAILABLE FAULT CURRENT  
SYMMETRICAL R.M.S. AMPERES


TEST VOLTAGE: 500V	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER: <b>L50S 10A-800A</b>
BASIS FOR DATA:		
		DRAWN BY: LLL
		DATE: 02/10/2015
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: FCC05-L50S SHEET 3 OF 9

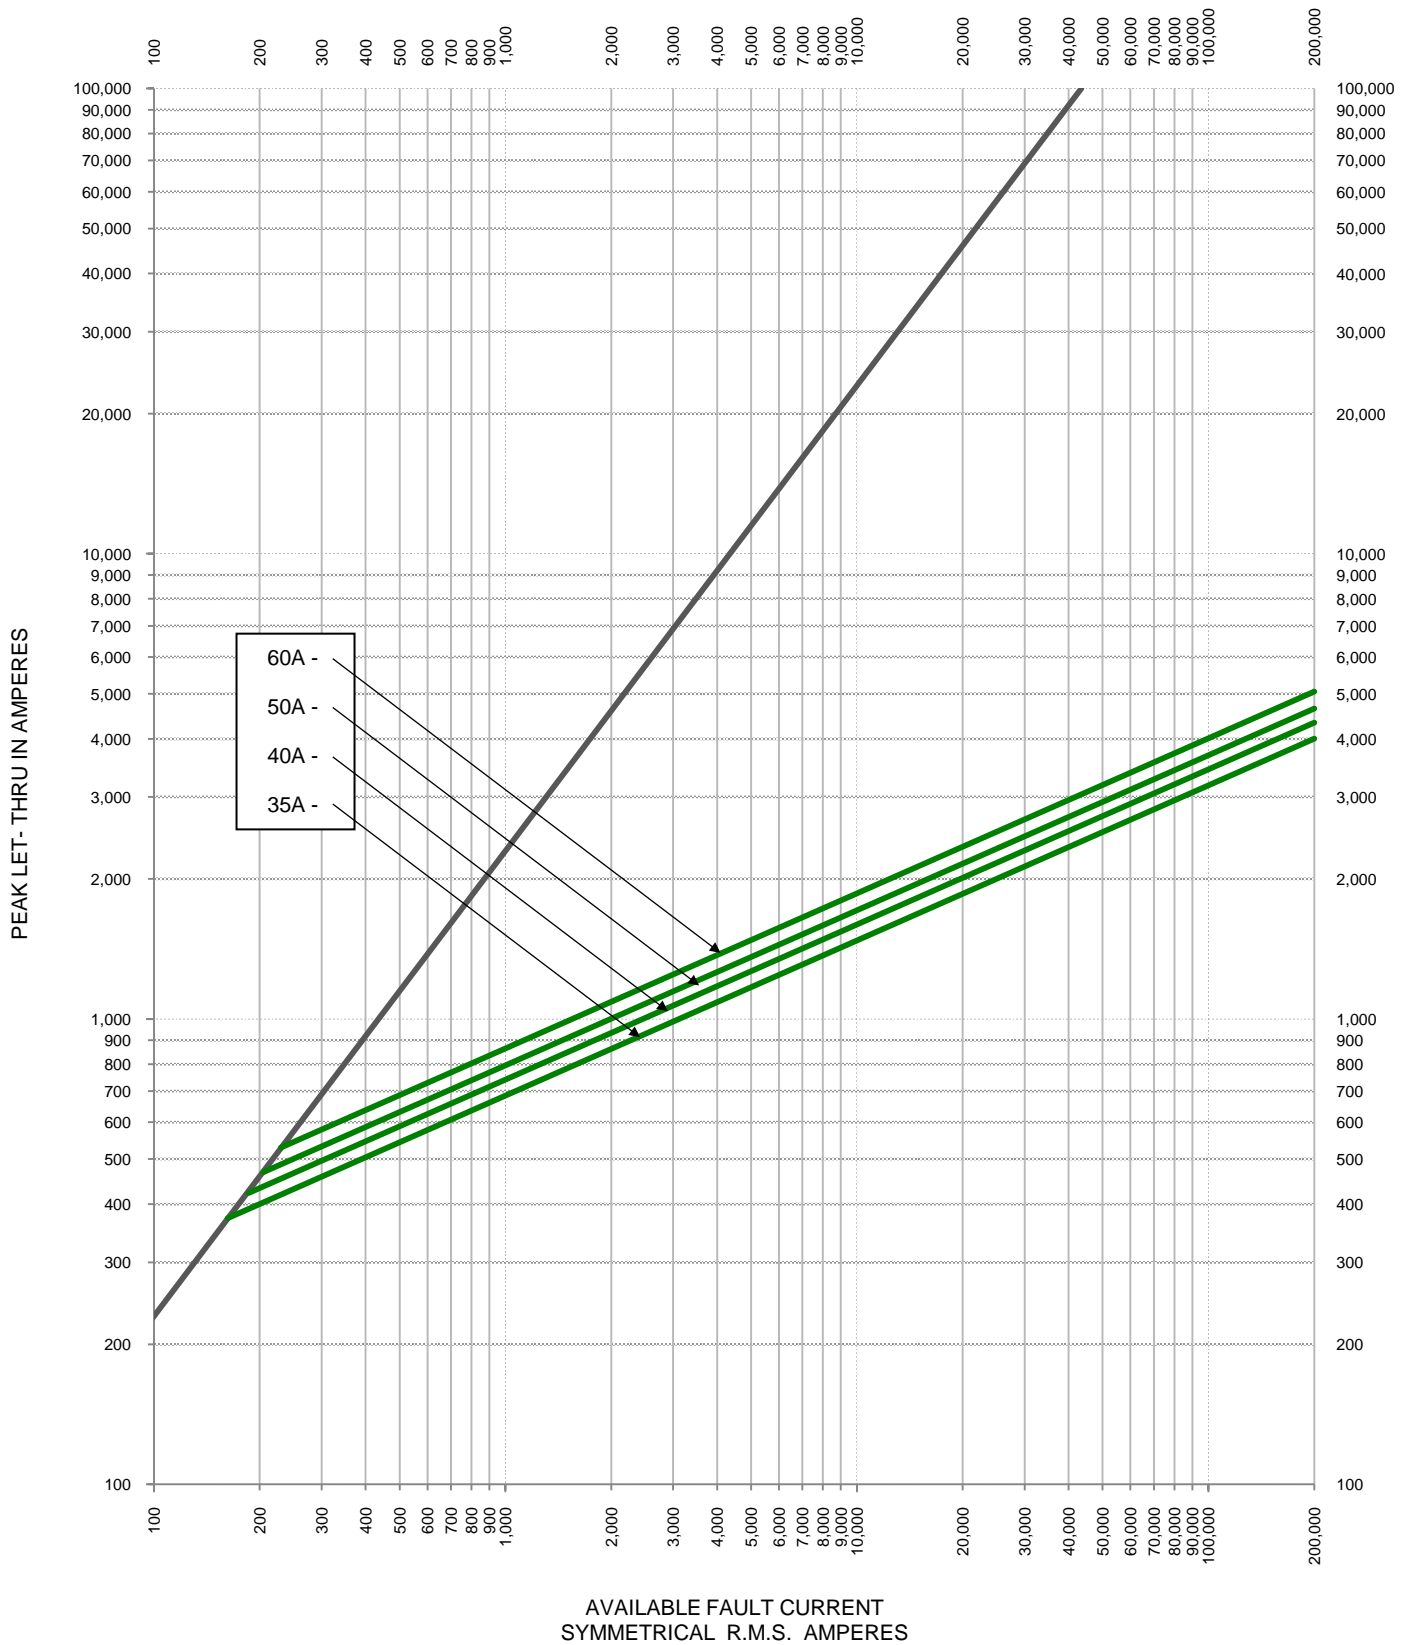


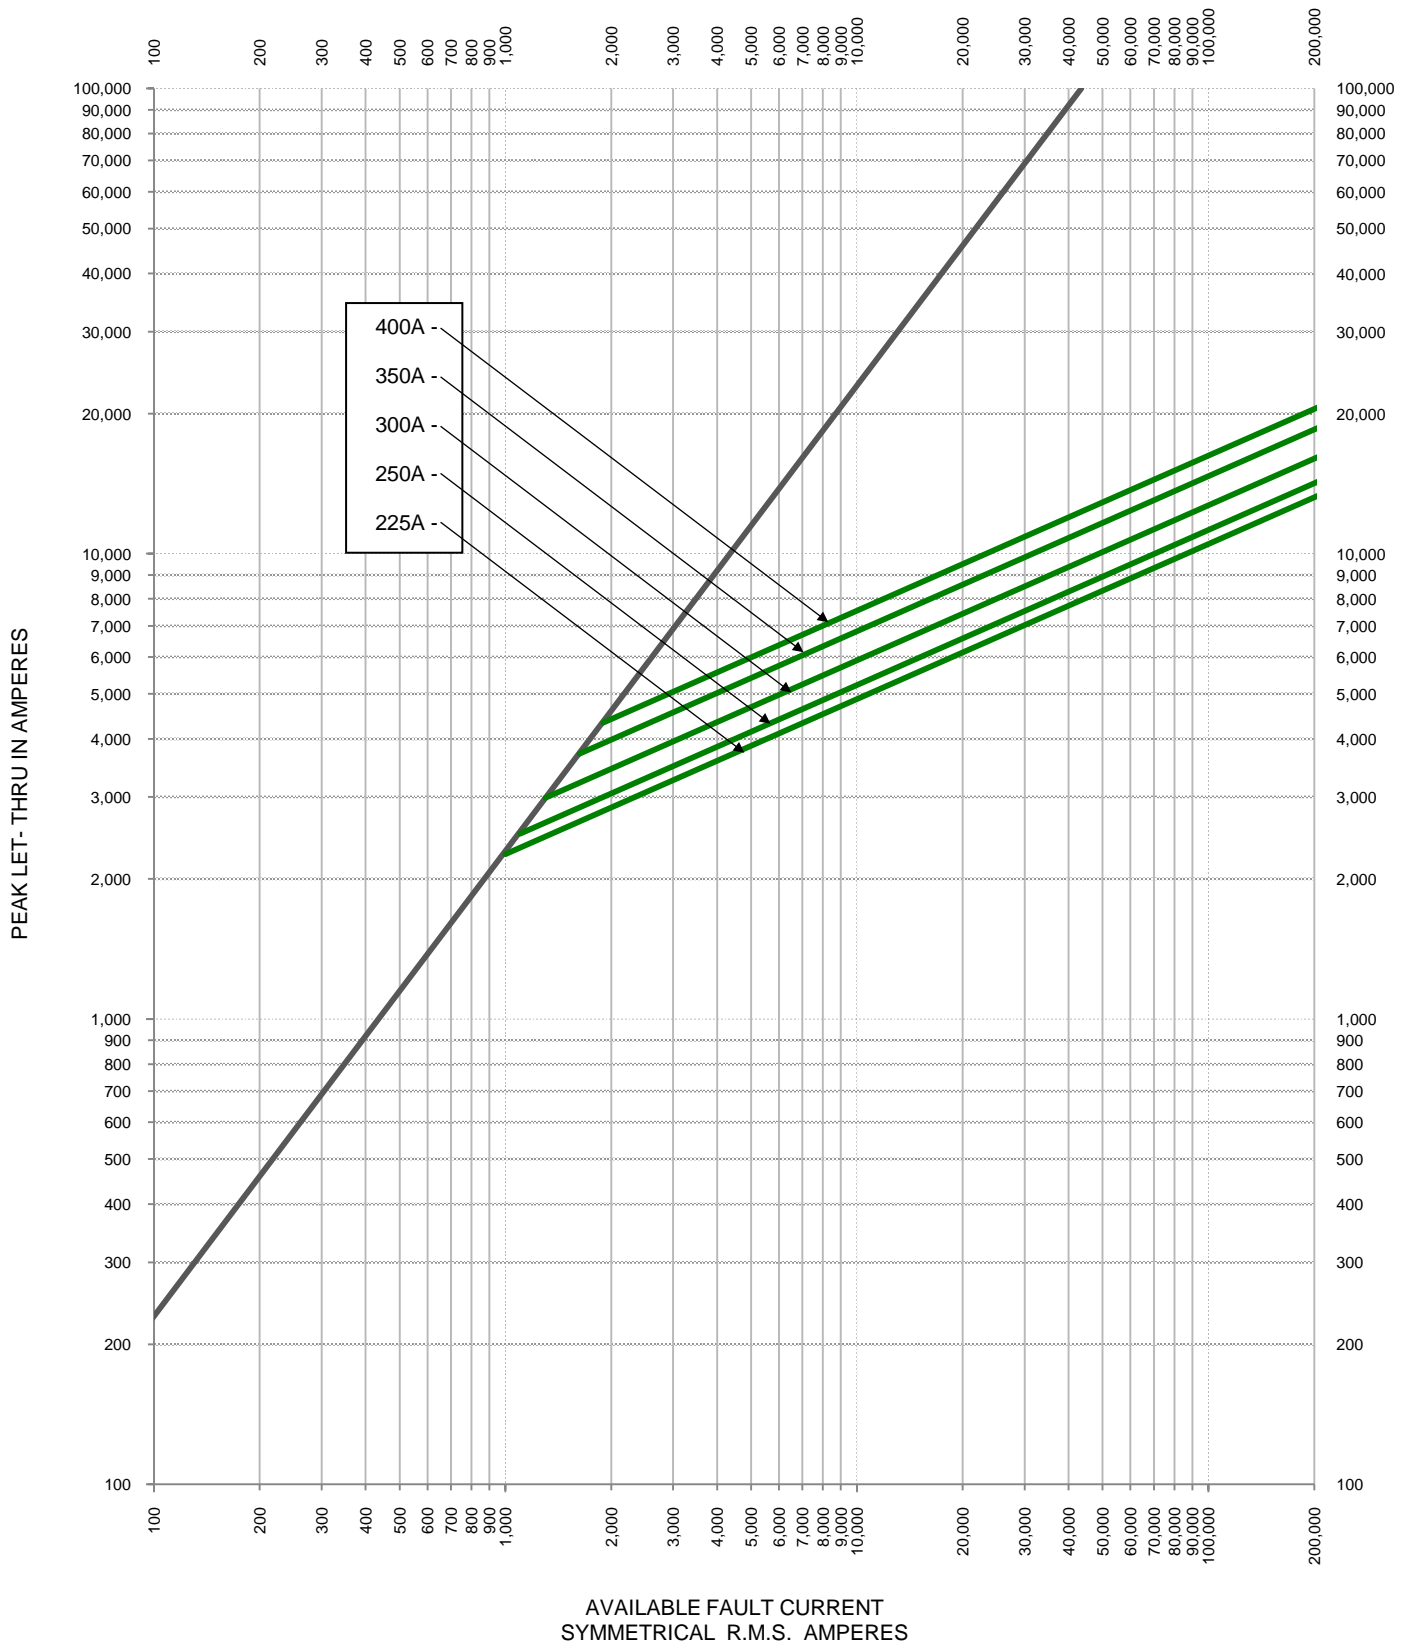
TEST VOLTAGE: 500V	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER: <b>L50S 10A-800A</b>
BASIS FOR DATA:		
		DRAWN BY: LLL
		DATE: 02/10/2015
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: FCC05-L50S SHEET 4 OF 9

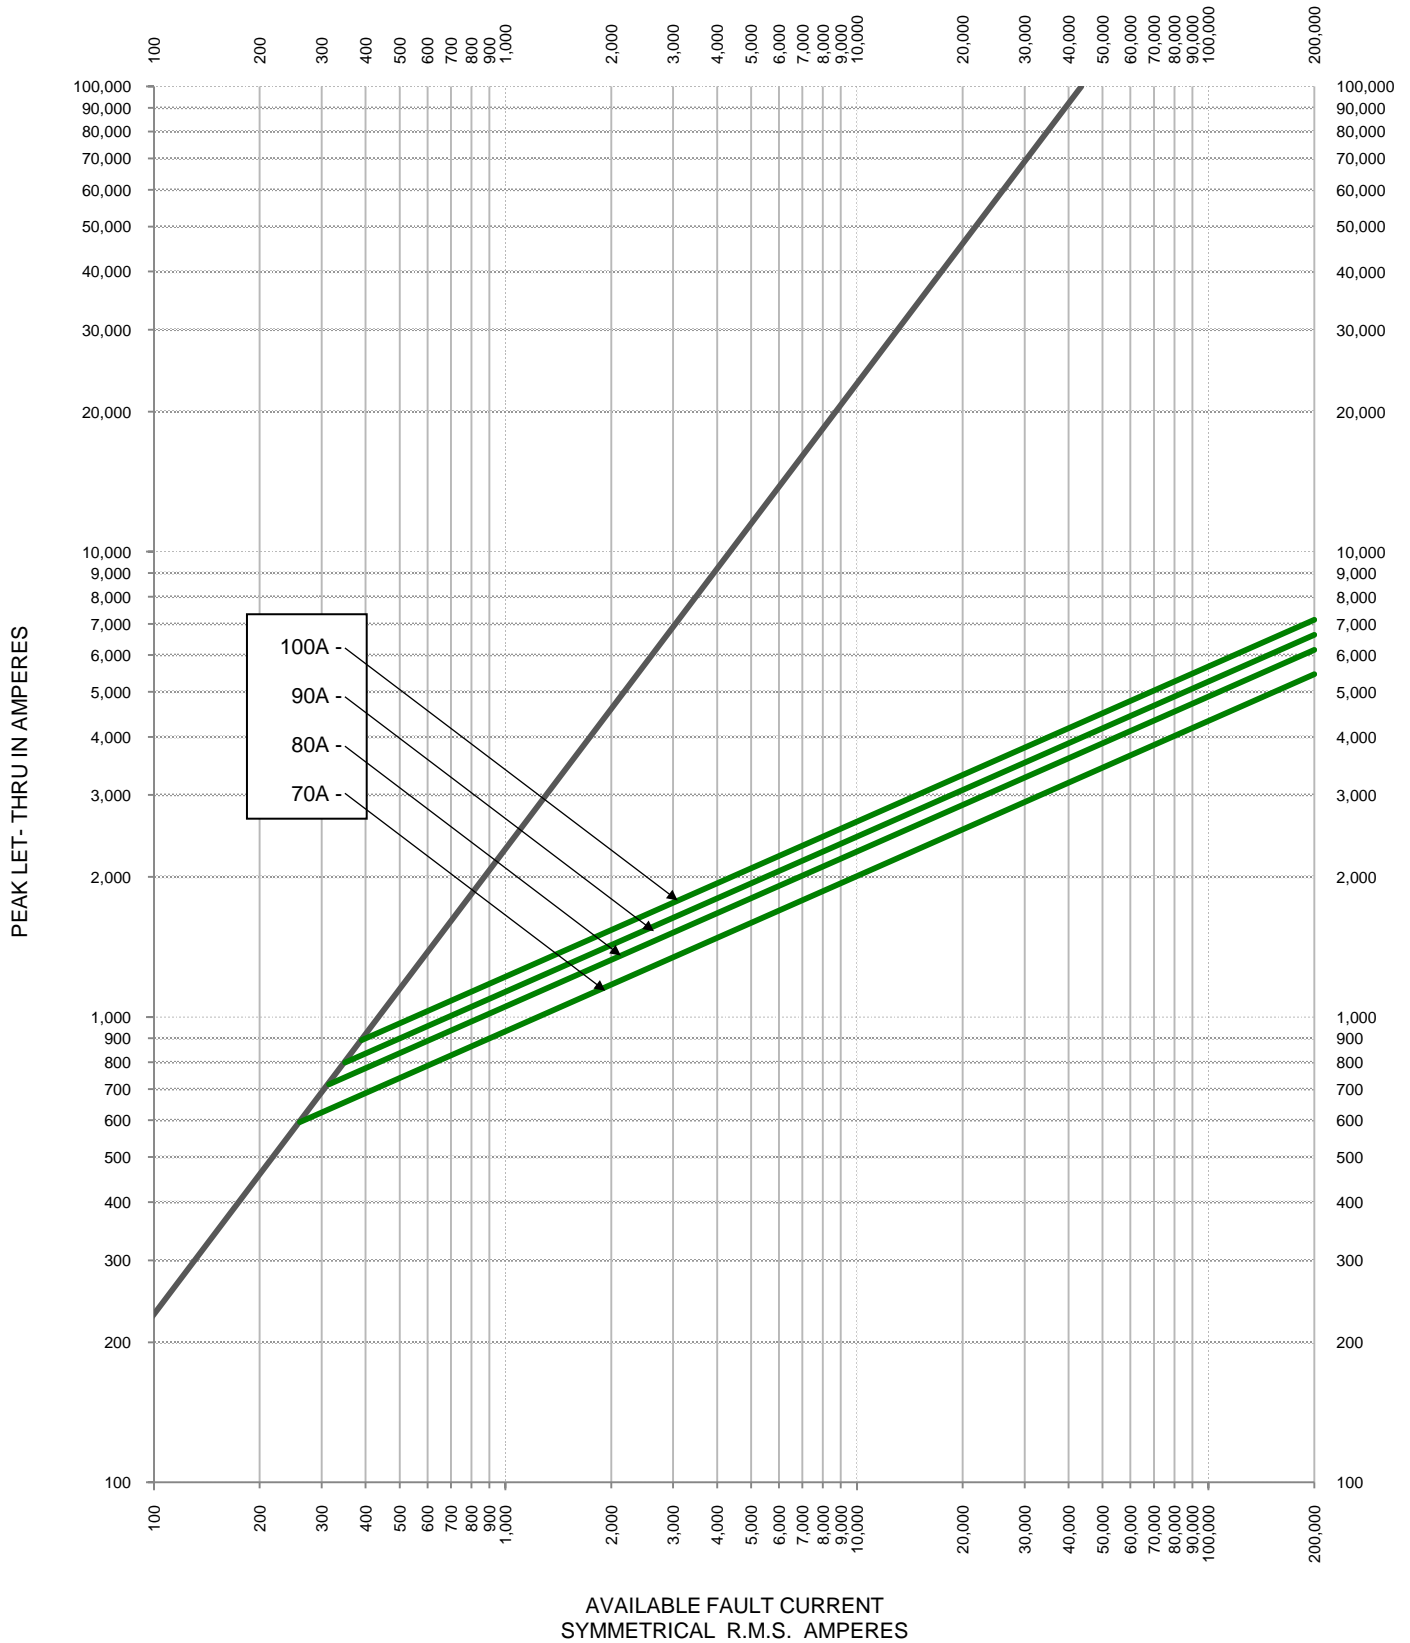


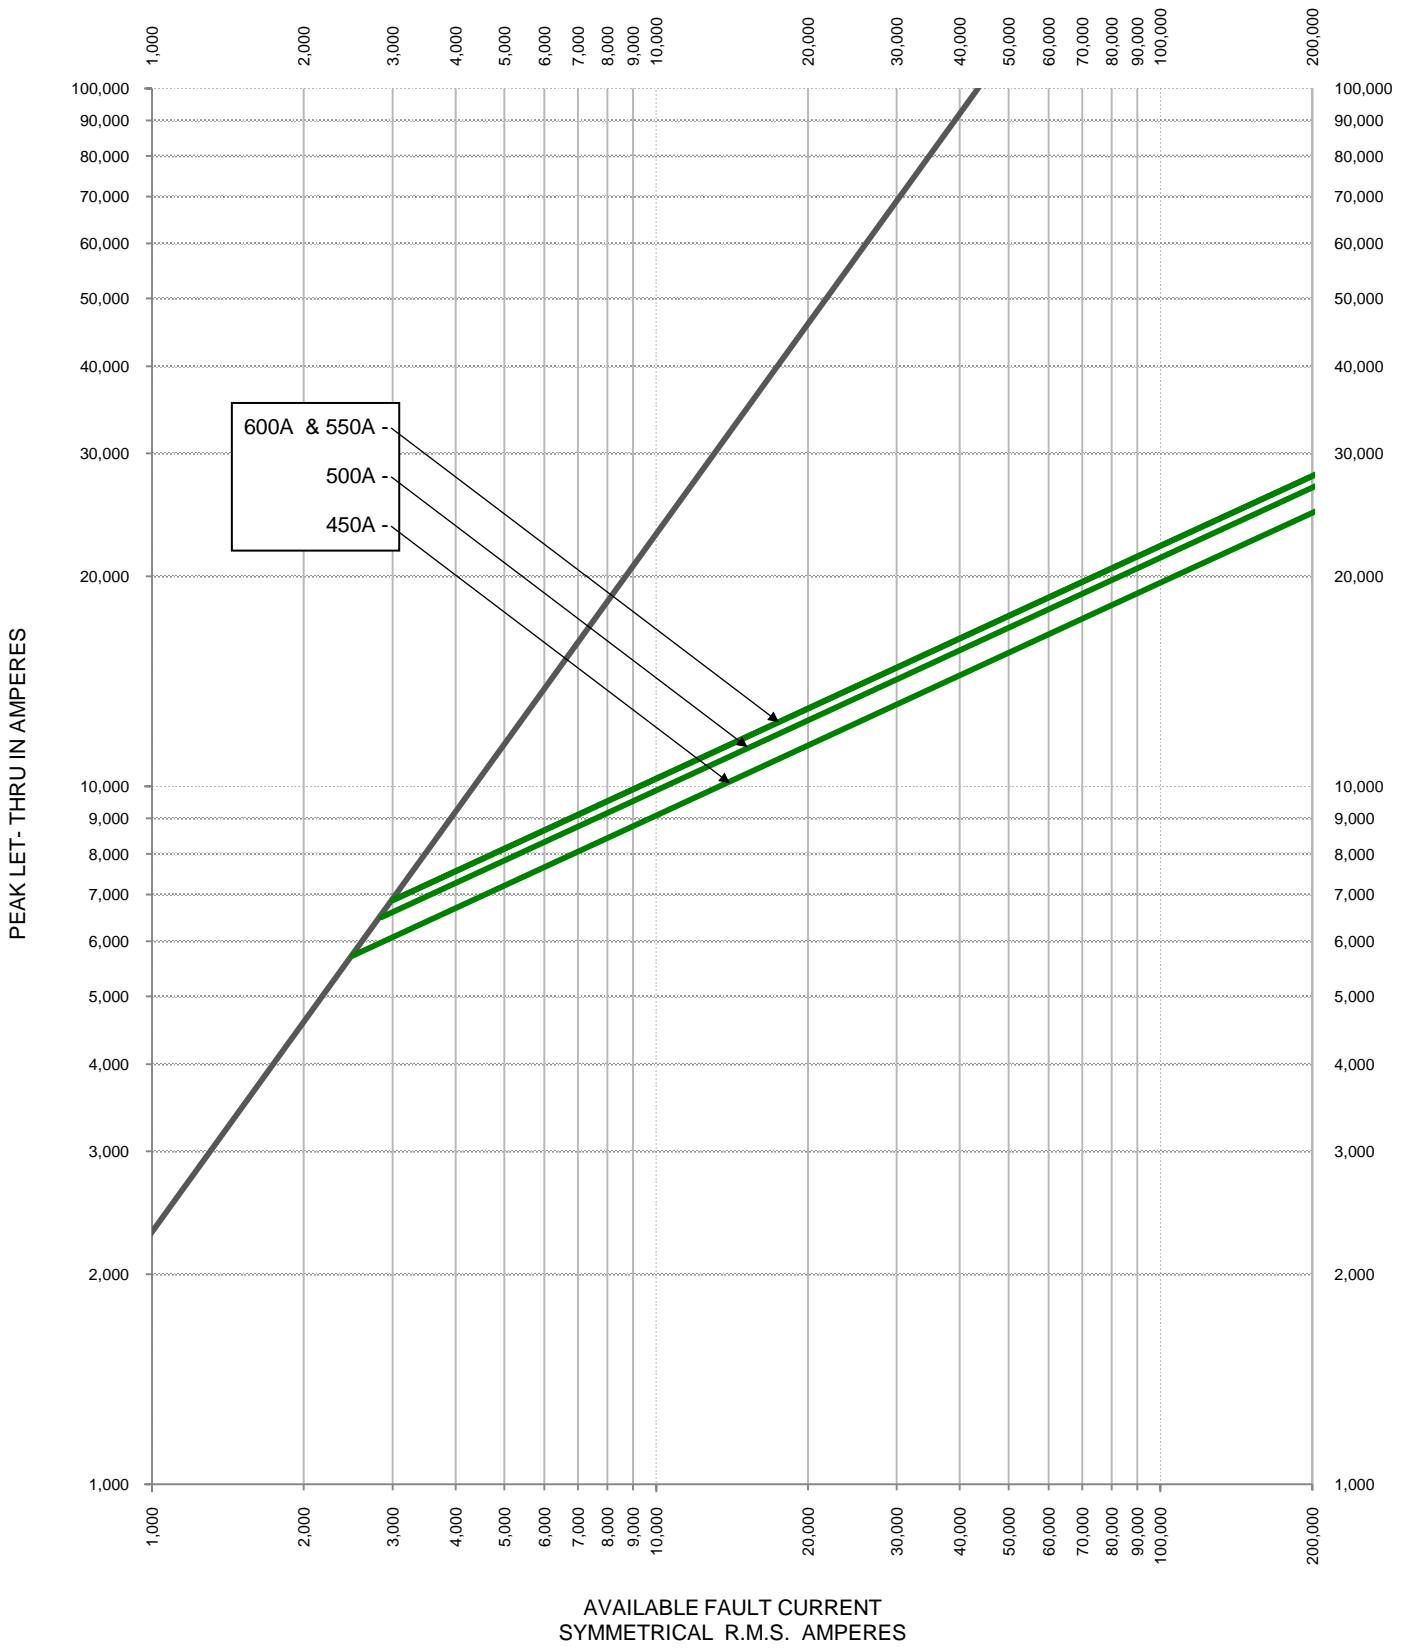
TEST VOLTAGE: 500V	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L50S 10A-800A
		DRAWN BY: LLL
		DATE: 02/10/2015
		REVISION: A
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: FCC05-L50S SHEET 5 OF 9

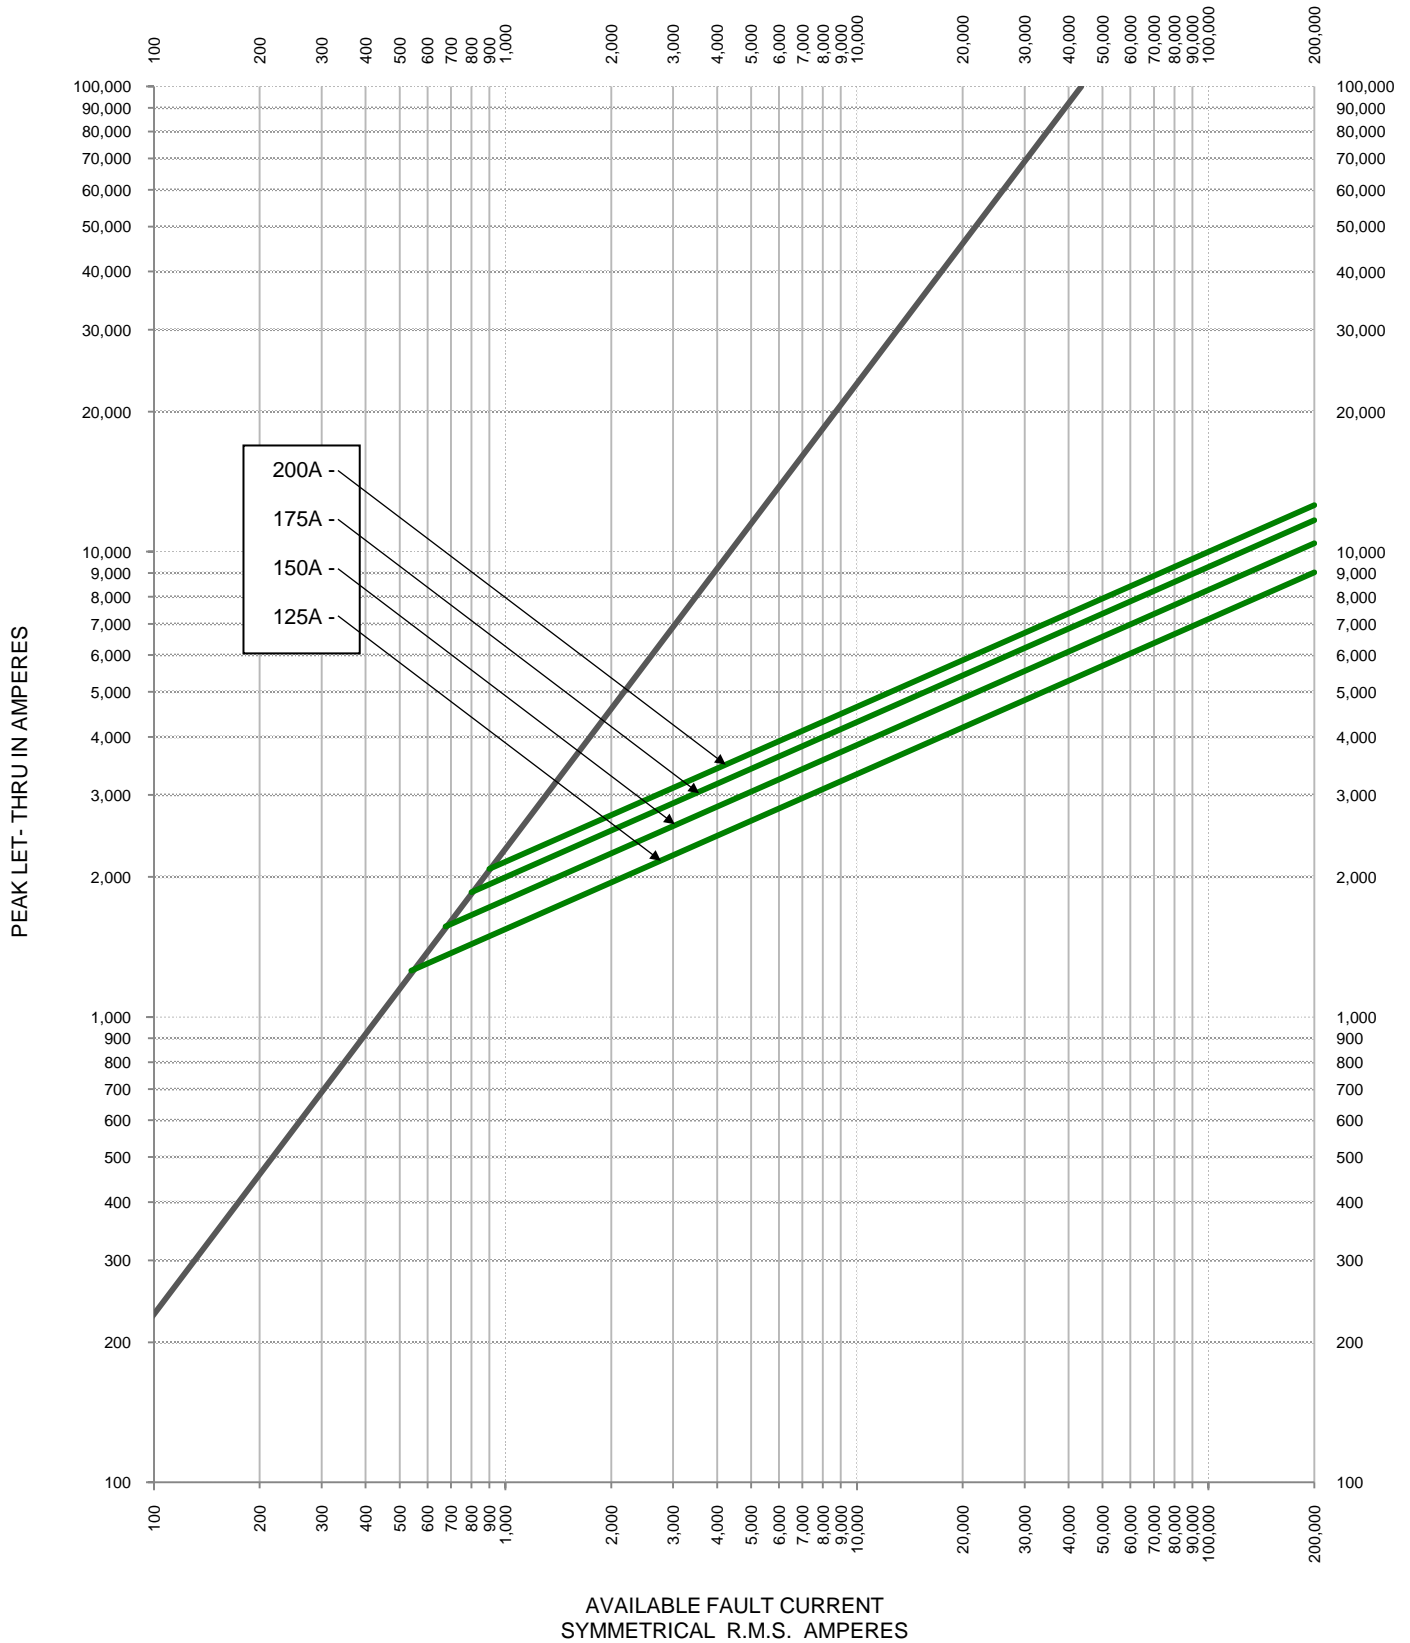


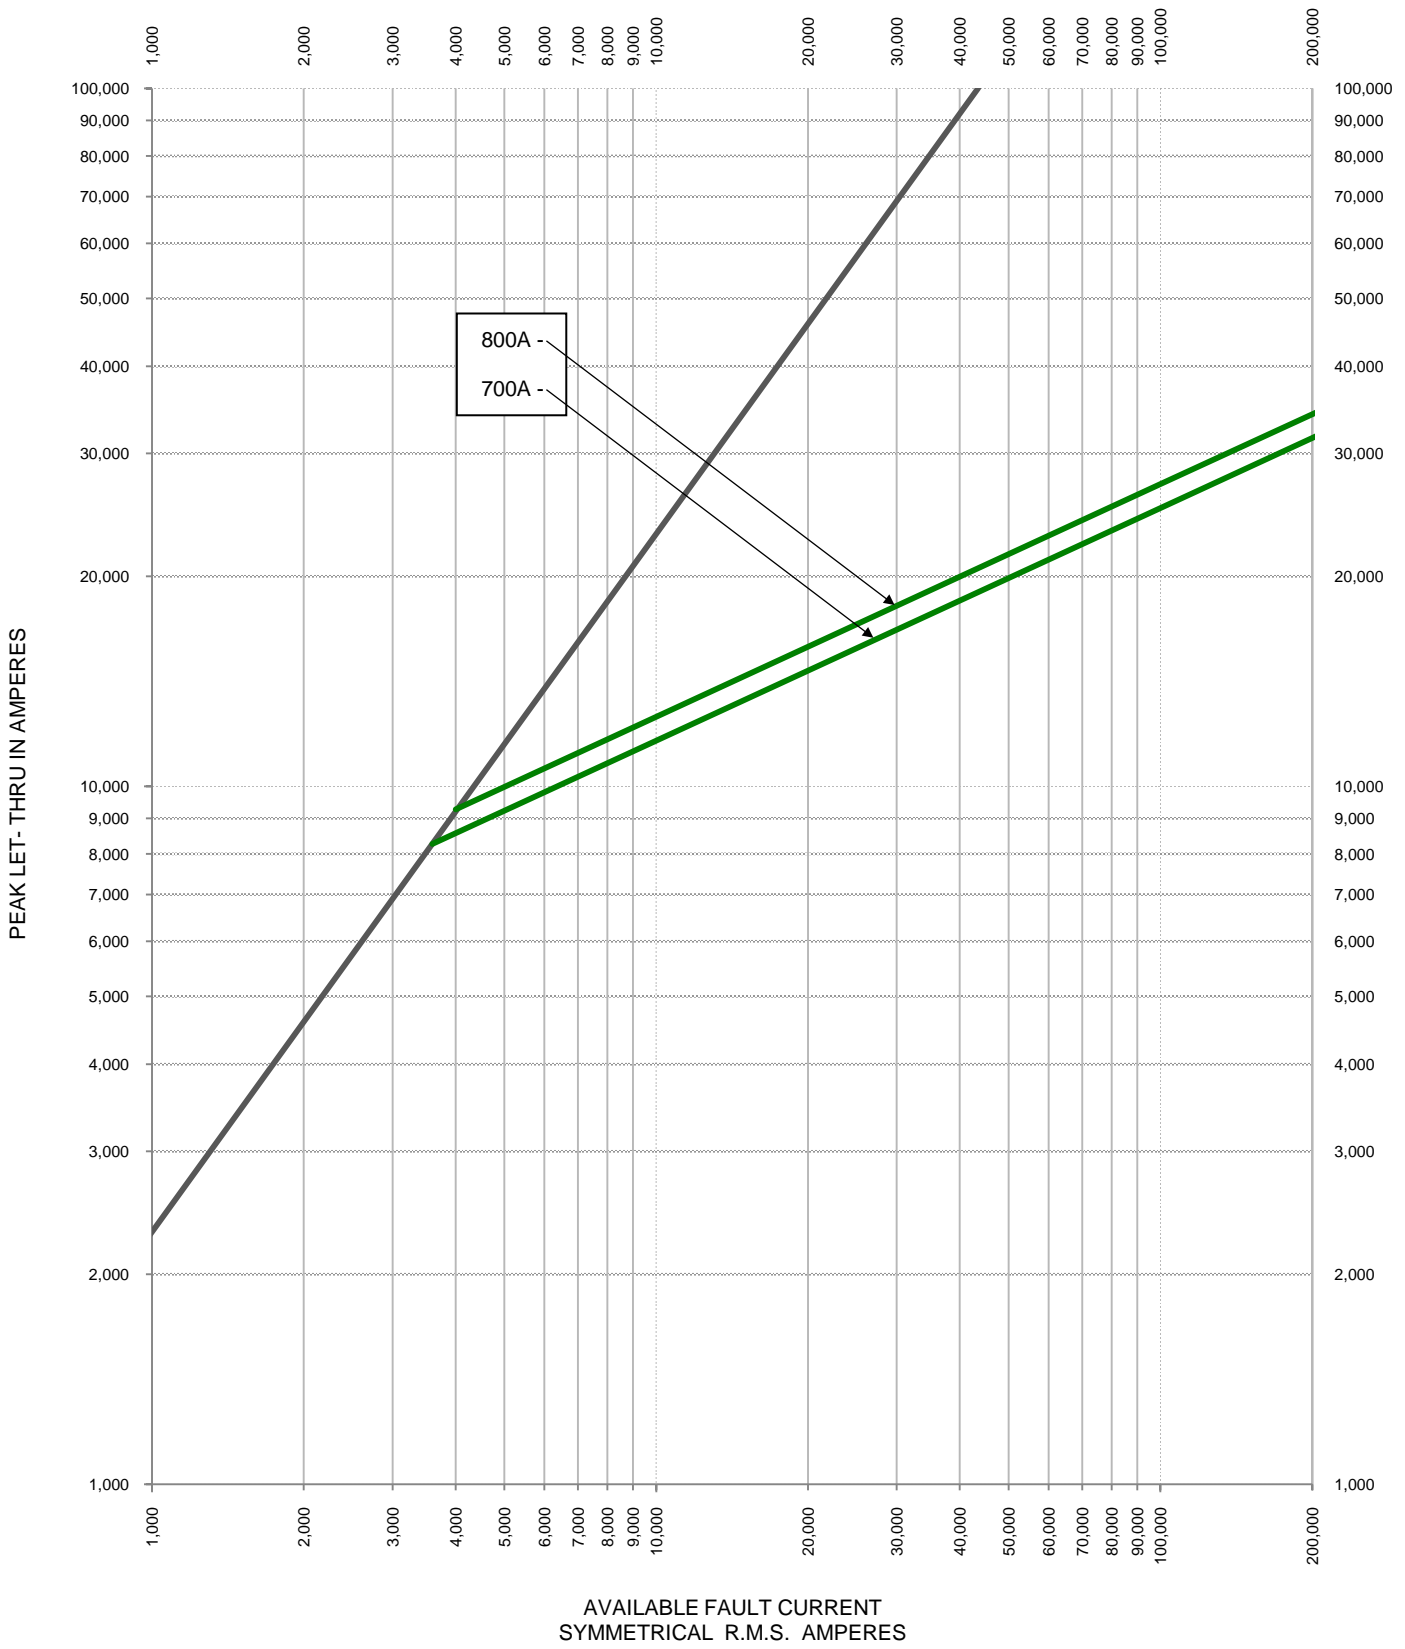
TEST VOLTAGE: 500V	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L50S 10A-800A
		DRAWN BY: LLL
		DATE: 02/10/2015
		REVISION: A
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: SHEET 6 OF 9
		FCC05-L50S




TEST VOLTAGE: 500V	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L50S 10A-800A
		DRAWN BY: LLL
		DATE: 02/10/2015
		REVISION: A
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO.: SHEET 7 OF 9
		FCC05-L50S



TEST VOLTAGE: 500V	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		L50S 10A-800A
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL DATE: 02/10/2015 REVISION: A
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		DRAWING NO.: FCC05-L50S SHEET 8 OF 9



TEST VOLTAGE: 500V	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER: <b>L50S 10A-800A</b>
BASIS FOR DATA:		
 <b>LITTELFUSE, INC.</b> CHICAGO, IL. USA		DRAWN BY: LLL
		DATE: 02/10/2015
<b>PEAK LET-THRU CHARACTERISTIC CURVES</b>		REVISION: A
		DRAWING NO.: FCC05-L50S SHEET 9 OF 9