


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

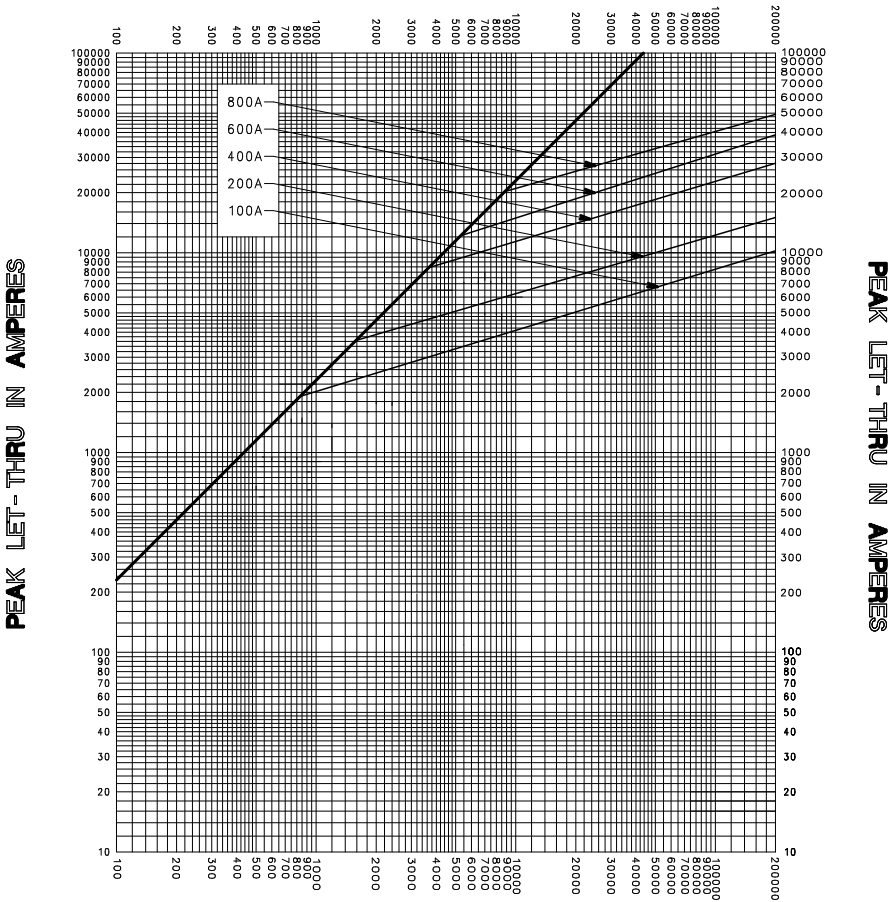

**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE <u>600V</u> TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	<u>L60S (100A - 800A)</u>

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>05/17/06</u>
	CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES	DRAWING NO. <u>A-FCC05</u>

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**