


CURRENT IN AMPERES

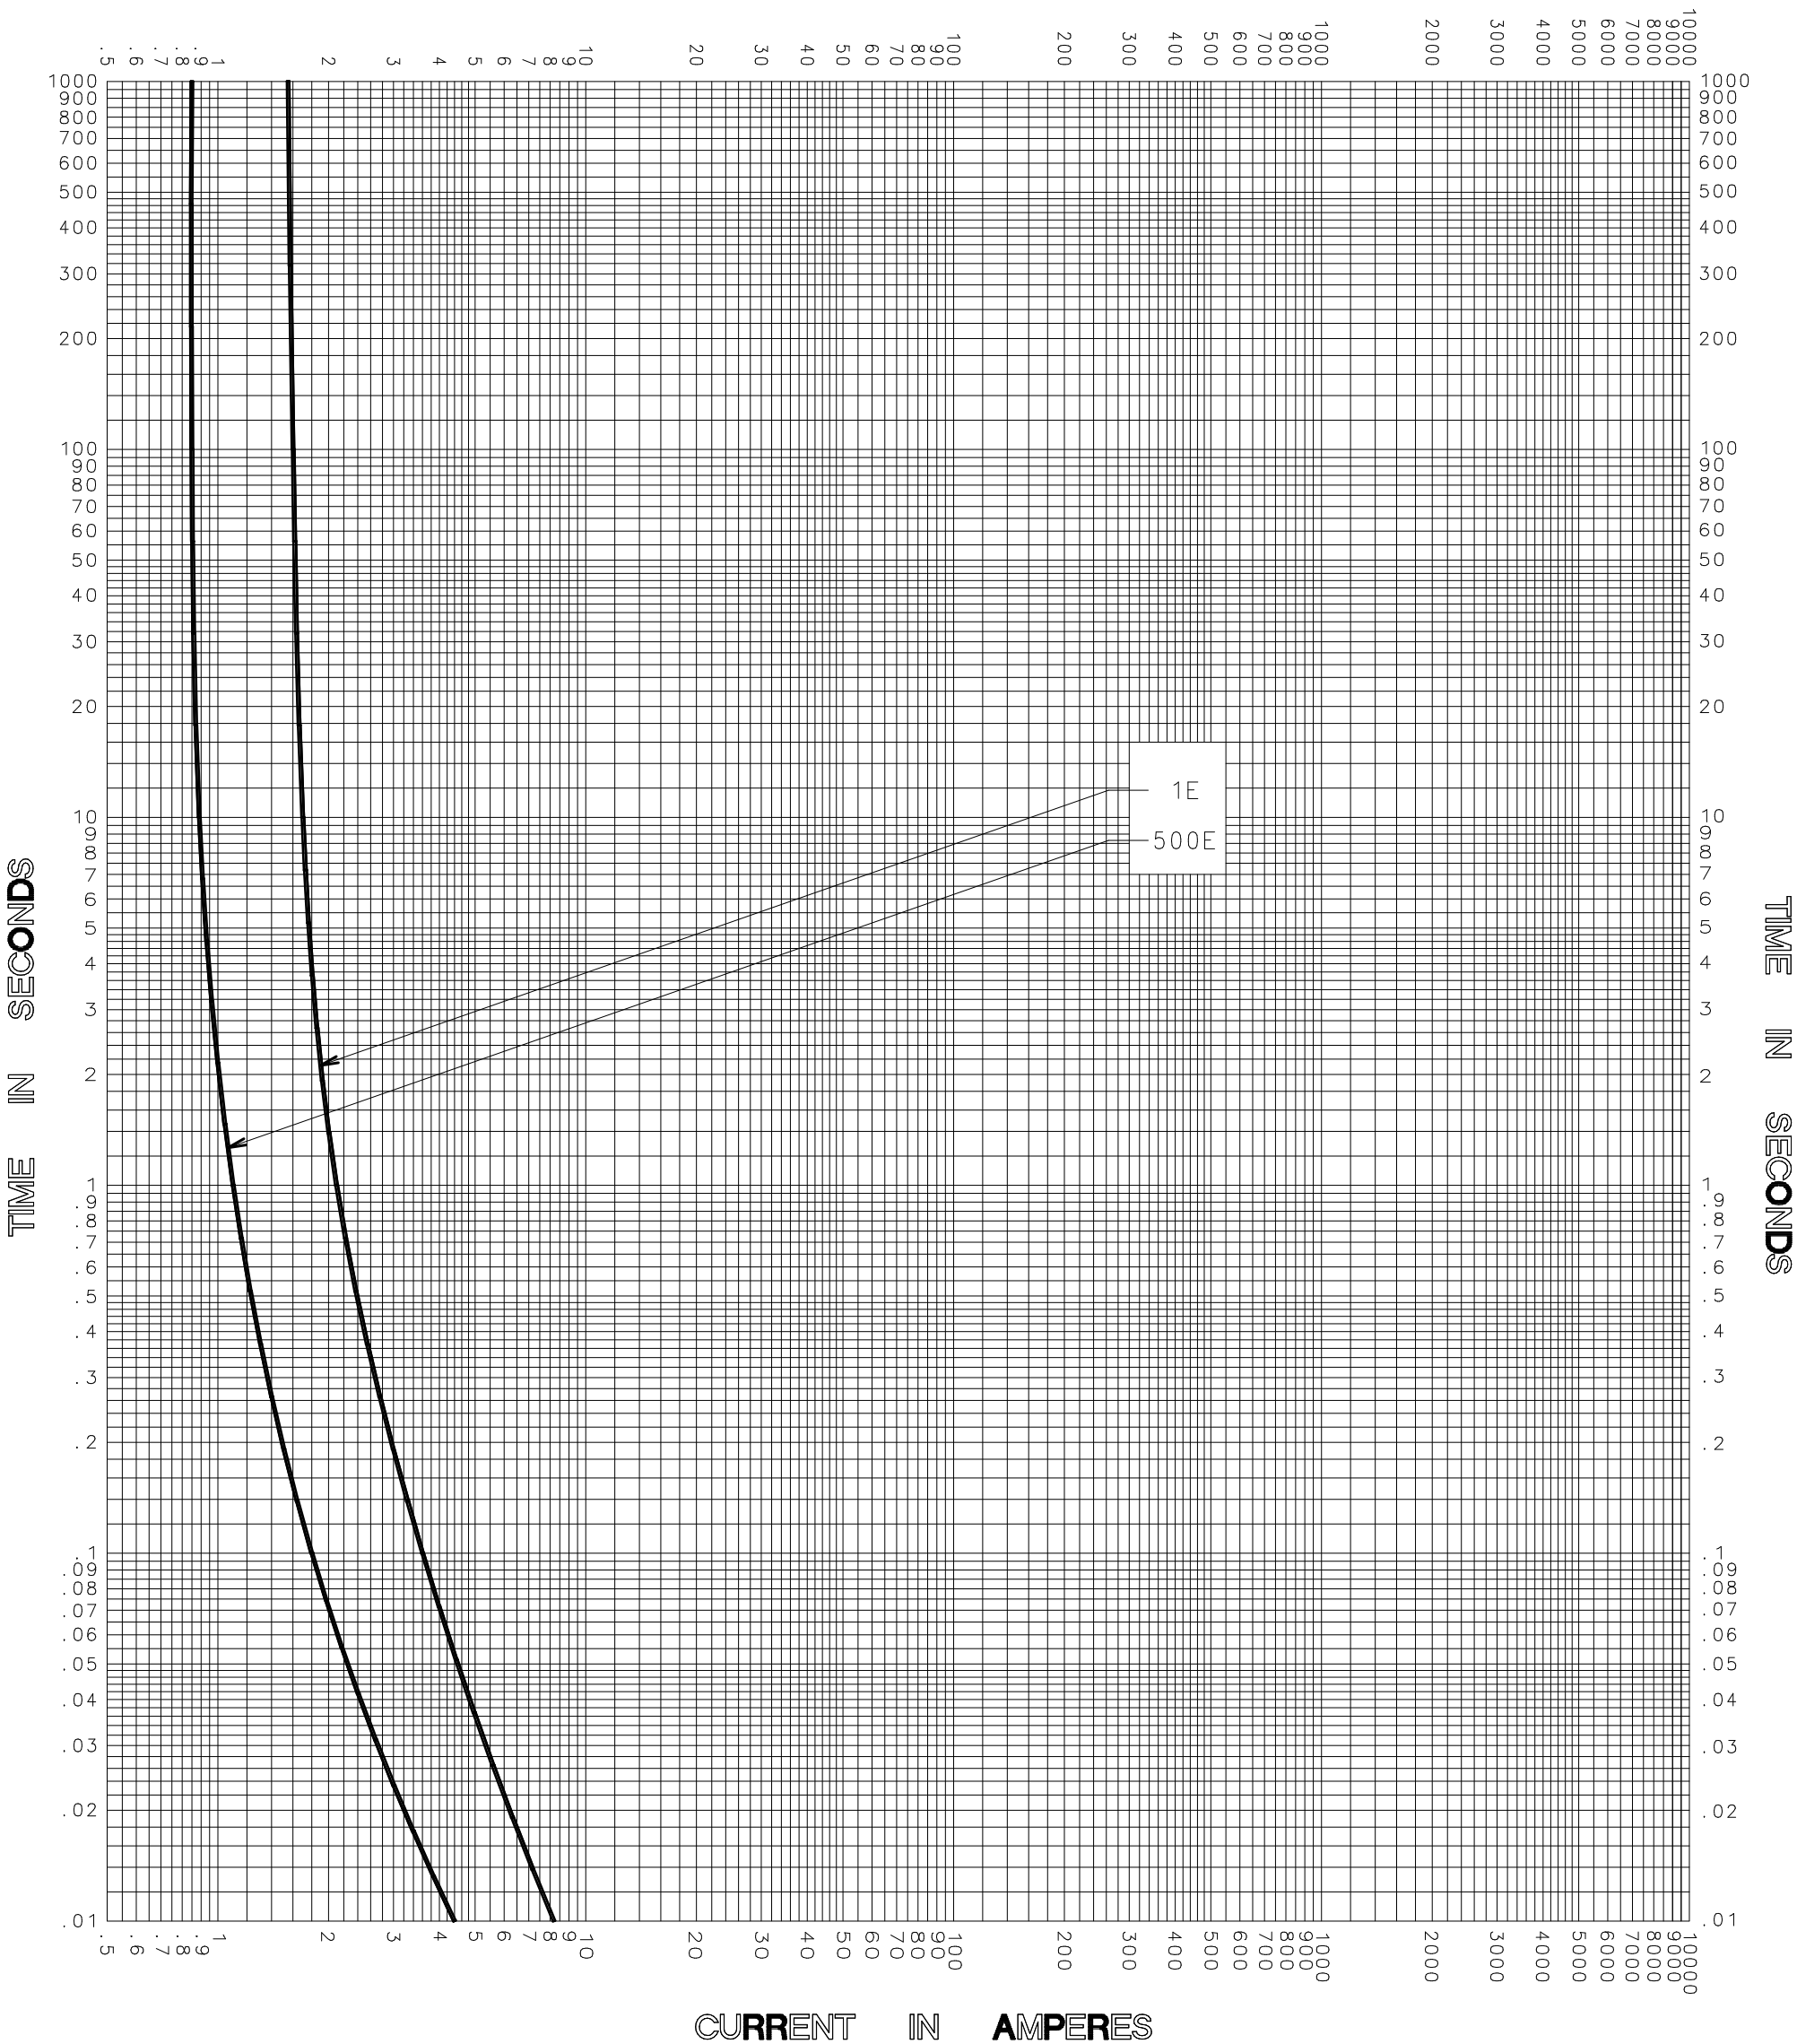

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	500E-16PT-25.5 thru 1E-16PT-25.5

 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 10/17/05
	CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A FCC01-01.5P-001
------------------------------------	-------------------------------

-THIS DATA GENERATED ON CAD-

**UNCONTROLLED DOCUMENT**