


CURRENT IN AMPERES

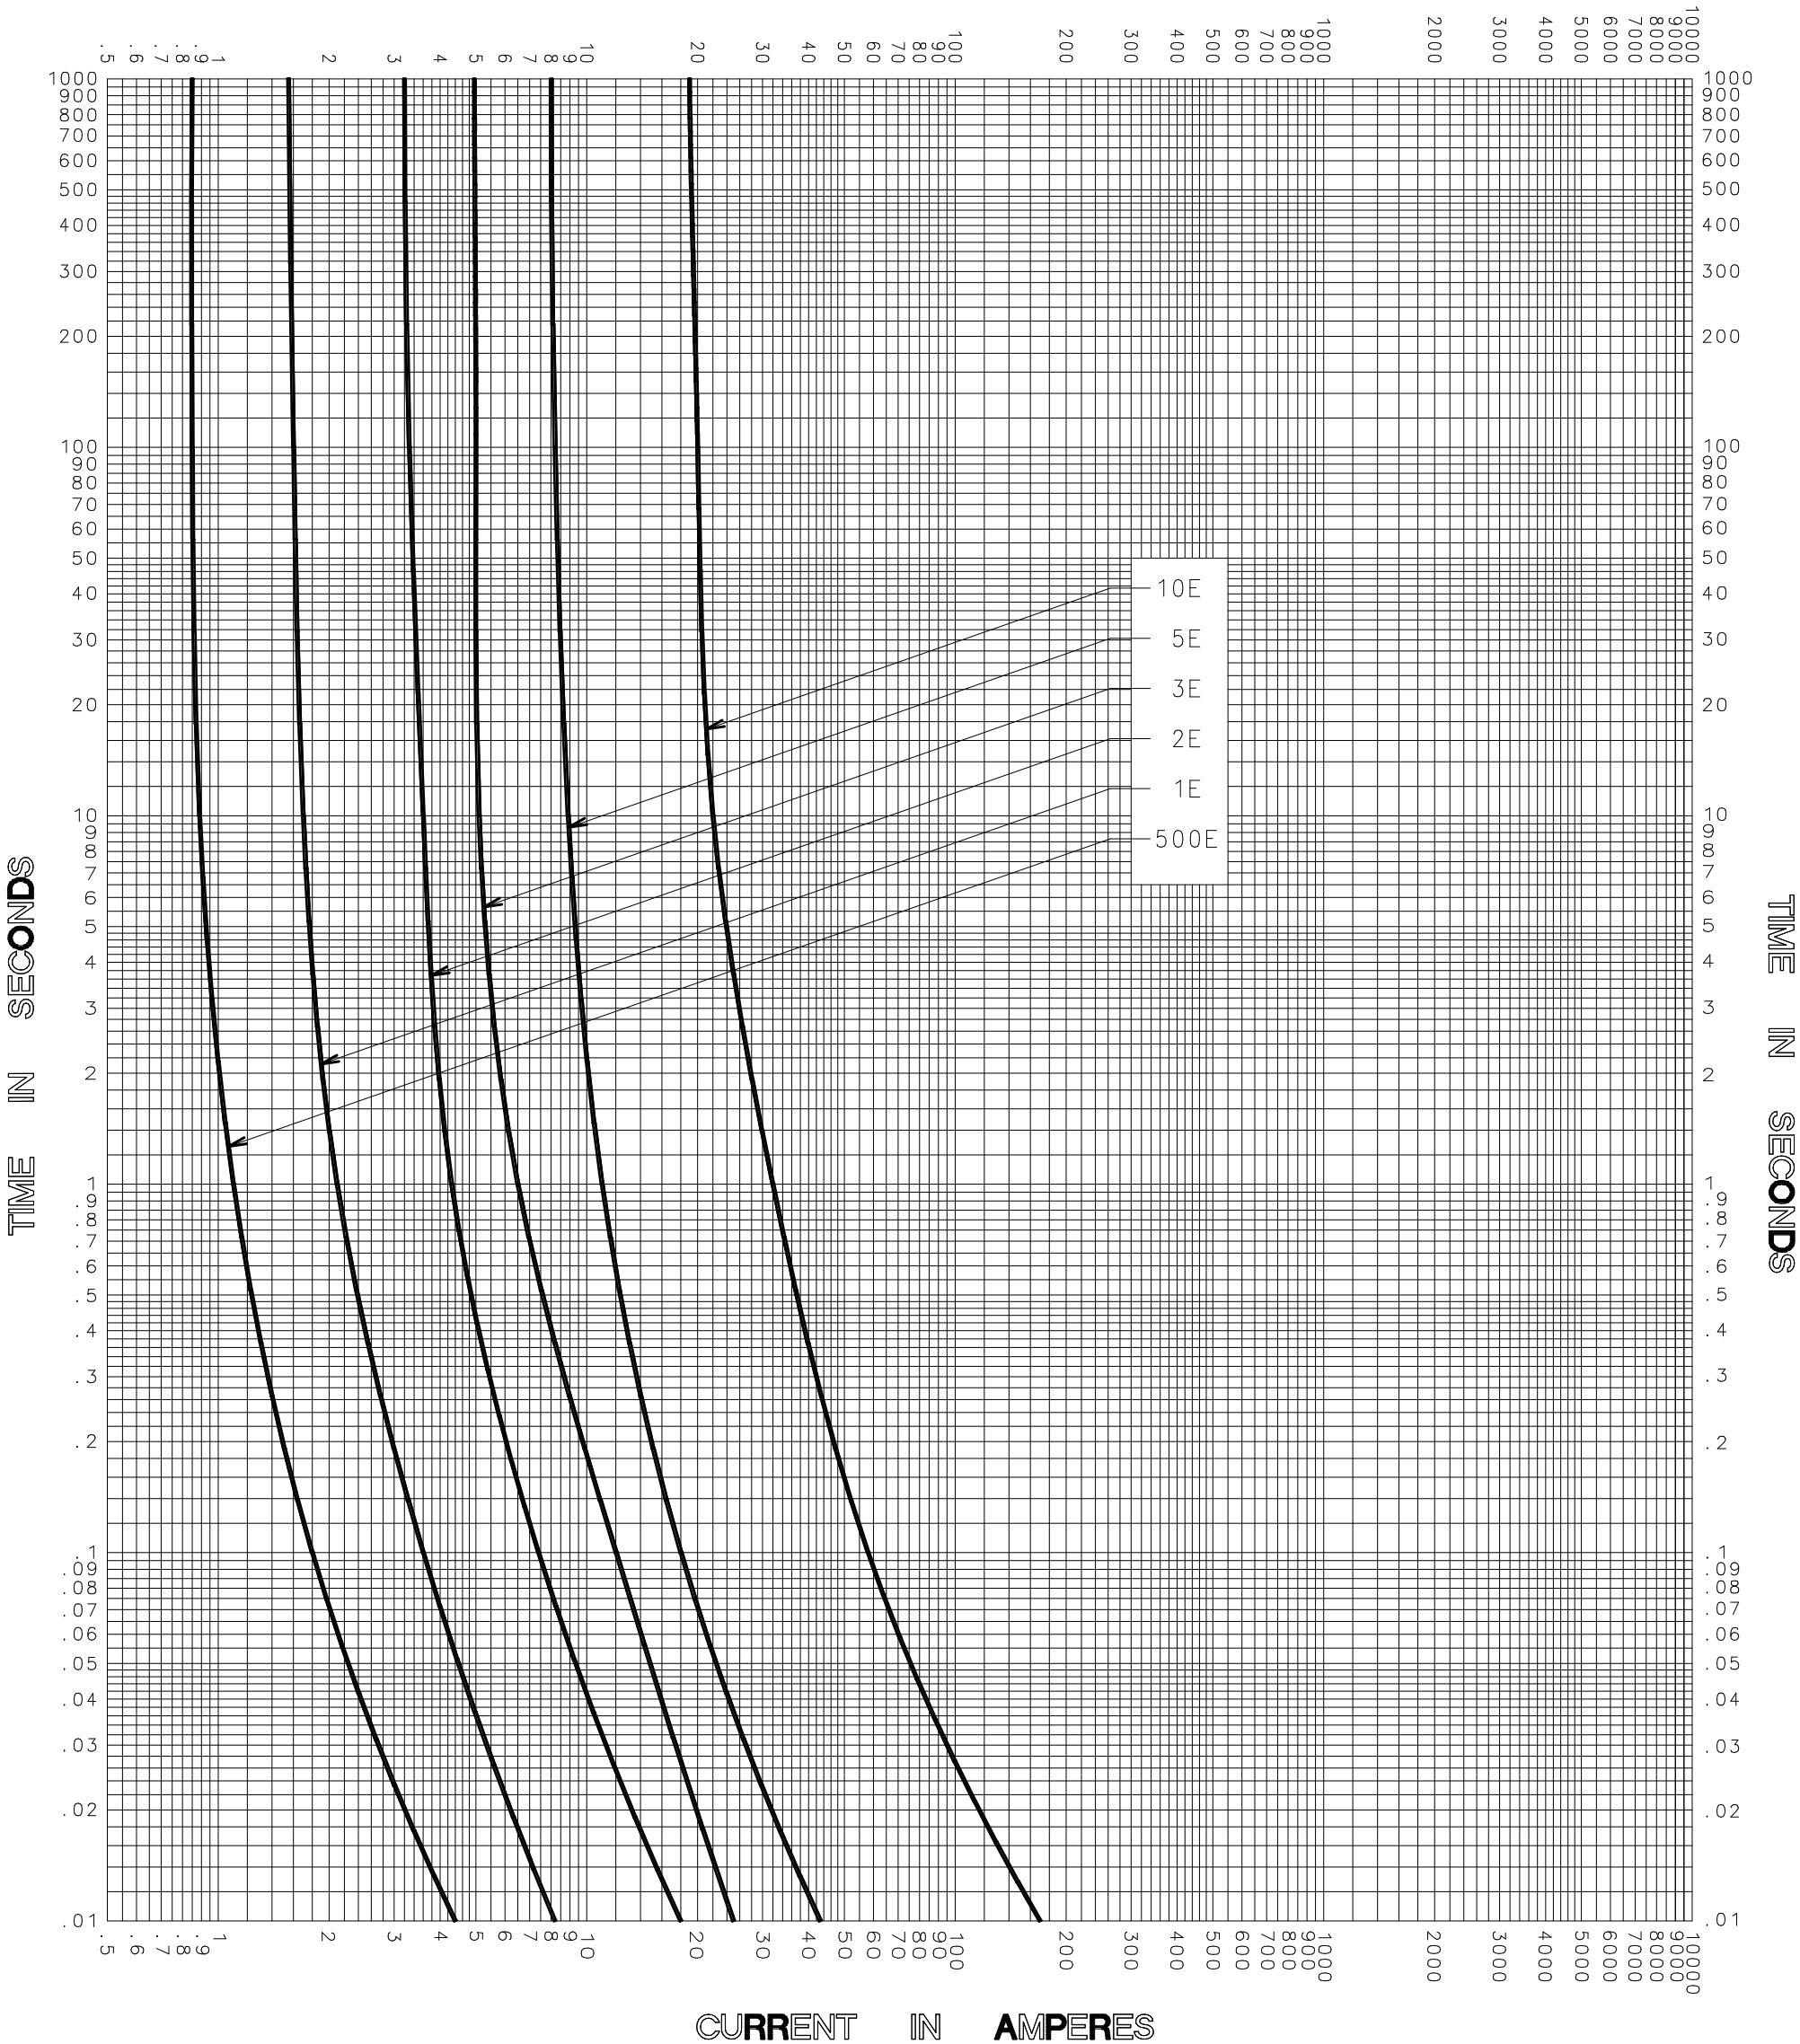

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	500E-6PT-5.5 thru 5E-6PT-5.5
	500E-8PT-5.5 thru 10E-8PT-5.5

 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u>
	DATE <u>10/17/05</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>A FCC01</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT