

## SE-330 NEUTRAL-GROUNDING-RESISTOR MONITOR SETTINGS

SE-330 Model Number: SE-330 - \_\_\_\_ - \_\_\_\_

SE-330 Serial Number: \_\_\_\_\_ Revision: \_\_\_\_\_

Substation Identification: \_\_\_\_\_

Transformer Specifications: \_\_\_\_\_

### SE-330 Communications

CHECK ONE	
	Local USB
	Other: _____

### Current Transformer

CHECK ONE	
	EFCT (5-A primary rating when connected to sensitive input)
	SE-CS30 (30-A primary rating when connected to sensitive input)
	Other: _____

### Current Transformer Connection

CHECK ONE	
	Sensitive Input (Terminals 8, 11)
	1-A Input (Terminals 9, 11)
	5-A Input (Terminals 10, 11)

### Sensing Resistor

CHECK ONE	
	ER-600VC <input type="checkbox"/> SE-MRE-600
	ER-5KV
	ER-5WP
	ER-15KV
	ER-25KV
	ER-35KV

### Remote Indication

CHECK ONE	
	None
	RK-232
	Other: _____

### NGR Ratings

Current: \_\_\_\_\_ A  
 Voltage: \_\_\_\_\_ V  
 Time: \_\_\_\_\_  
 Resistance \_\_\_\_\_ Ω  
 Serial No.: \_\_\_\_\_  
 Mfg.: \_\_\_\_\_

### GF Trip Level

Setting: \_\_\_\_\_ % \_\_\_\_\_ A  
 MEM Selected

### GF Trip Time

Setting: \_\_\_\_\_ s


### V<sub>N</sub> Trip Level

Setting: \_\_\_\_\_ V  
 X 5 for 100 kΩ Sensing Resistor:

## SE-330 NEUTRAL-GROUNDING-RESISTOR SETTINGS

 CALIBRATION PUSH BUTTON

### CAL

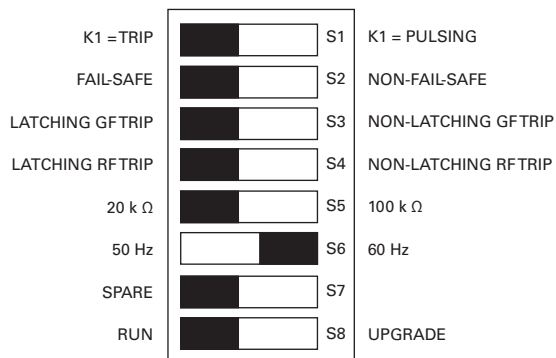

NOTE: DEFAULT SETTINGS SHOWN

### CONFIGURATION SWITCH SETTINGS

		CHECK ONE		CHECK ONE
S1:	K1 = Trip		K1 = Pulsing	
S2:	K1 = Fail-Safe		K1 = Non-Fail-Safe	
S3:	Latching GF Trip		Non-Latching GF Trip	
S4:	Latching RF Trip		Non-Latching RF Trip	
S5:	20 k Ω		100 k Ω	
S6:	50 Hz		60 Hz	
S7:	Not Used			
S8:	Run		Upgrade	

### System Calibration

Calibration Successful: \_\_\_\_\_

Date (YYYY-MM-DD): \_\_\_\_\_

Calibration Number (if available): \_\_\_\_\_

### SOFTWARE SETTINGS

		CHECK ONE		CHECK ONE
K2:	Fail Safe		Non-Fail Safe	
K3:	Fail Safe		Non-Fail Safe	