


CURRENT IN AMPERES

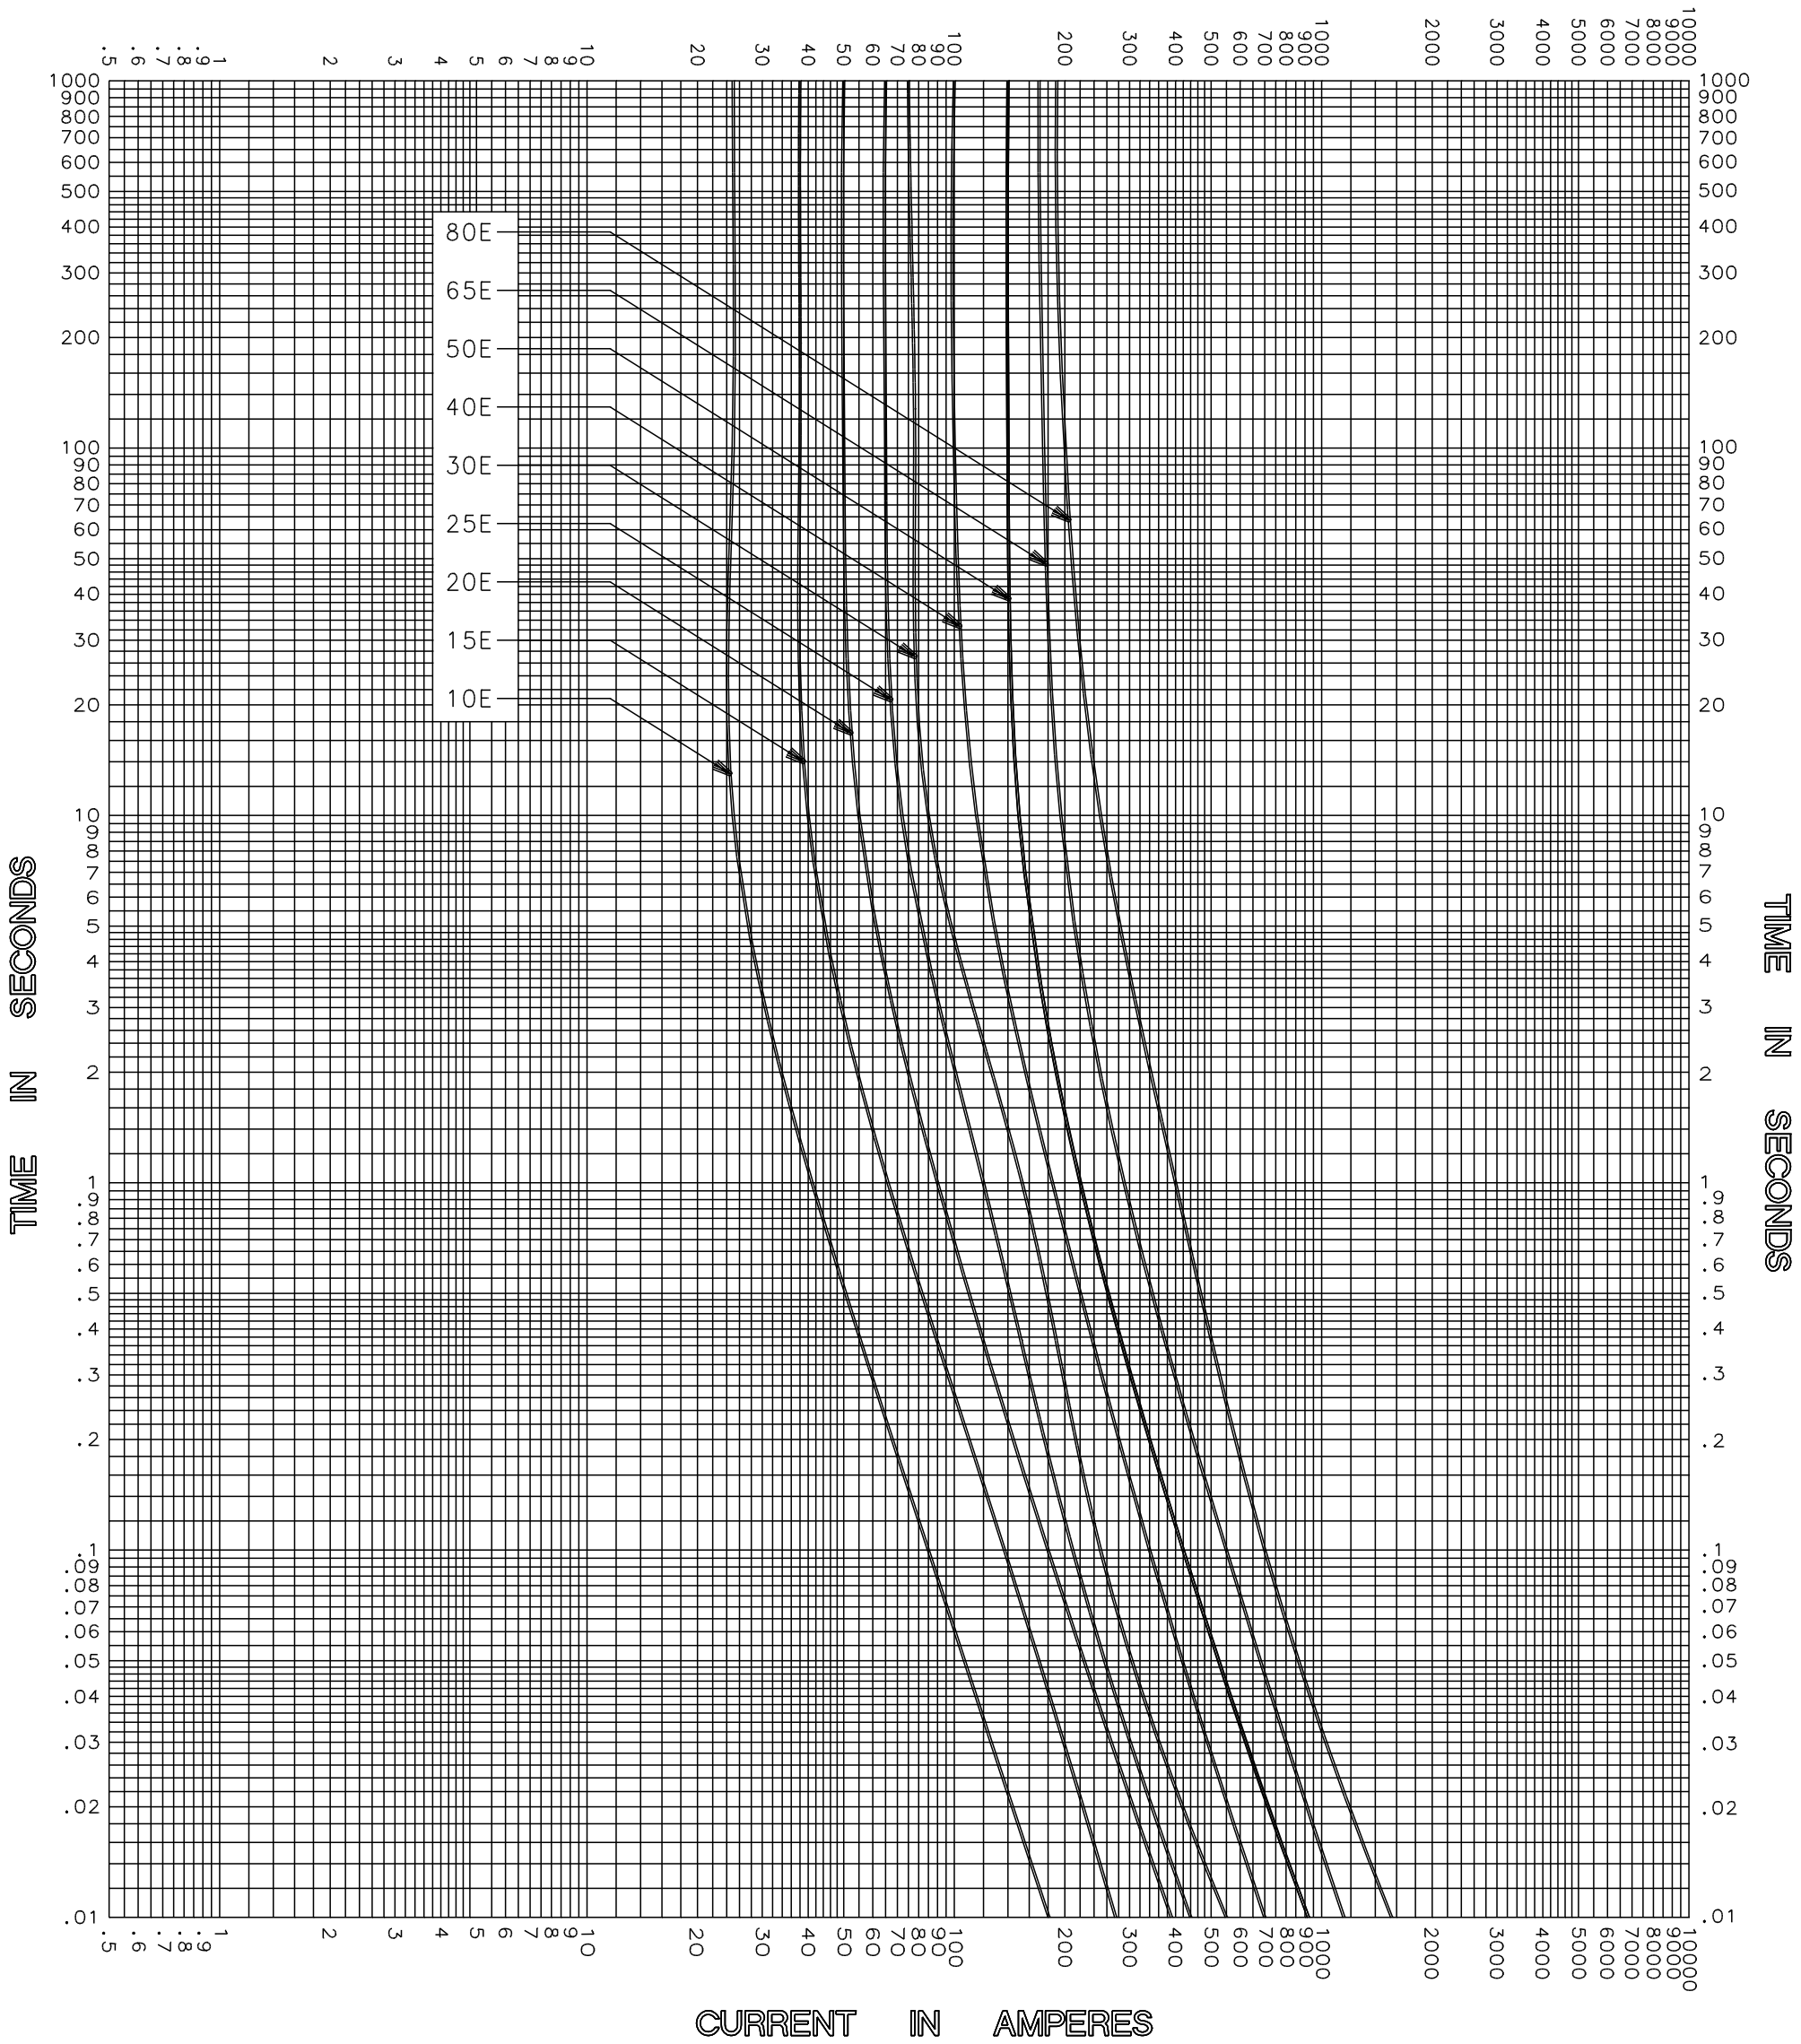

CLEARING TIME CHARACTERISTICS

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 15.5kV E-RATED 10E-80E
BASIS FOR DATA _____		

 DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u>
	DATE <u>05/17/04</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>A-FCC04</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT