


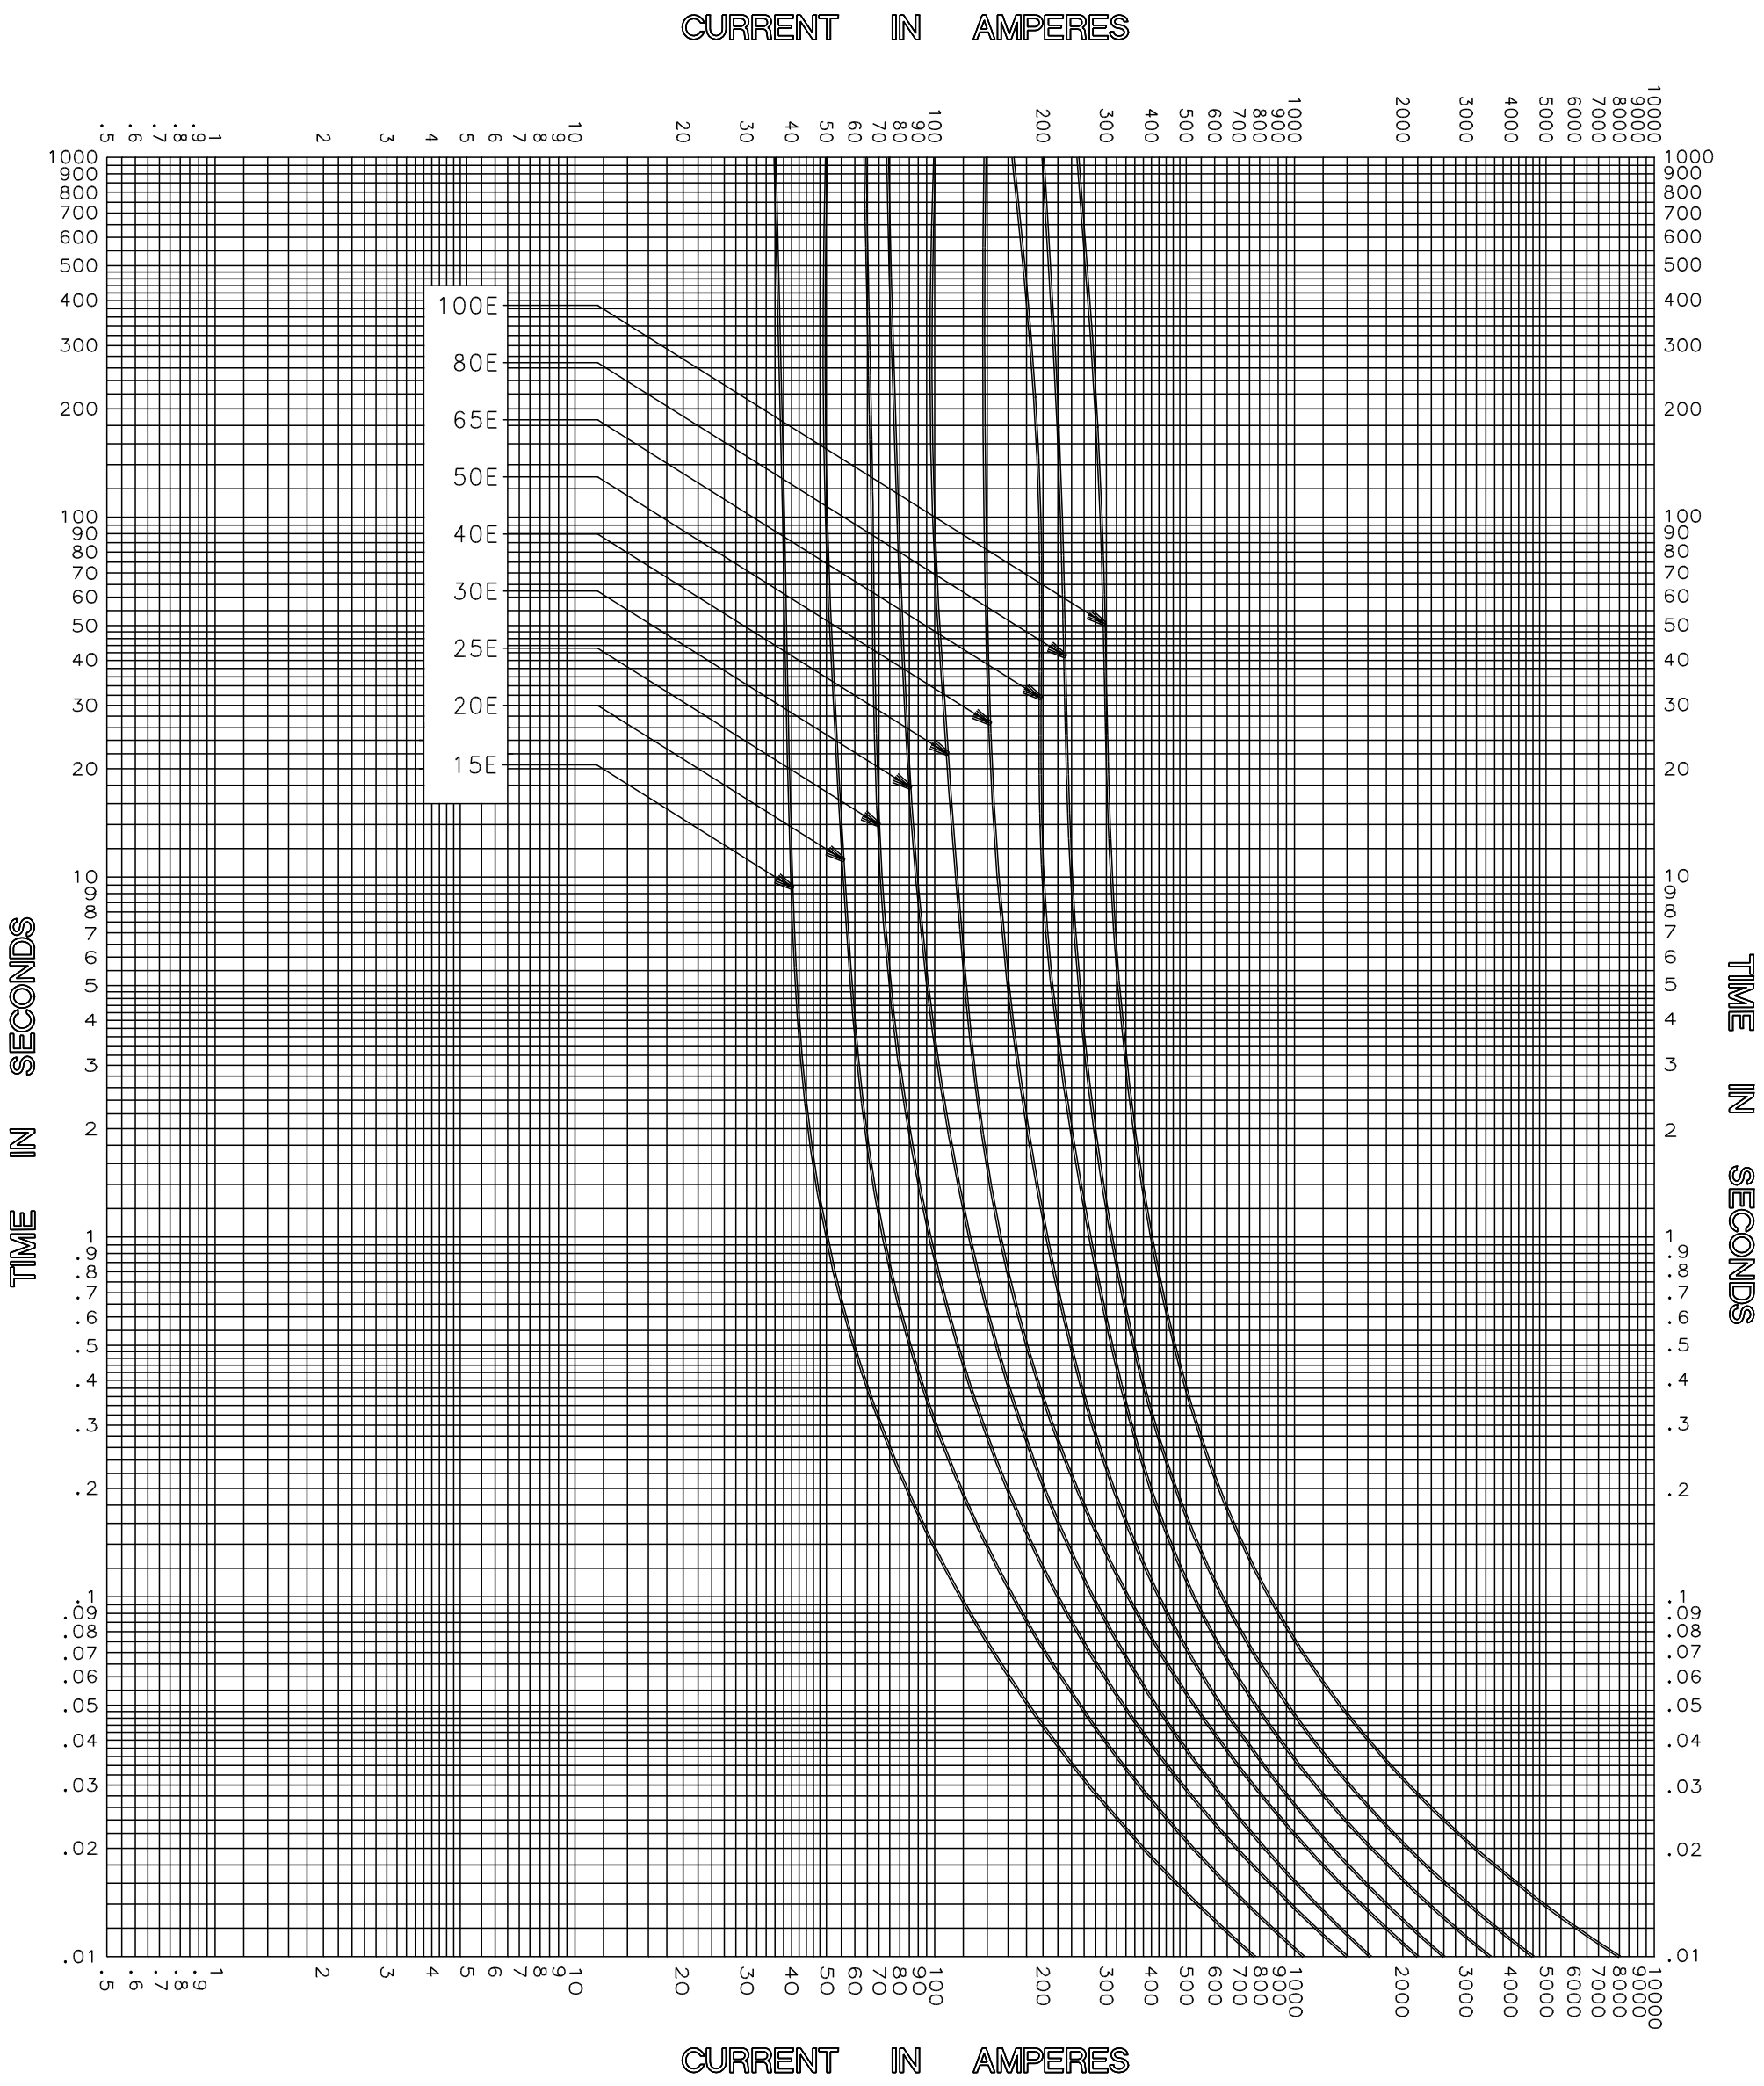

CLEARING TIME CHARACTERISTICS

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER 25.8kV E-RATED 15E-100E
 Littelfuse® DES PLAINES, ILLINOIS 60016	DRAWN BY LLL DATE 05/21/04 CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC04 15E-100E

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT