


CURRENT IN AMPERES

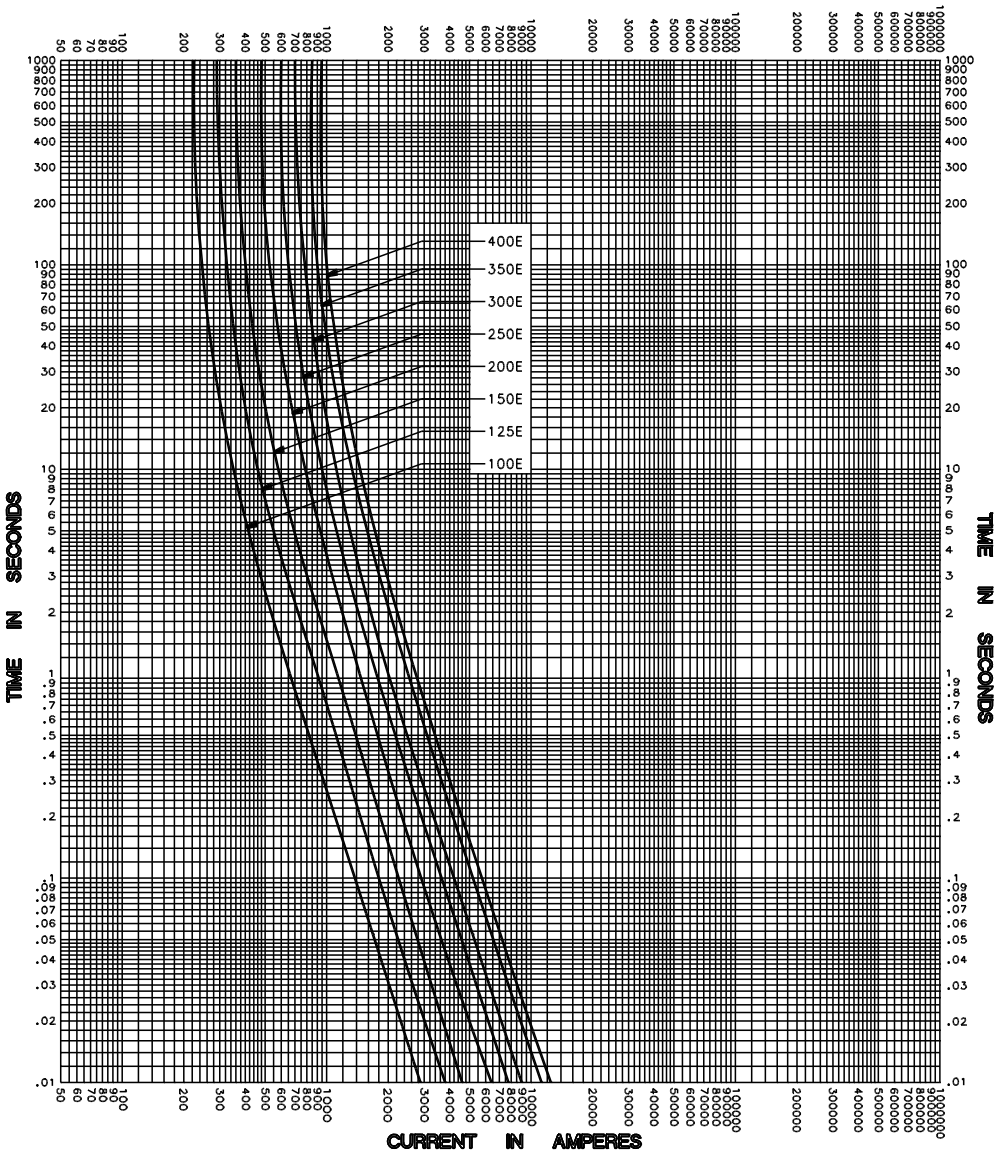

CLEARING TIME CHARACTERISTIC

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER 8.25kV E-RATED 100E-400E
BASIS FOR DATA _____		
 DES PLAINES, ILLINOIS 60016		DRAWN BY <u>LLL</u>
		DATE <u>07/26/04</u>
TIME CURRENT CHARACTERISTIC CURVES		CHECKED BY <u>MP</u>
		DRAWING NO. <u>A-FCC001</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT