


CURRENT IN AMPERES



CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (1/10A - 3/10A)
BASIS FOR DATA _____		

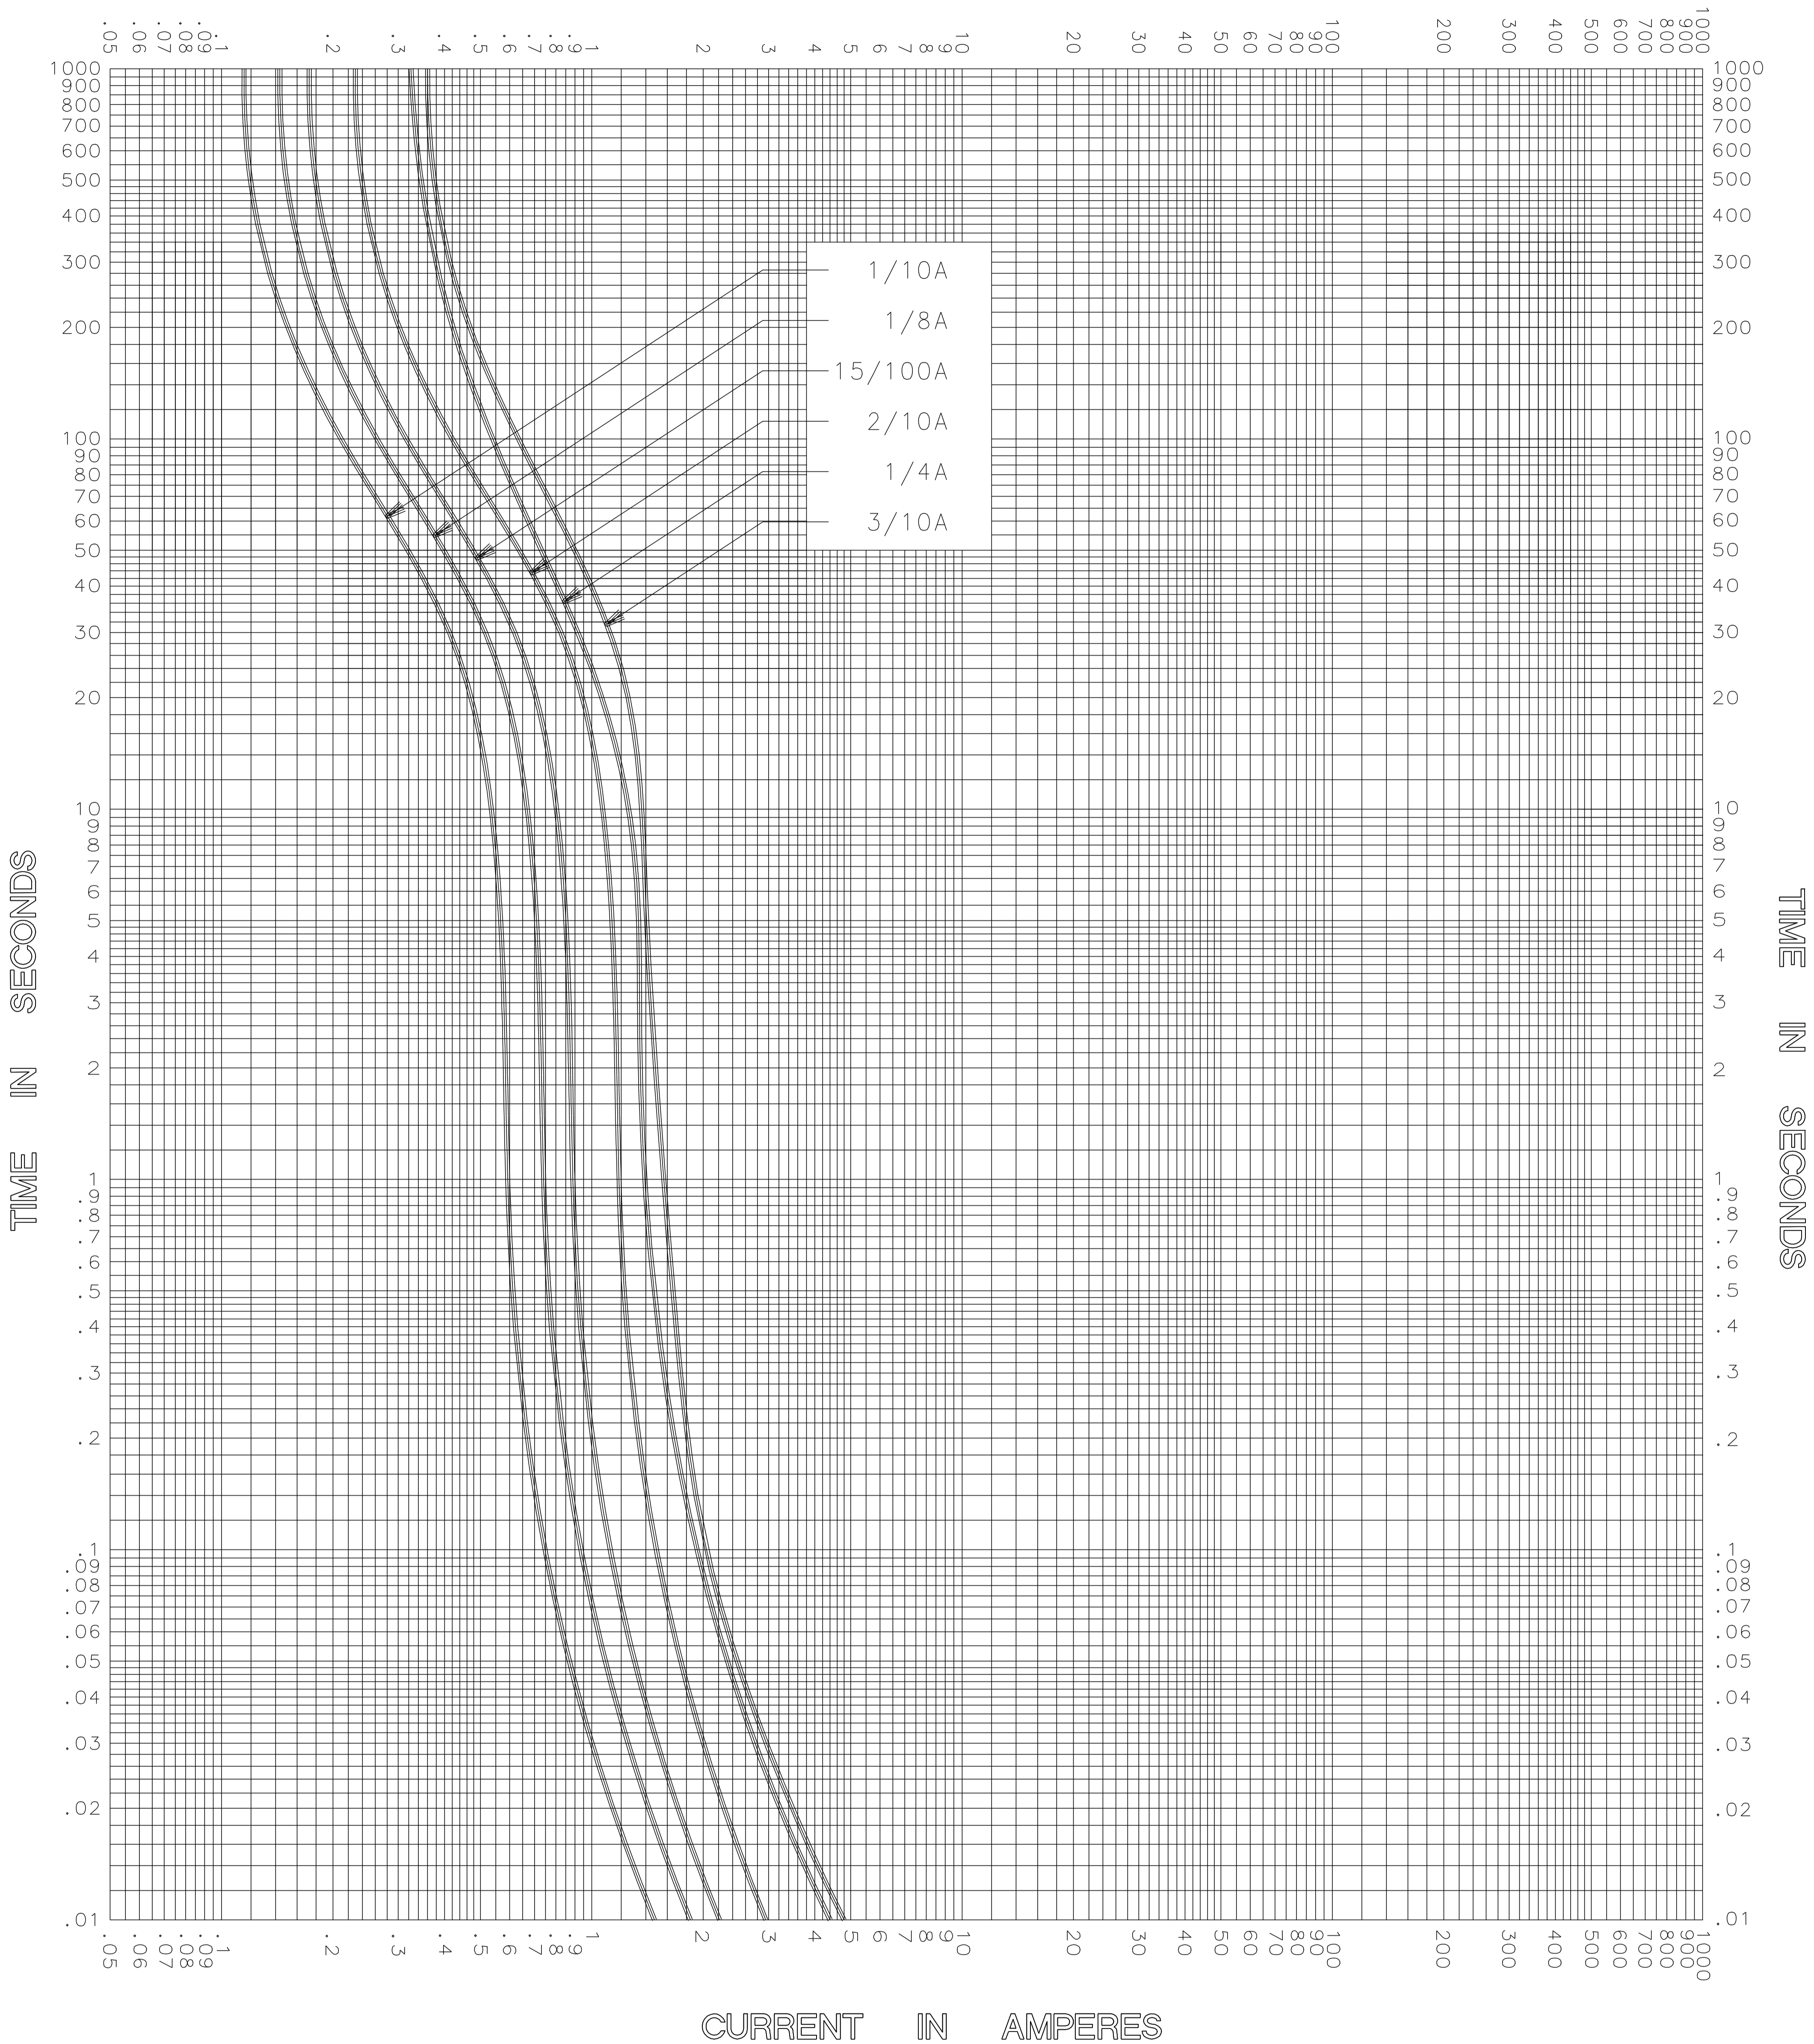

LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY	MRD
DATE	02/03/04
CHECKED BY	MP
DRAWING NO.	B-FCC01-1/001

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

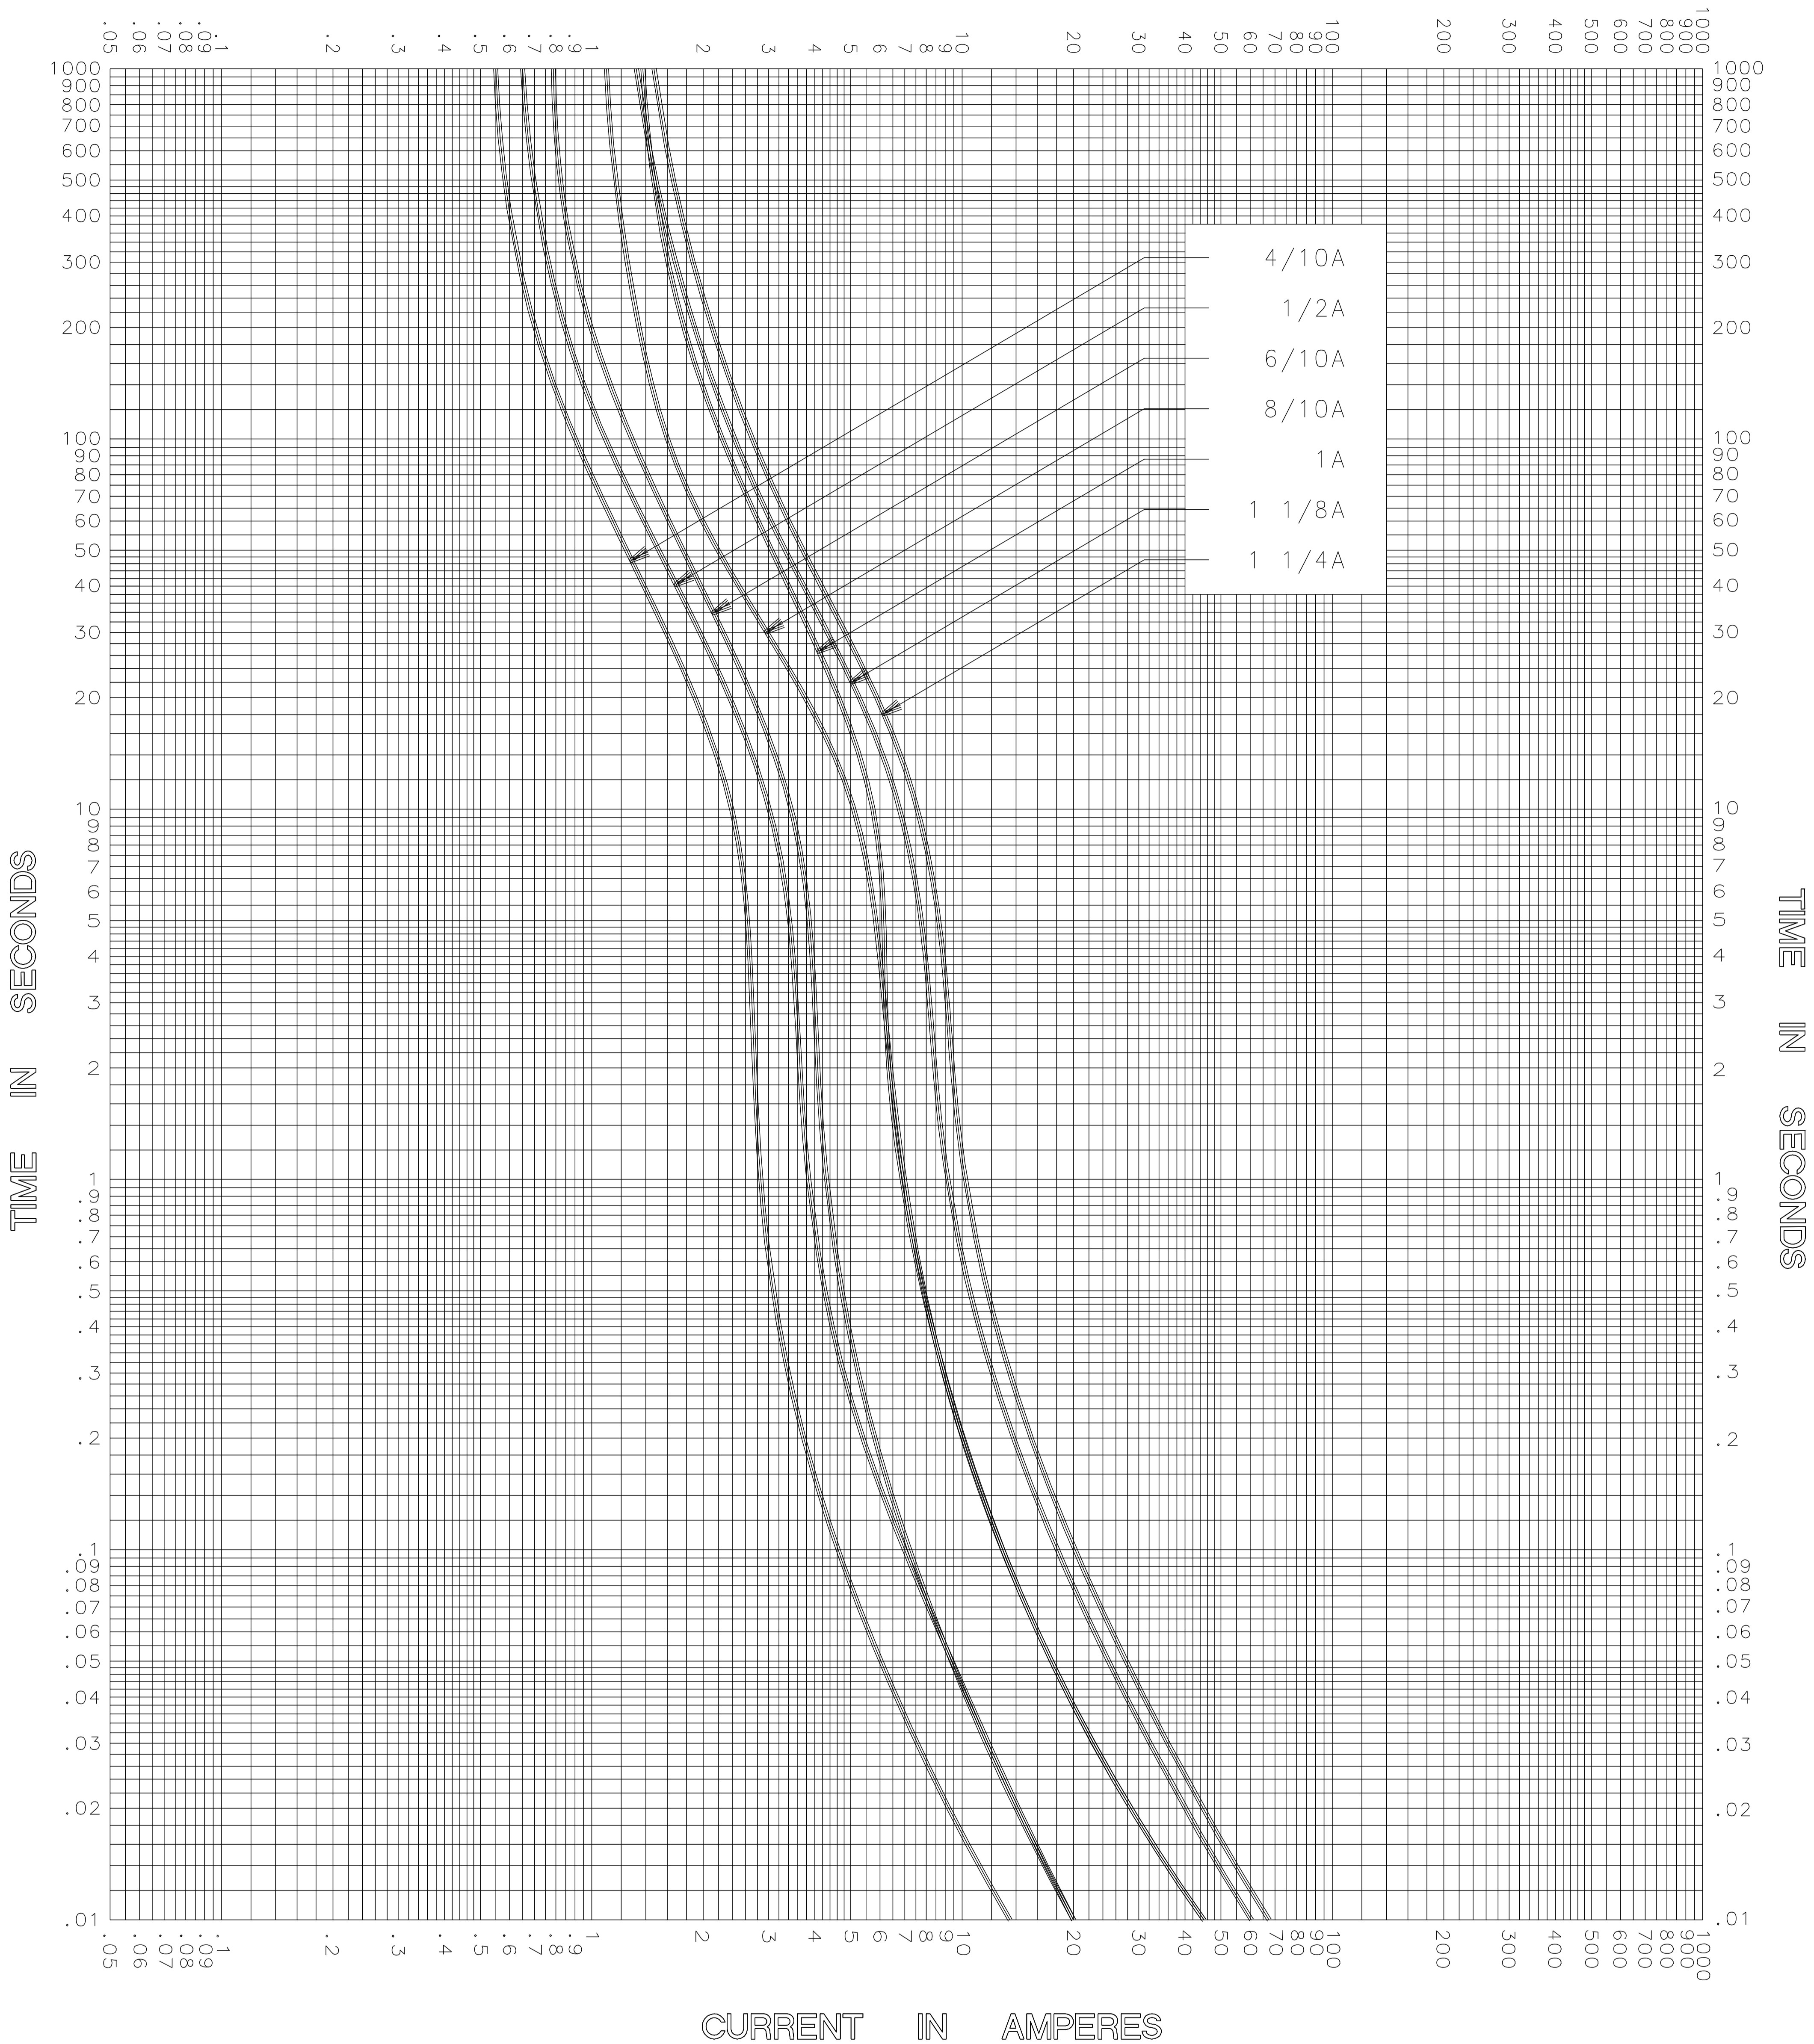

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLNR (4/10A - 1 1/4A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY	MRD
DATE	02/03/04
CHECKED BY	MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.	B-FCC01/FLNR-002
-------------	------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

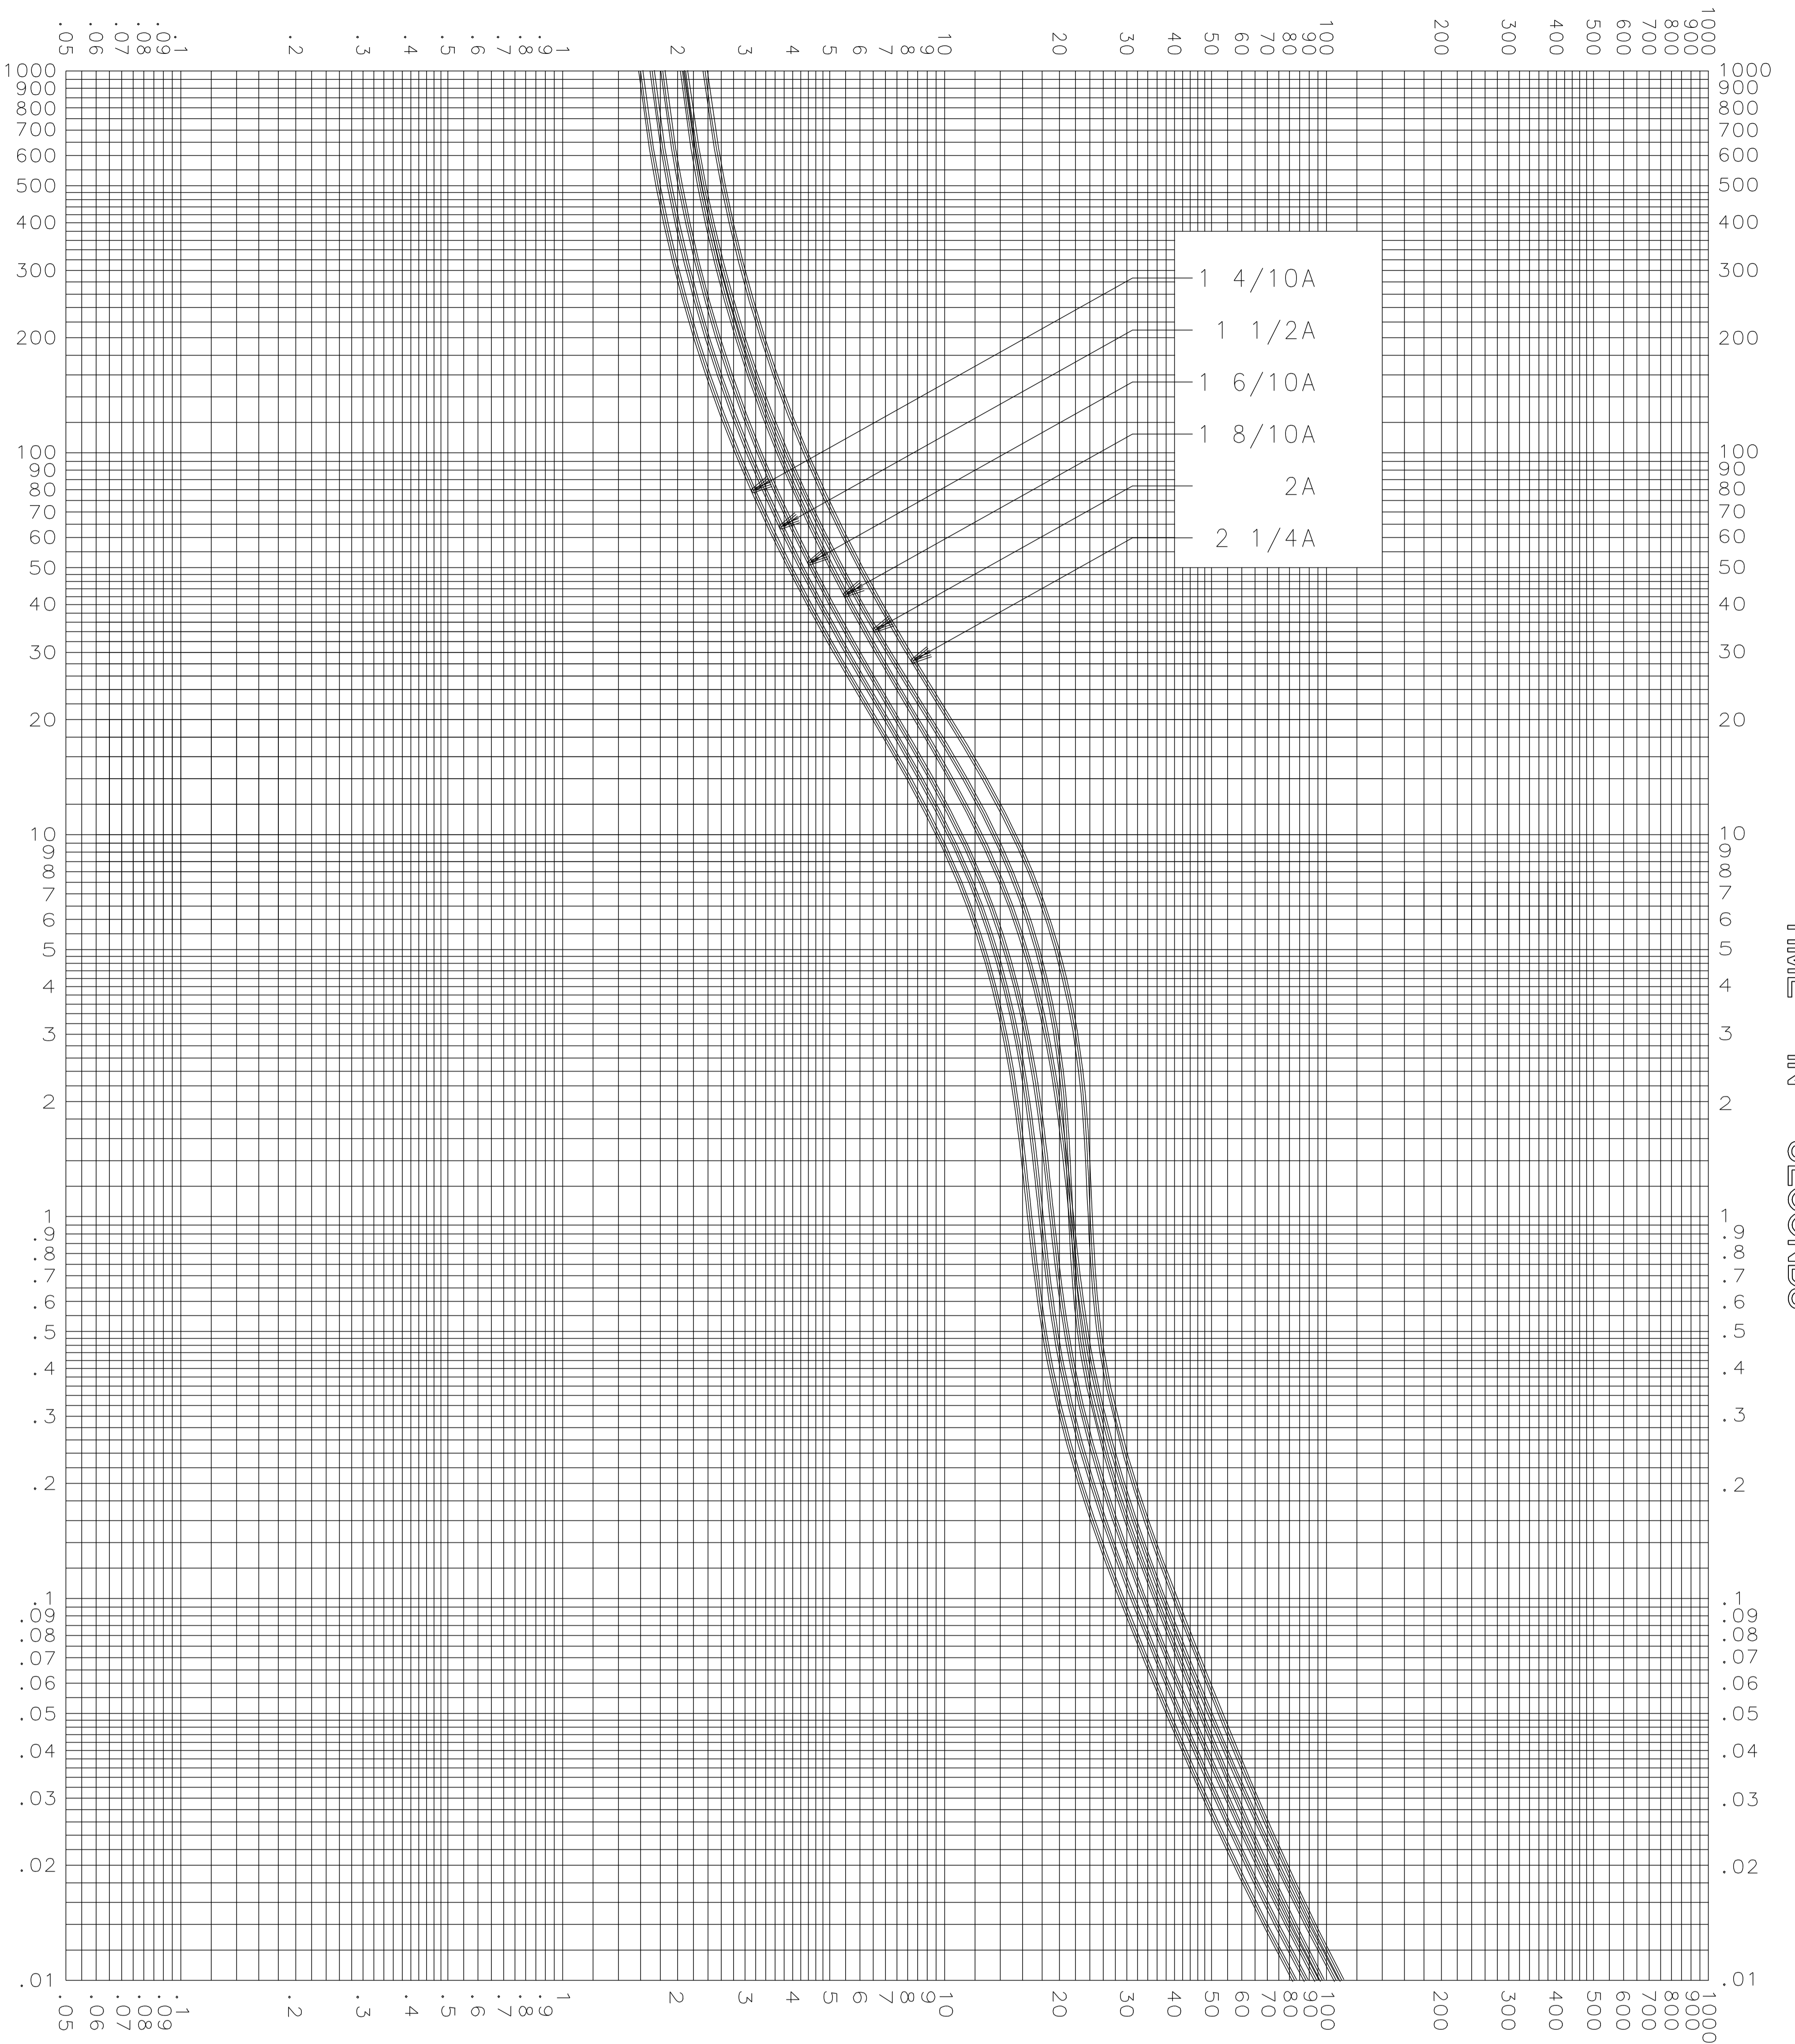

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLNR (1 4/10A - 2 1/4A)


LITTELFUSE, INC.
 DES PLAINES, ILL. USA

DRAWN BY MRD
 DATE 02/03/04
 CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. B-FCC01 / VP 003

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

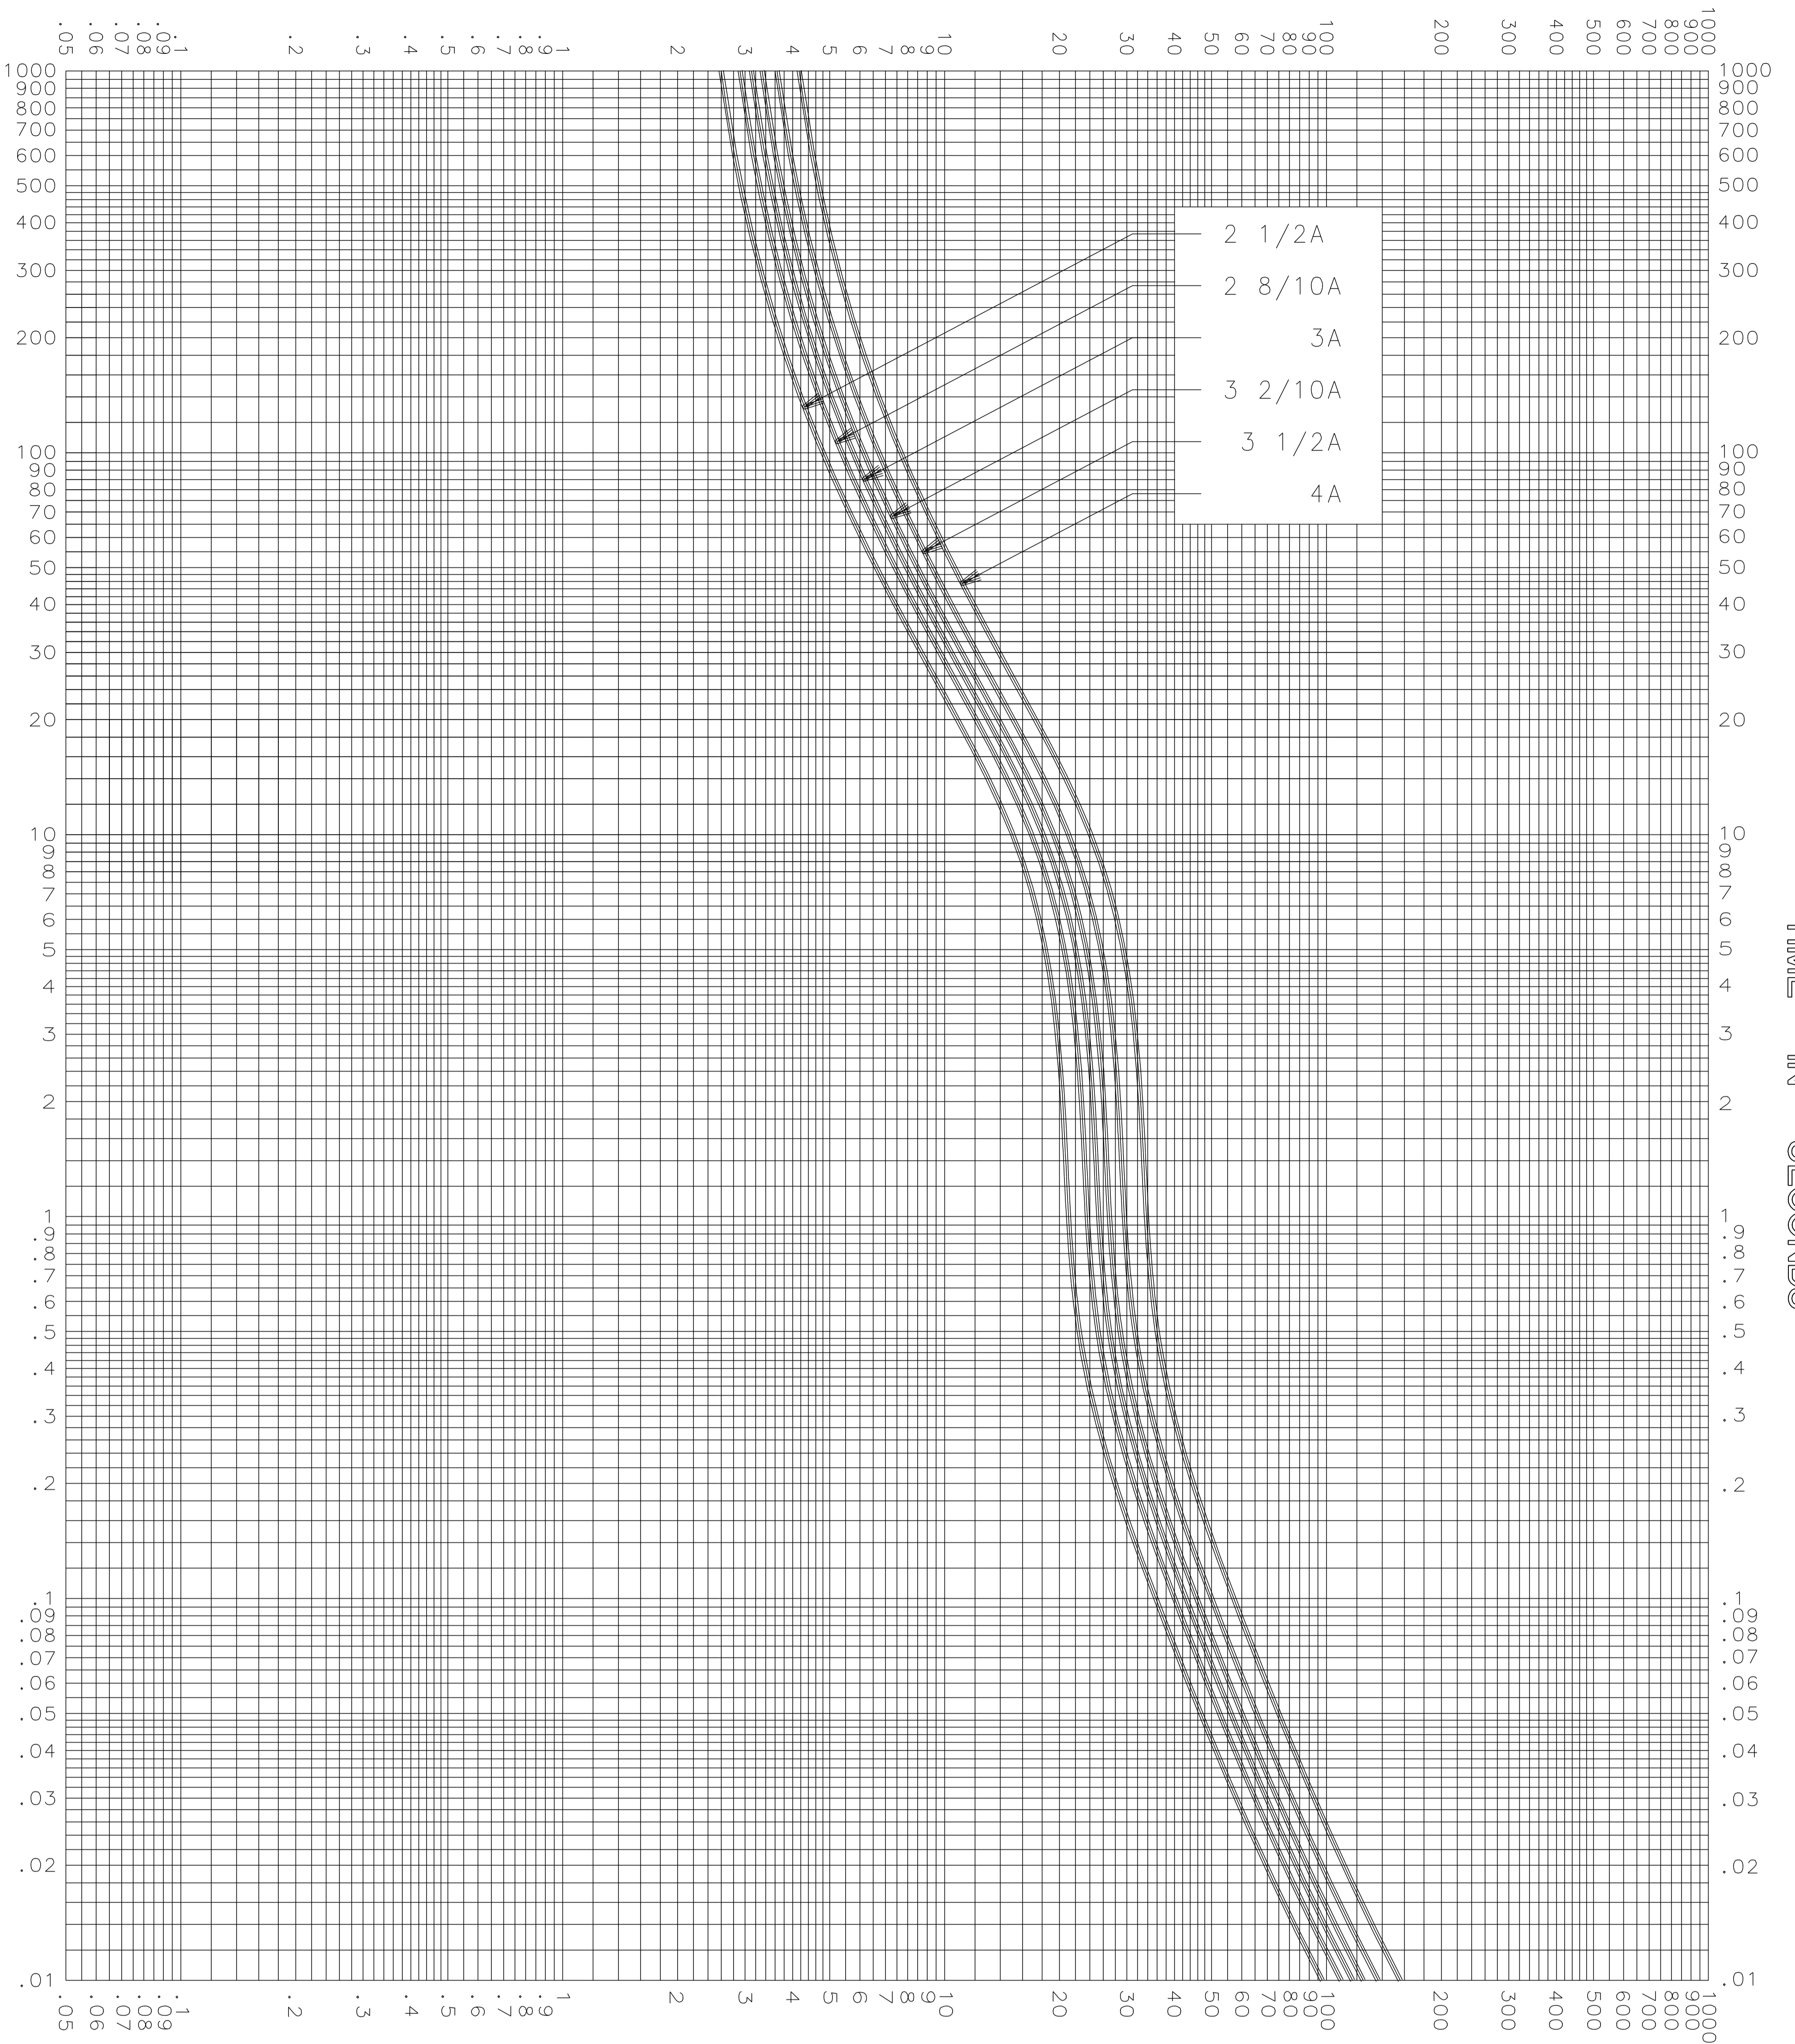

CURRENT IN AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (2 1/2A - 4A)
BASIS FOR DATA _____		

 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY MRD
	DATE 02/03/04
	CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B-FCC015-VR-004

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

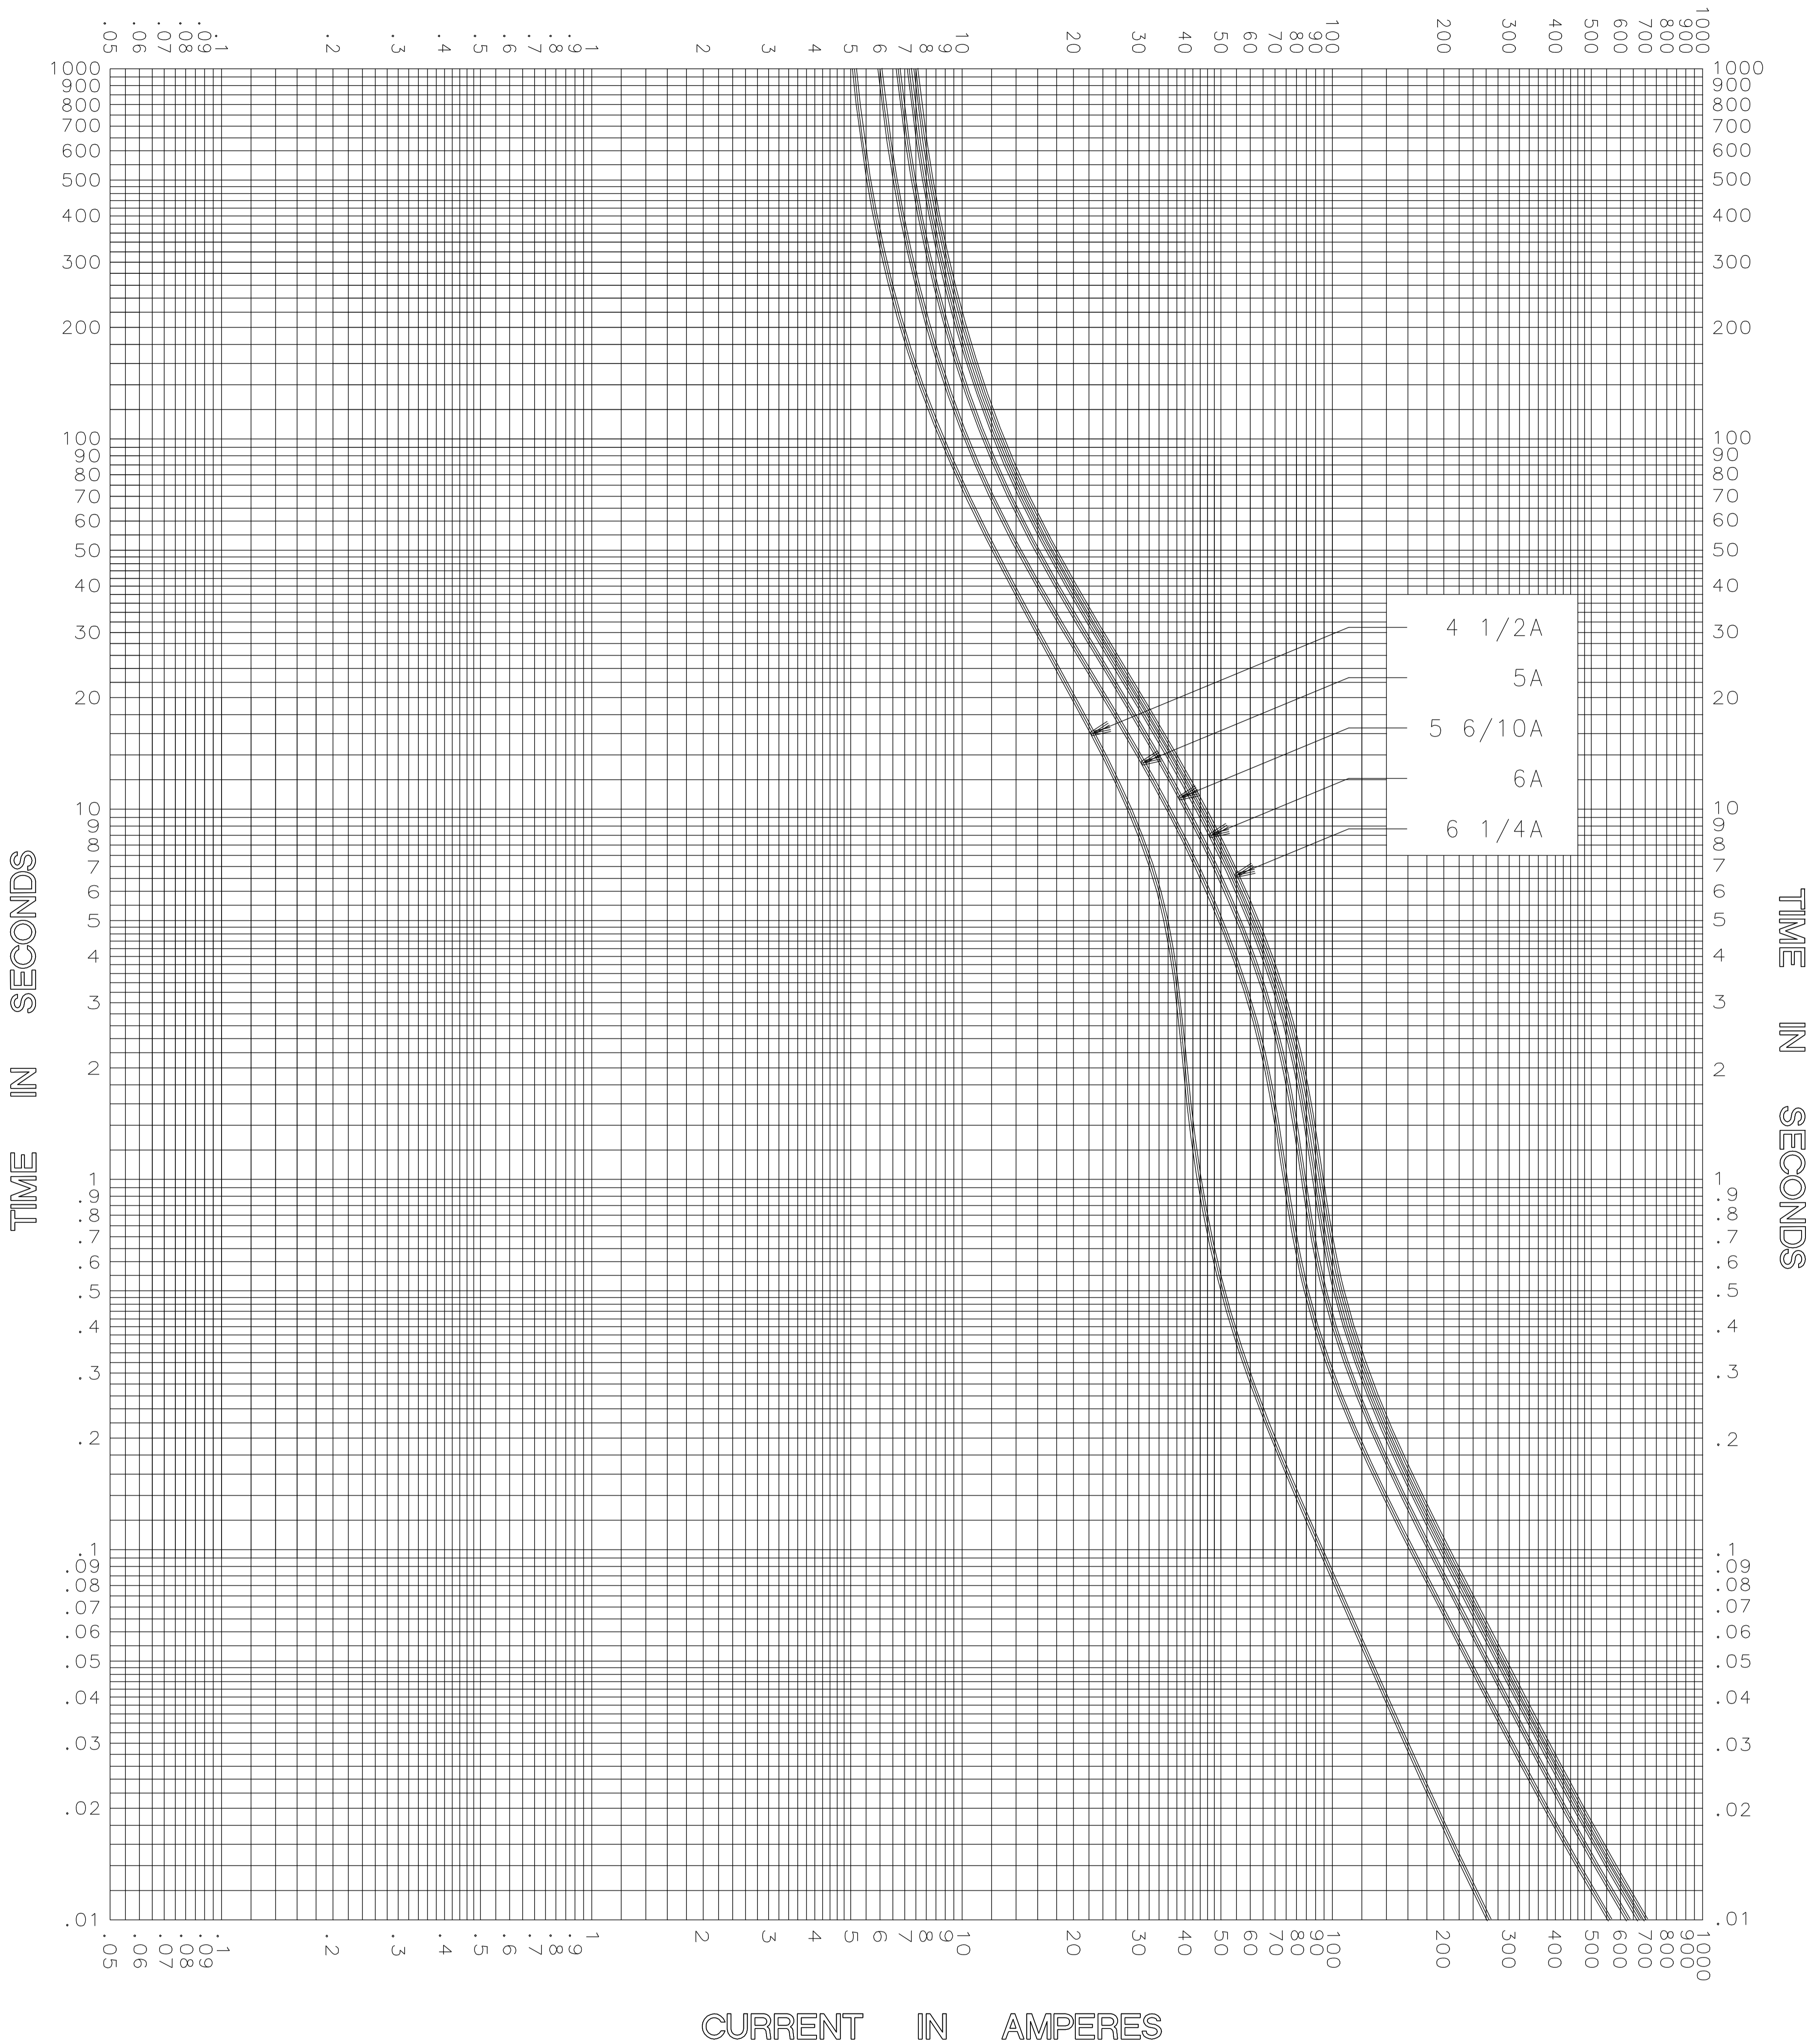

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		FLNR (4 1/2A - 6 1/4A)



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY	MRD
DATE	02/03/04
CHECKED BY	MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.	B-FCC015-1-005
-------------	----------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

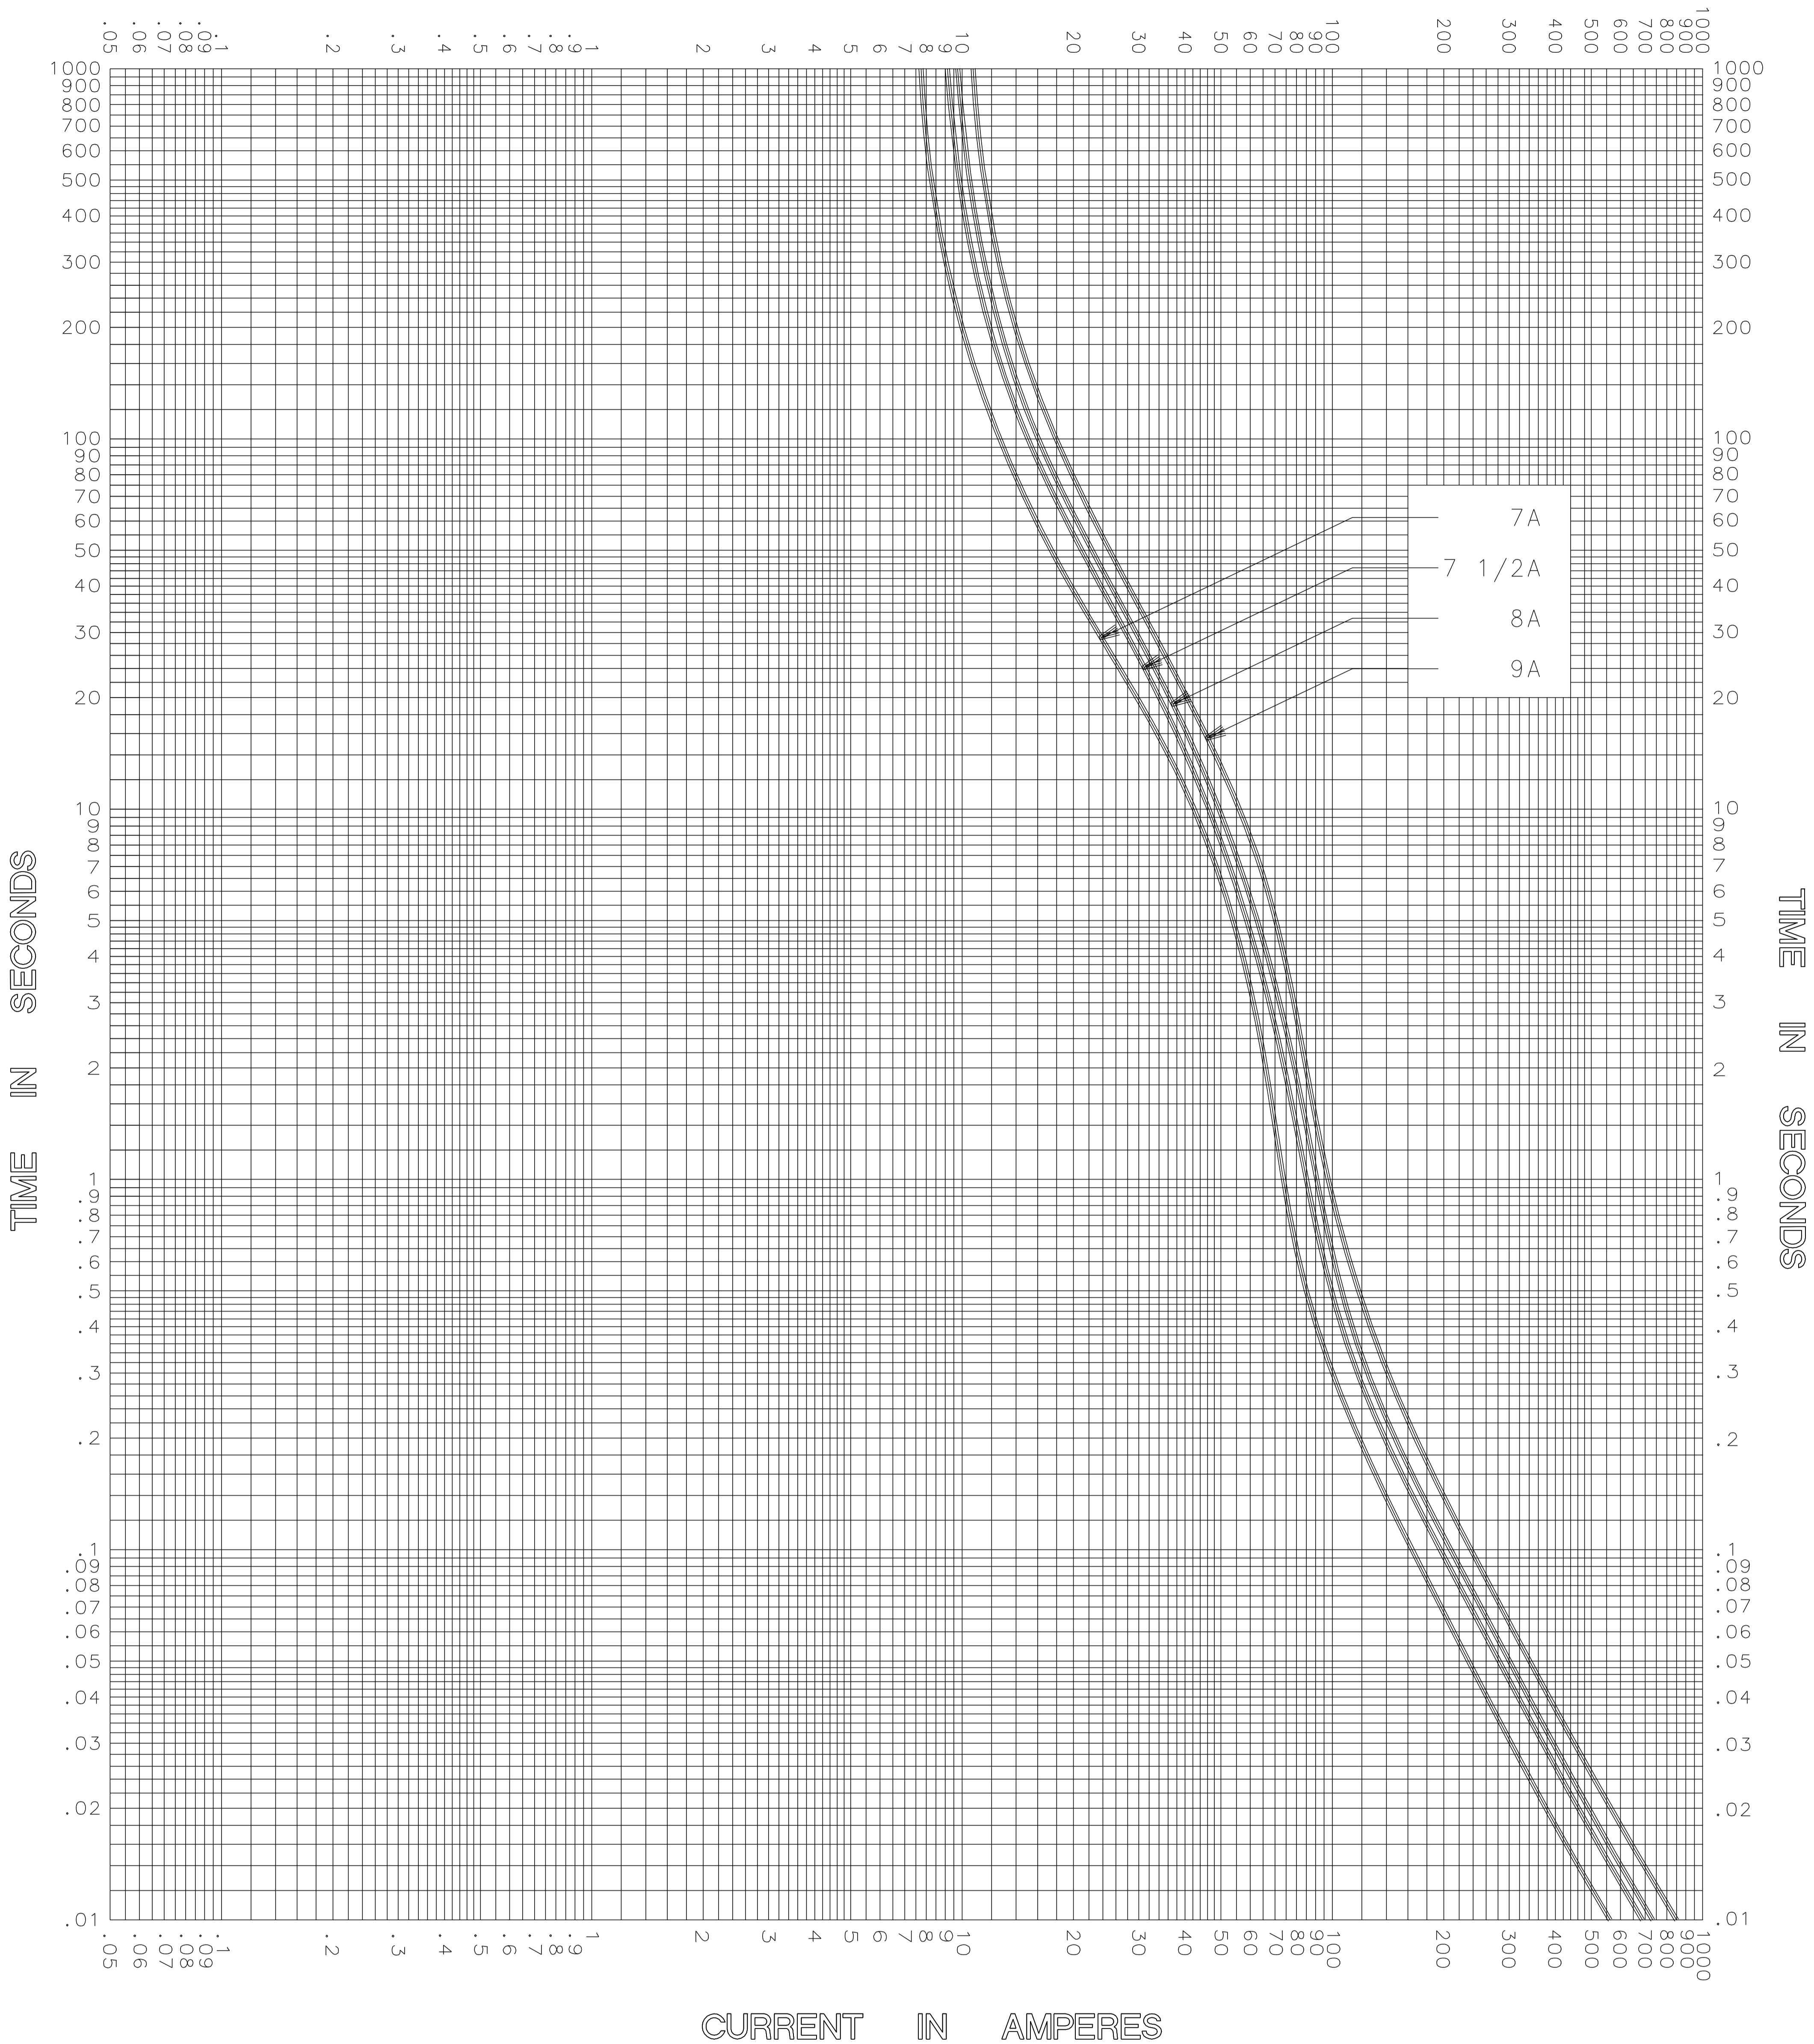

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (7A - 9A)
BASIS FOR DATA _____		



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY MRD
DATE 02/03/04
CHECKED BY MP
DRAWING NO. B-FCC01 VR 006

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

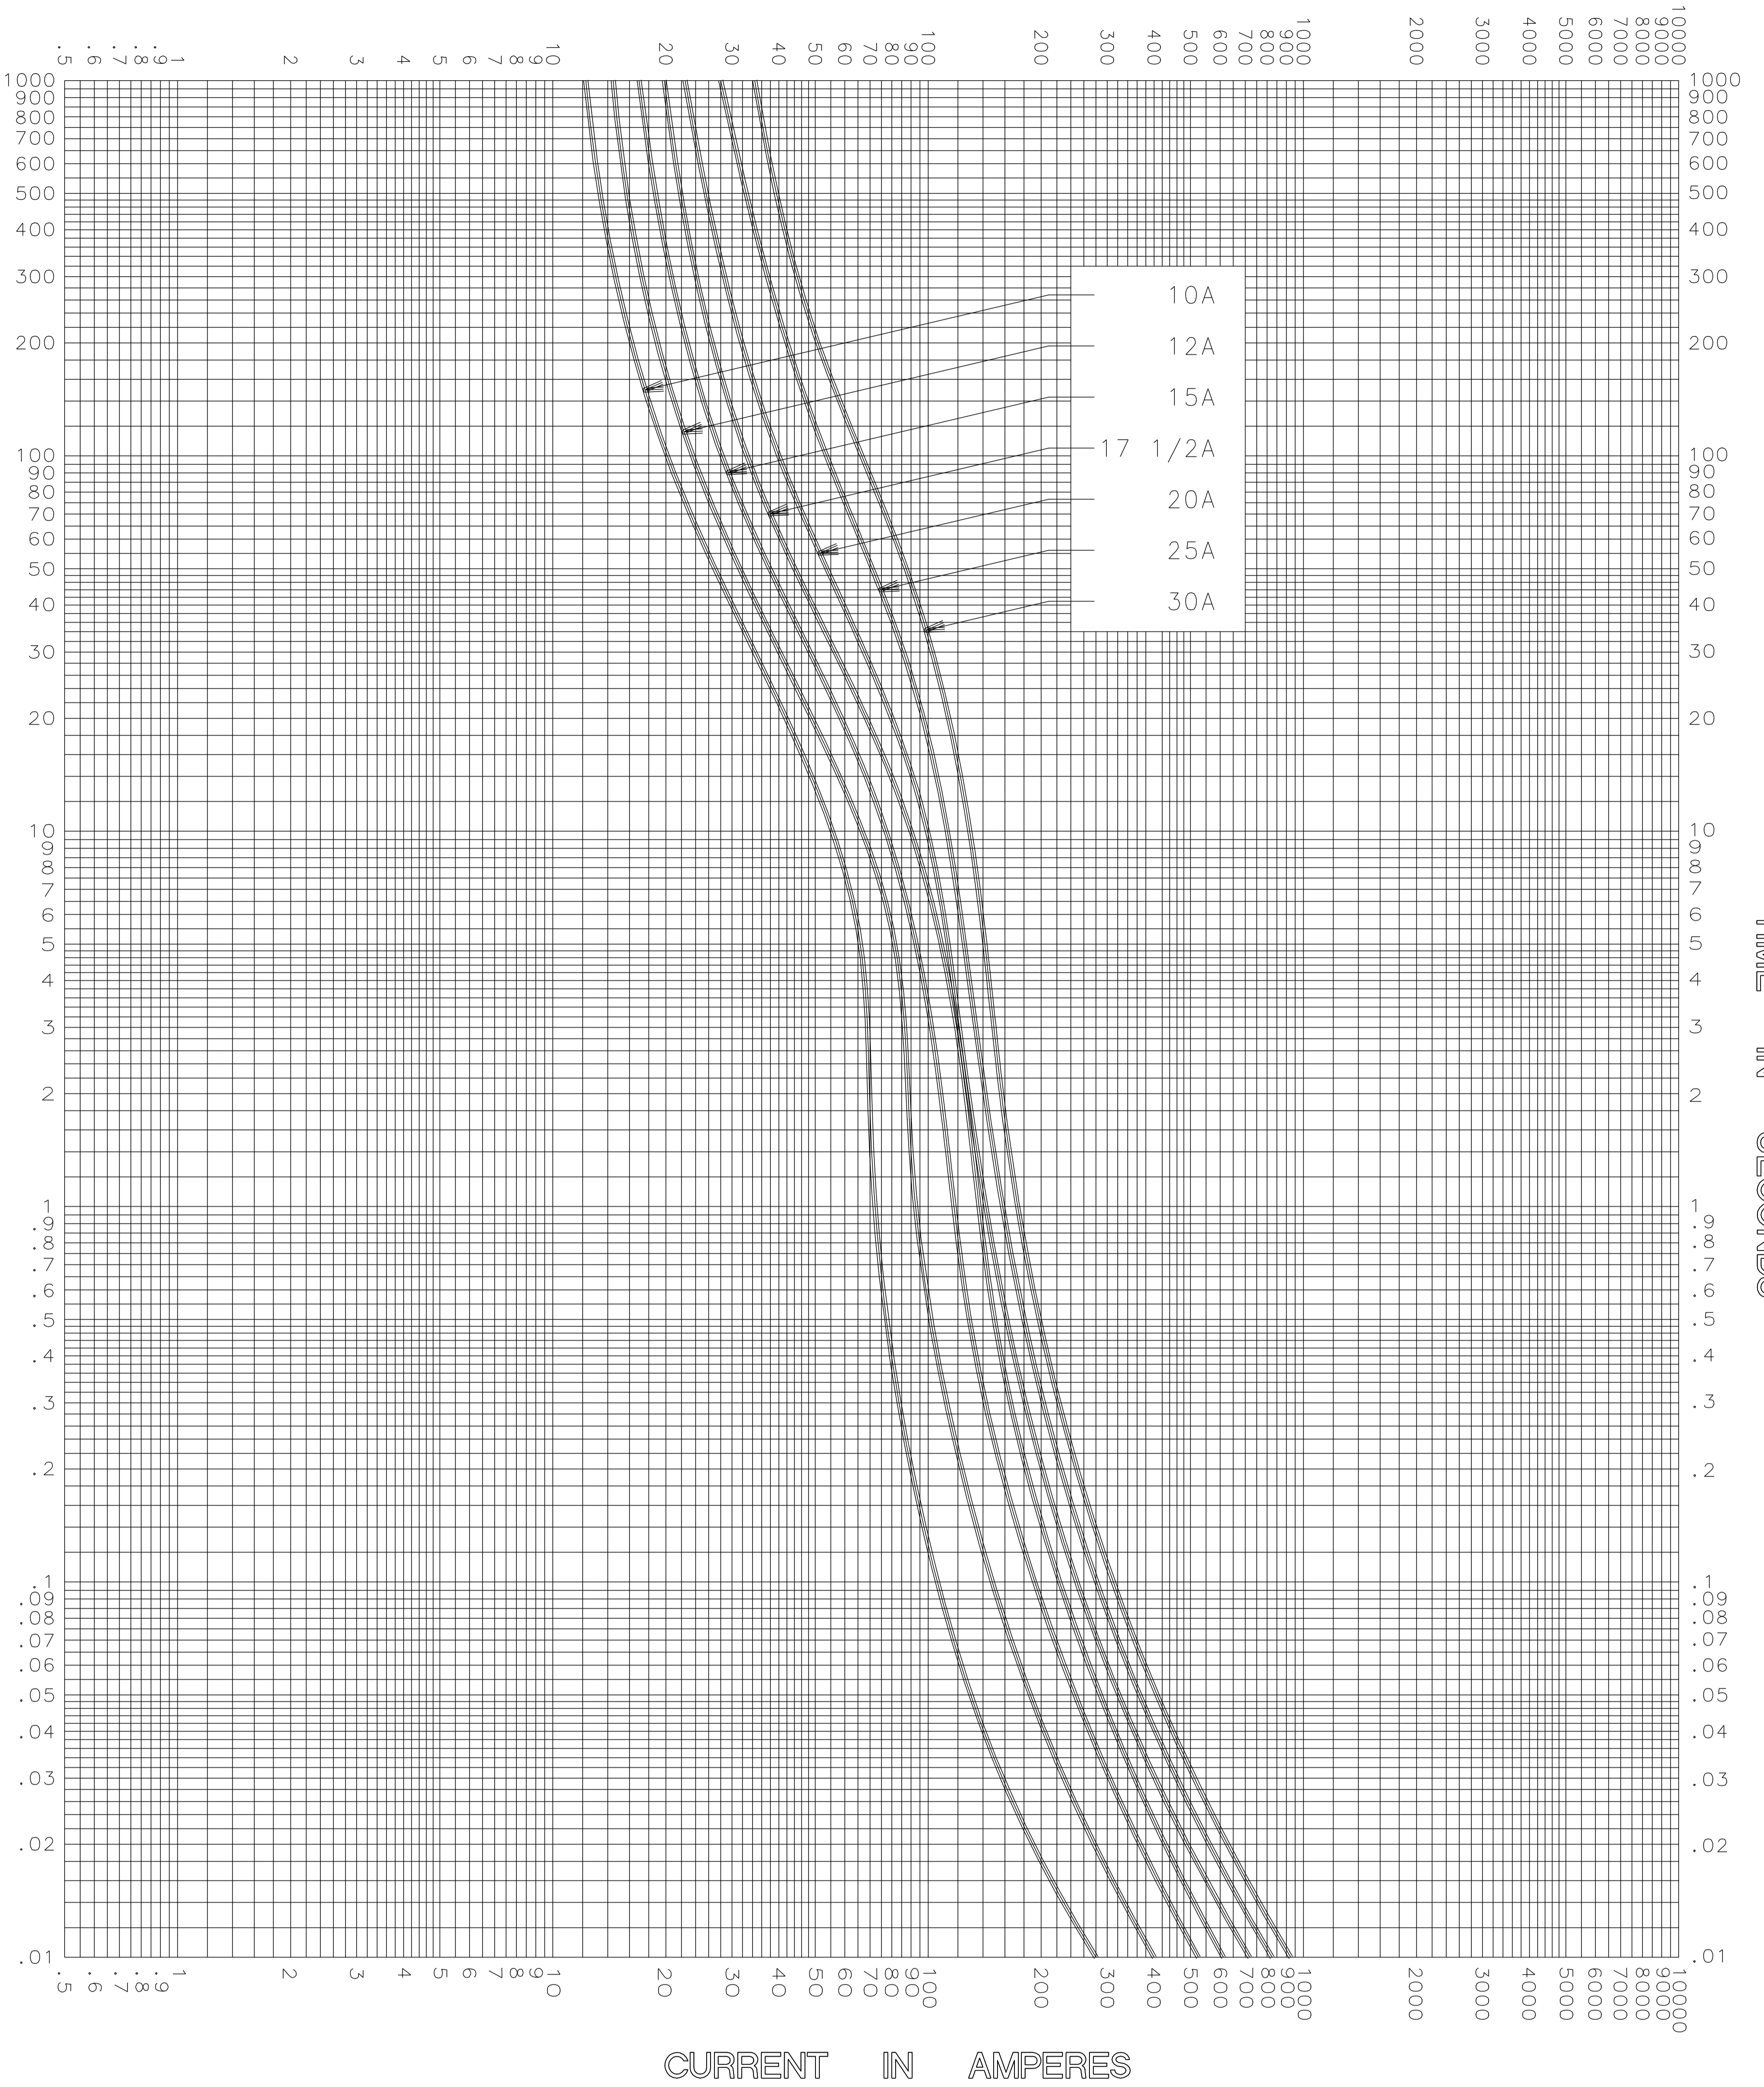

CURRENT IN AMPERES


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER FLNR (10A - 30A)
---	---

LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY MRD DATE 02/03/04 CHECKED BY MP
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. B-FCC01 REV 007

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

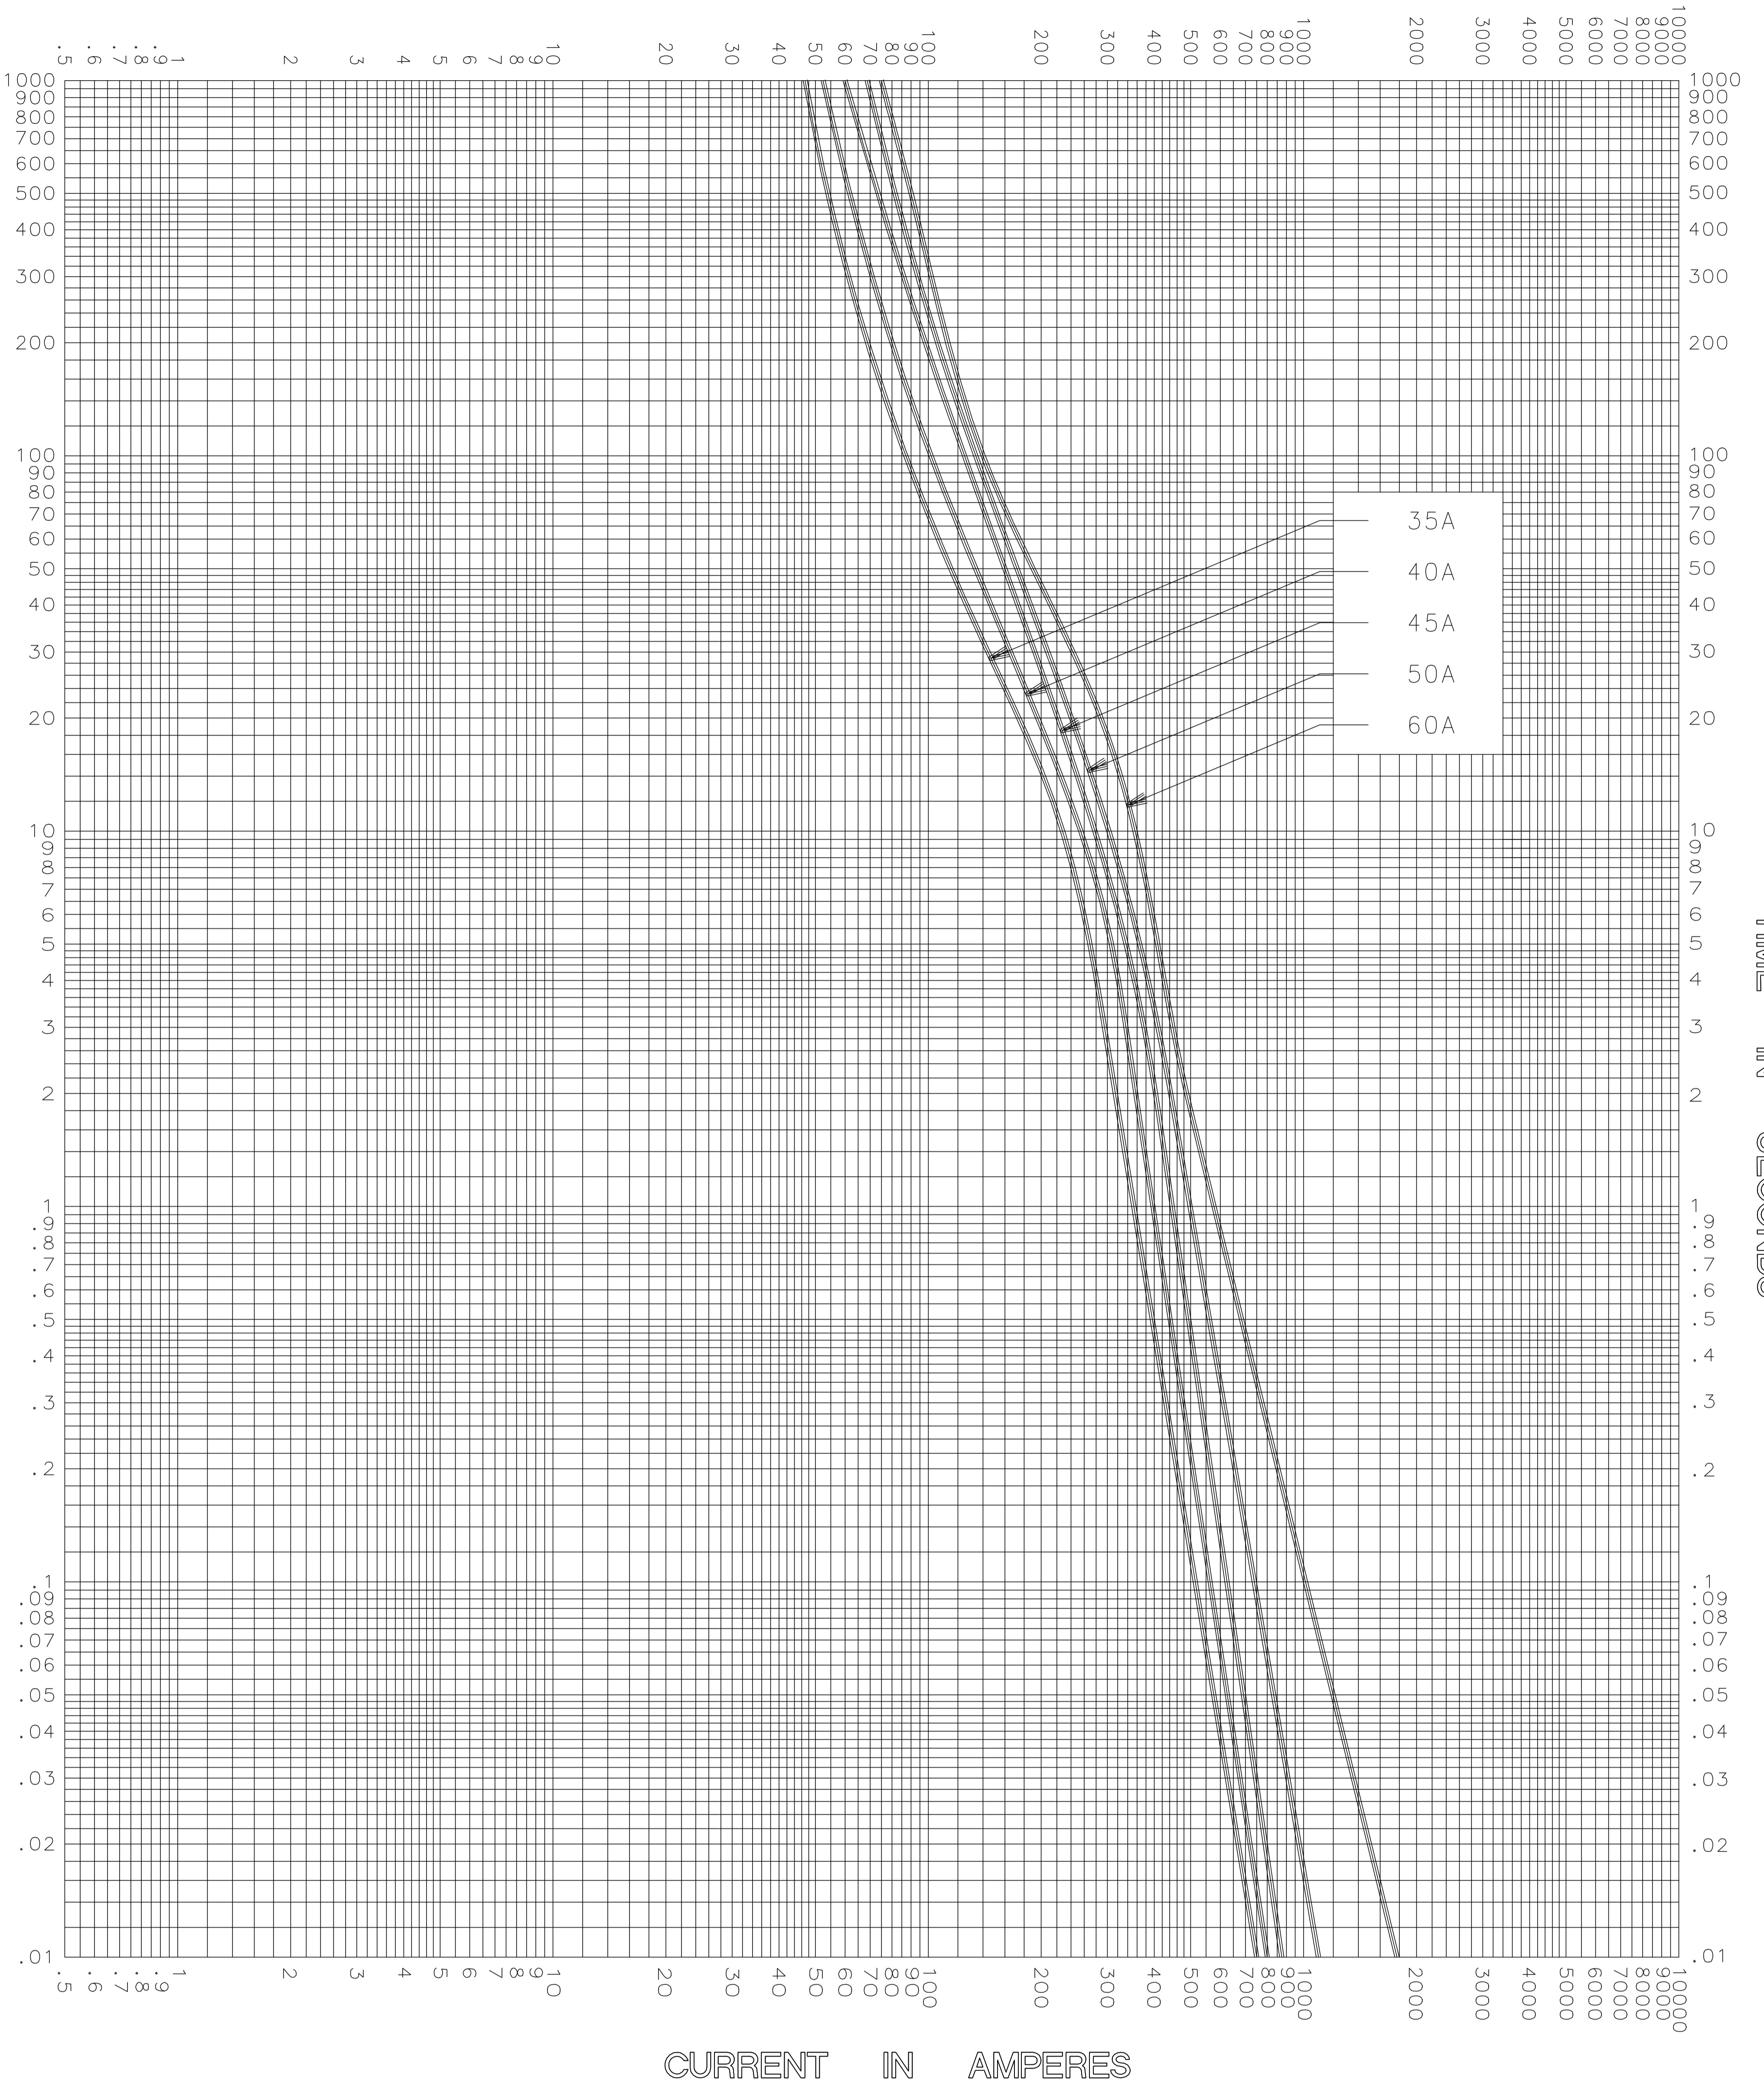

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (35A - 60A)
BASIS FOR DATA _____		



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	05/02/05
CHECKED BY	MP
DRAWING NO.	A-FCC01 FLNR 008

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

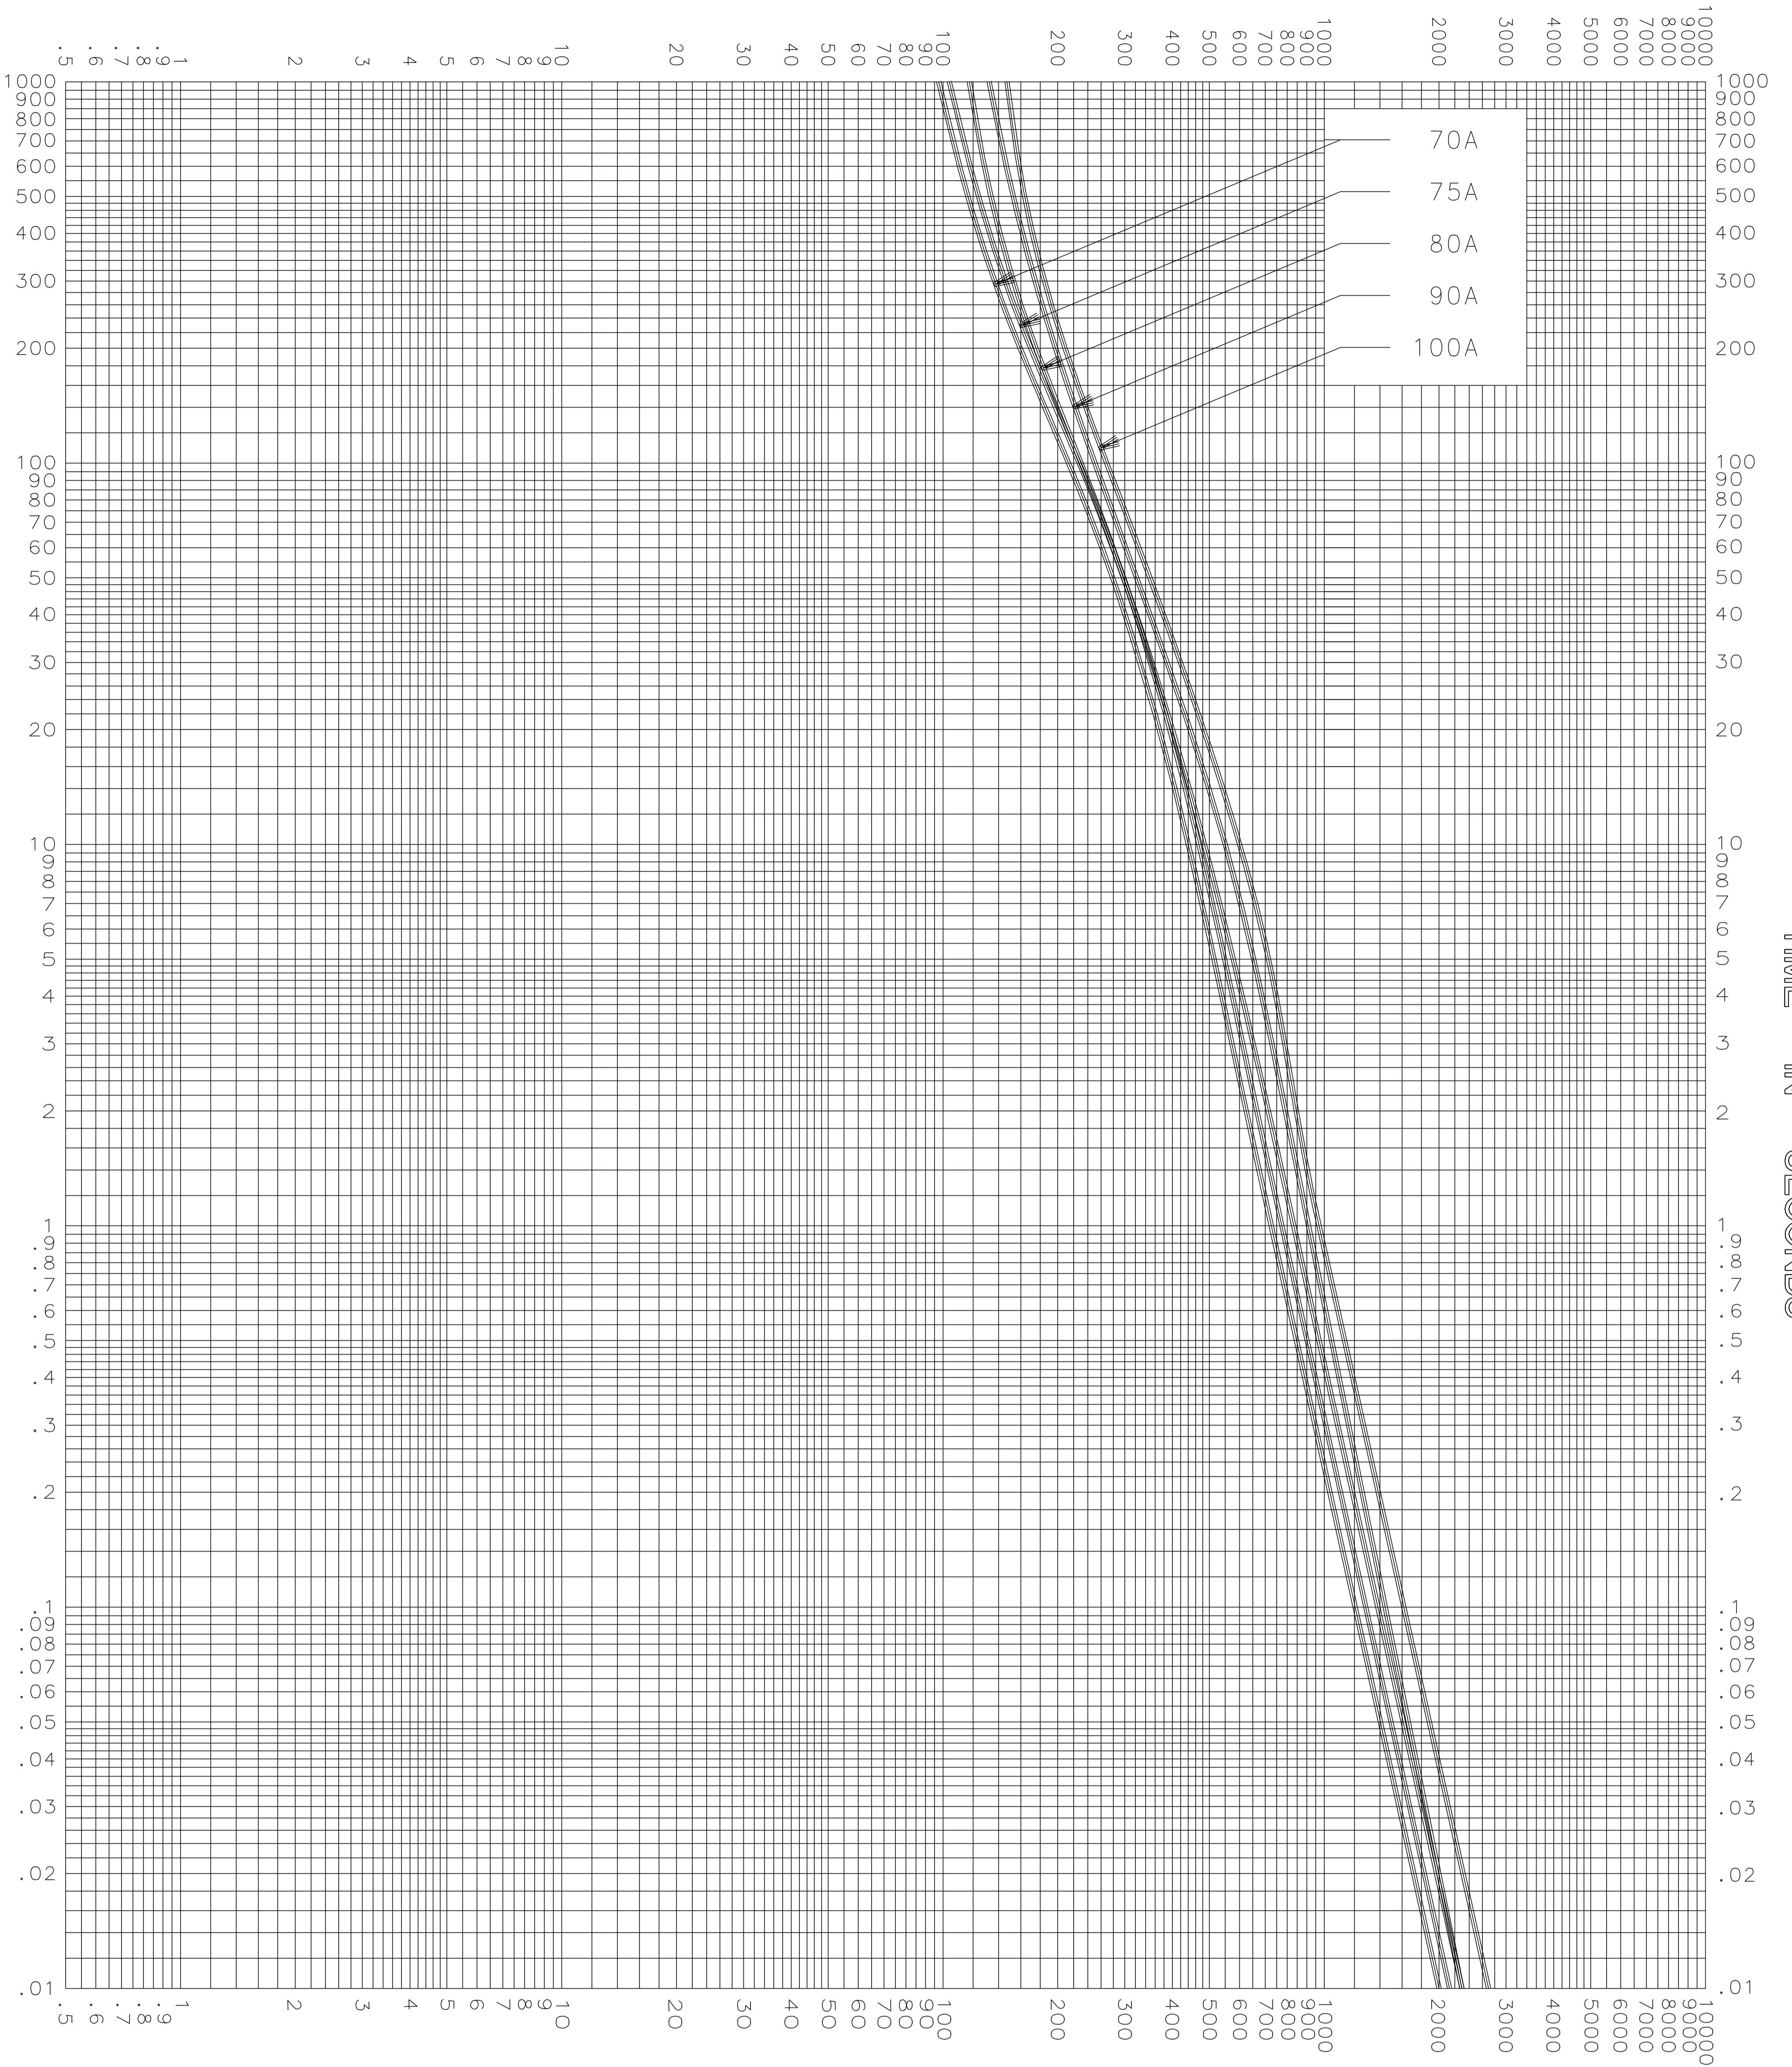

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (70A - 100A)
BASIS FOR DATA _____		



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	05/02/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01 FLNR 1009
------------------------------------	----------------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

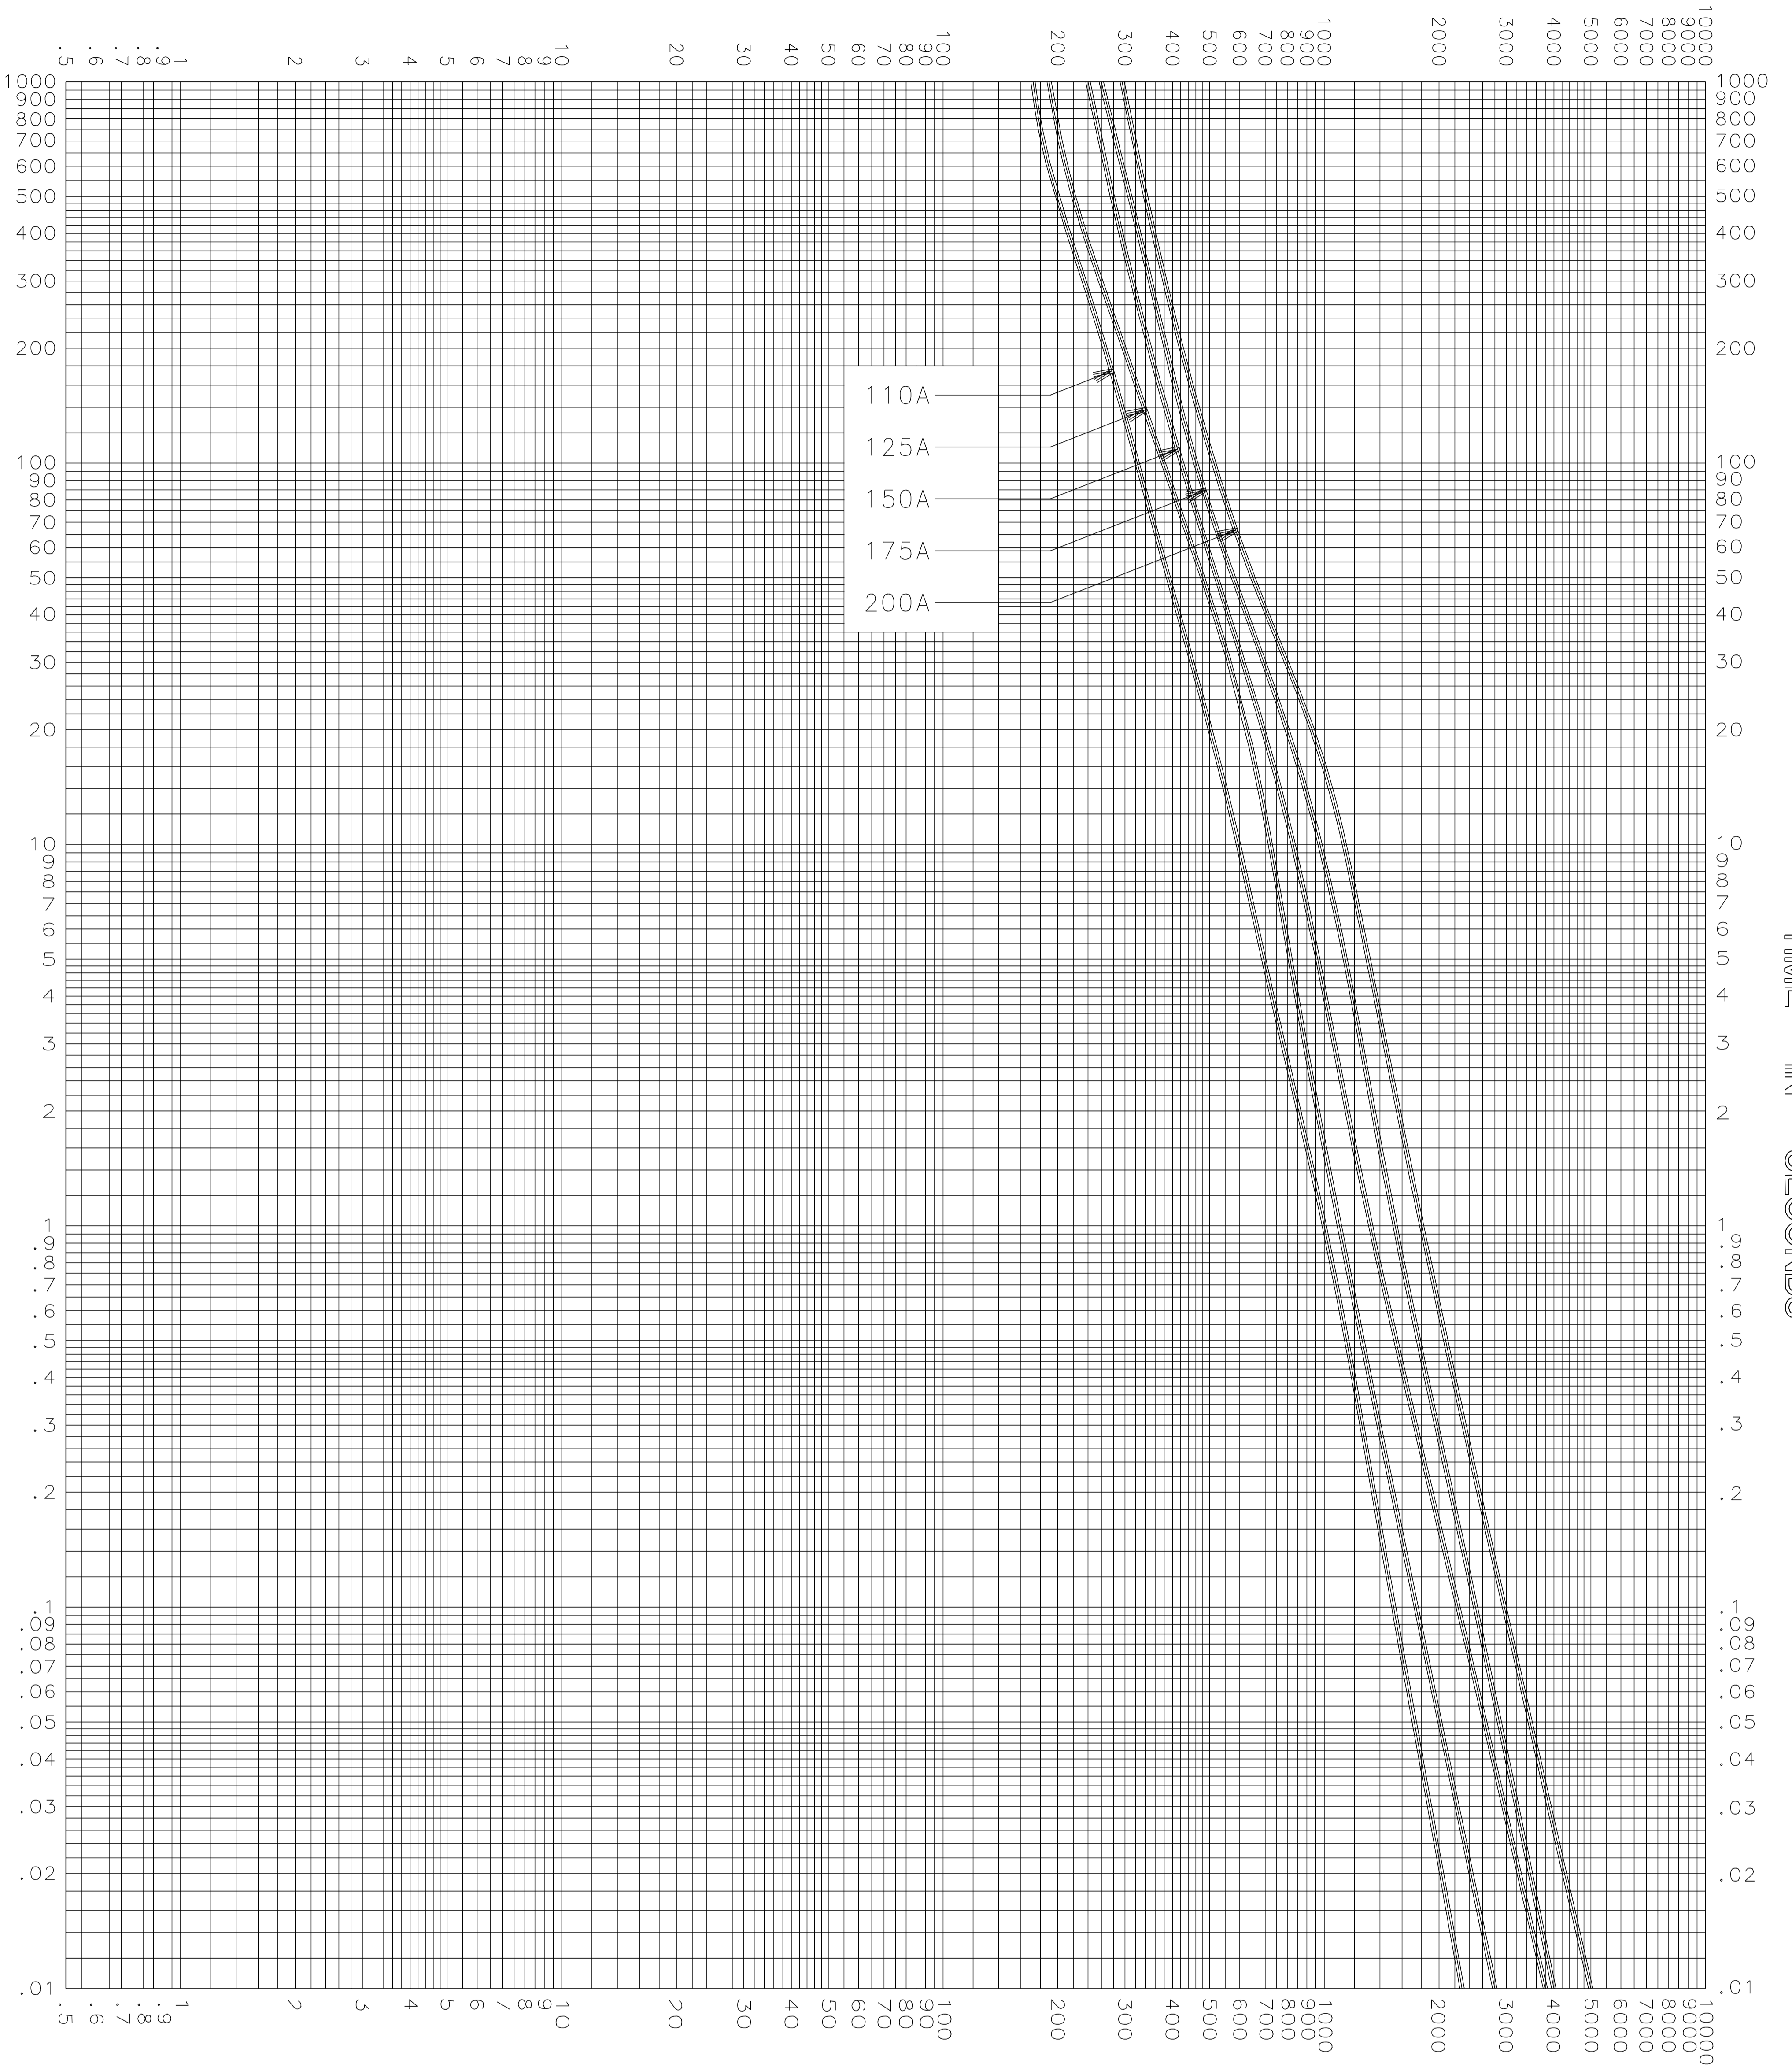

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (110A - 200A)
BASIS FOR DATA _____	


 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>05/02/05</u> CHECKED BY <u>MP</u>
	DRAWING NO. A-FCC01-11NR-010

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

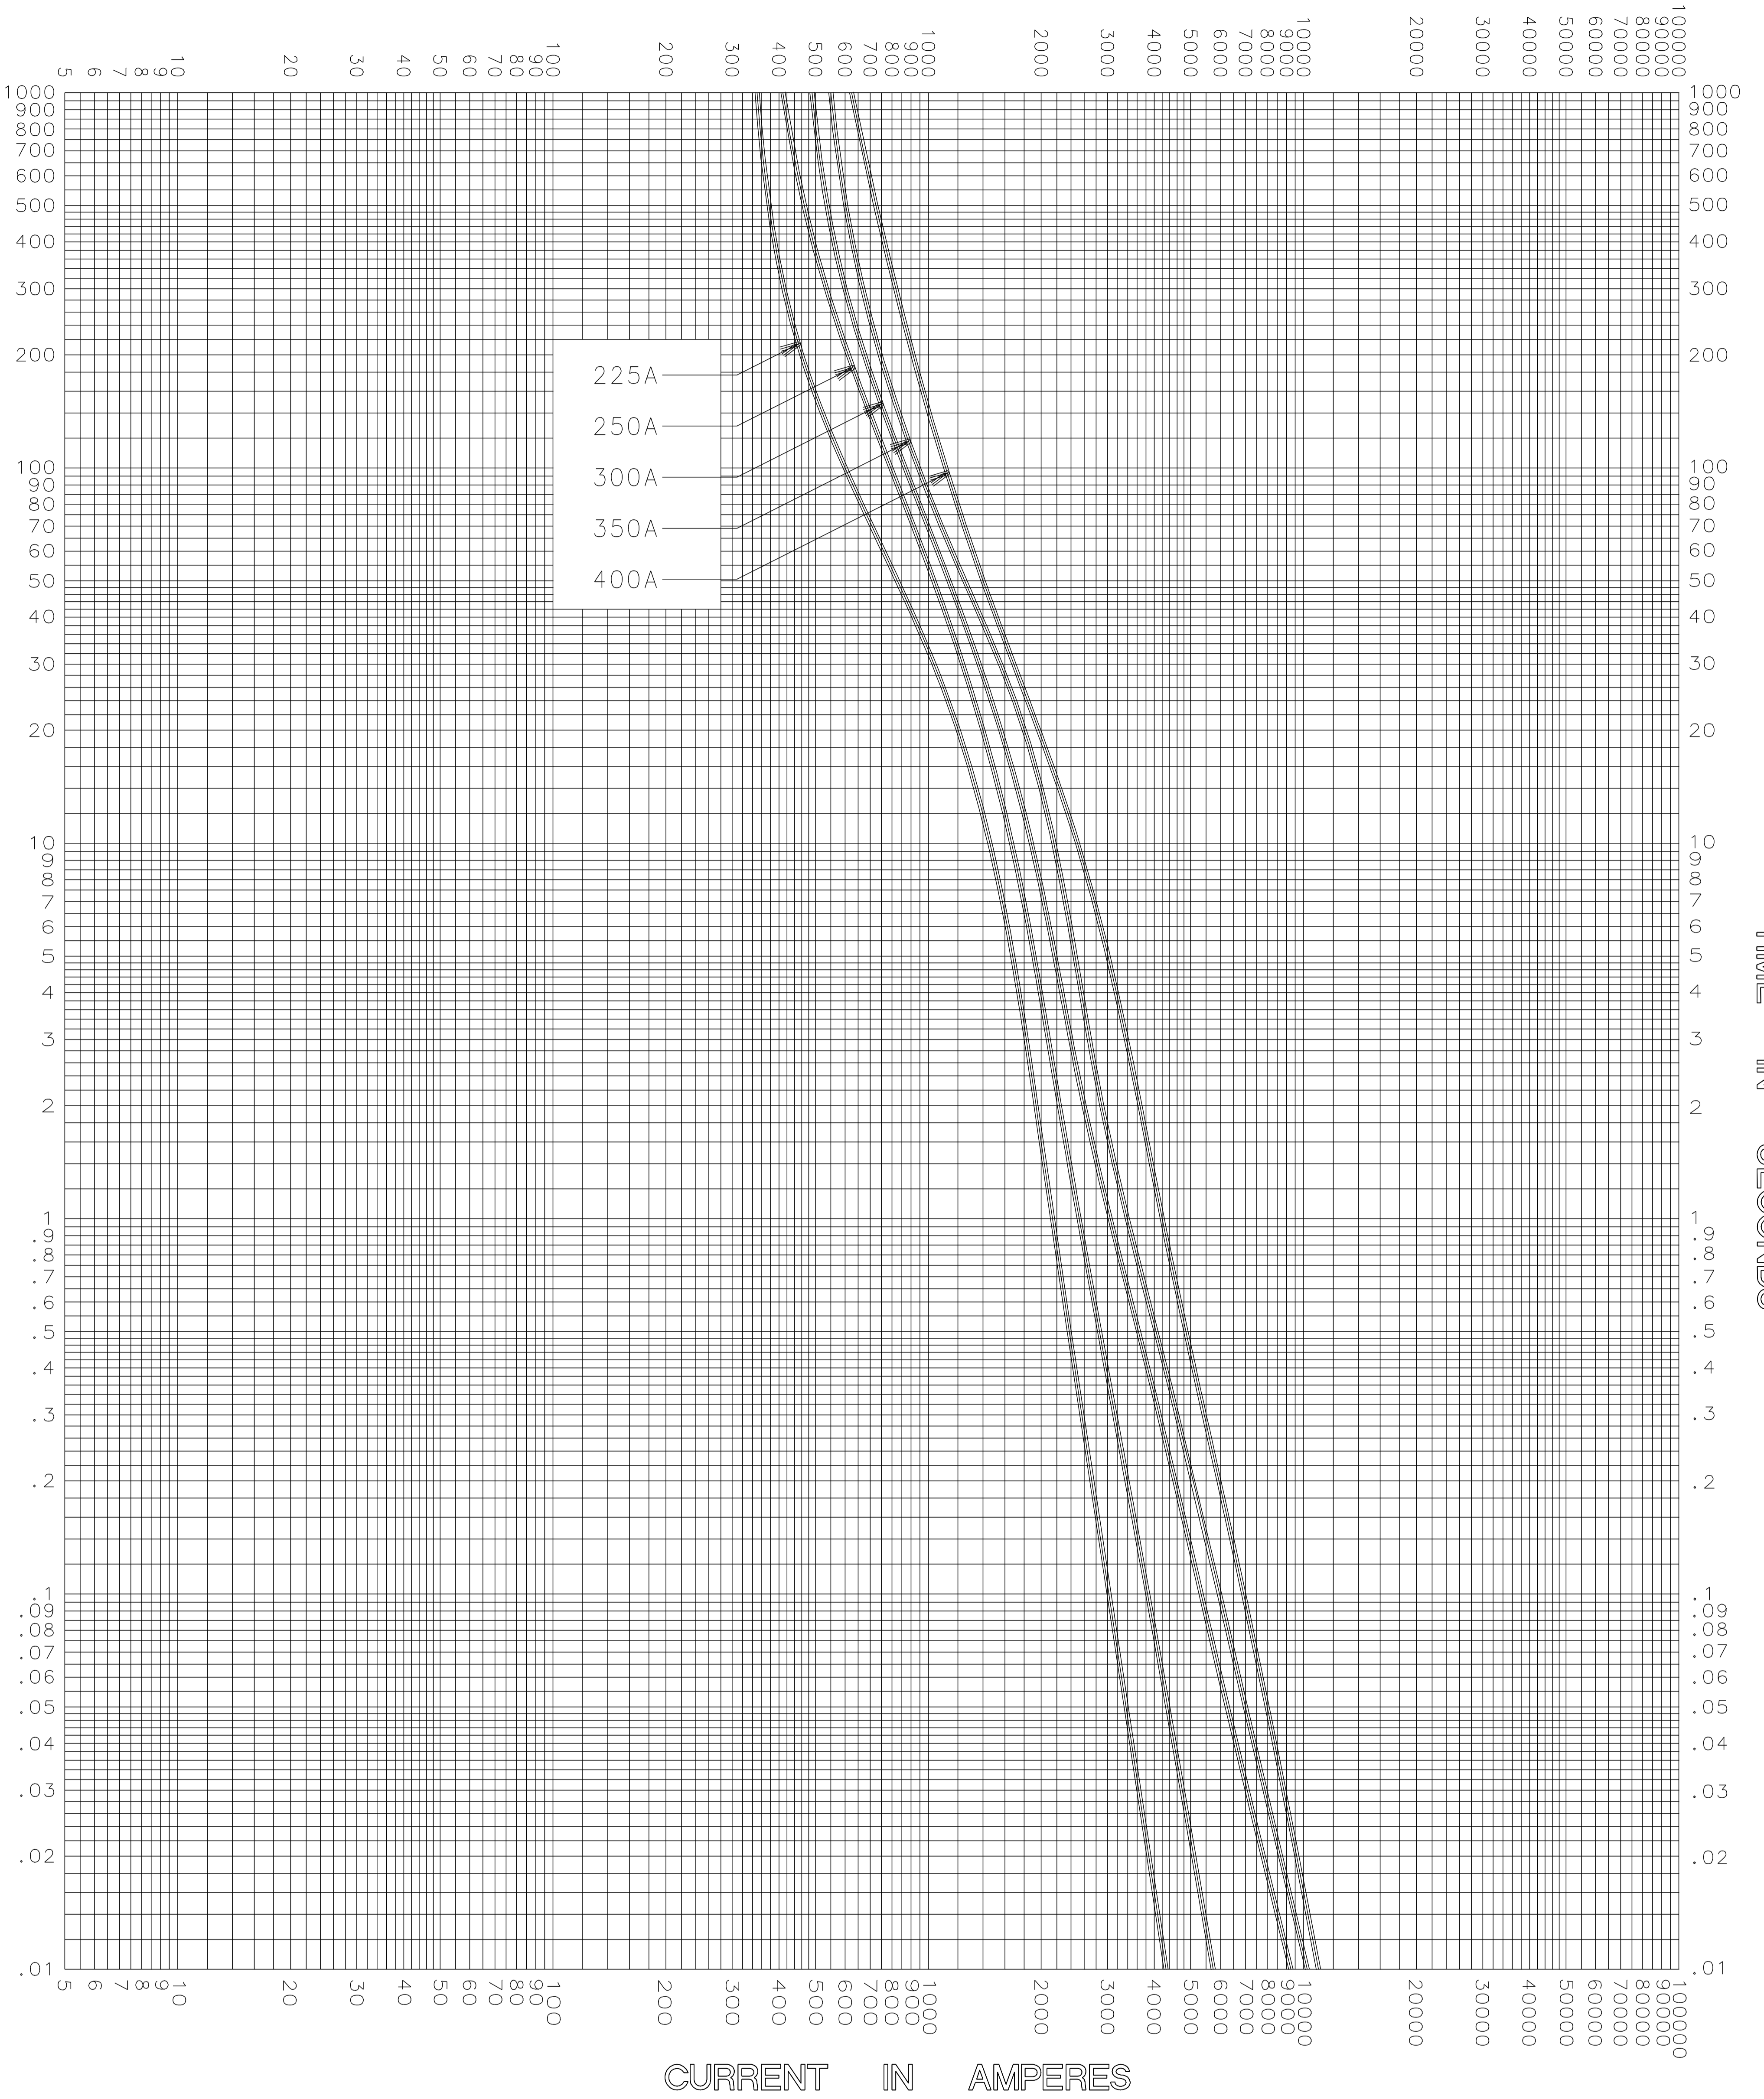

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (225A - 400A)
BASIS FOR DATA _____		



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	05/02/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-FLNR-011
------------------------------------	---------------------------------

-THIS DATA GENERATED ON CAD-


UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

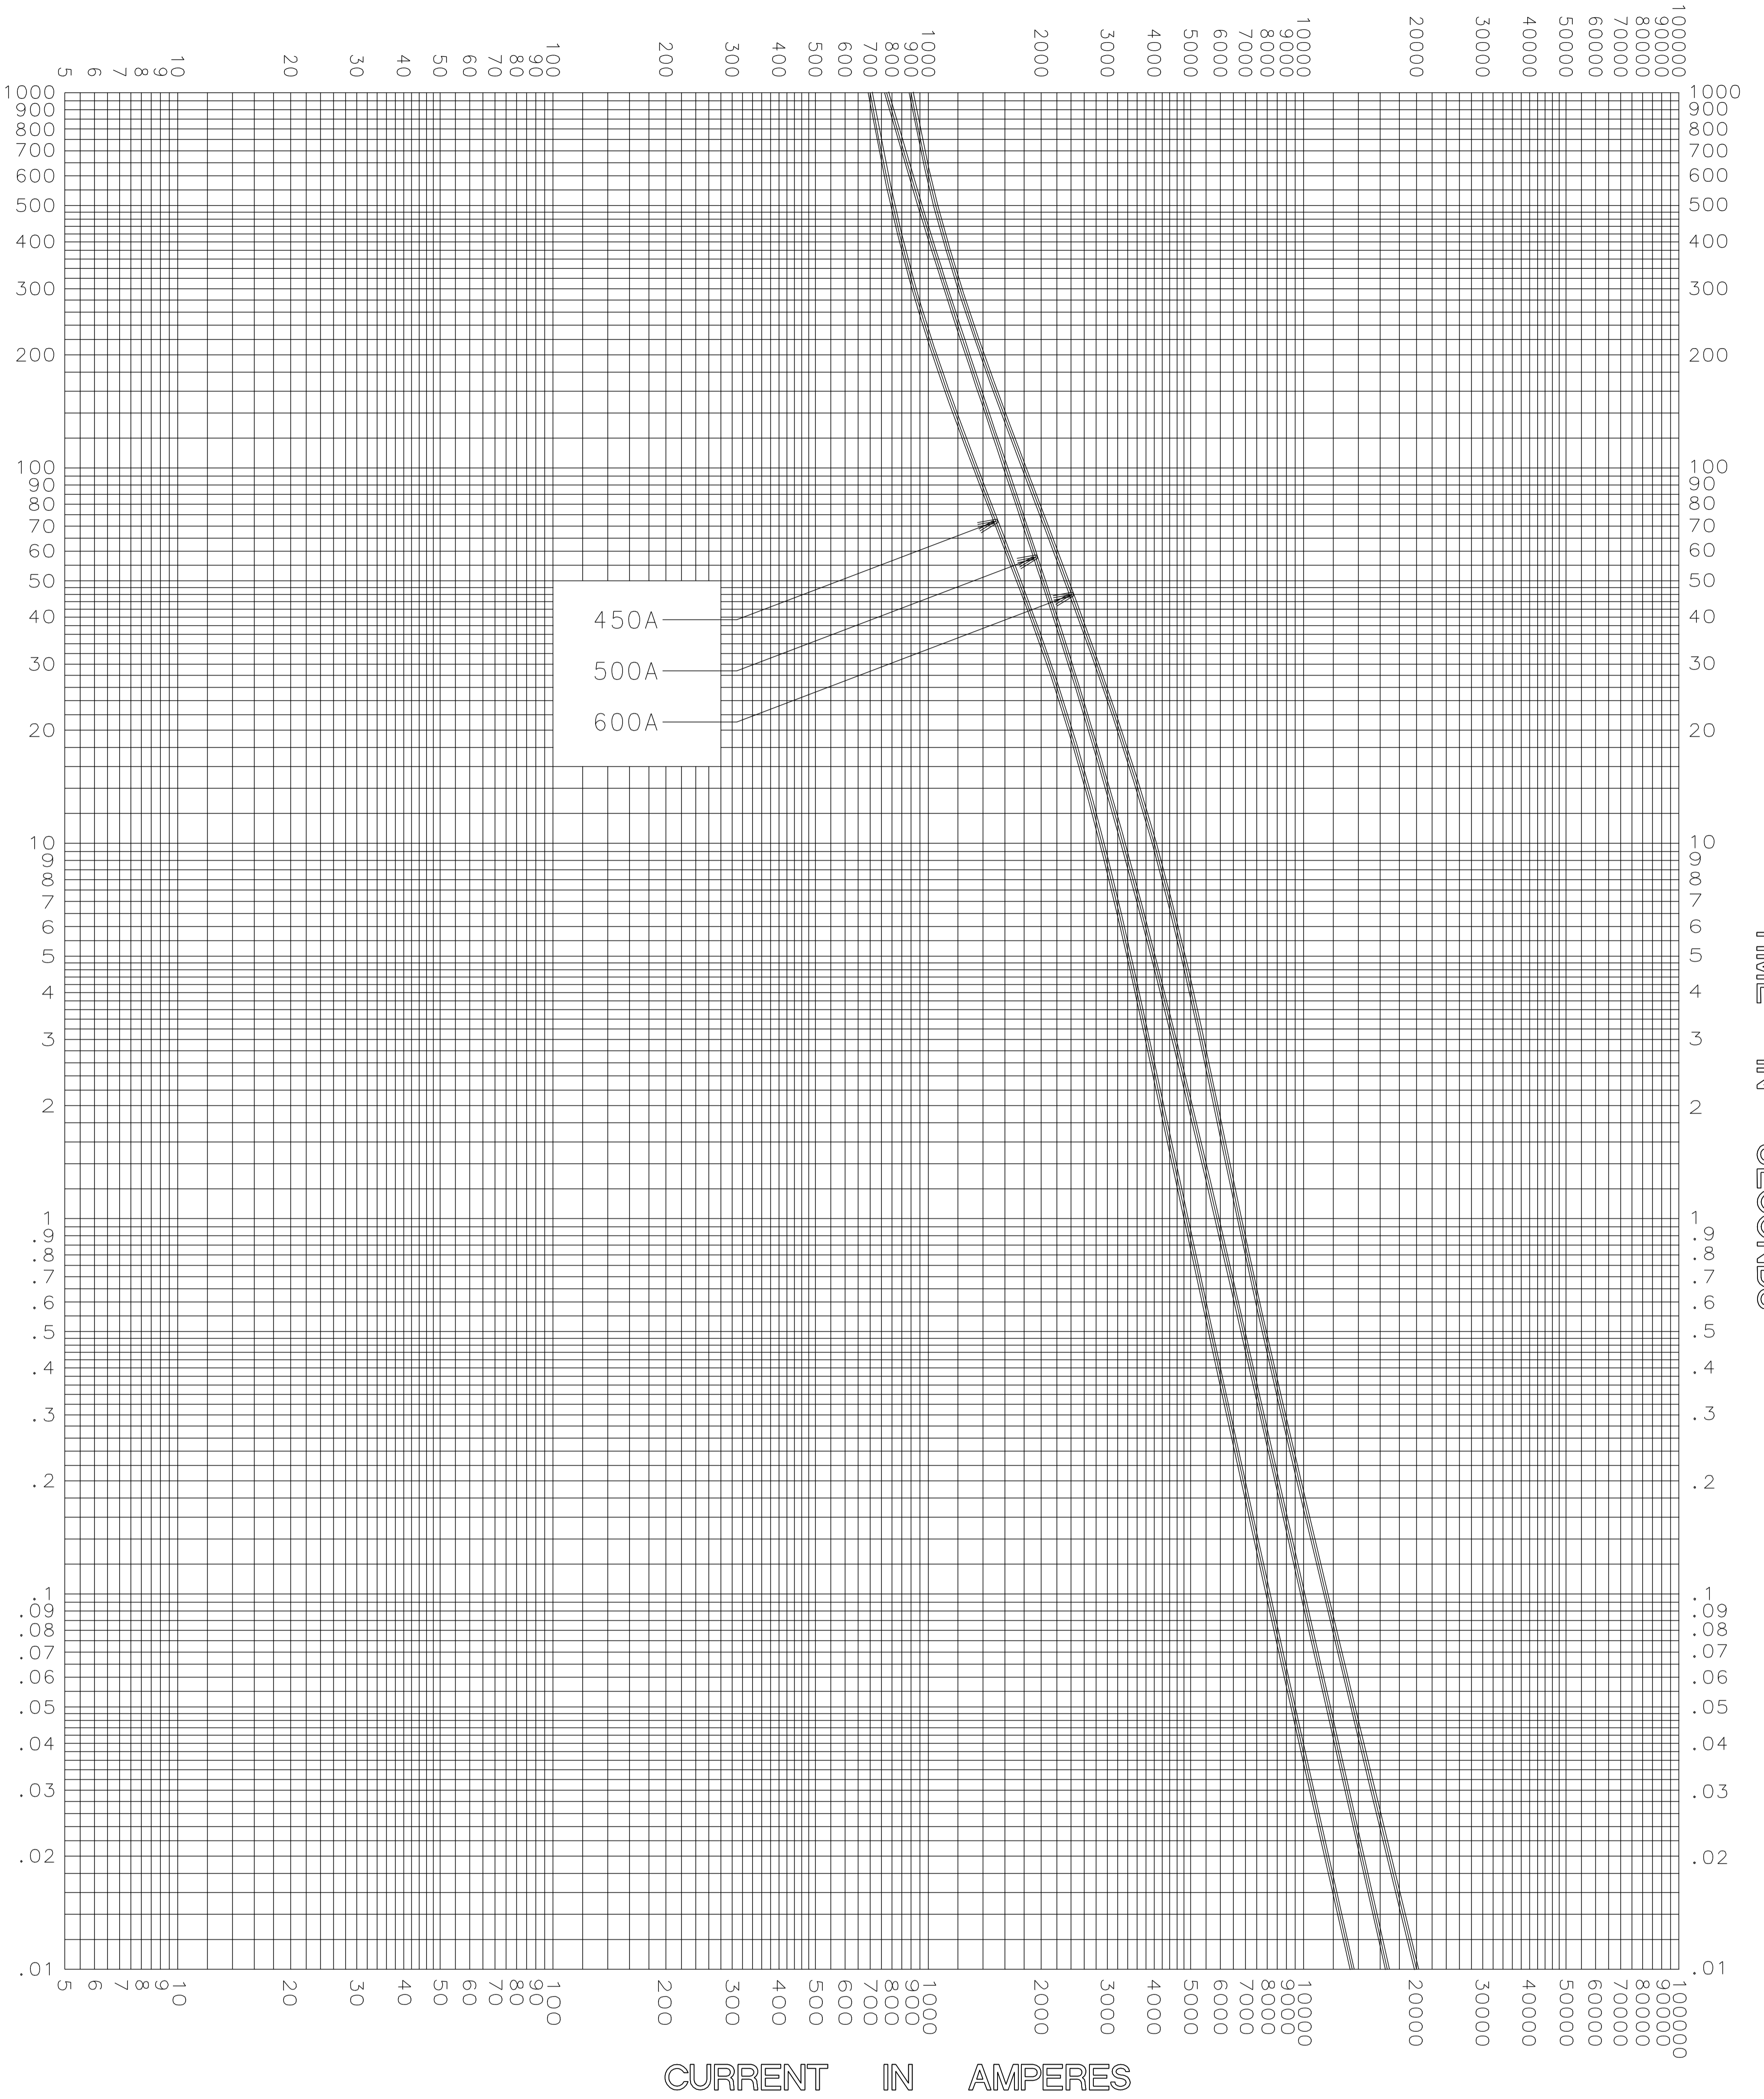

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (450A - 600A)
BASIS FOR DATA _____		


 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY <u>LLL</u> DATE <u>05/02/05</u> CHECKED BY <u>MP</u>
	DRAWING NO. A-FCC01-FLNR-012

TIME CURRENT CHARACTERISTIC CURVES

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

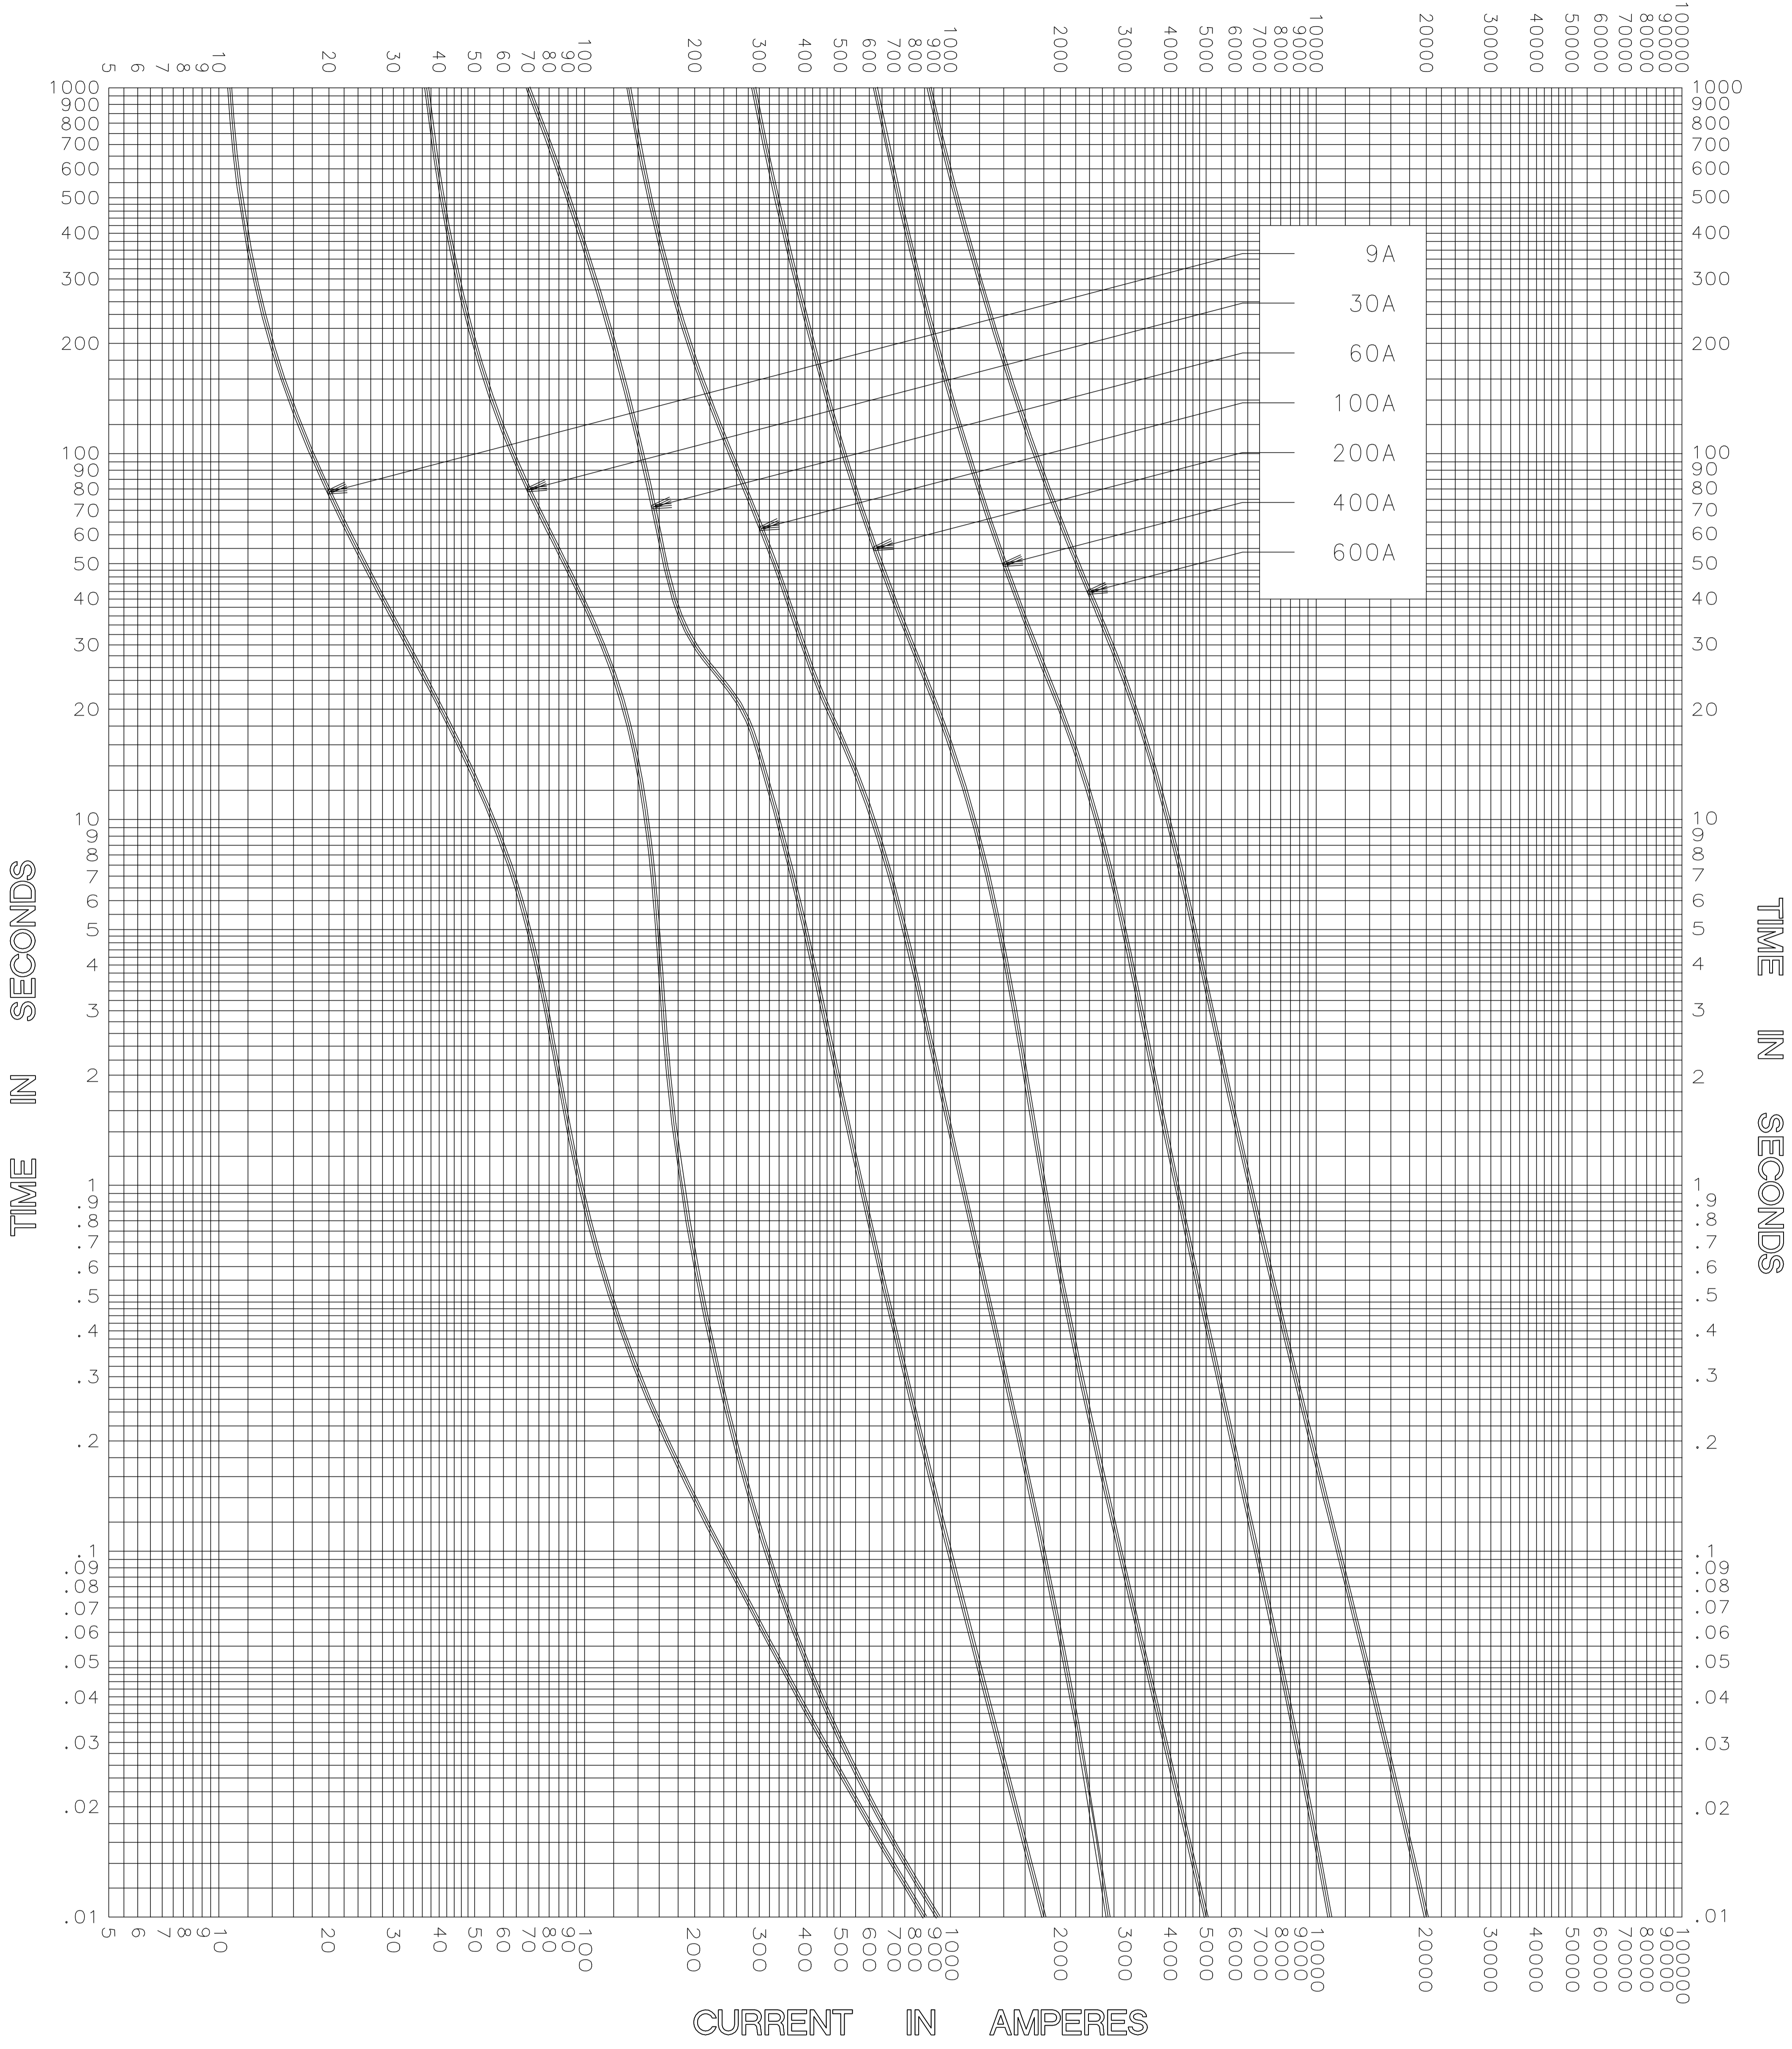

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER FLNR (9A - 600A)
BASIS FOR DATA _____	



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 05/02/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC013

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT