



CURRENT IN AMPERES

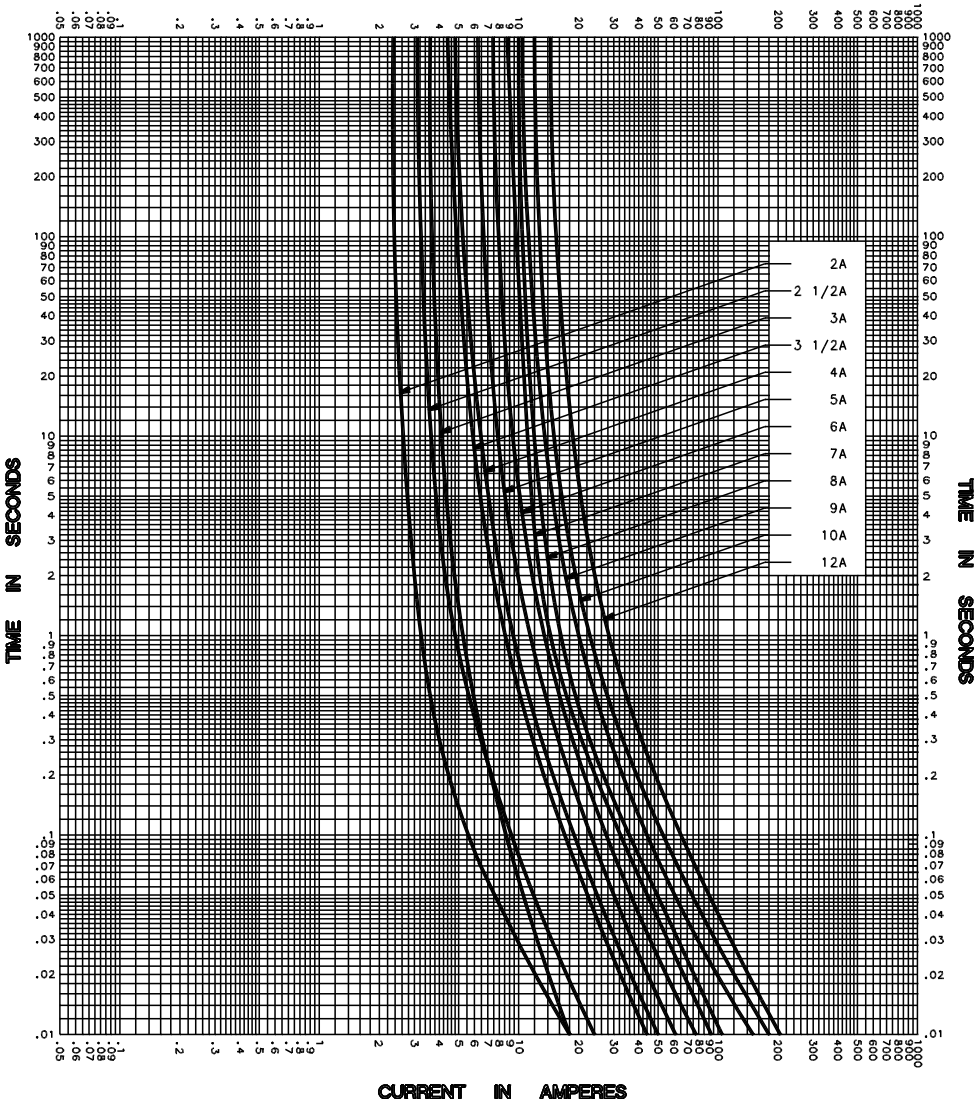


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	KLK (2A - 12A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/08/05</u>
TIME CURRENT CHARACTERISTIC CURVES	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC002</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

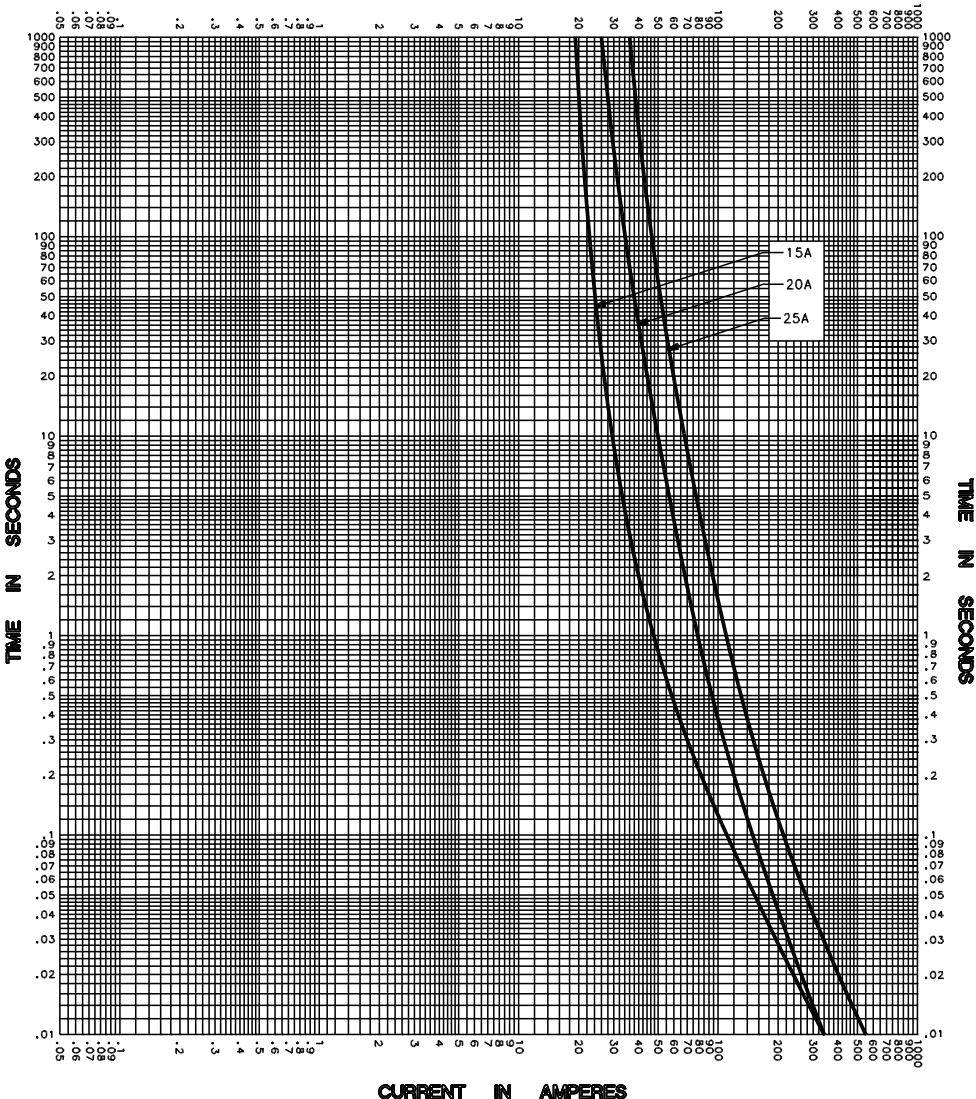

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (15A - 25A)
BASIS FOR DATA _____		

 LITTELFUSE, INC. DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>04/08/05</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>A-FCC003</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

