
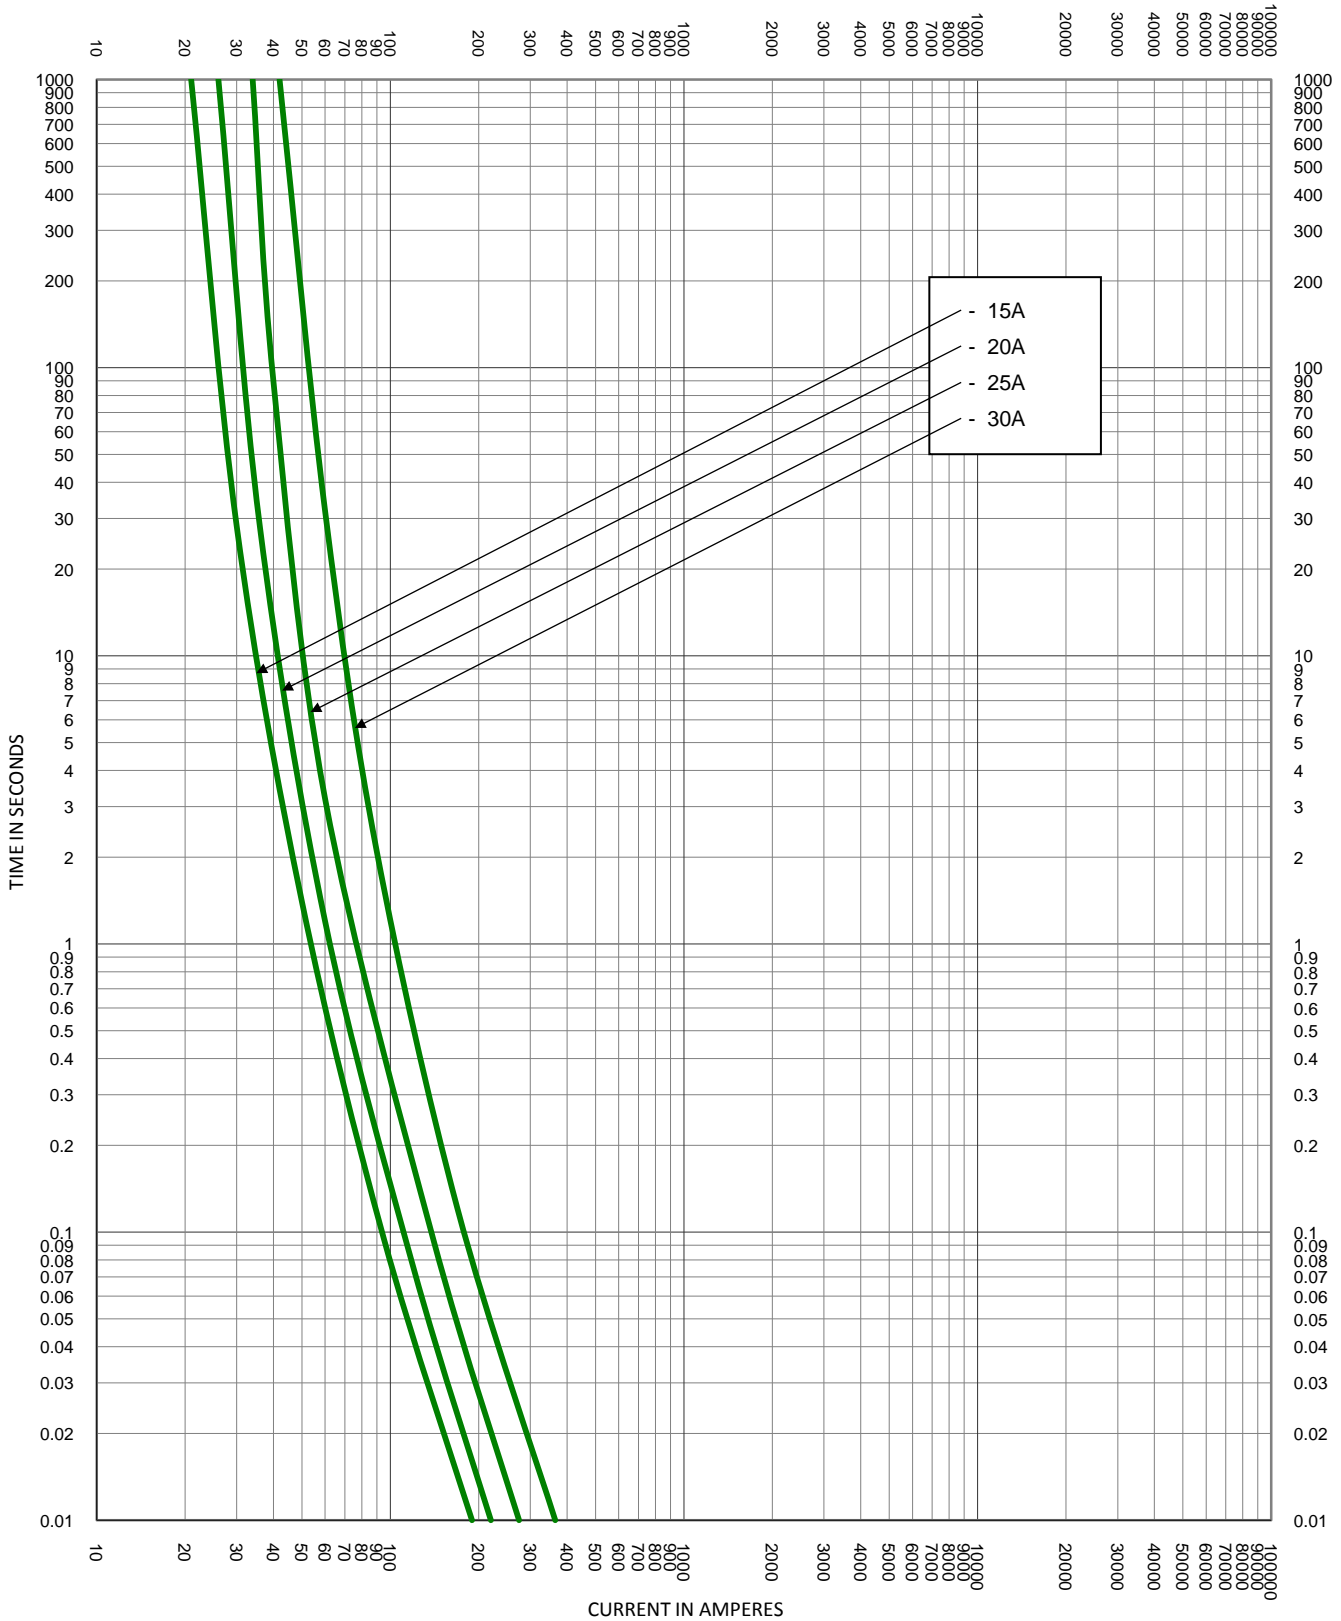

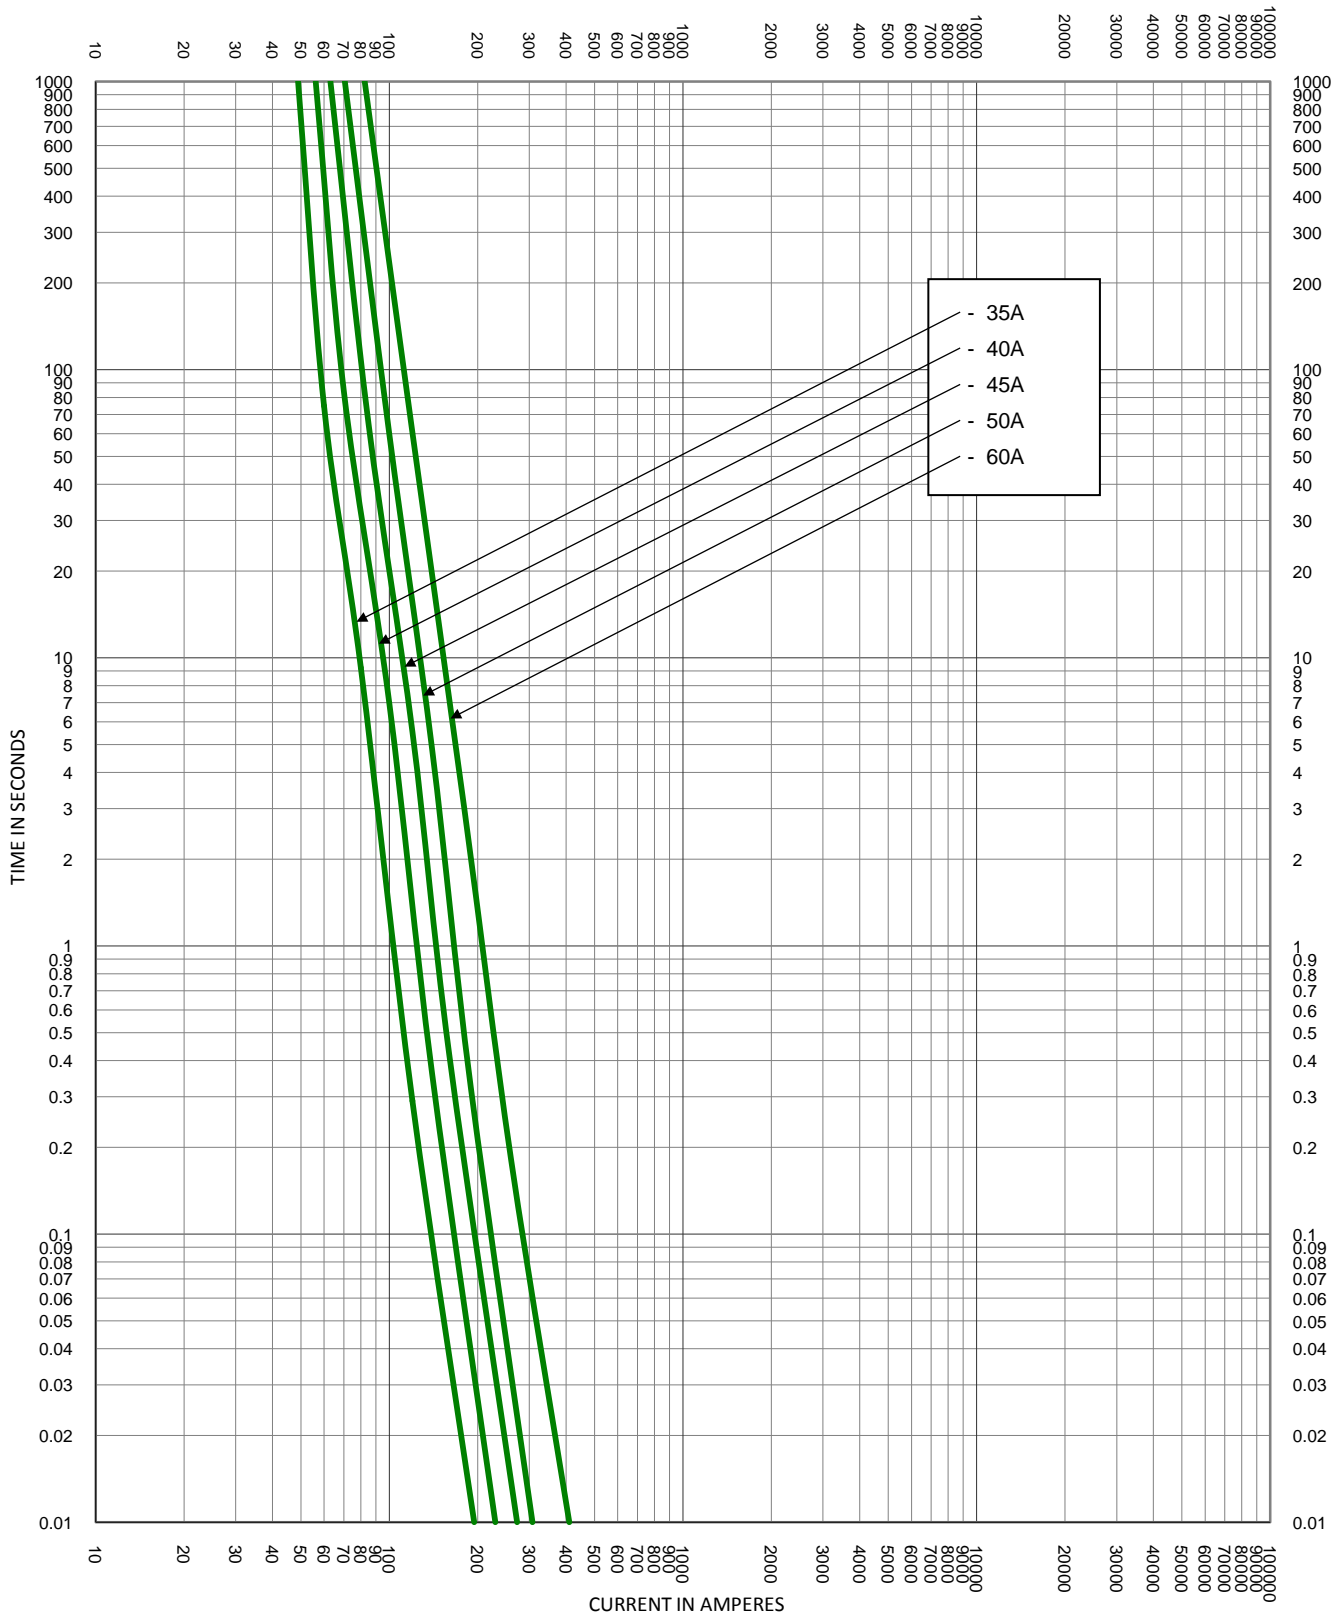



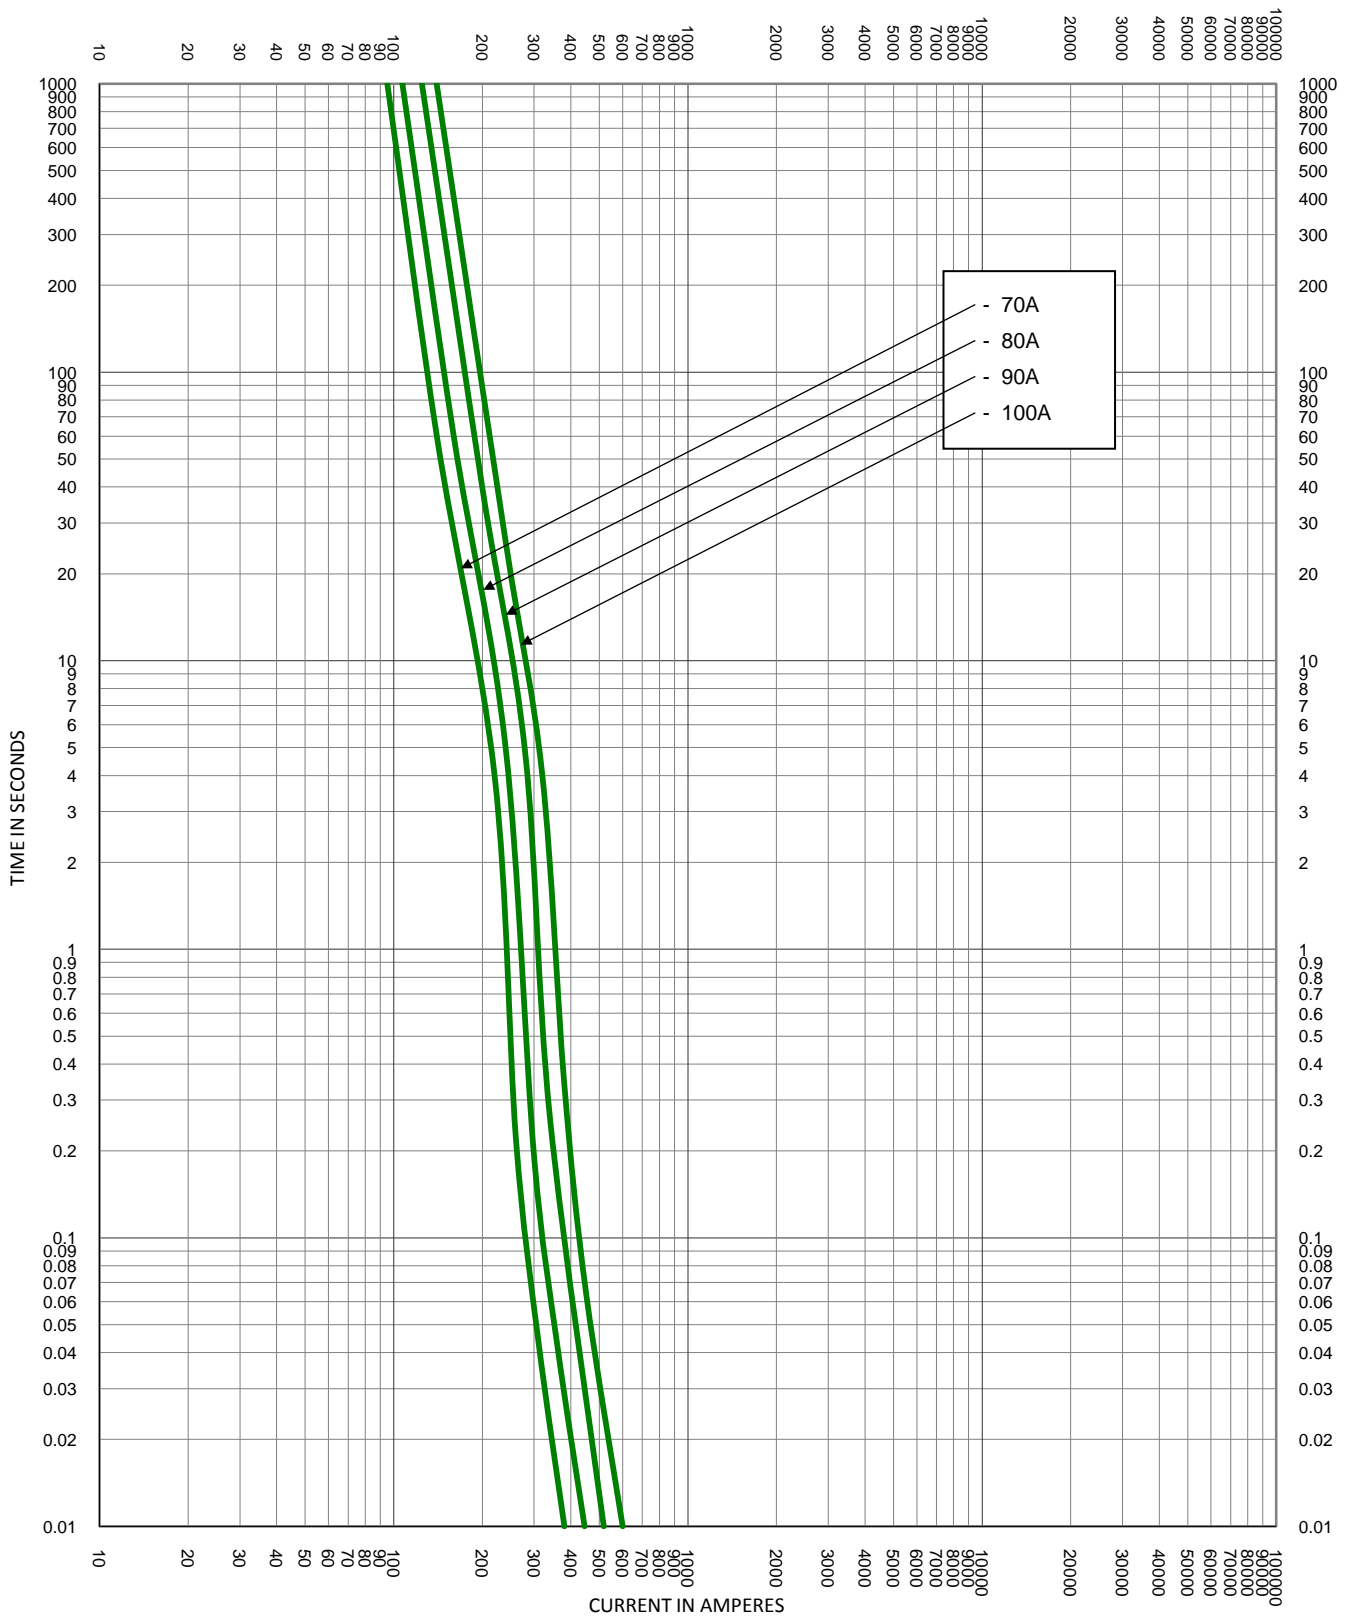
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL DATE: 03/19/14 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLLN SHEET 2 OF 8




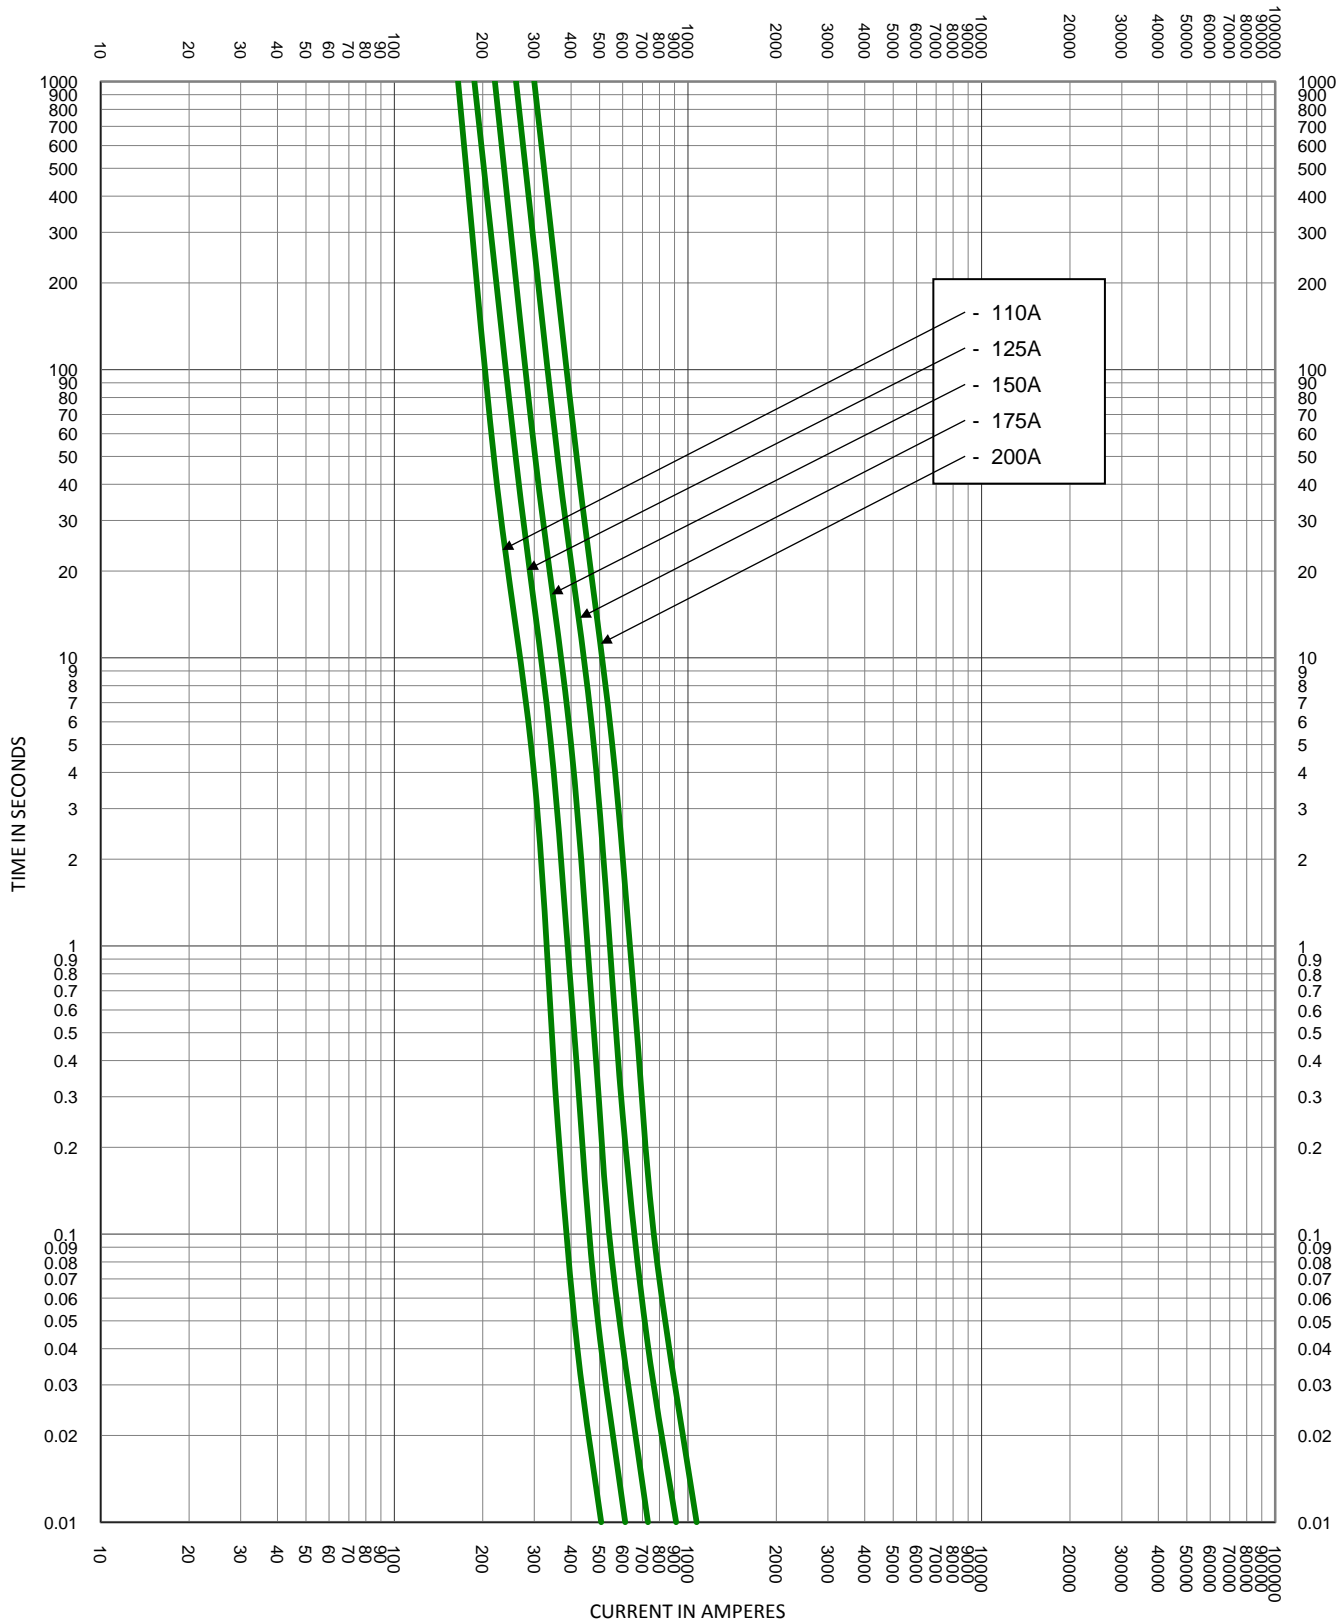
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL
		DATE: 03/19/14
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A
		DRAWING NO.: SHEET 3 OF 8
		FCC01-JLLN




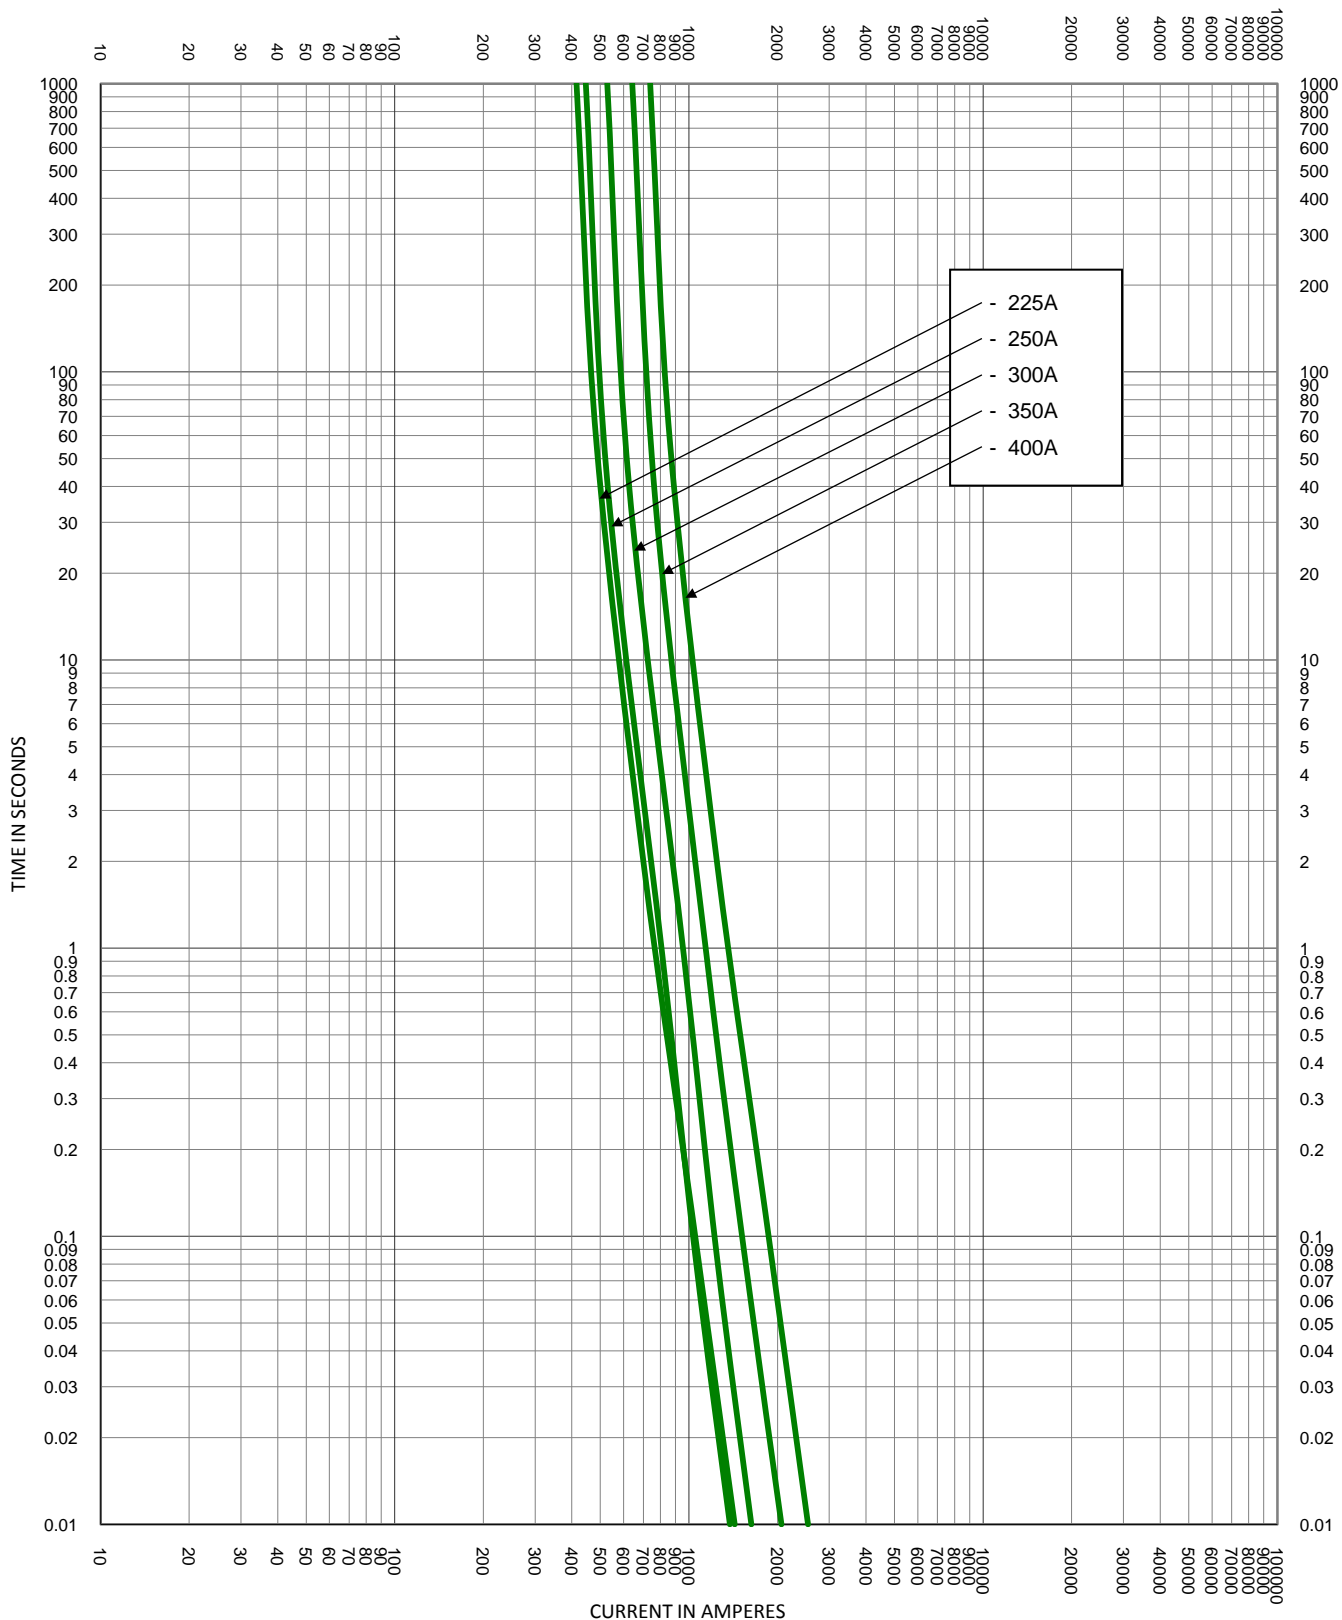
TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL DATE: 03/19/14 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLLN SHEET 4 OF 8




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL DATE: 03/19/14 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLLN SHEET 5 OF 8




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
		DRAWN BY: LLL
		DATE: 03/19/14
TIME CURRENT CHARACTERISTIC CURVES		REVISION: A
		DRAWING NO.: SHEET 6 OF 8
		FCC01-JLLN




TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A

	DRAWN BY: LLL DATE: 03/19/14 REVISION: A
	DRAWING NO.: FCC01-JLLN SHEET 7 OF 8

TIME CURRENT CHARACTERISTIC CURVES

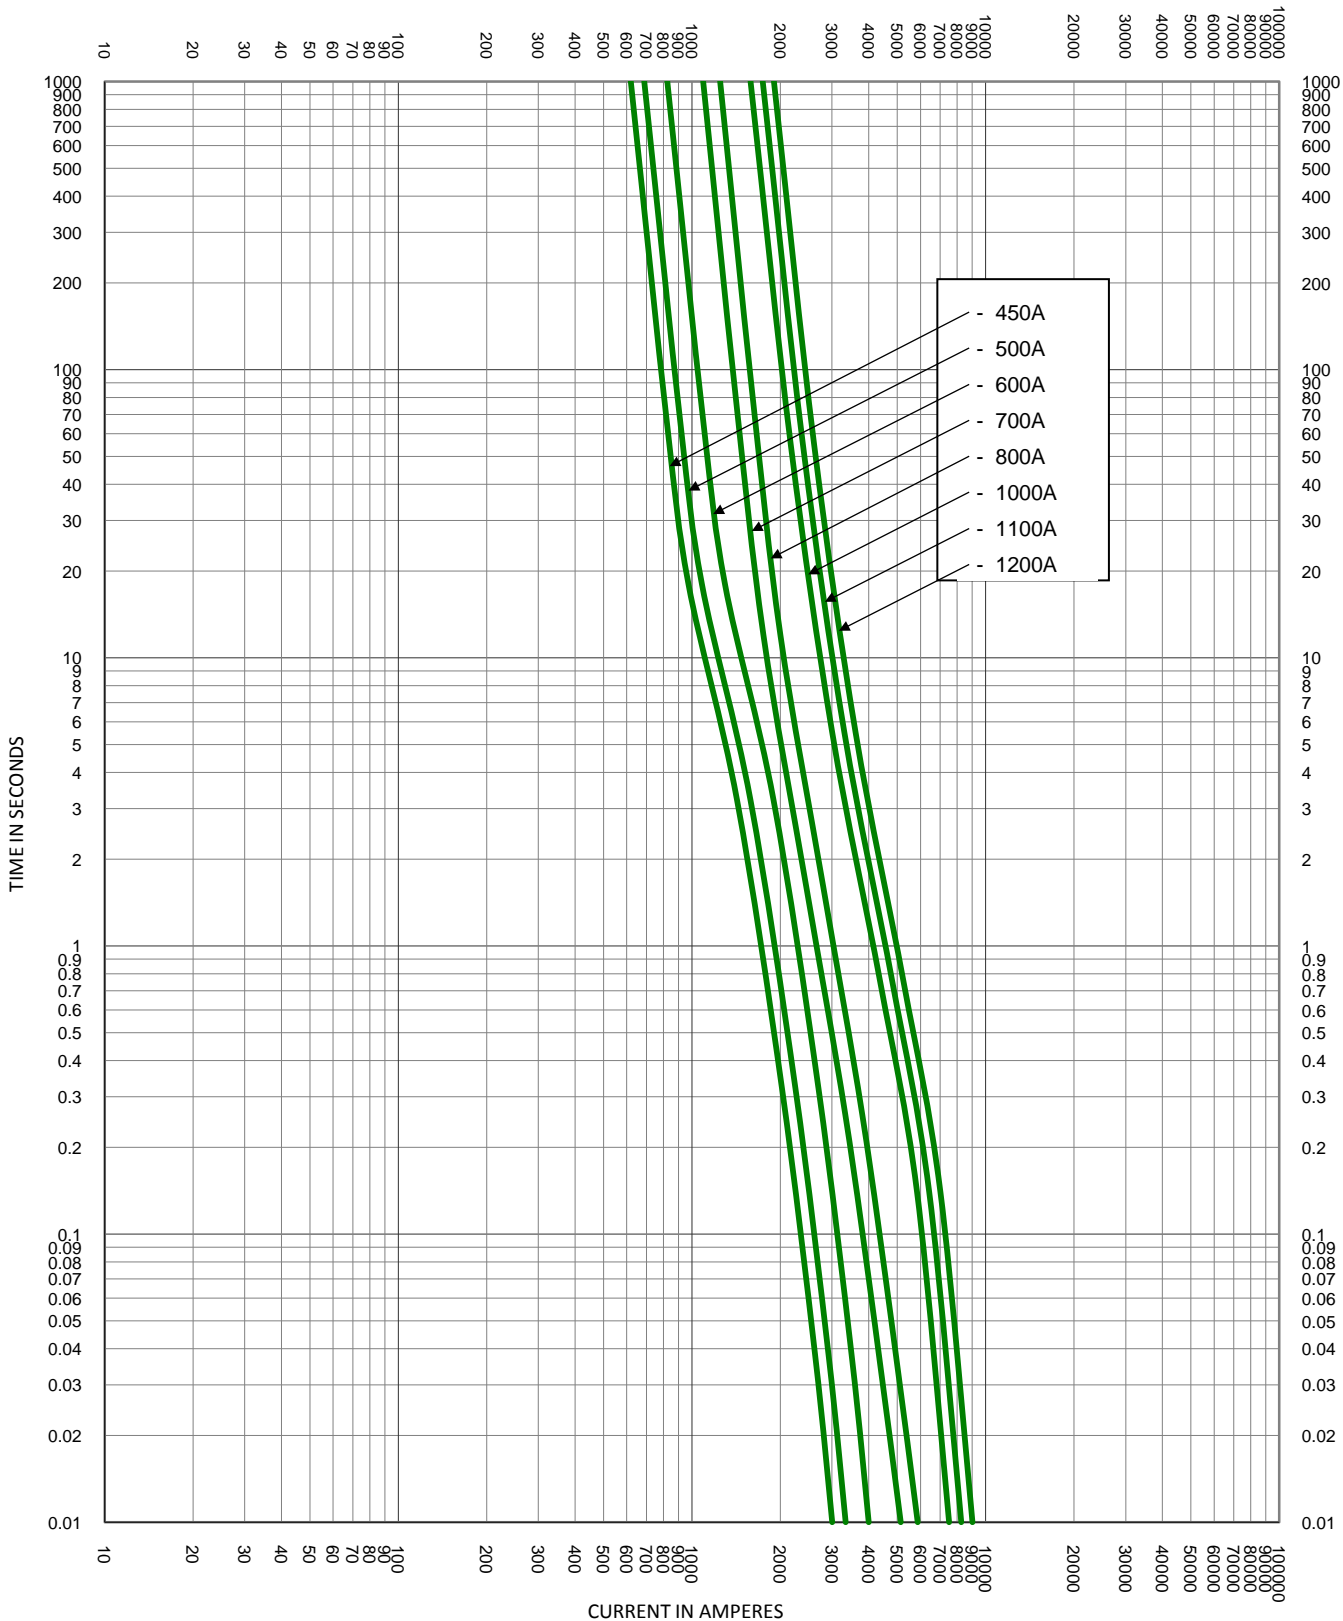

TEST VOLTAGE:	TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:		JLLN 1A - 1200A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 3/19/14 REVISION: A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: FCC01-JLLN SHEET 8 OF 8