


CURRENT IN AMPERES

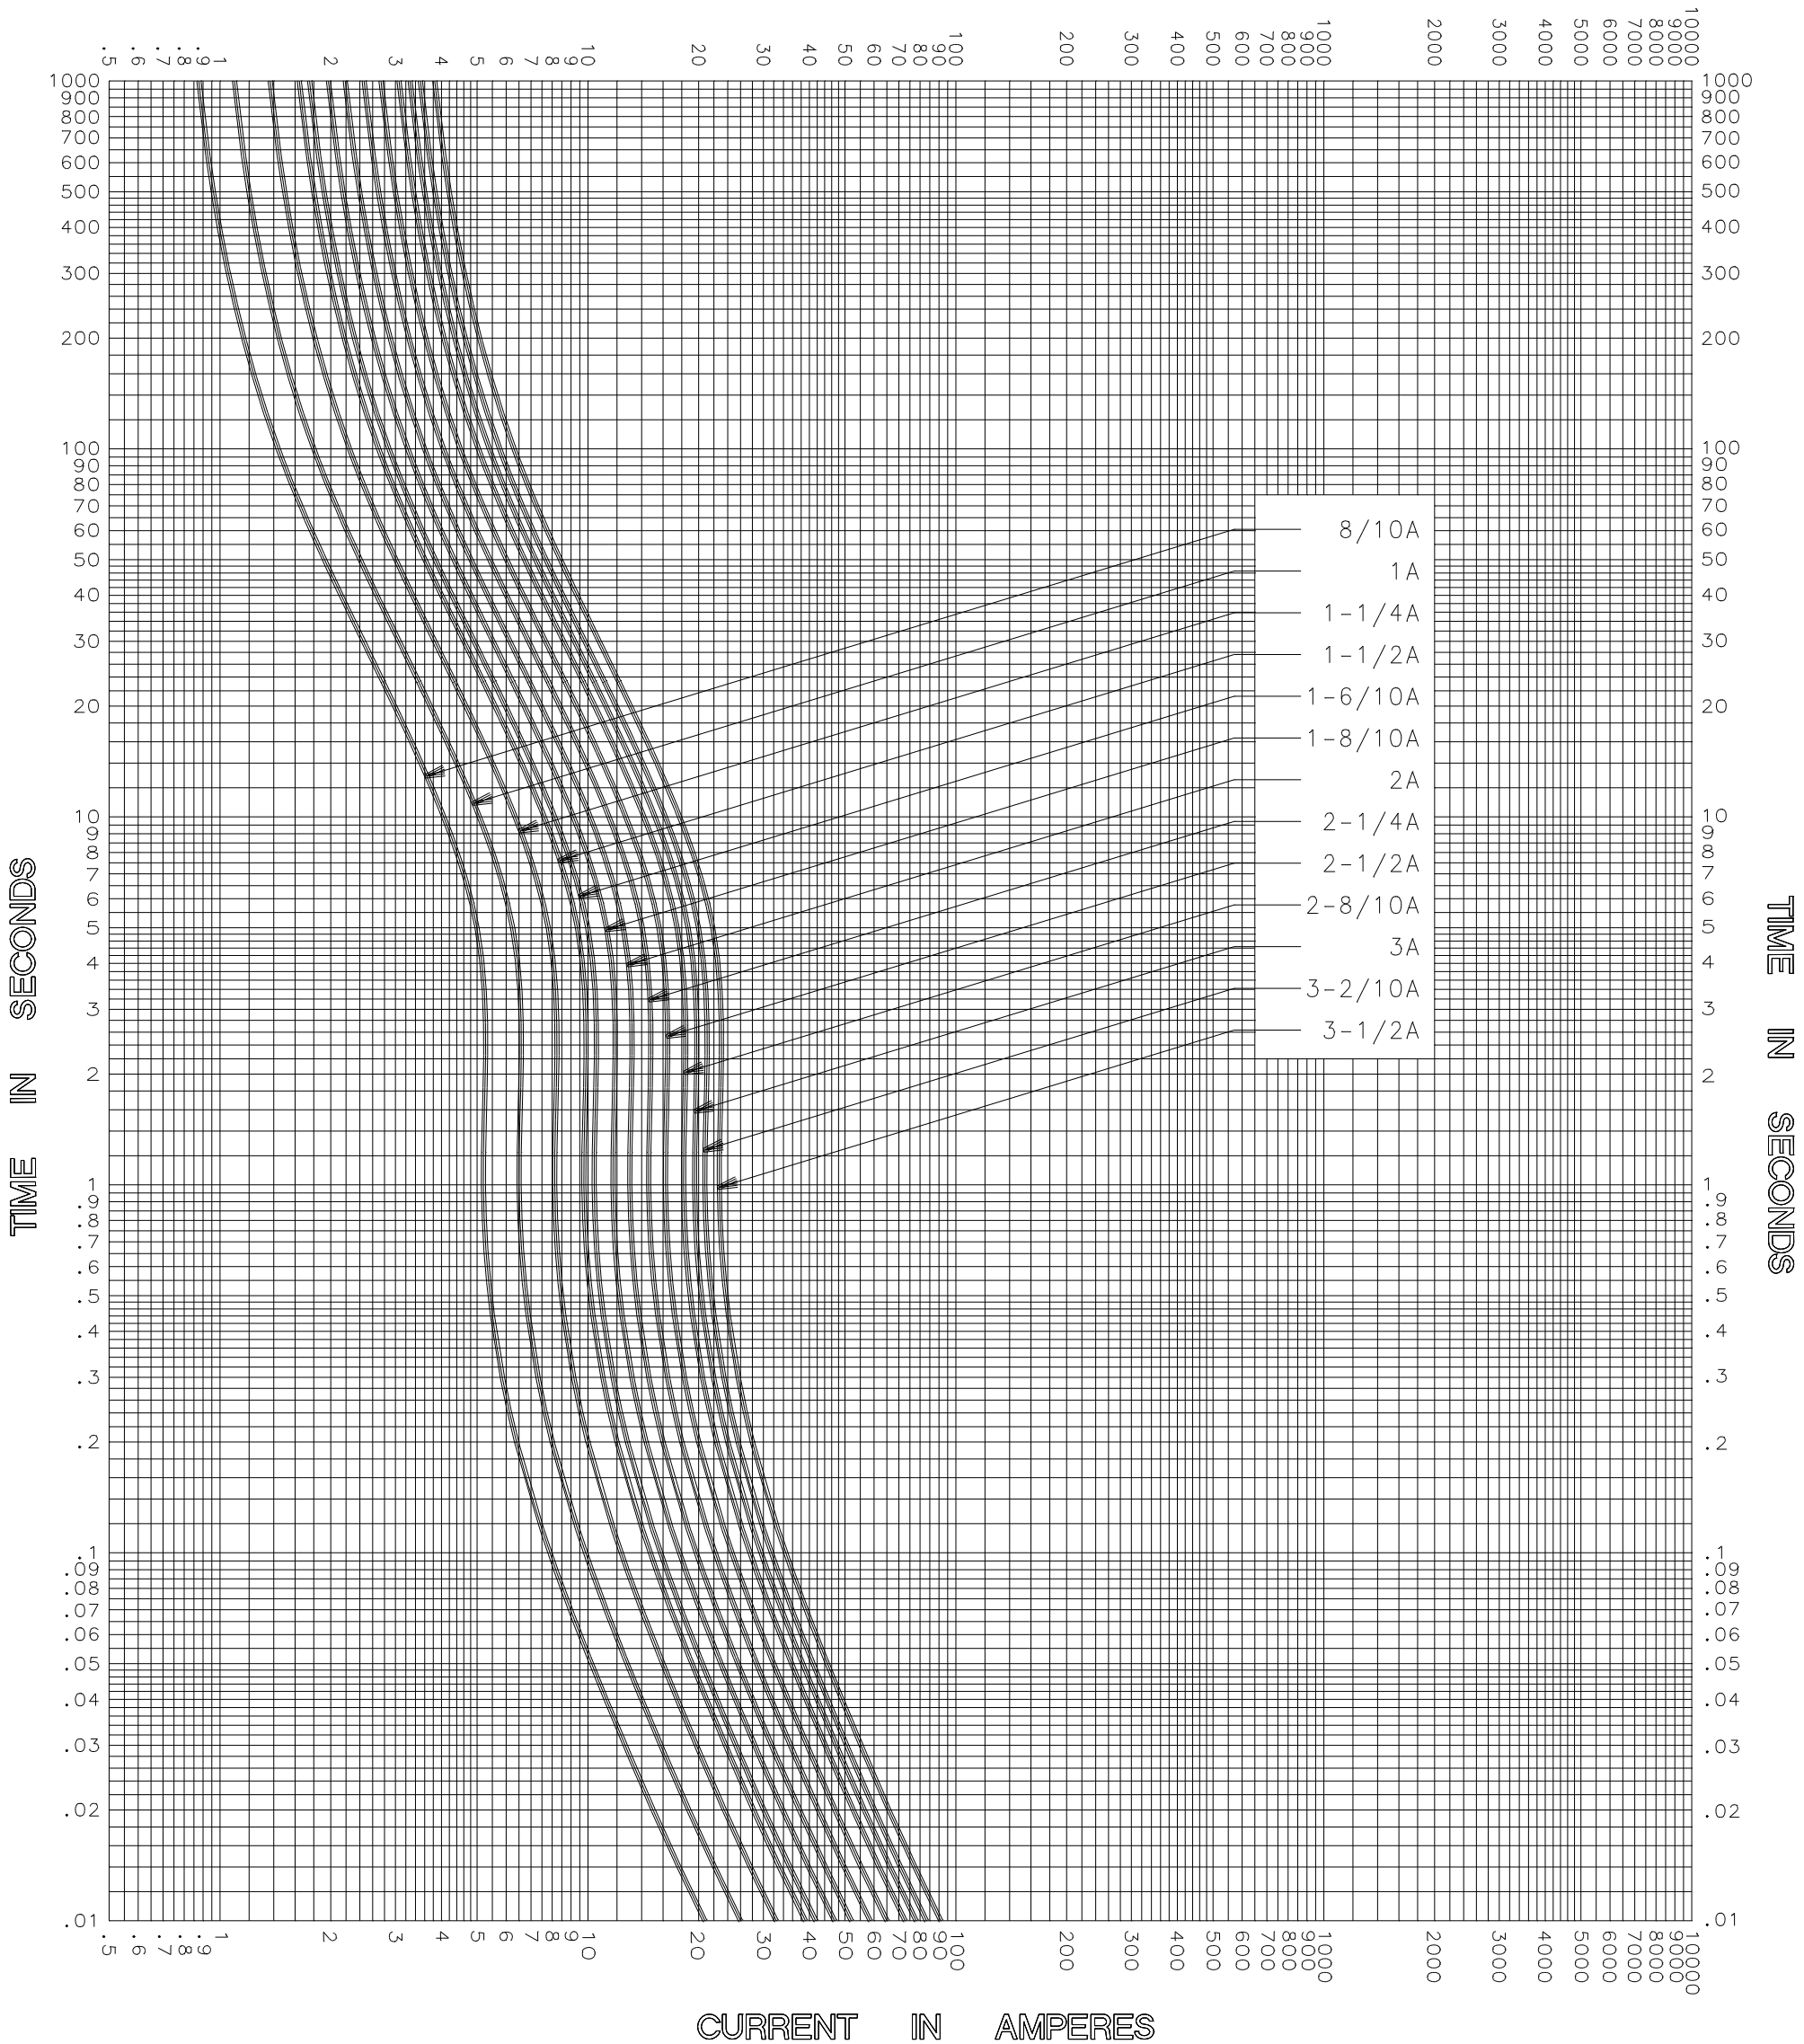

CURRENT IN AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		JTD (8/10A - 3-1/2A) ID

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>A-FCC01-1013</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

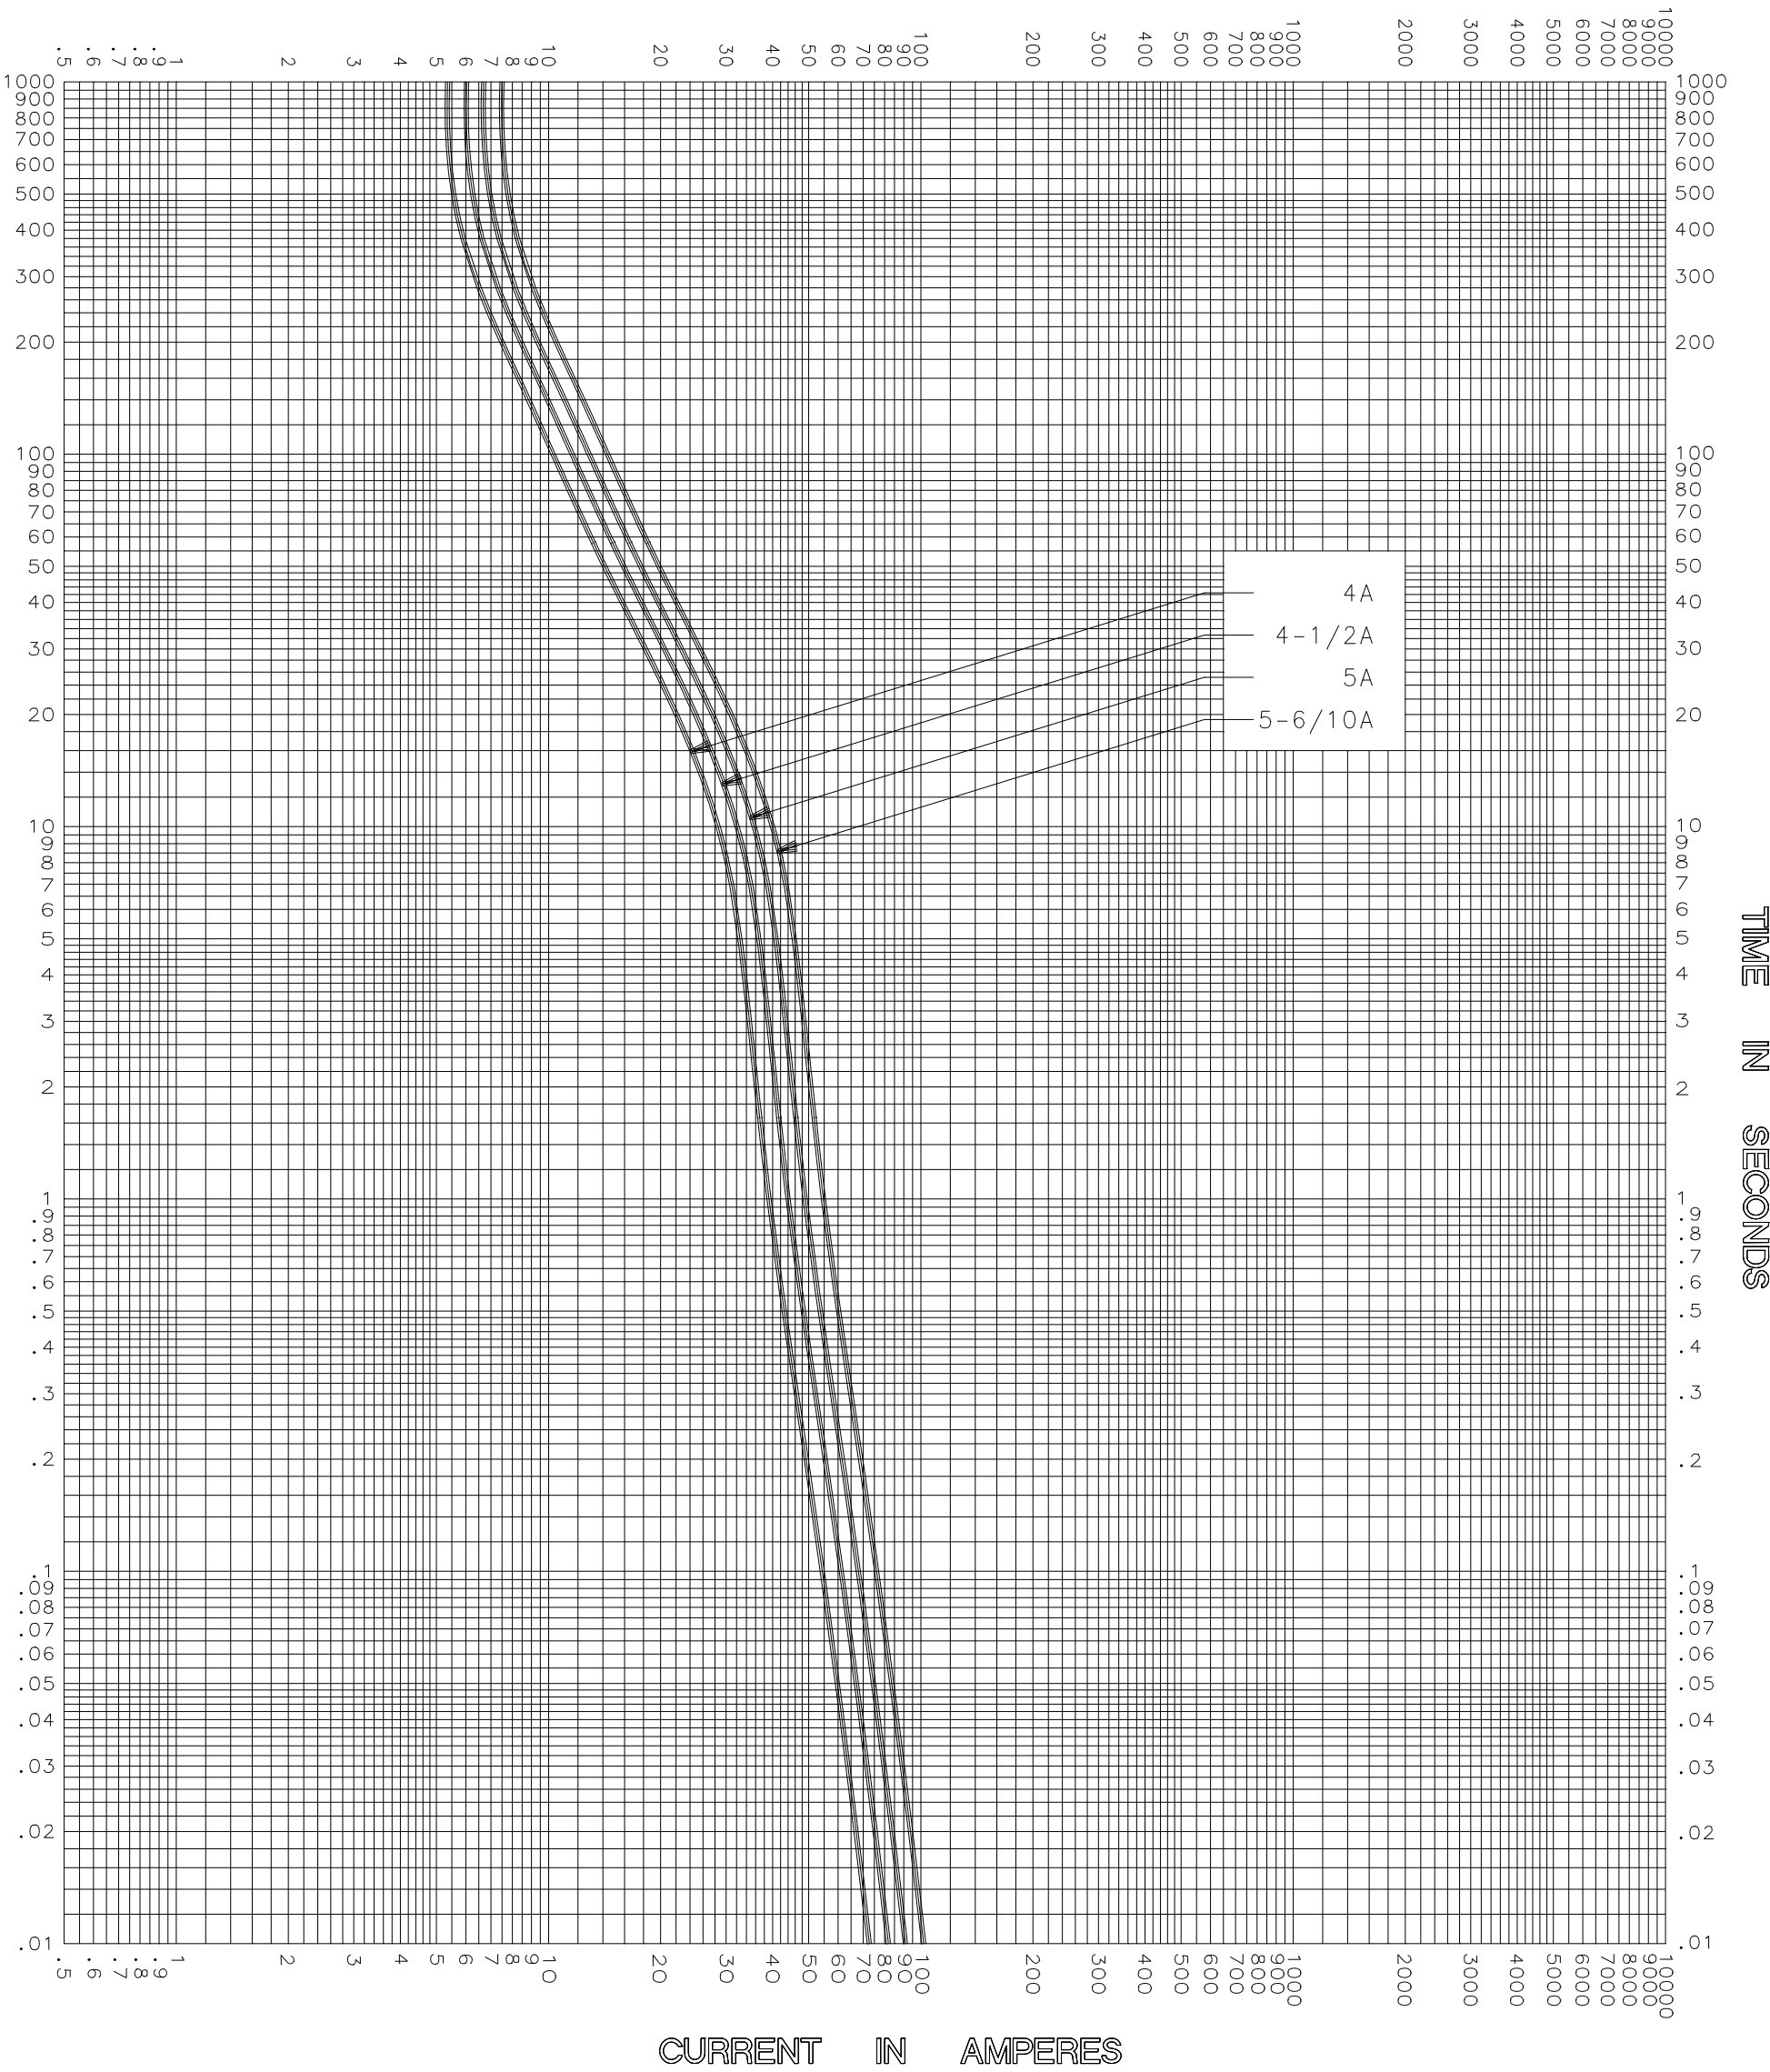


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER JTD (4A - 5-6/10A) ID
BASIS FOR DATA _____		

 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-1/02

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

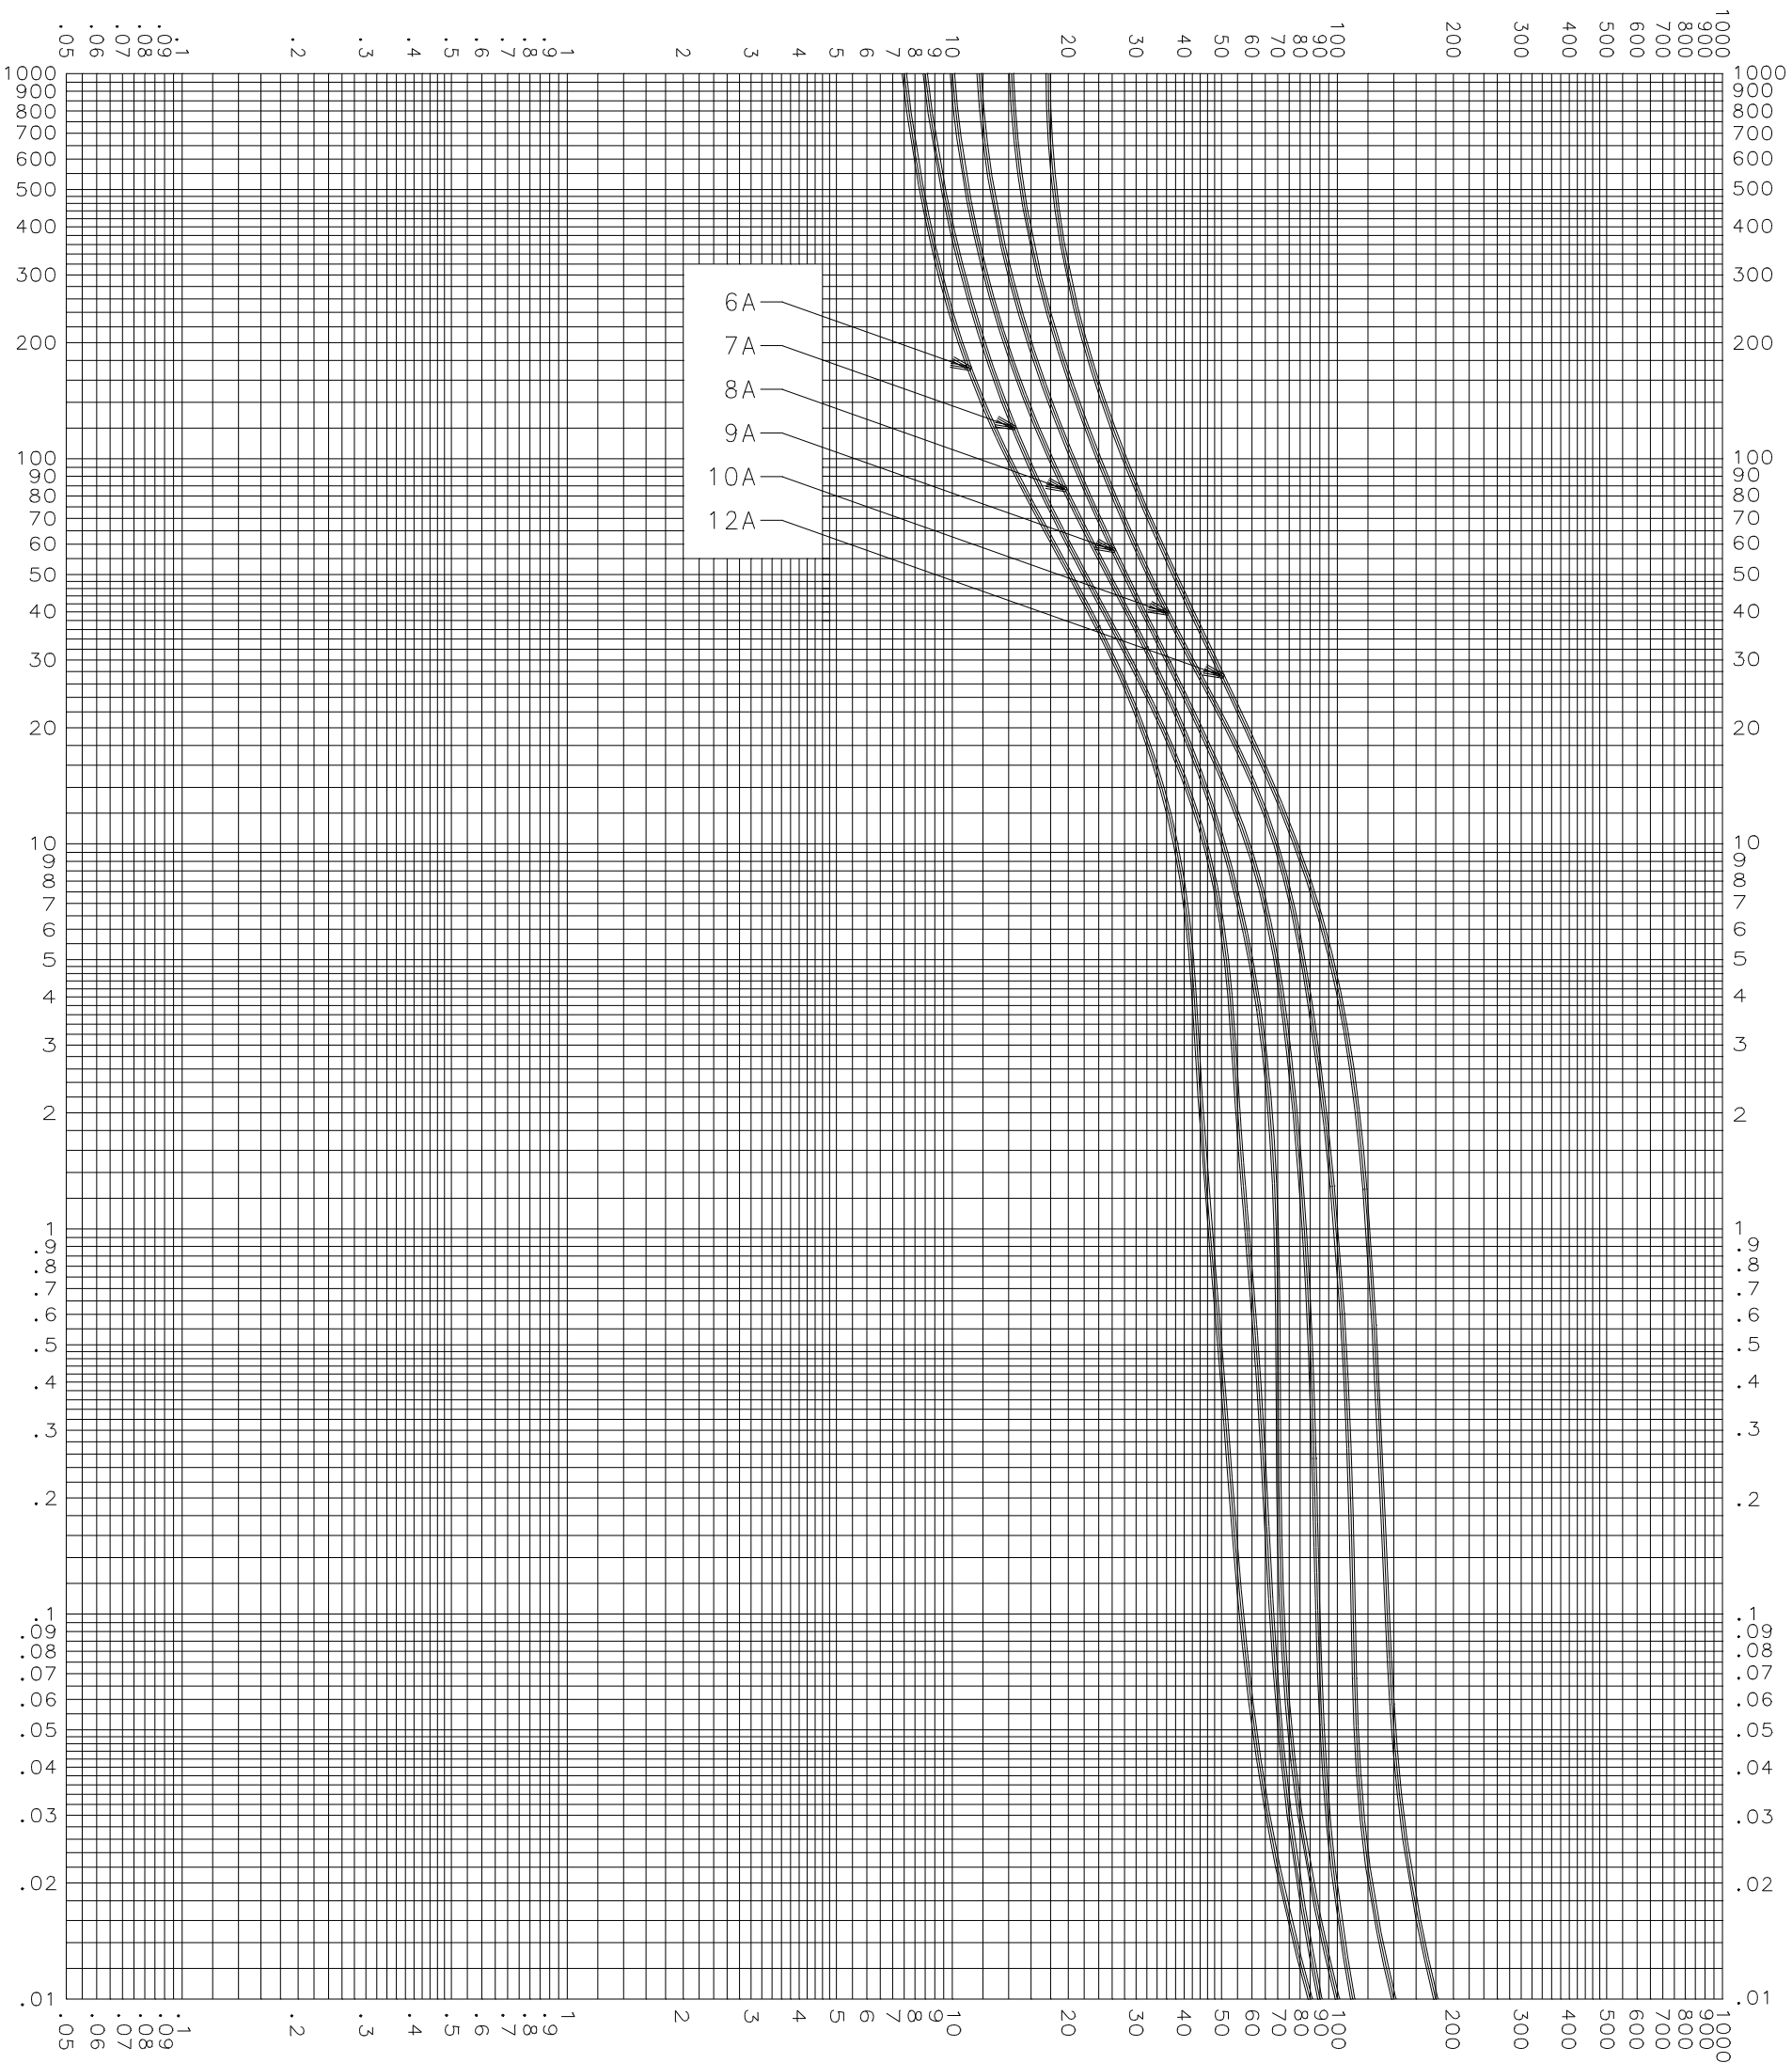

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER JTD (6A - 12A) ID
BASIS FOR DATA _____		




LITTELFUSE, INC.  
DES PLAINES, ILL. USA

DRAWN BY	LLL
DATE	01/07/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-JTDID-003
------------------------------------	----------------------------------

CURRENT IN AMPERES

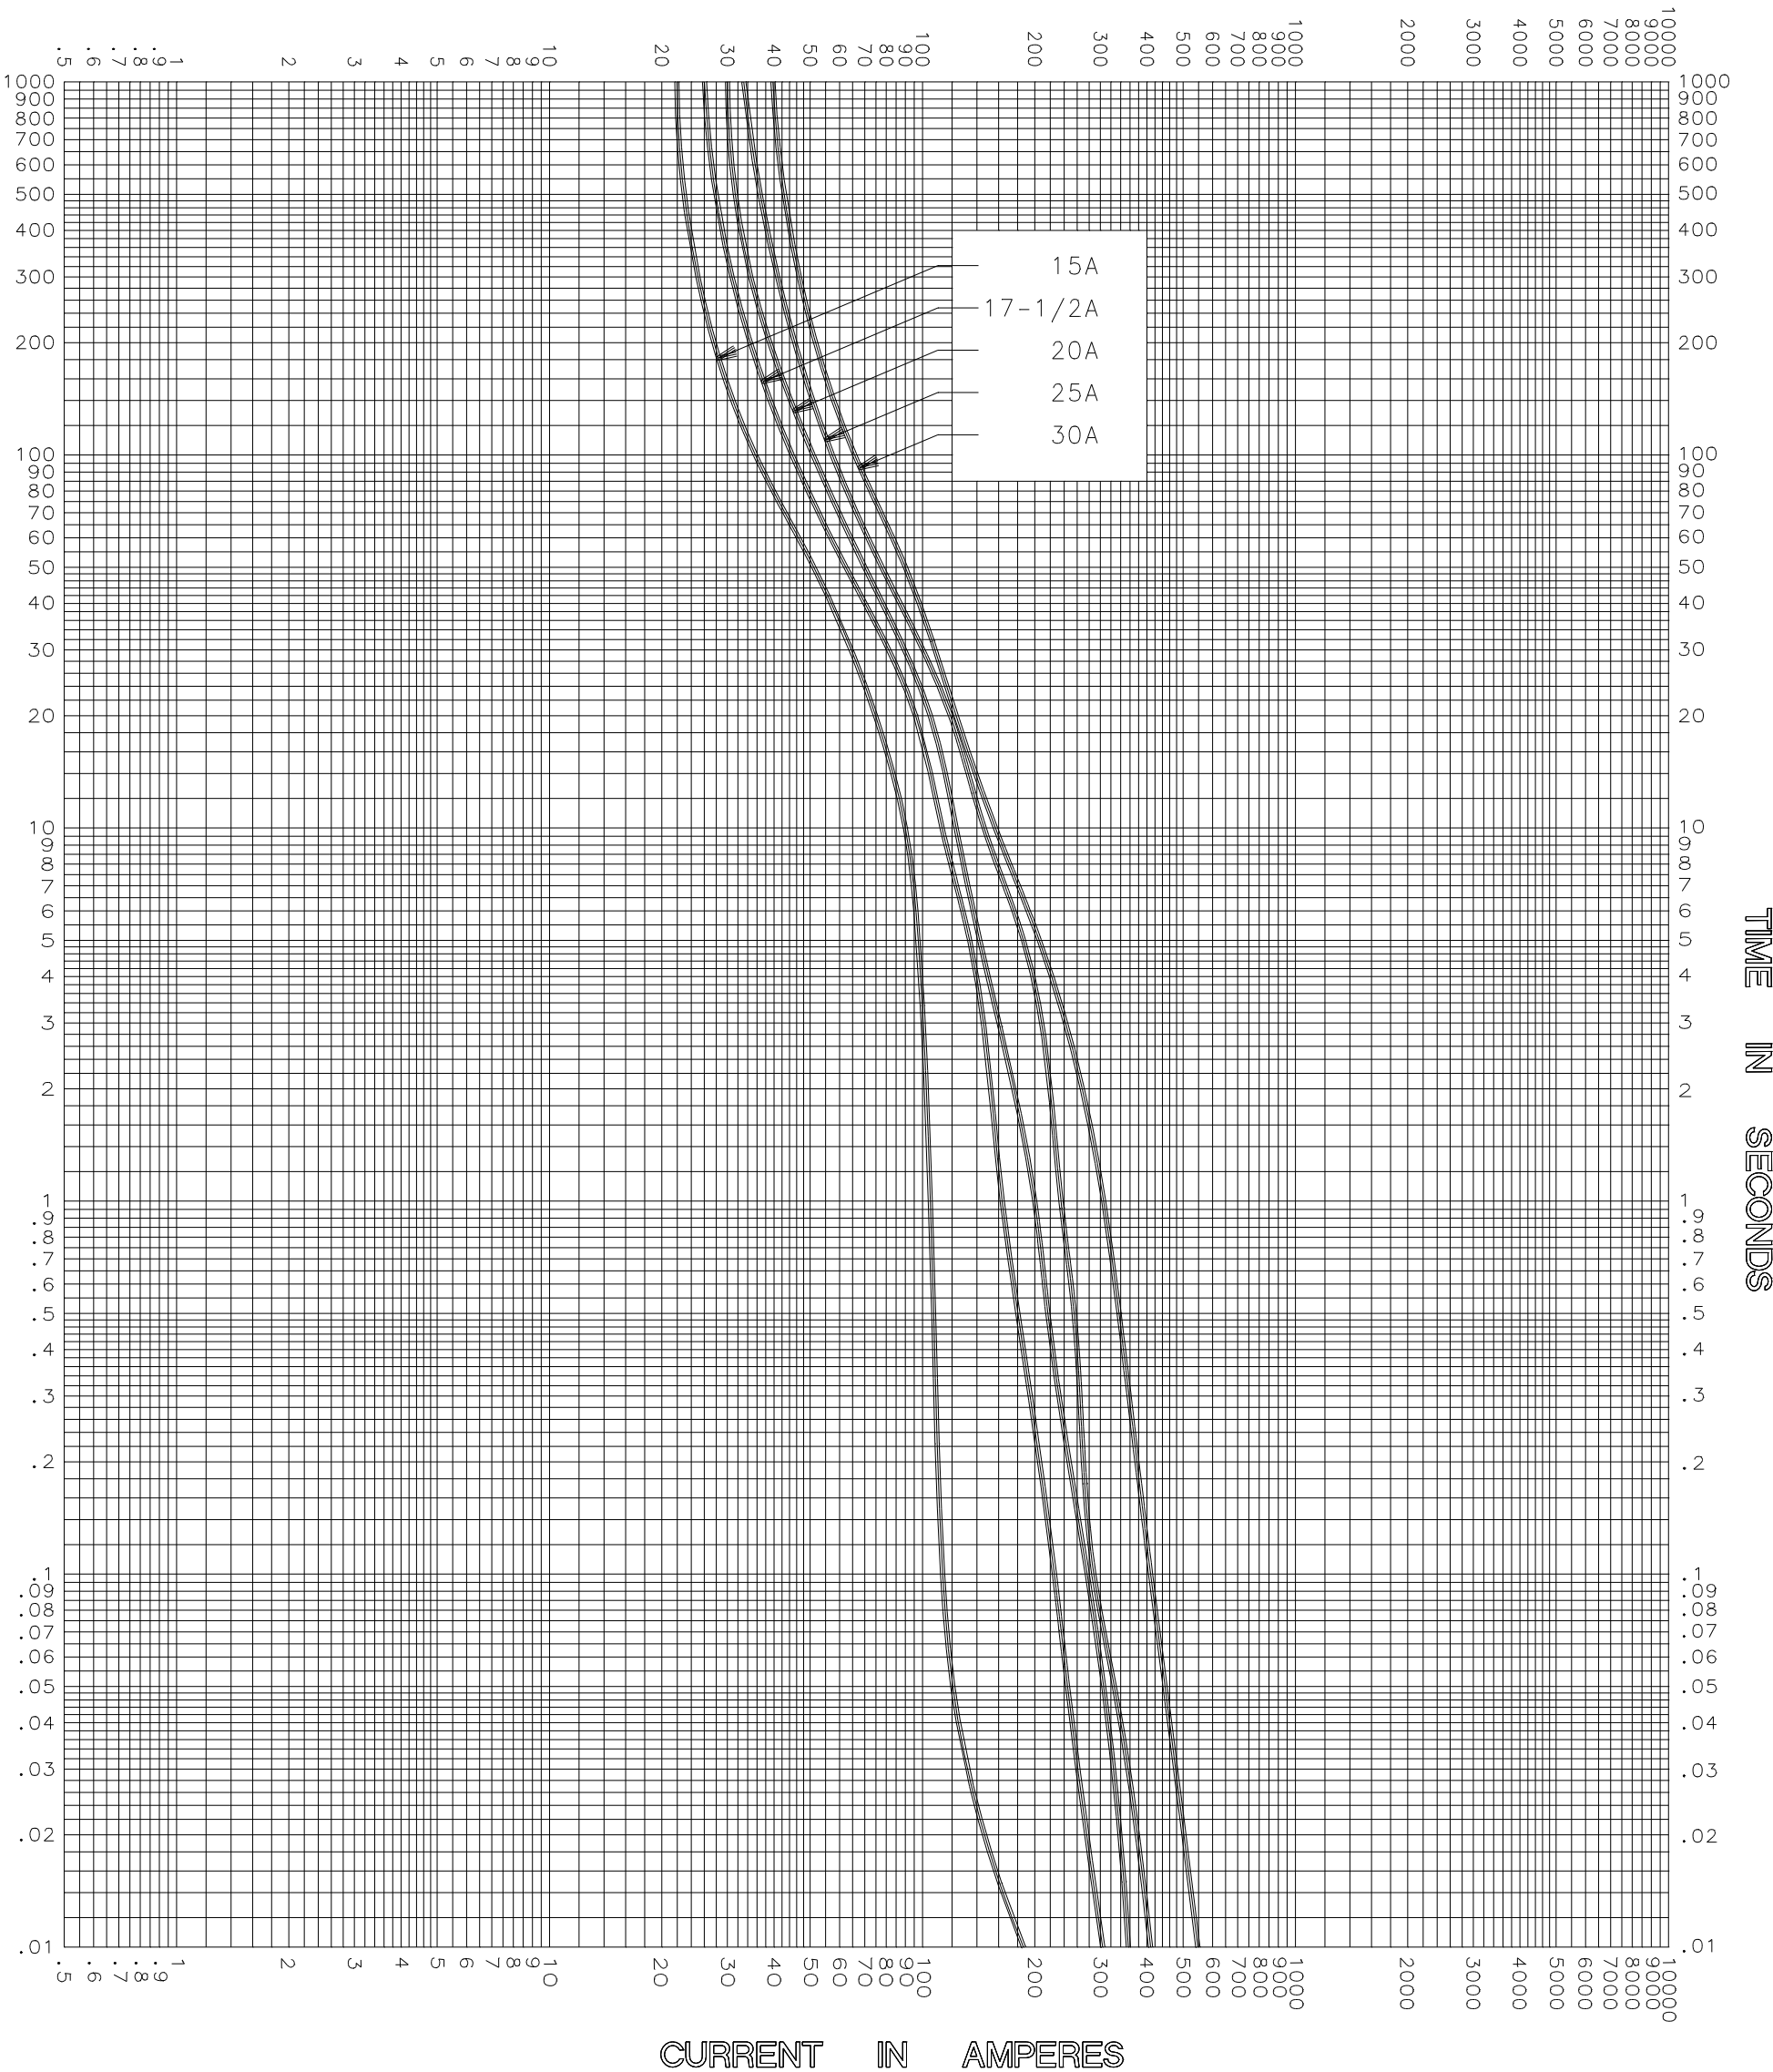

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER JTD (15A - 30A) ID
BASIS FOR DATA _____		




LITTELFUSE, INC.  
DES PLAINES, ILL. USA

DRAWN BY	LLL
DATE	01/07/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-JTDID-004
------------------------------------	----------------------------------

CURRENT IN AMPERES

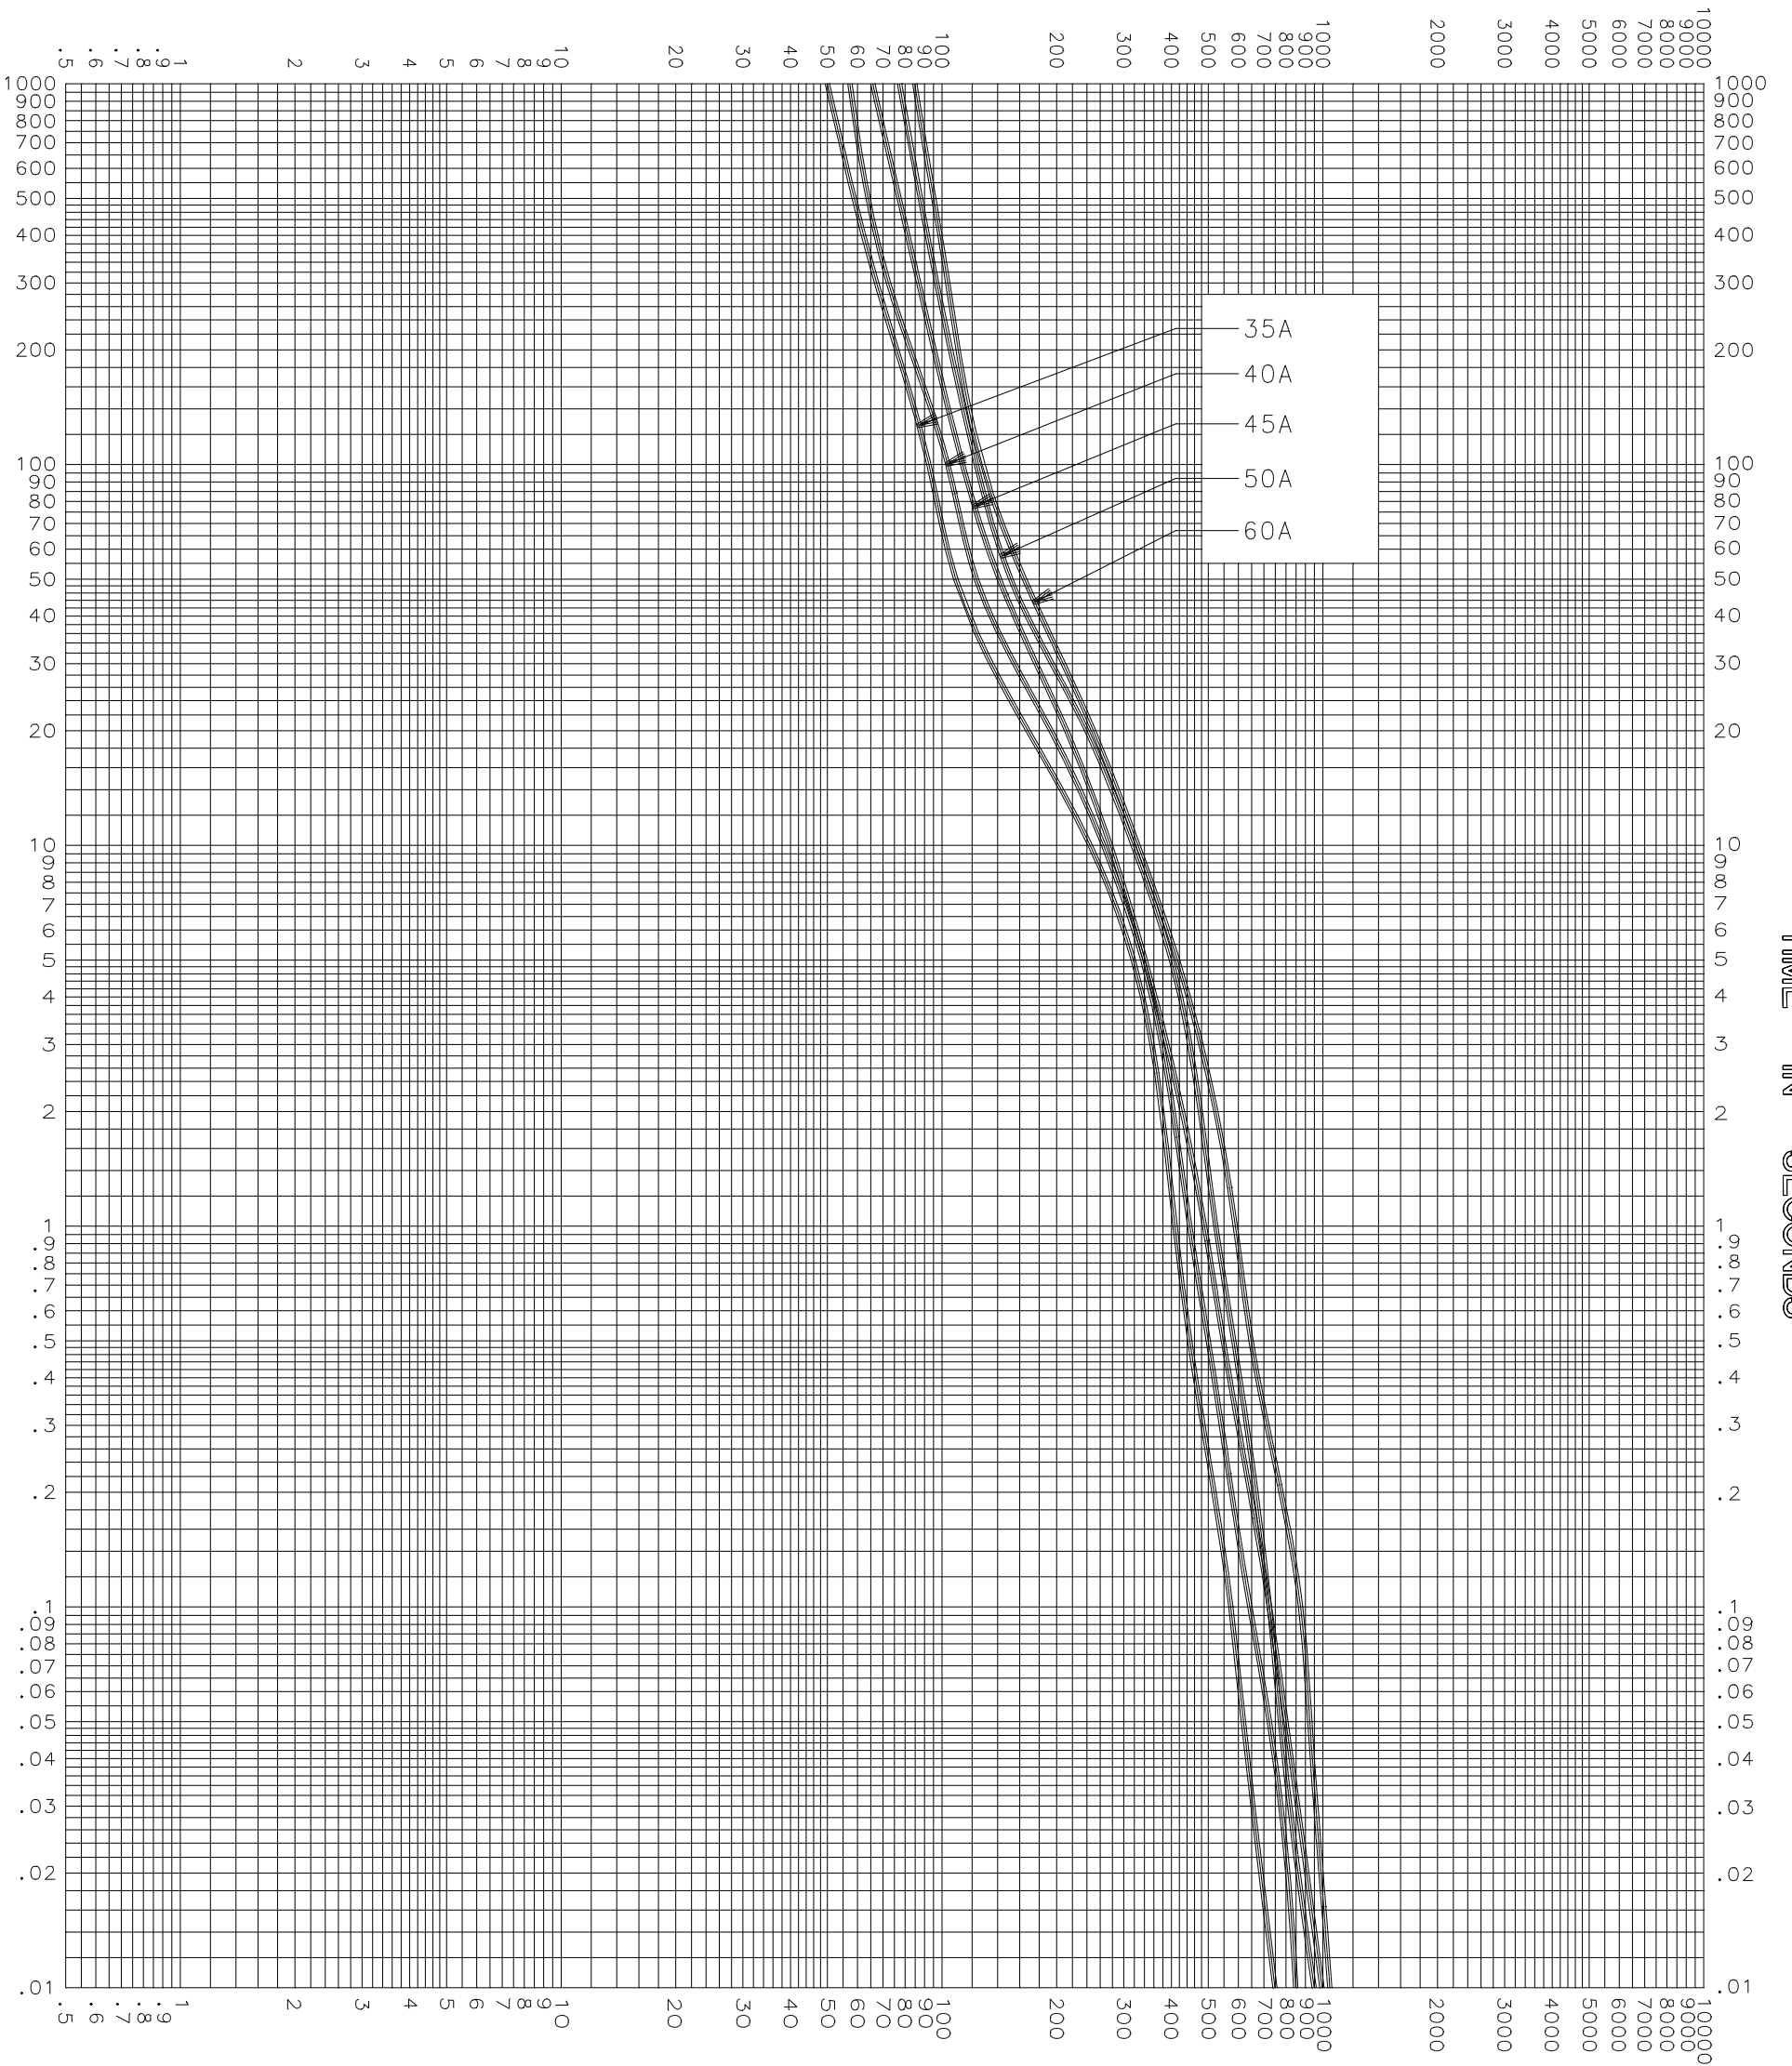


CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		JTD (35A - 60A) ID

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. A-FCC01-JTDID-005
---	----------------------------------

CURRENT IN AMPERES

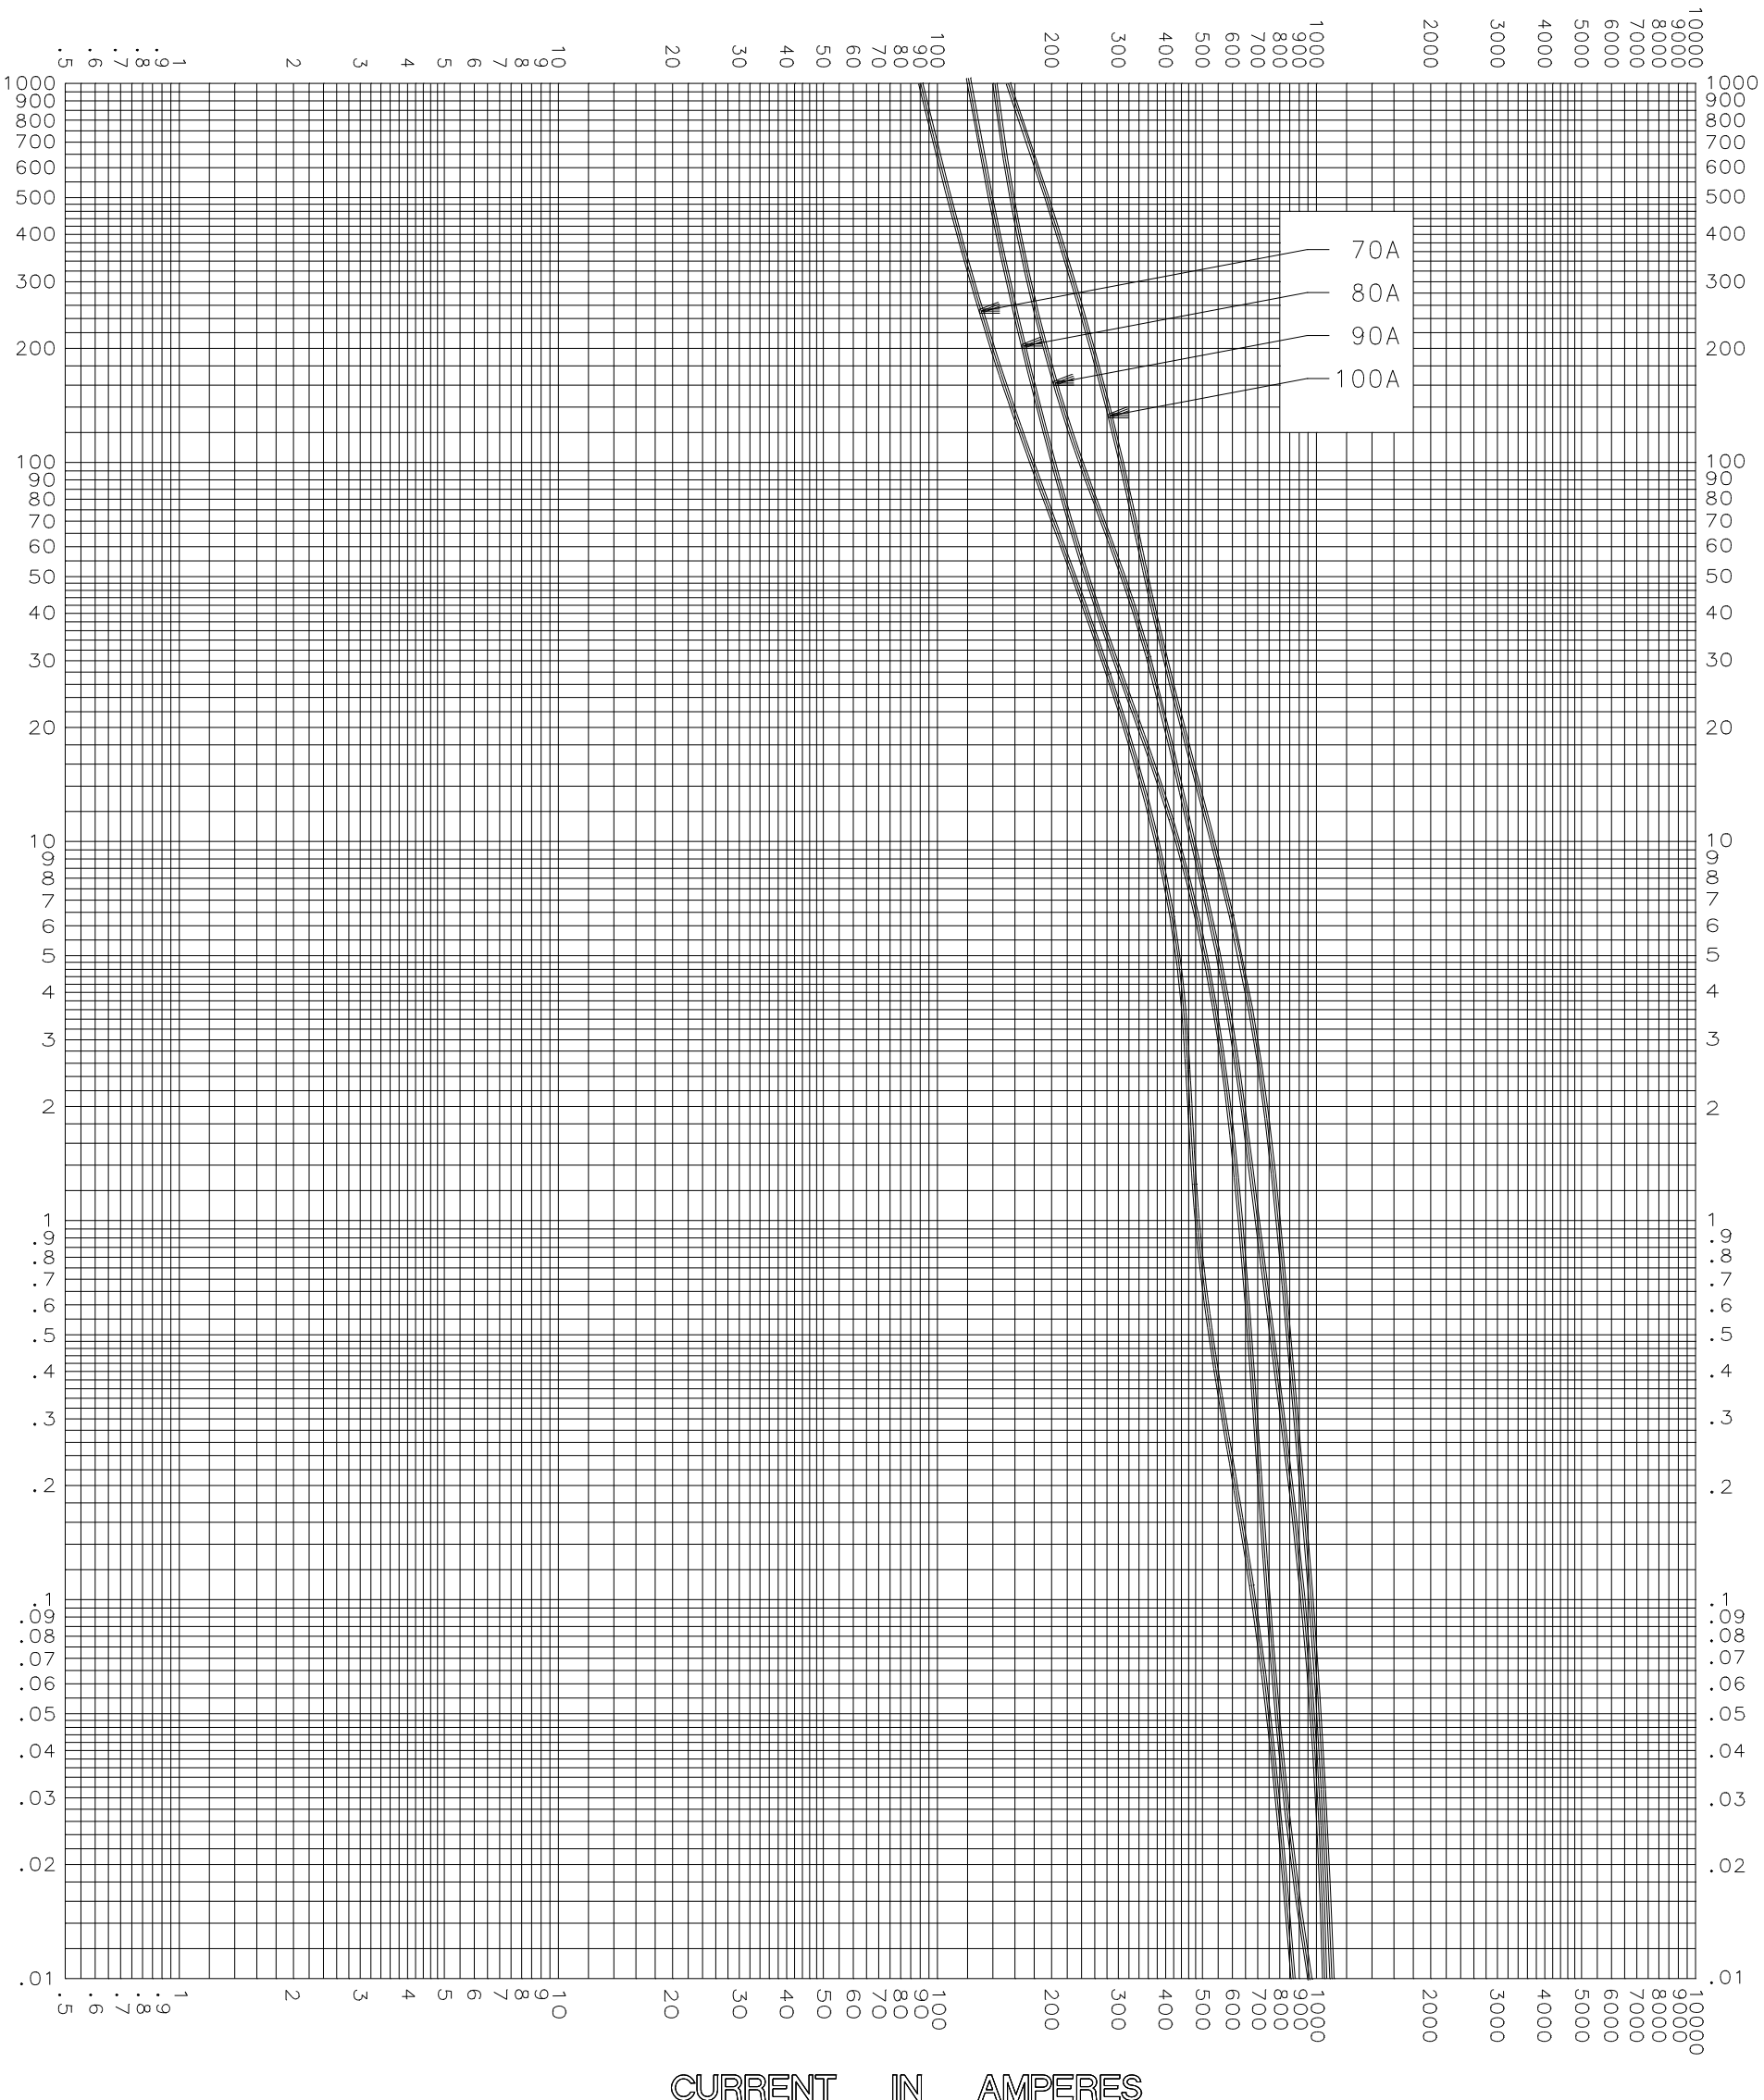

CURRENT IN AMPERES


TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	JTD (70A - 100A) ID

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>A-FCC01</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

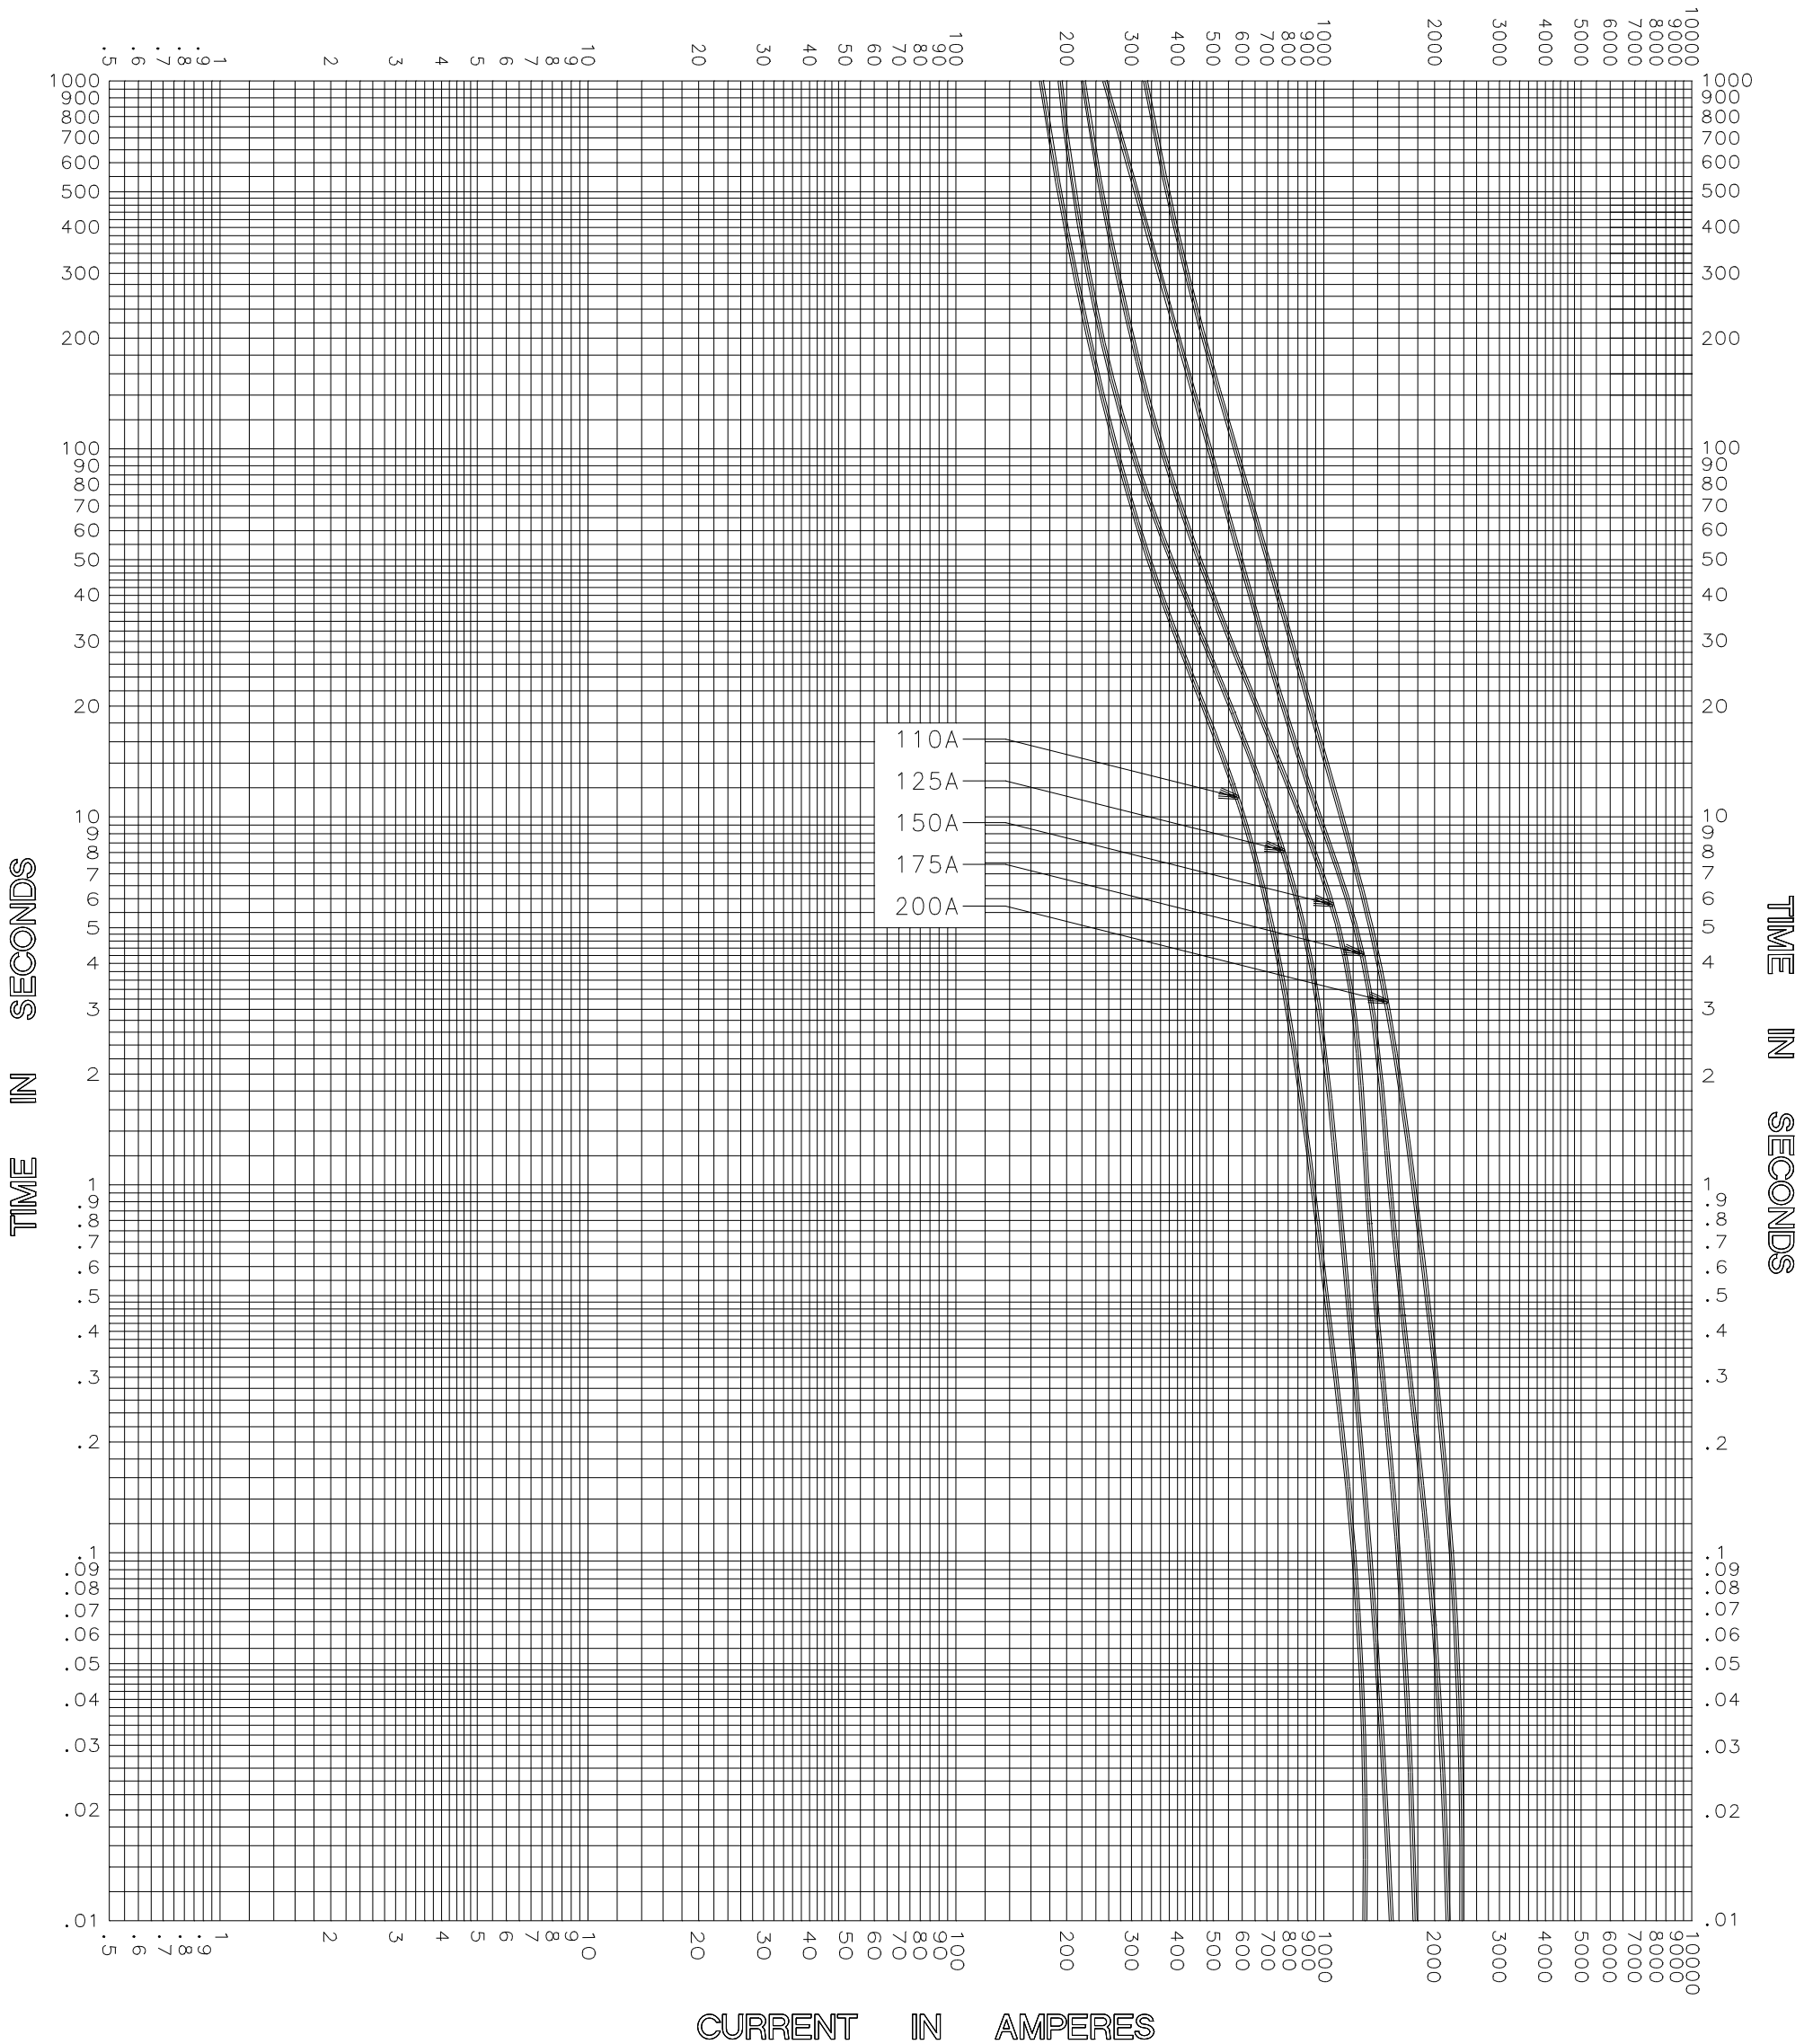


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	JTD (110A -200A) ID

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. A-FCC01-JTDID-007
---	----------------------------------

CURRENT IN AMPERES

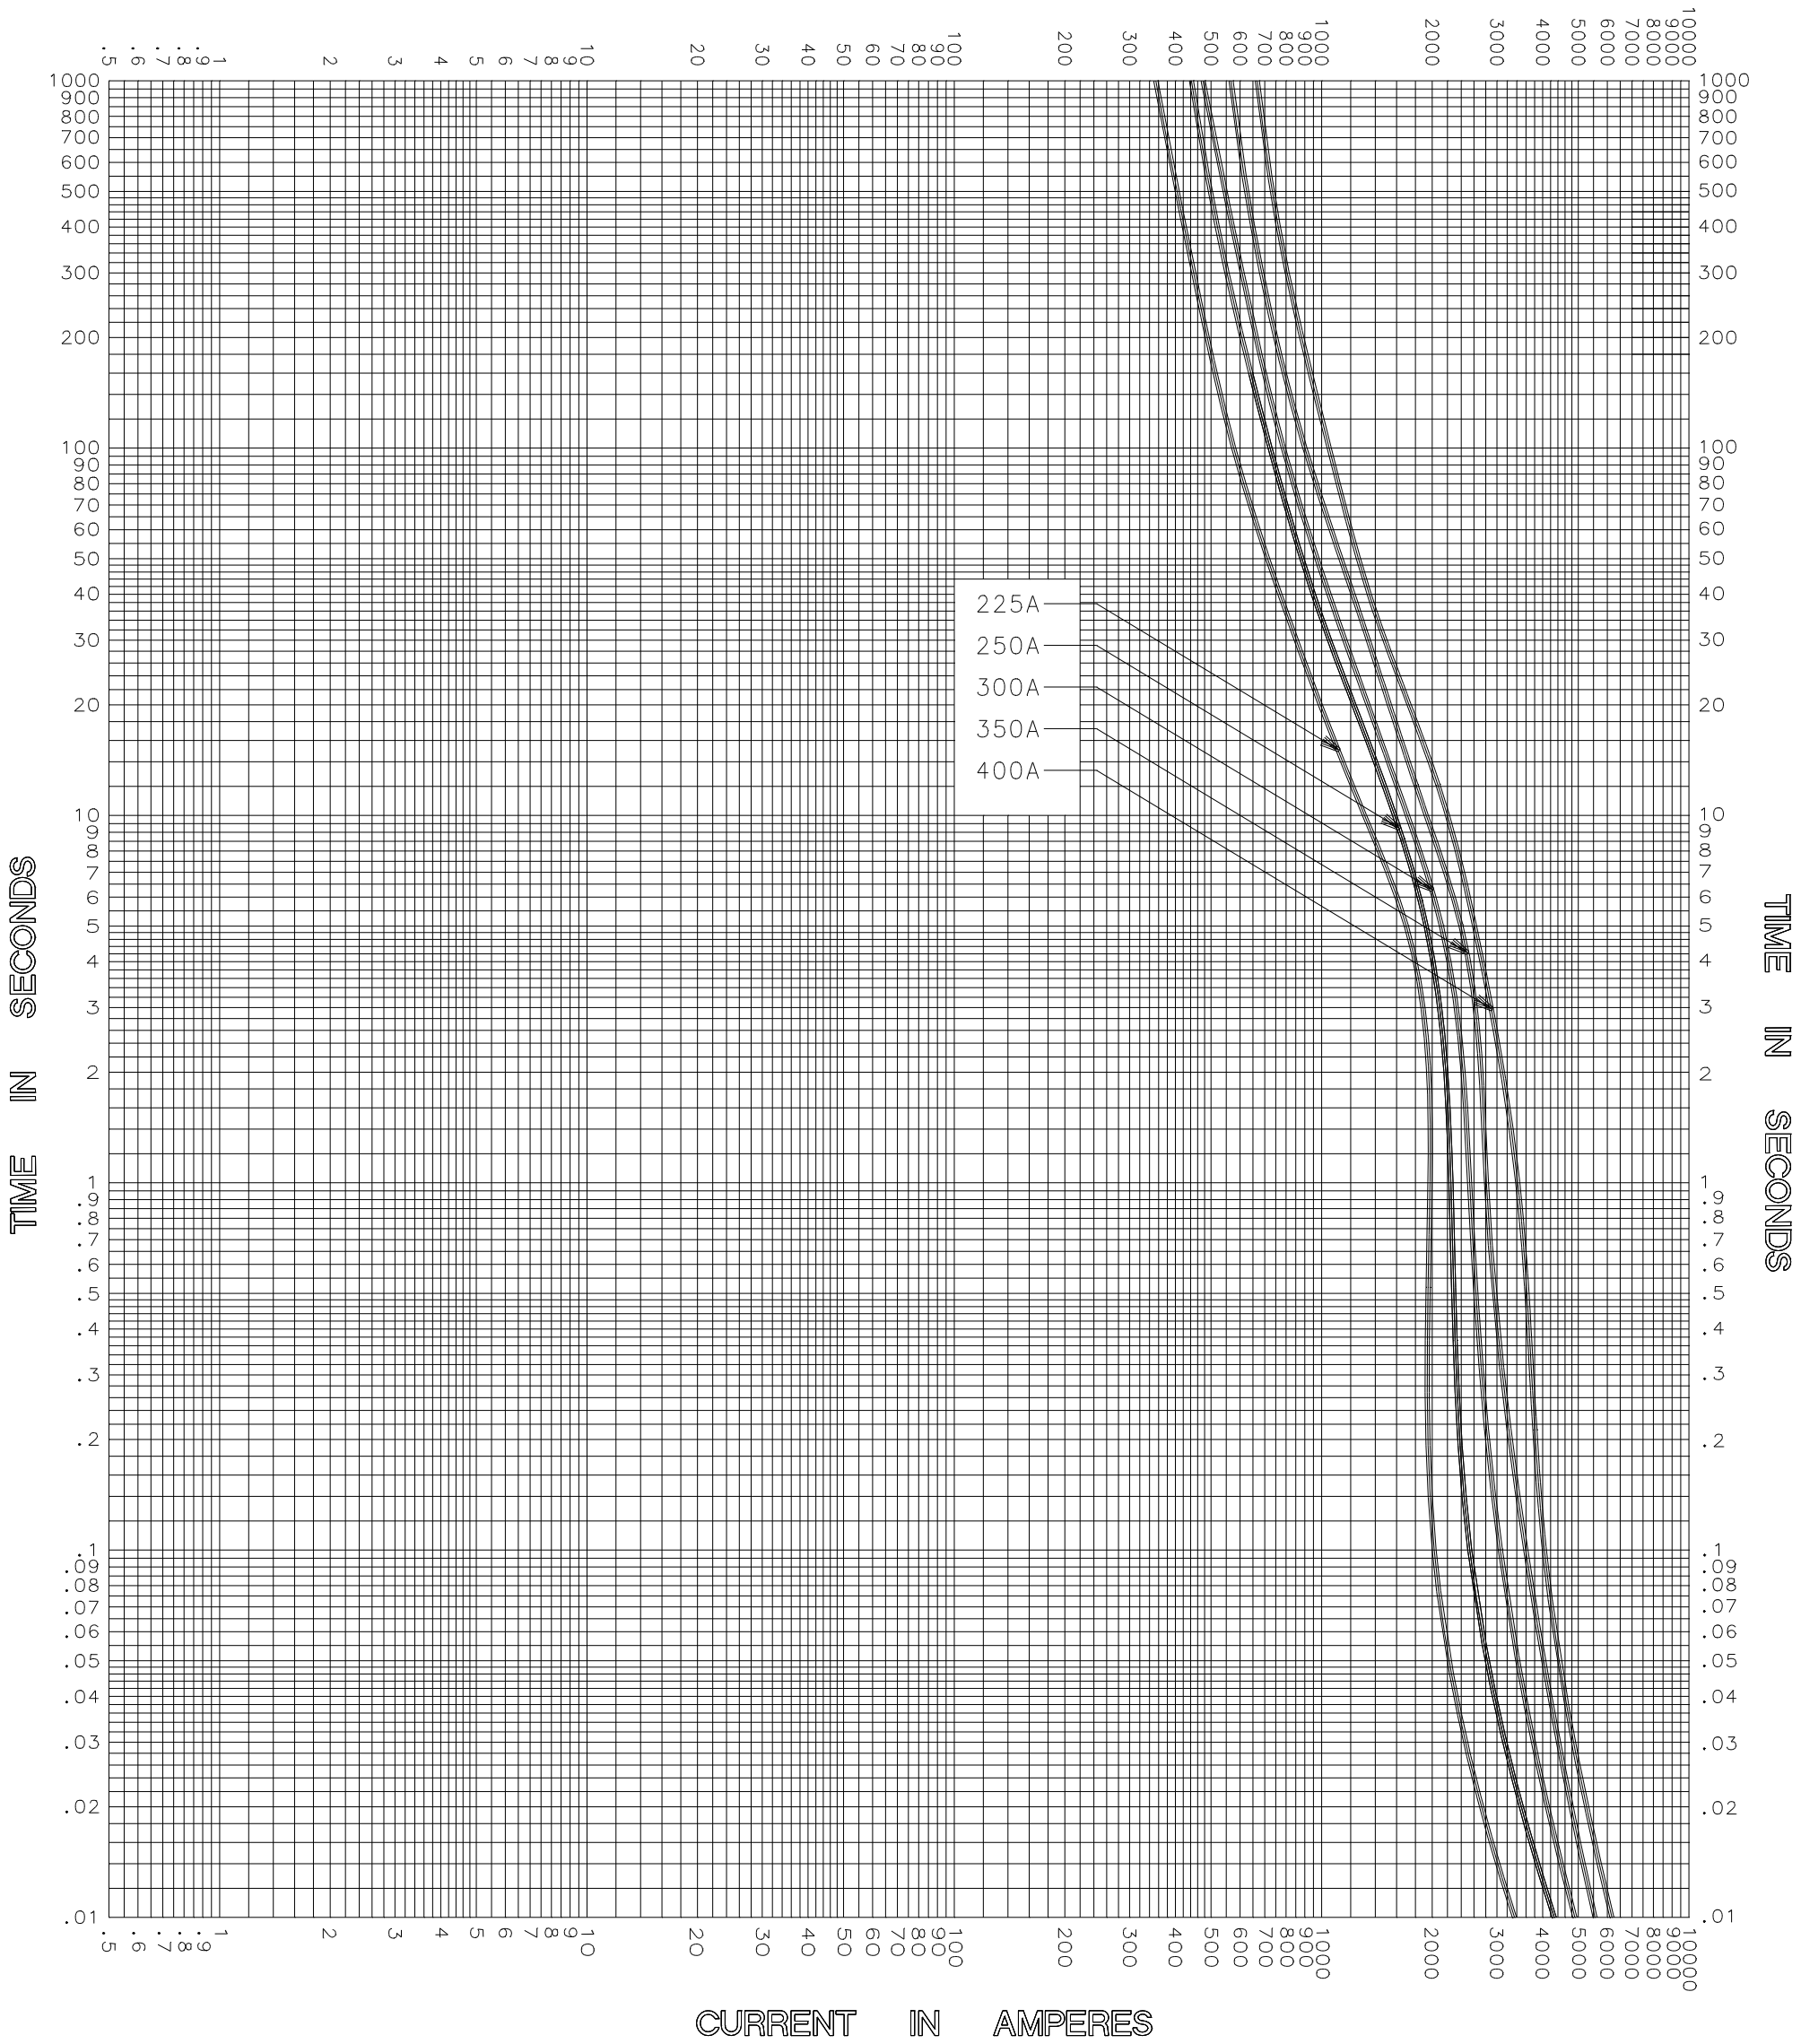

CURRENT IN AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		JTD (225A - 400A) ID

 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-JTDID-008
------------------------------------	----------------------------------



CURRENT IN AMPERES

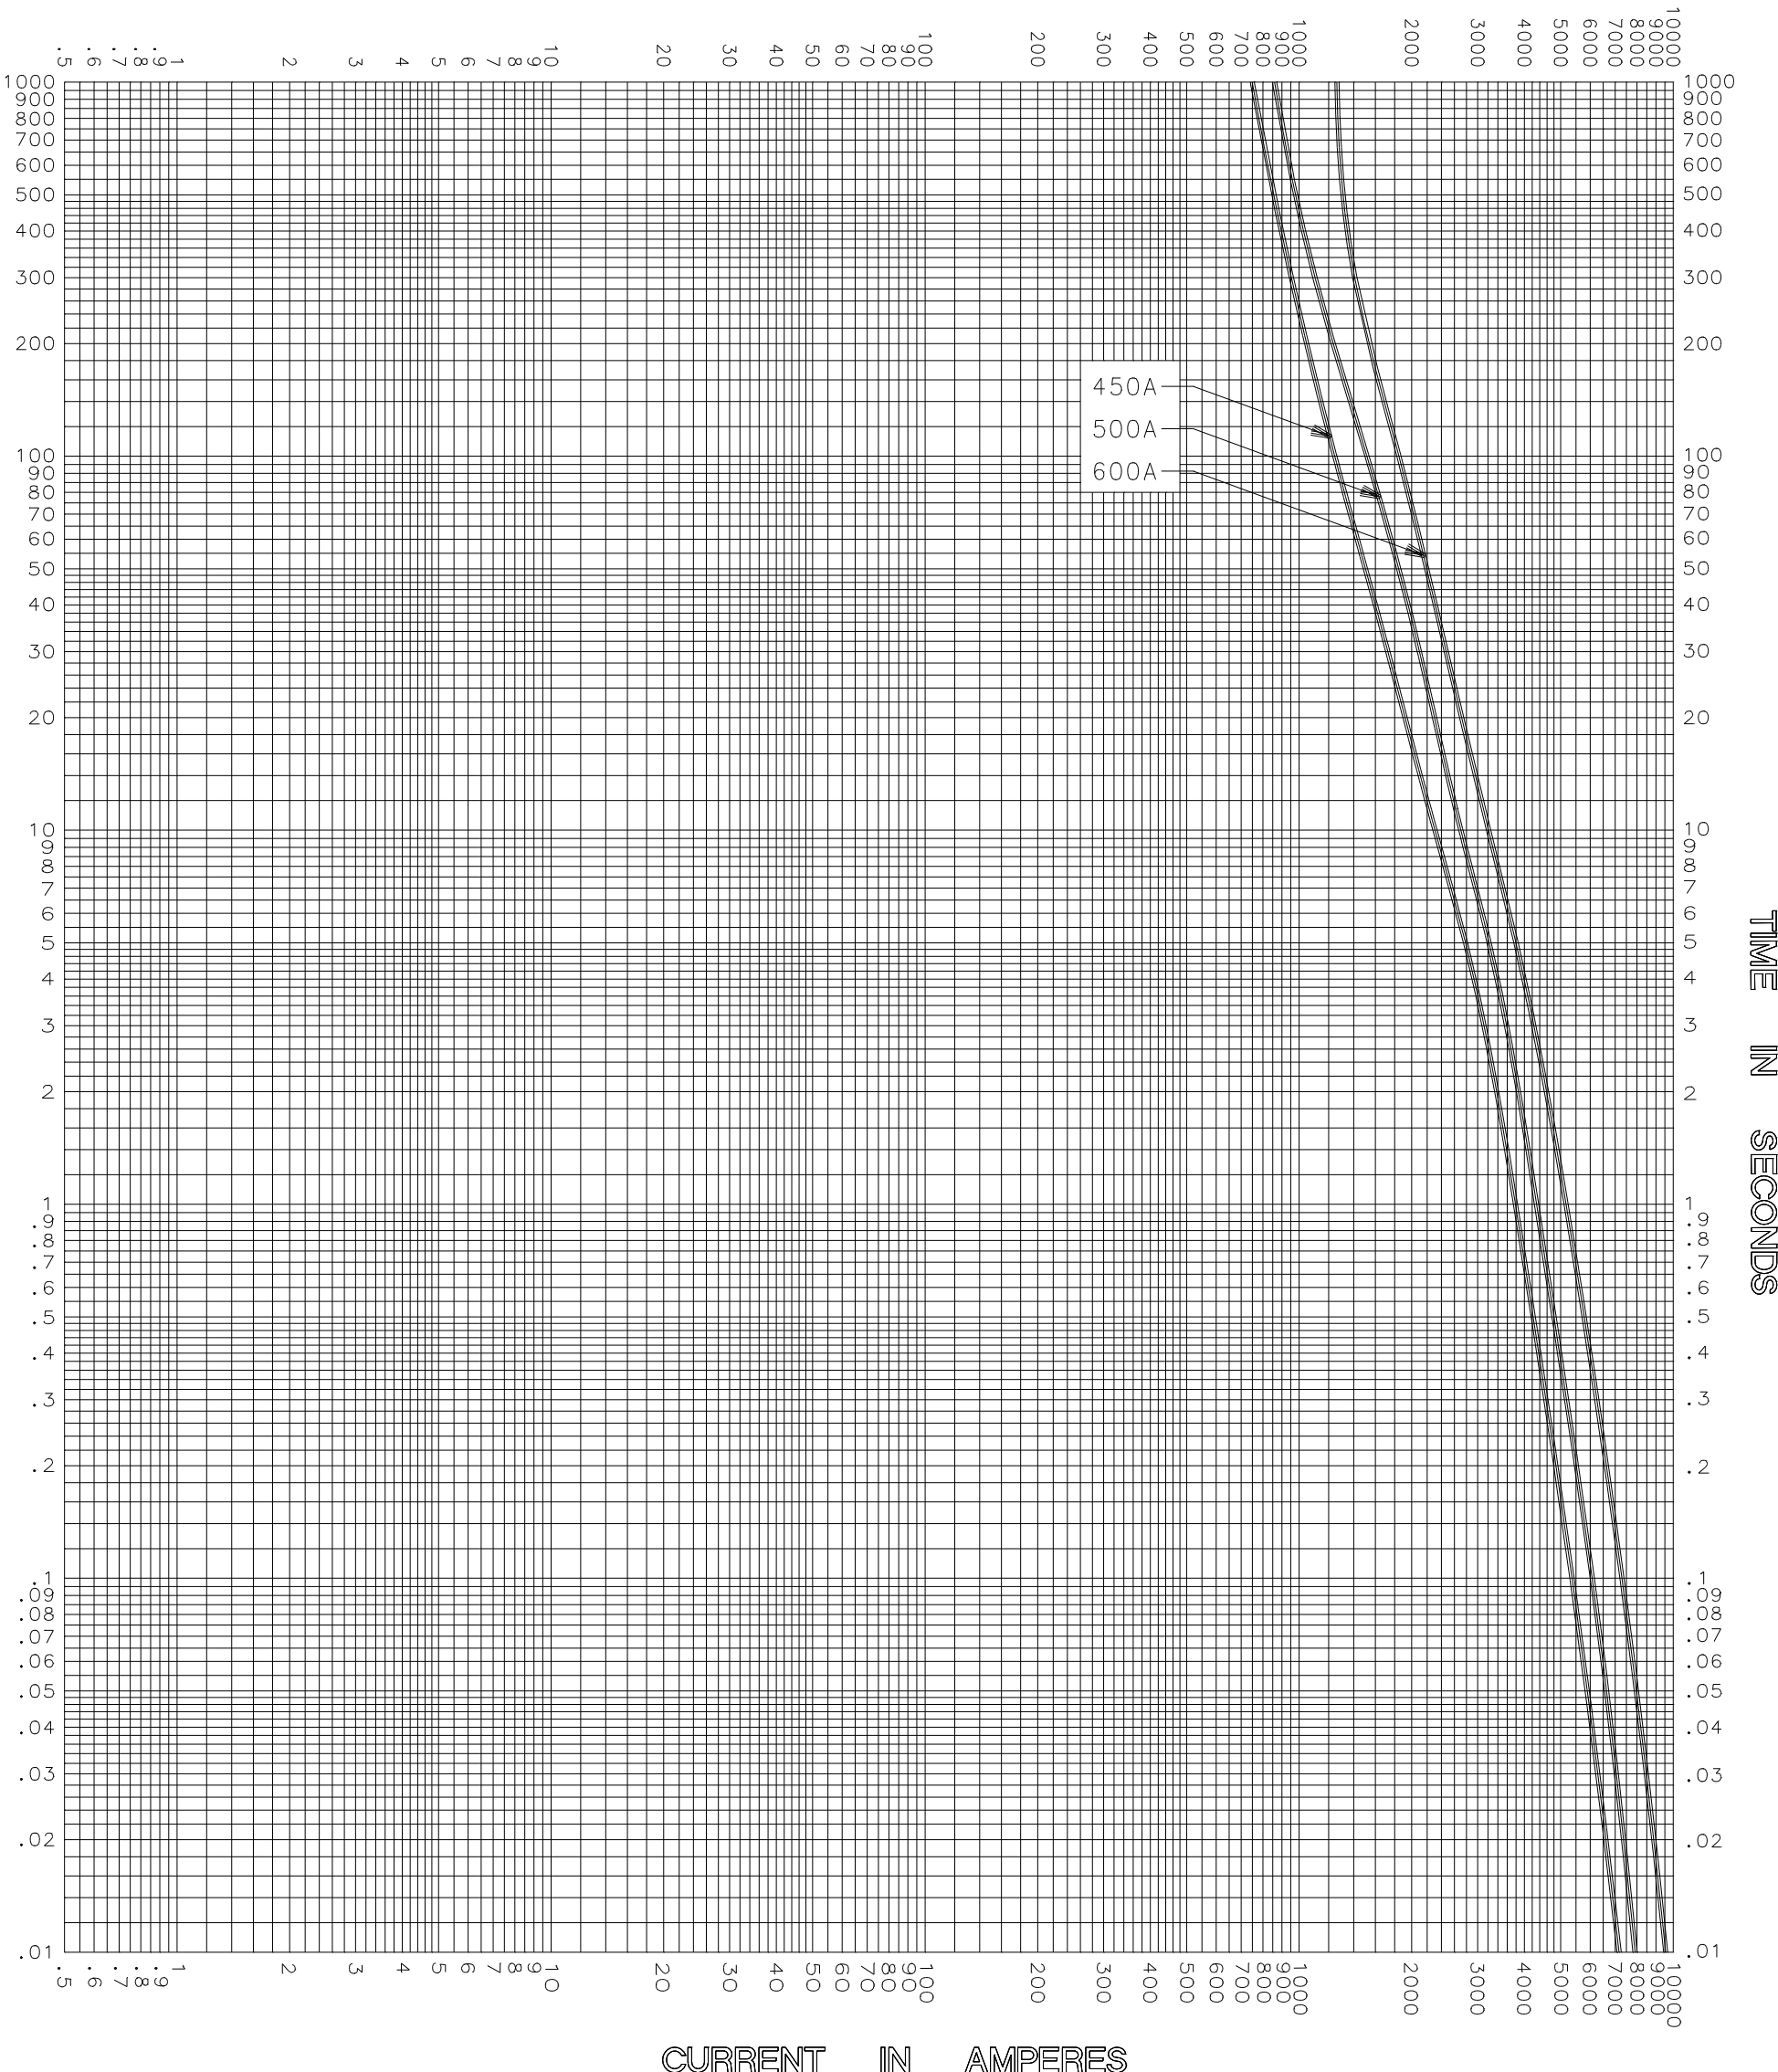

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	JTD (450A - 600A) ID



LITTELFUSE, INC.  
DES PLAINES, ILL. USA

DRAWN BY	LLL
DATE	01/07/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-JTDID-009
------------------------------------	----------------------------------