


CURRENT IN AMPERES



CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (2A - 12A)
BASIS FOR DATA _____		

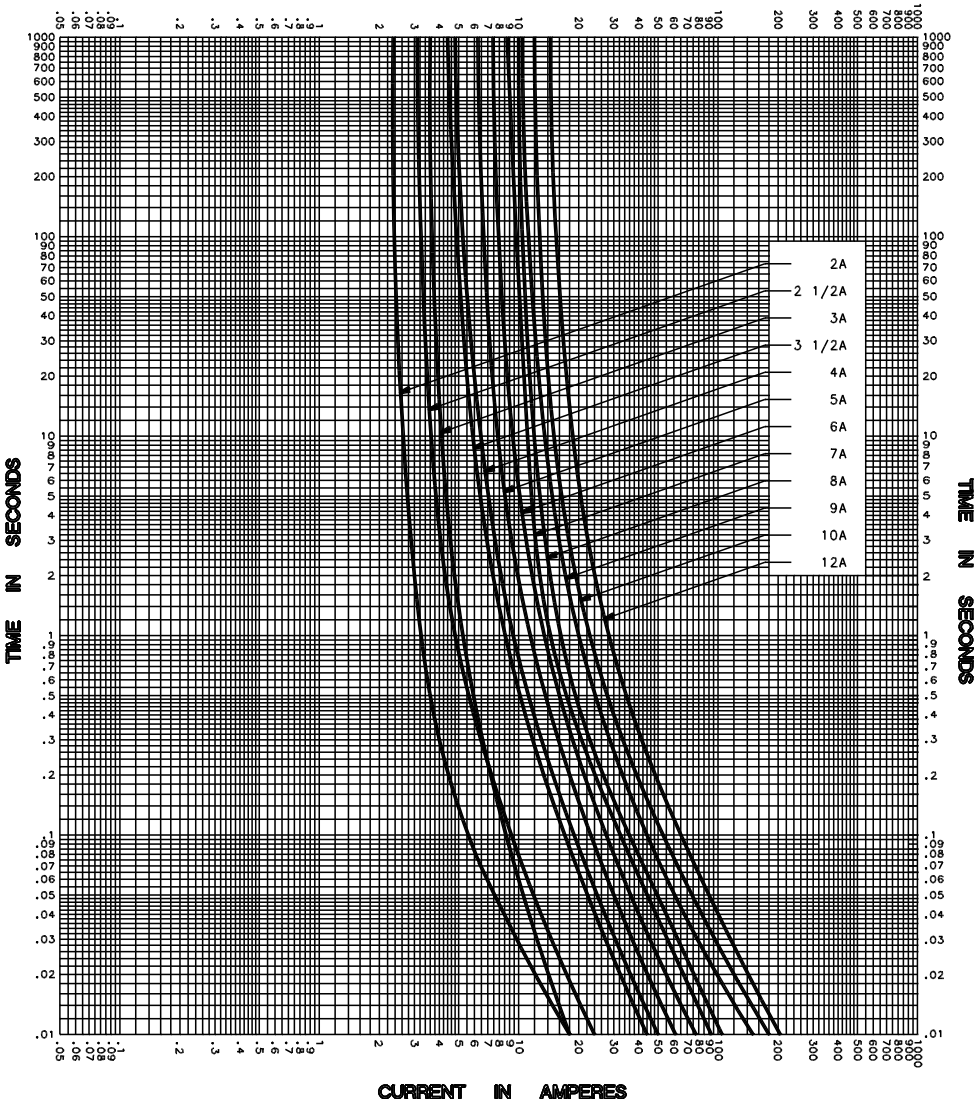

LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/08/05
CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC002

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

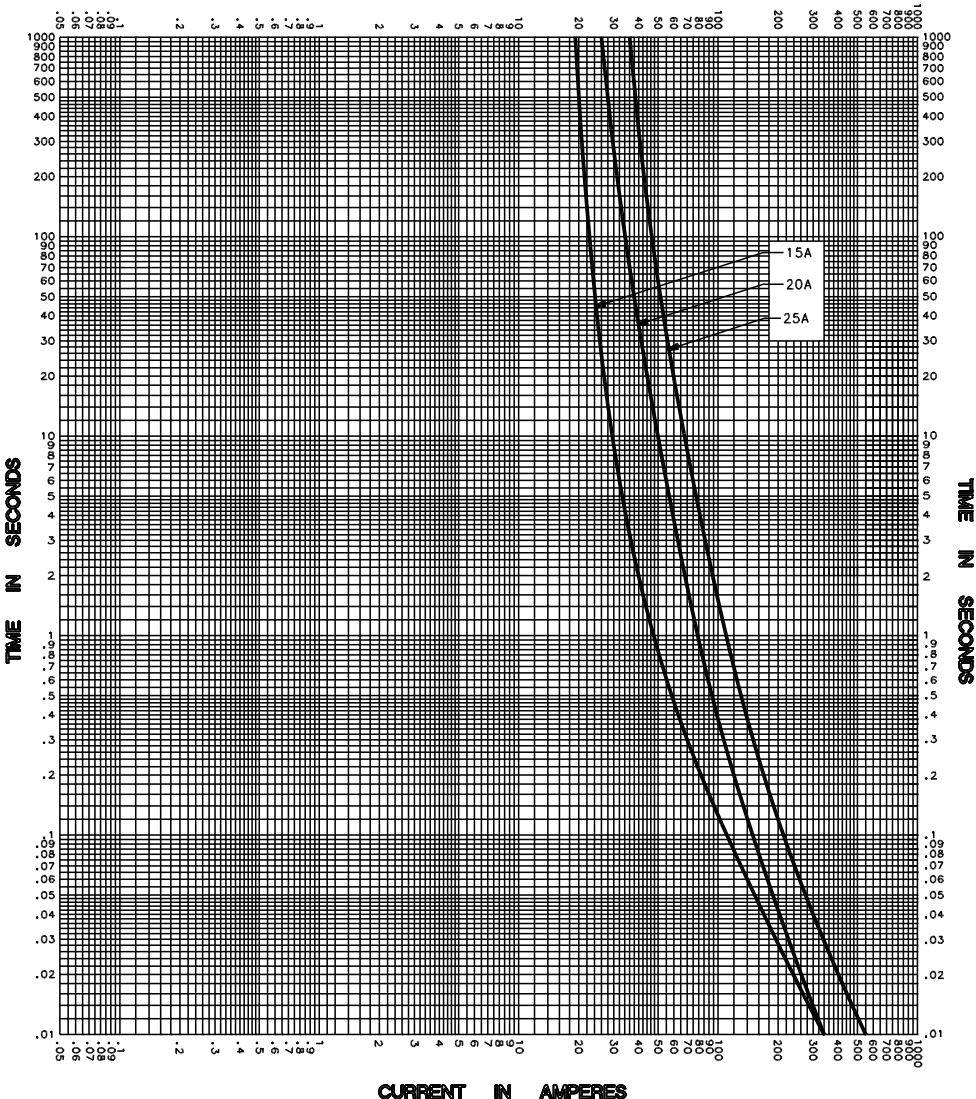

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (15A - 25A)
BASIS FOR DATA _____		



LITTELFUSE, INC.
DES PLAINES, ILL. USA


DRAWN BY LLL
DATE 04/08/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES DRAWING NO. A-FCC003

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

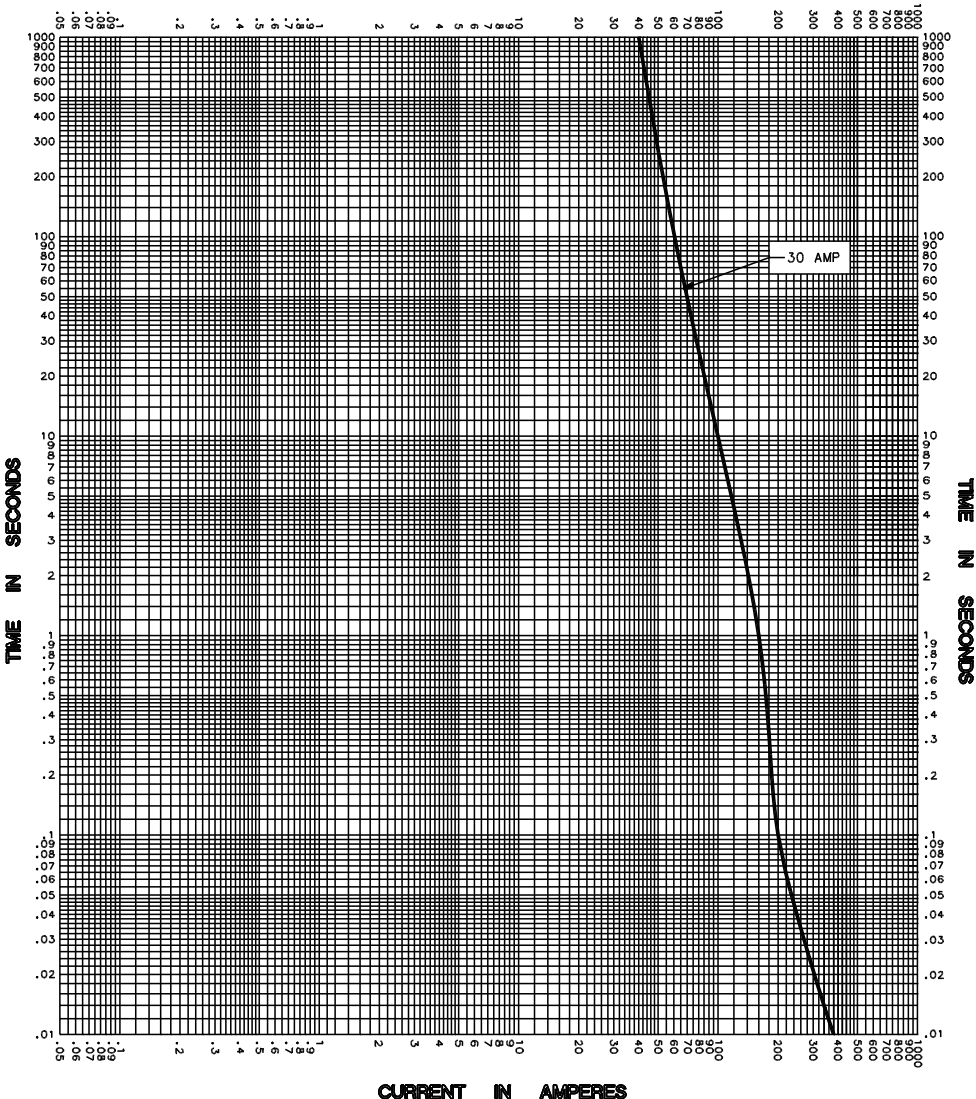

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER KLK (30A)
BASIS FOR DATA _____		



LITTELFUSE, INC.
DES PLAINES, ILL. USA

DRAWN BY LLL
DATE 04/08/05
CHECKED BY MP

TIME CURRENT CHARACTERISTIC CURVES DRAWING NO. A-FCC004

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT