



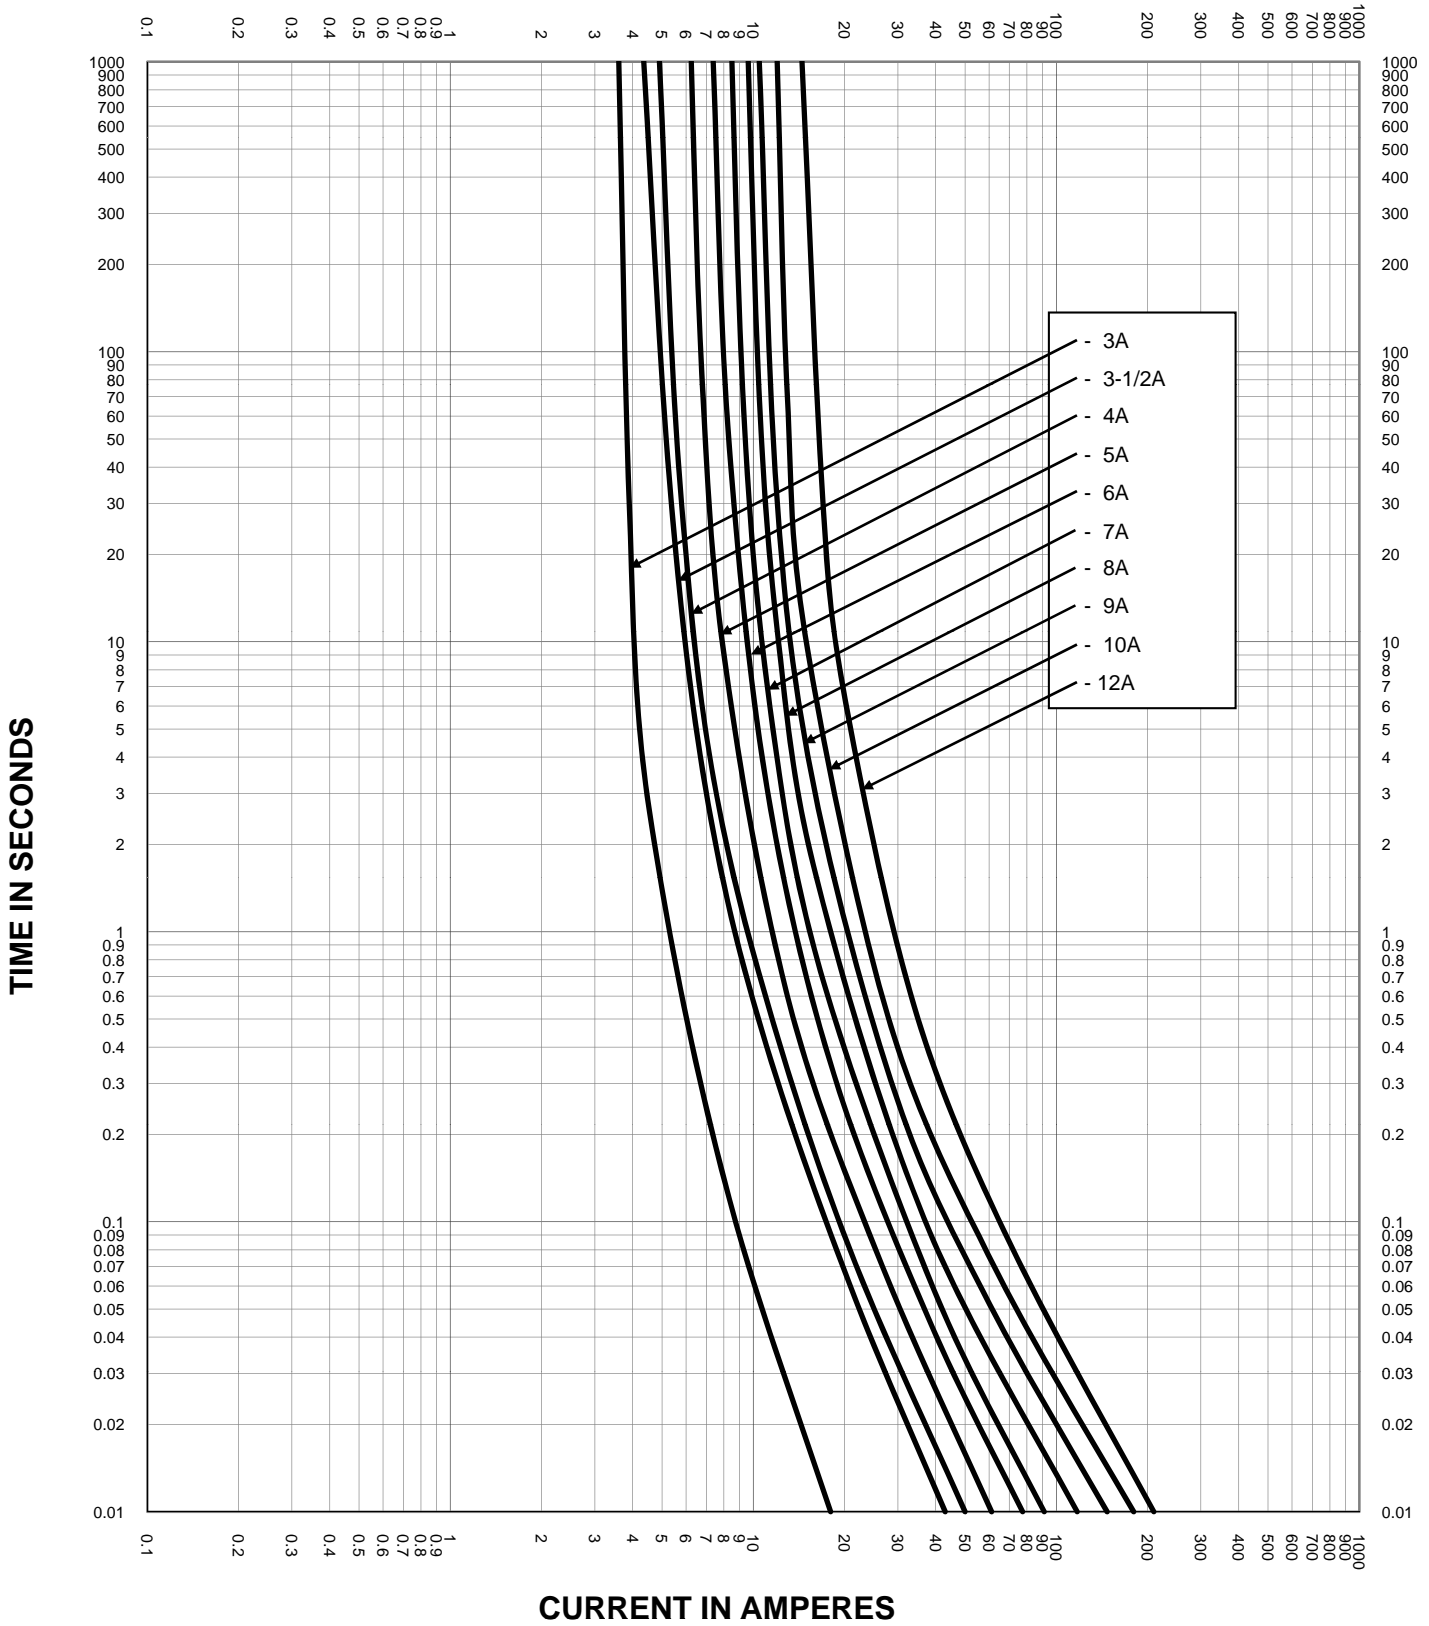
# Time Current Curve

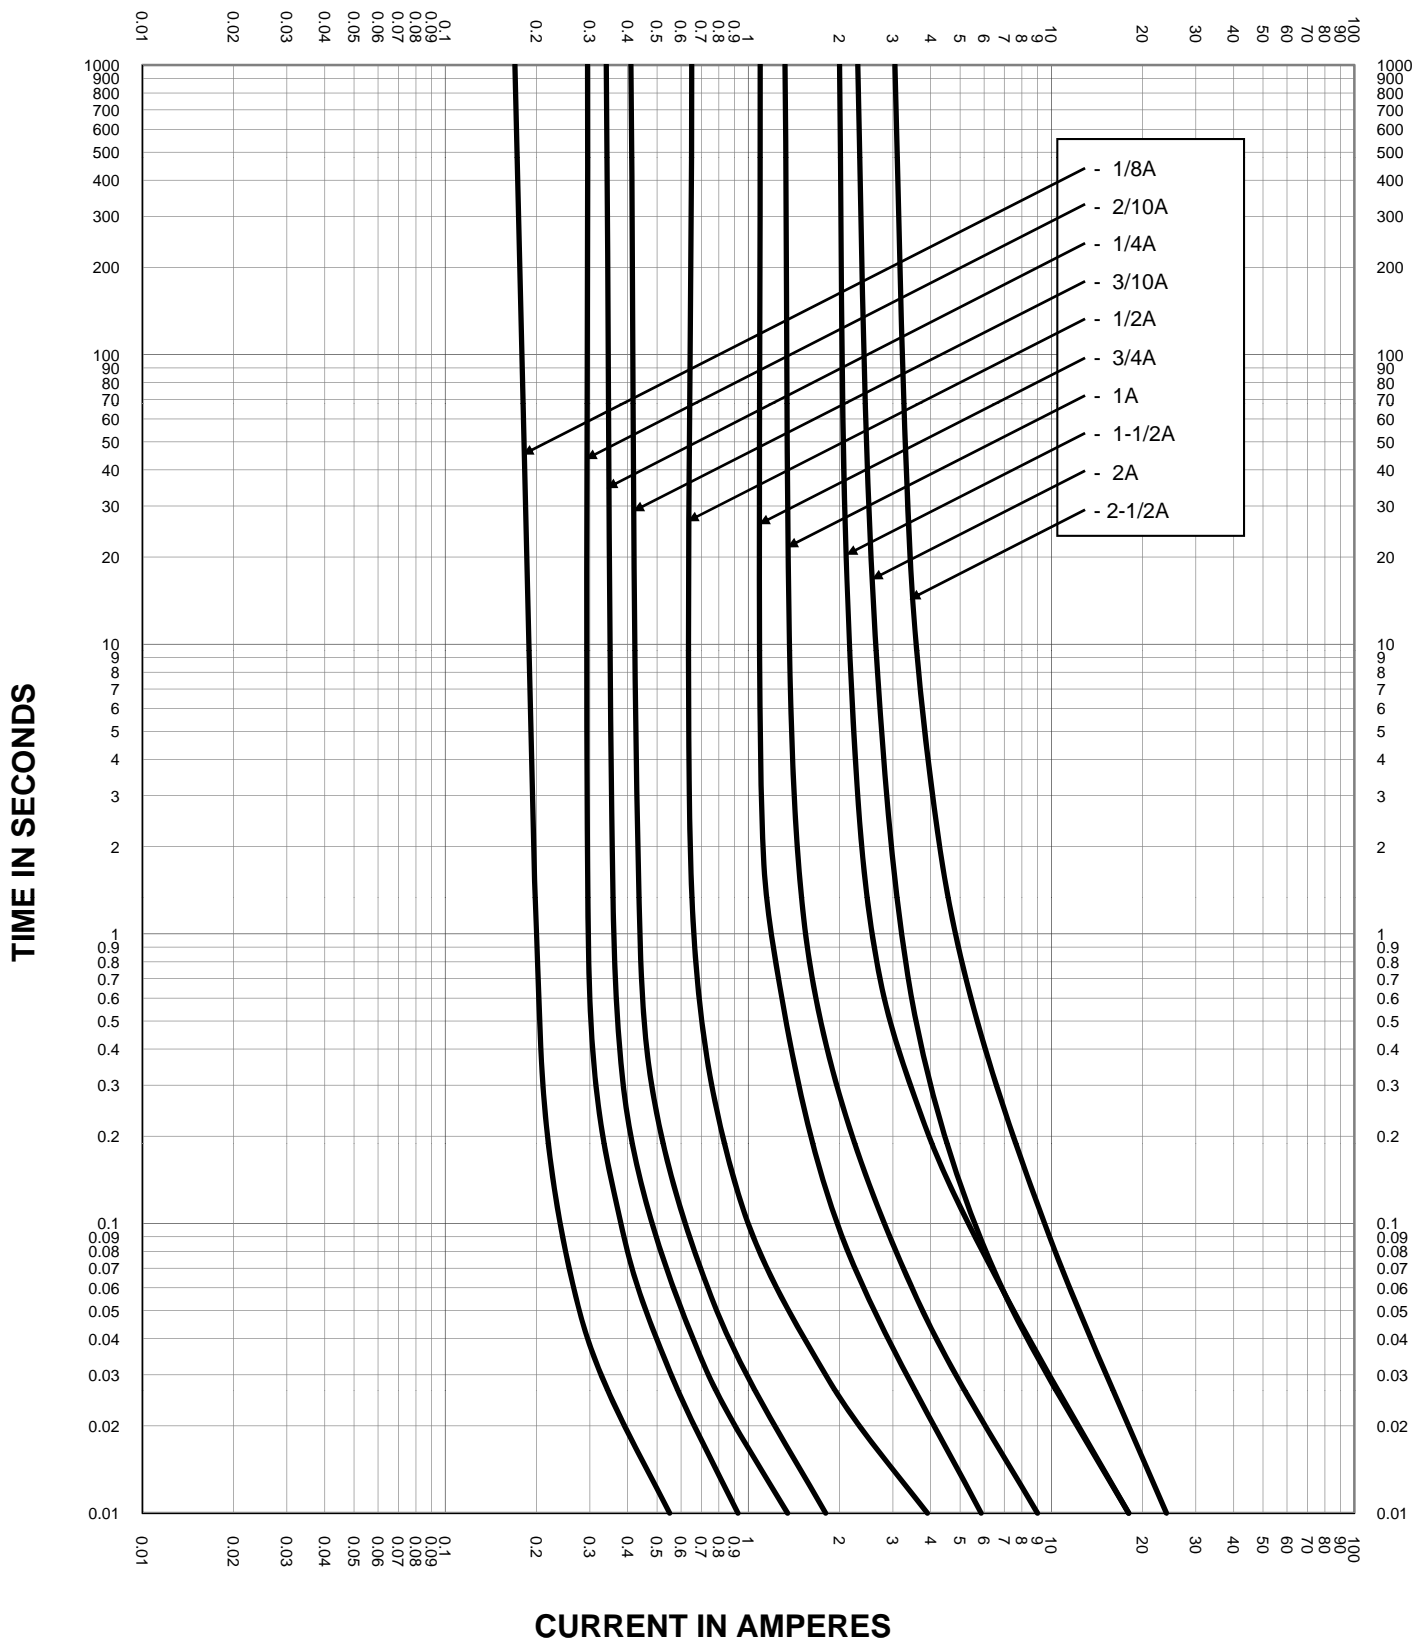


## CURRENT IN AMPERES


TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER
BASIS FOR DATA:		KLKD 1/8 - 2-1/2A
	<b>LITTELFUSE, INC.</b> DES PLAINES, IL USA	DRAWN BY: LLL DATE: 4/5/11 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO. Sheet 2 of 5 FCC01-KLKD

# Time Current Curve




TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER <b>KLKD 3A -12A</b>
BASIS FOR DATA:		
 <b>LITTELFUSE, INC.</b> DES PLAINES, IL USA		DRAWN BY: LLL DATE: 4/5/11 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO. Sheet 3 of 5 FCC01-KLKD


# Time Current Curve

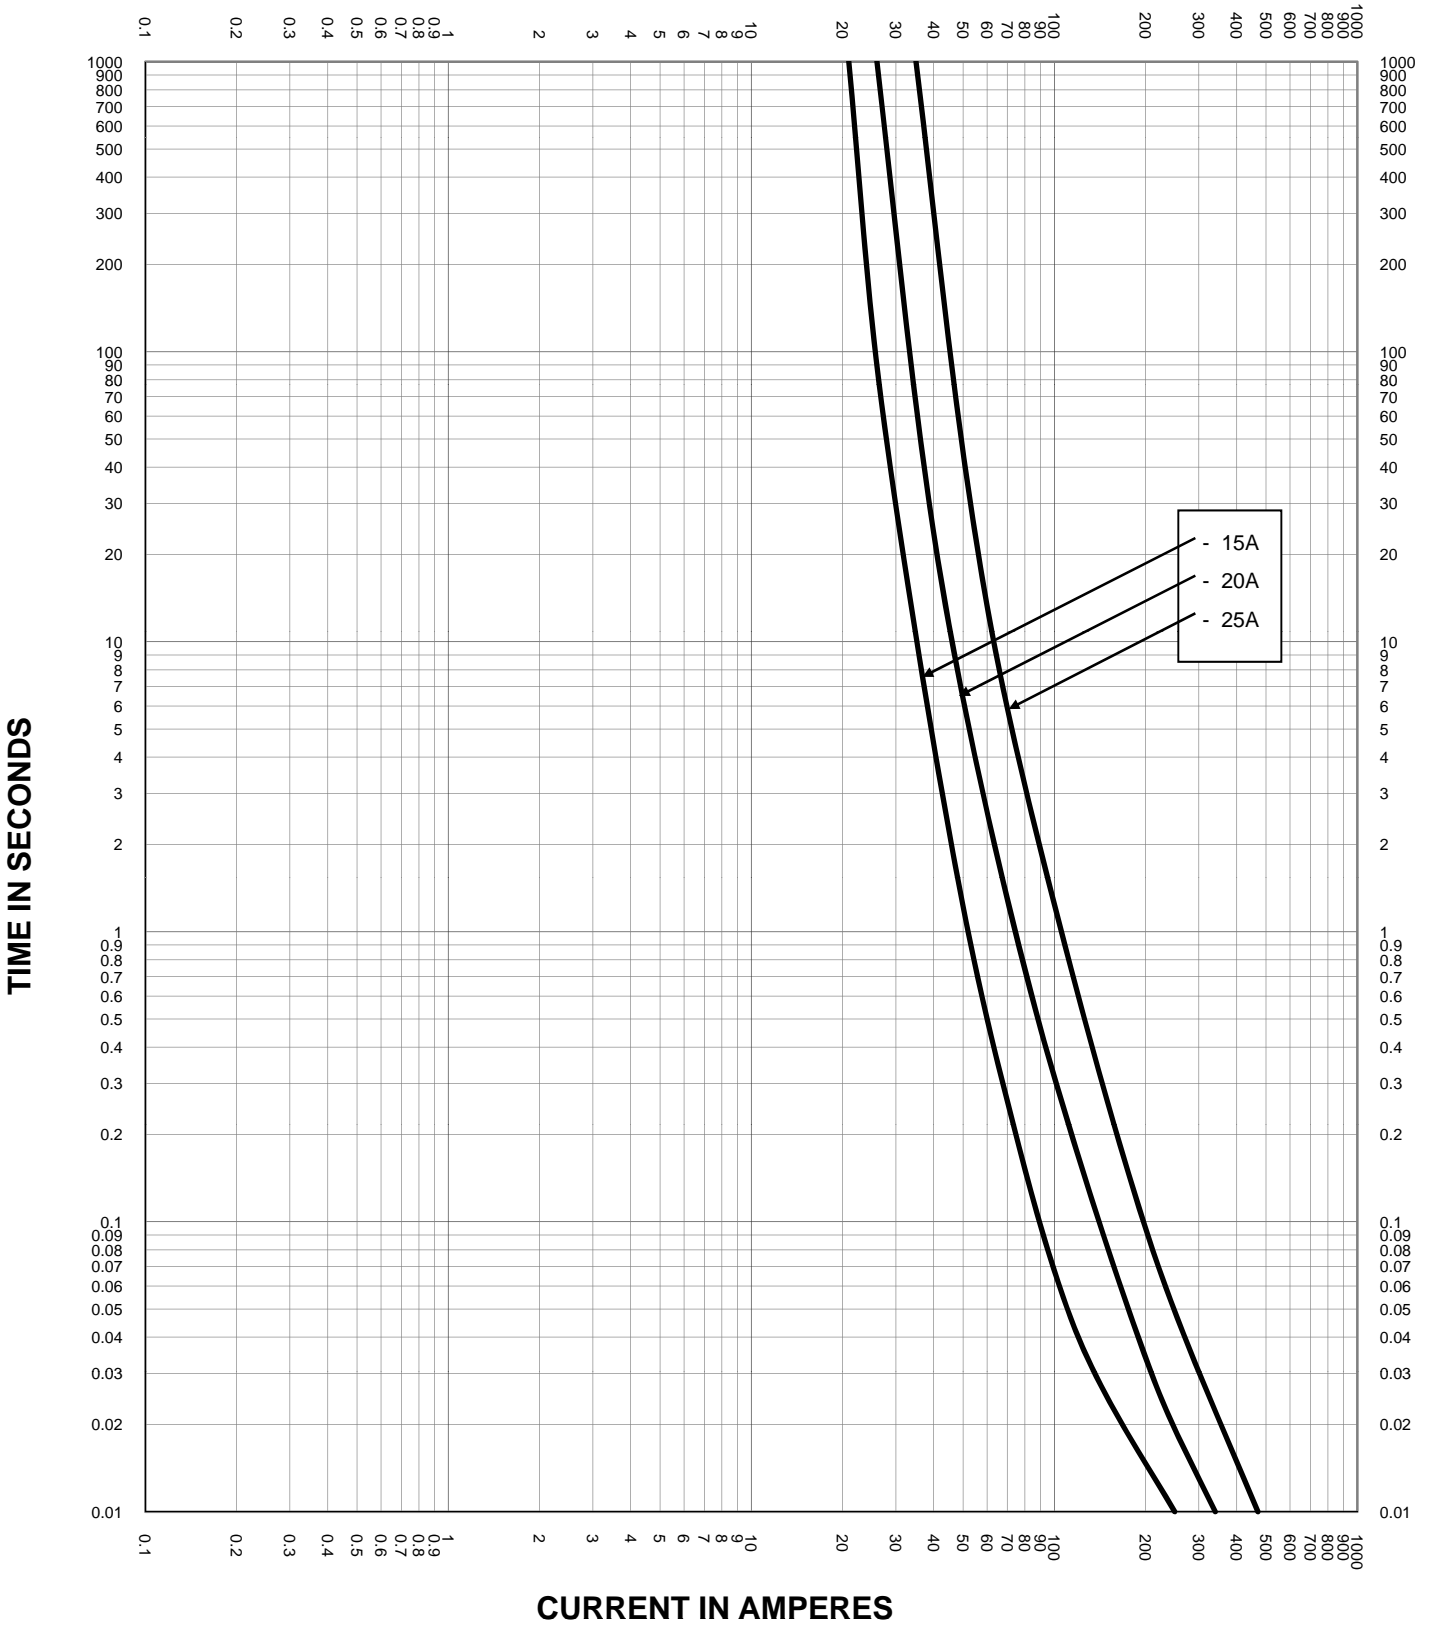

TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER <b>KLKD 15A - 25A</b>
BASIS FOR DATA:		
<b>LITTELFUSE, INC.</b> DES PLAINES, IL USA		DRAWN BY: LLL DATE: 4/5/11 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO. Sheet 4 of 5 FCC01-KLKD

# Time Current Curve

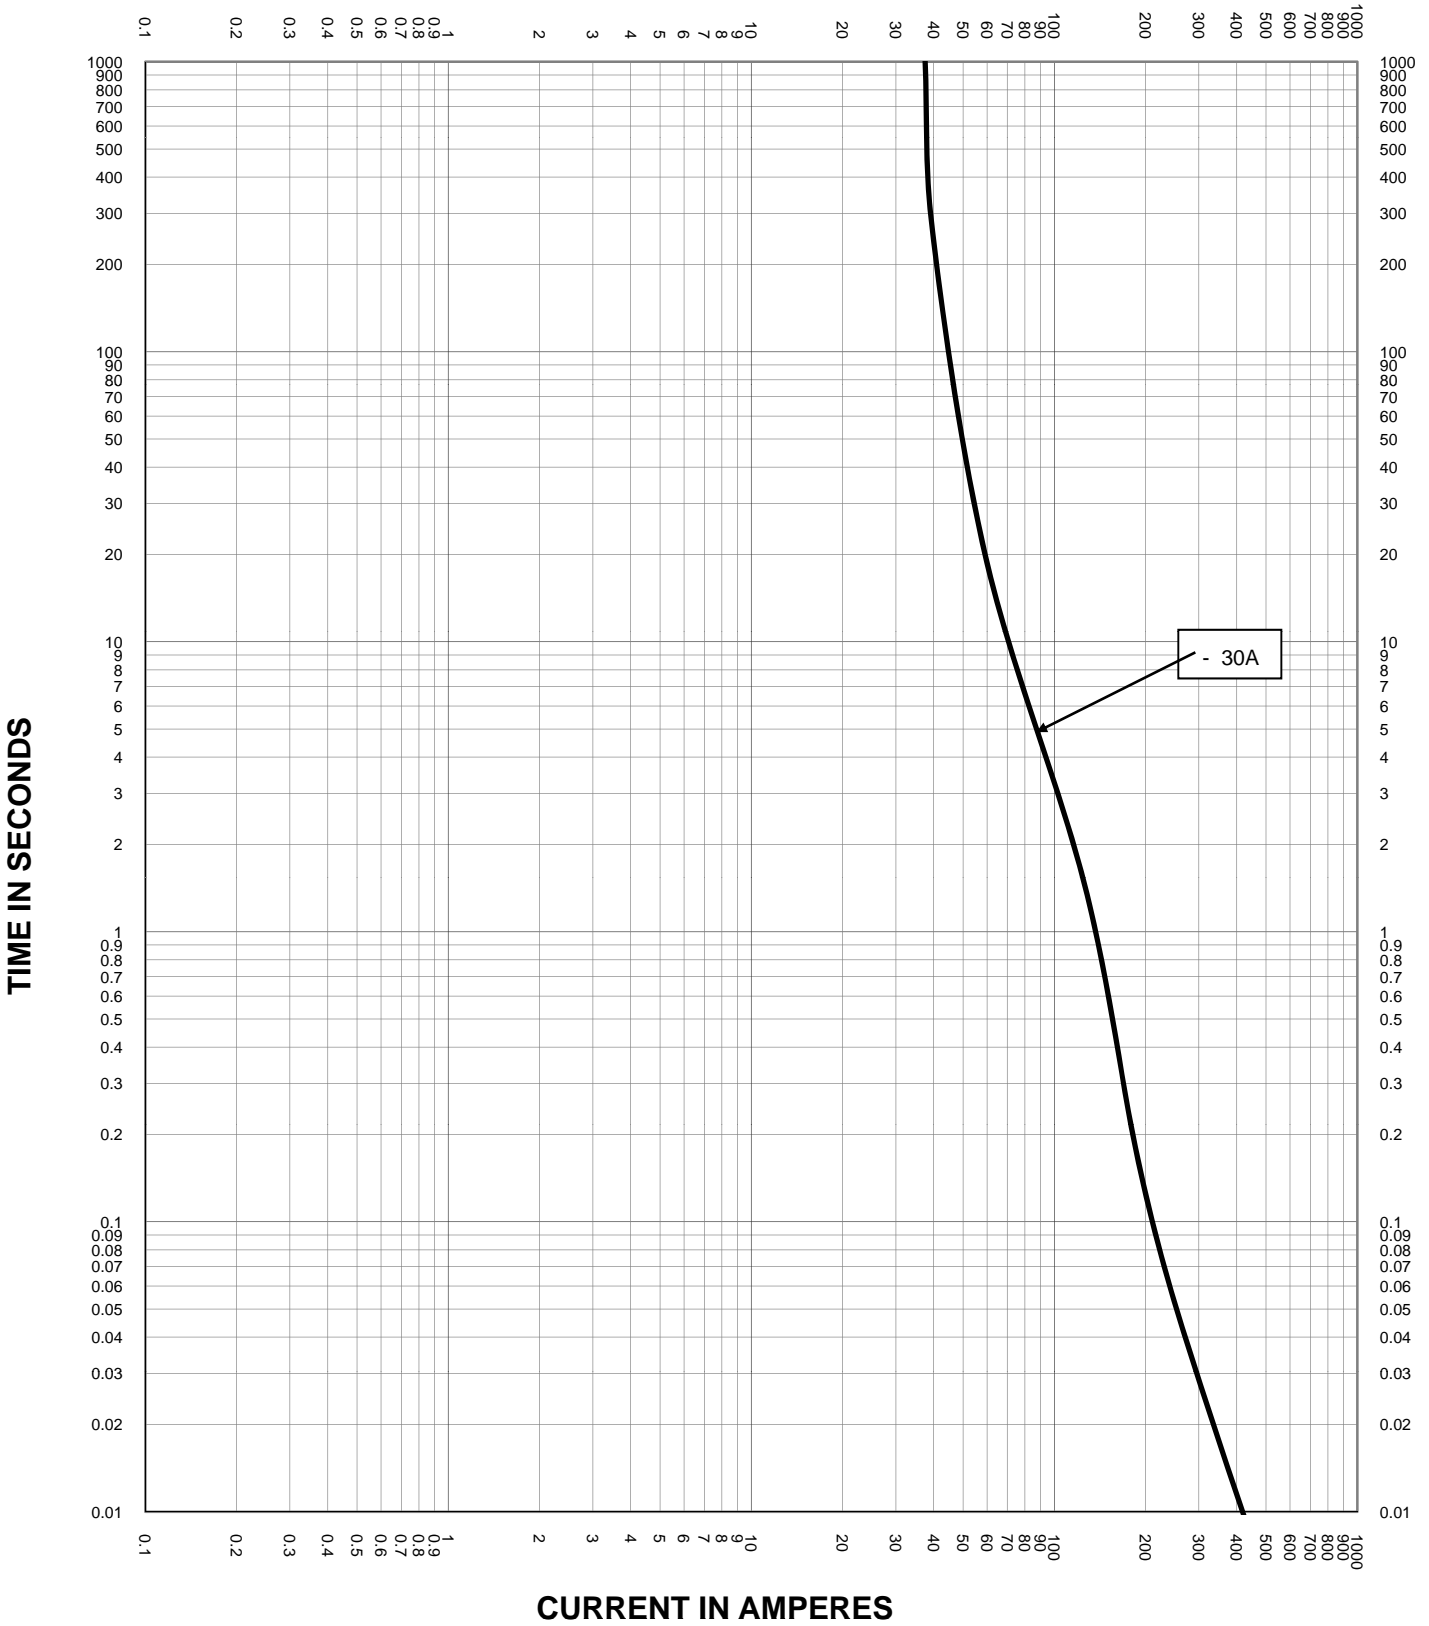

TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER <b>KLKD 30A</b>
BASIS FOR DATA:		
 <b>LITTELFUSE, INC.</b> DES PLAINES, IL USA		DRAWN BY: LLL DATE: 4/5/11 REVISION: B
<b>TIME CURRENT CHARACTERISTIC CURVES</b>		DRAWING NO. Sheet 5 of 5 FCC01-KLKD