


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

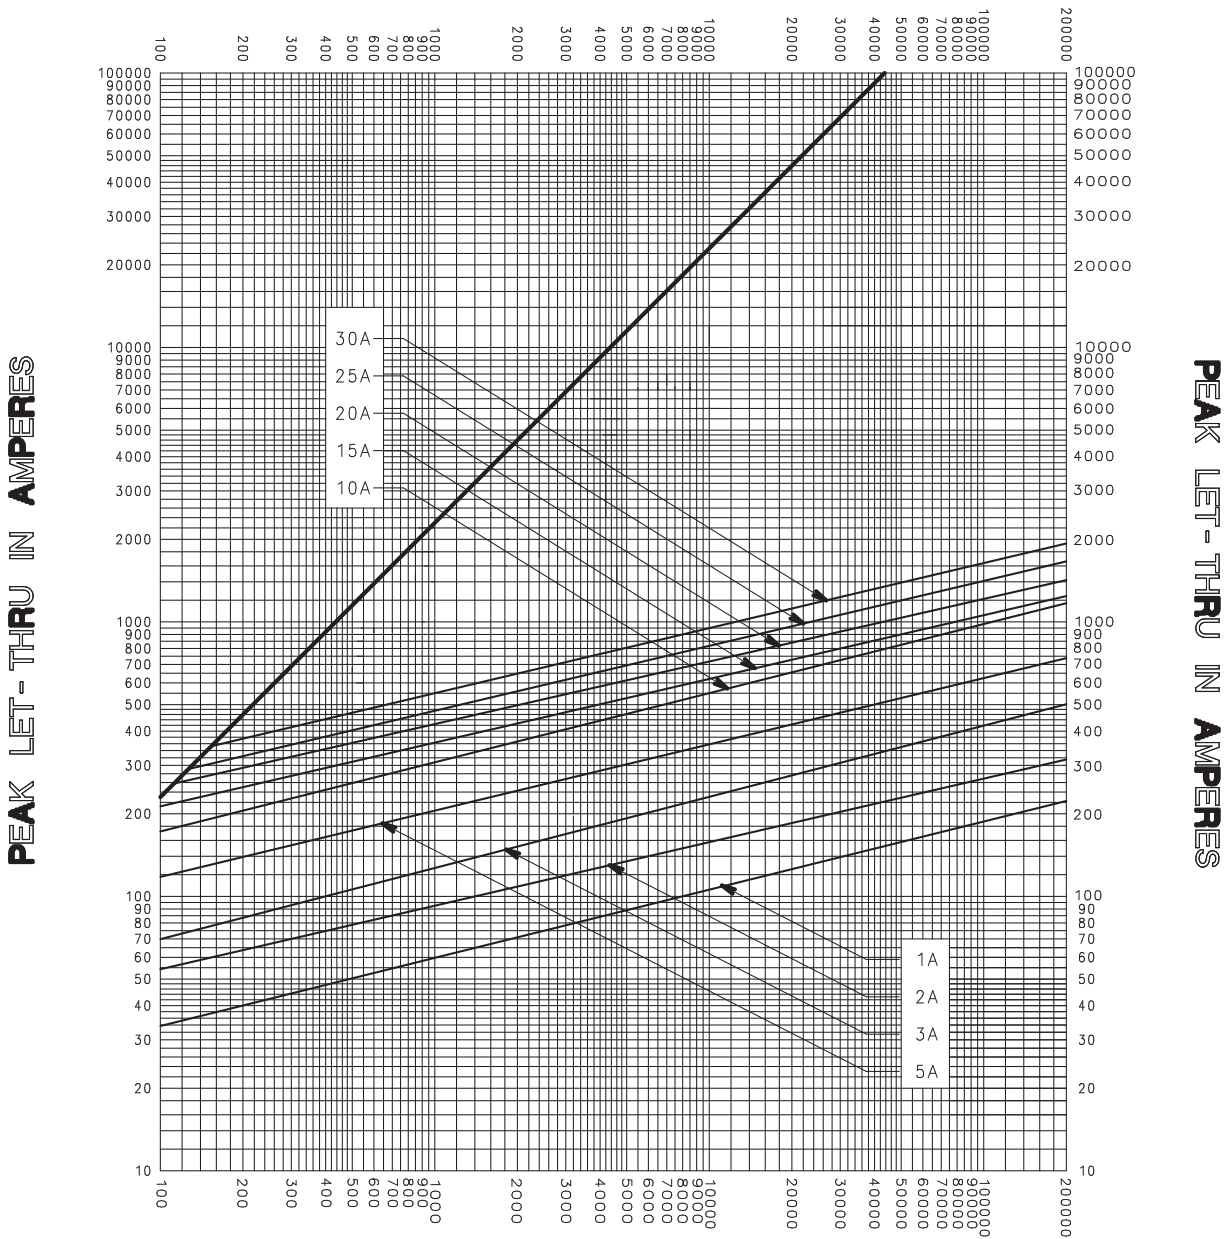


**AVAILABLE FAULT CURRENT
SYMMETRICAL R. M. S. AMPERES**

TEST VOLTAGE <u>250V</u> TIME CONSTANT / POWER FACTOR _____		FUSE CATALOG NUMBER
BASIS FOR DATA _____		<u>L25S (1A - 30A)</u>
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. <u>A-FCC05-1</u> 100000 90000 80000 70000 60000 50000 40000 30000 20000 10000 9000 8000 7000 6000 5000 4000 3000 2000 1000 900 800 700 600 500 400 300 200 100 90 80 70 60 50 40 30 20 10


-THIS DATA GENERATED ON CAD-

**UNCONTROLLED
DOCUMENT**

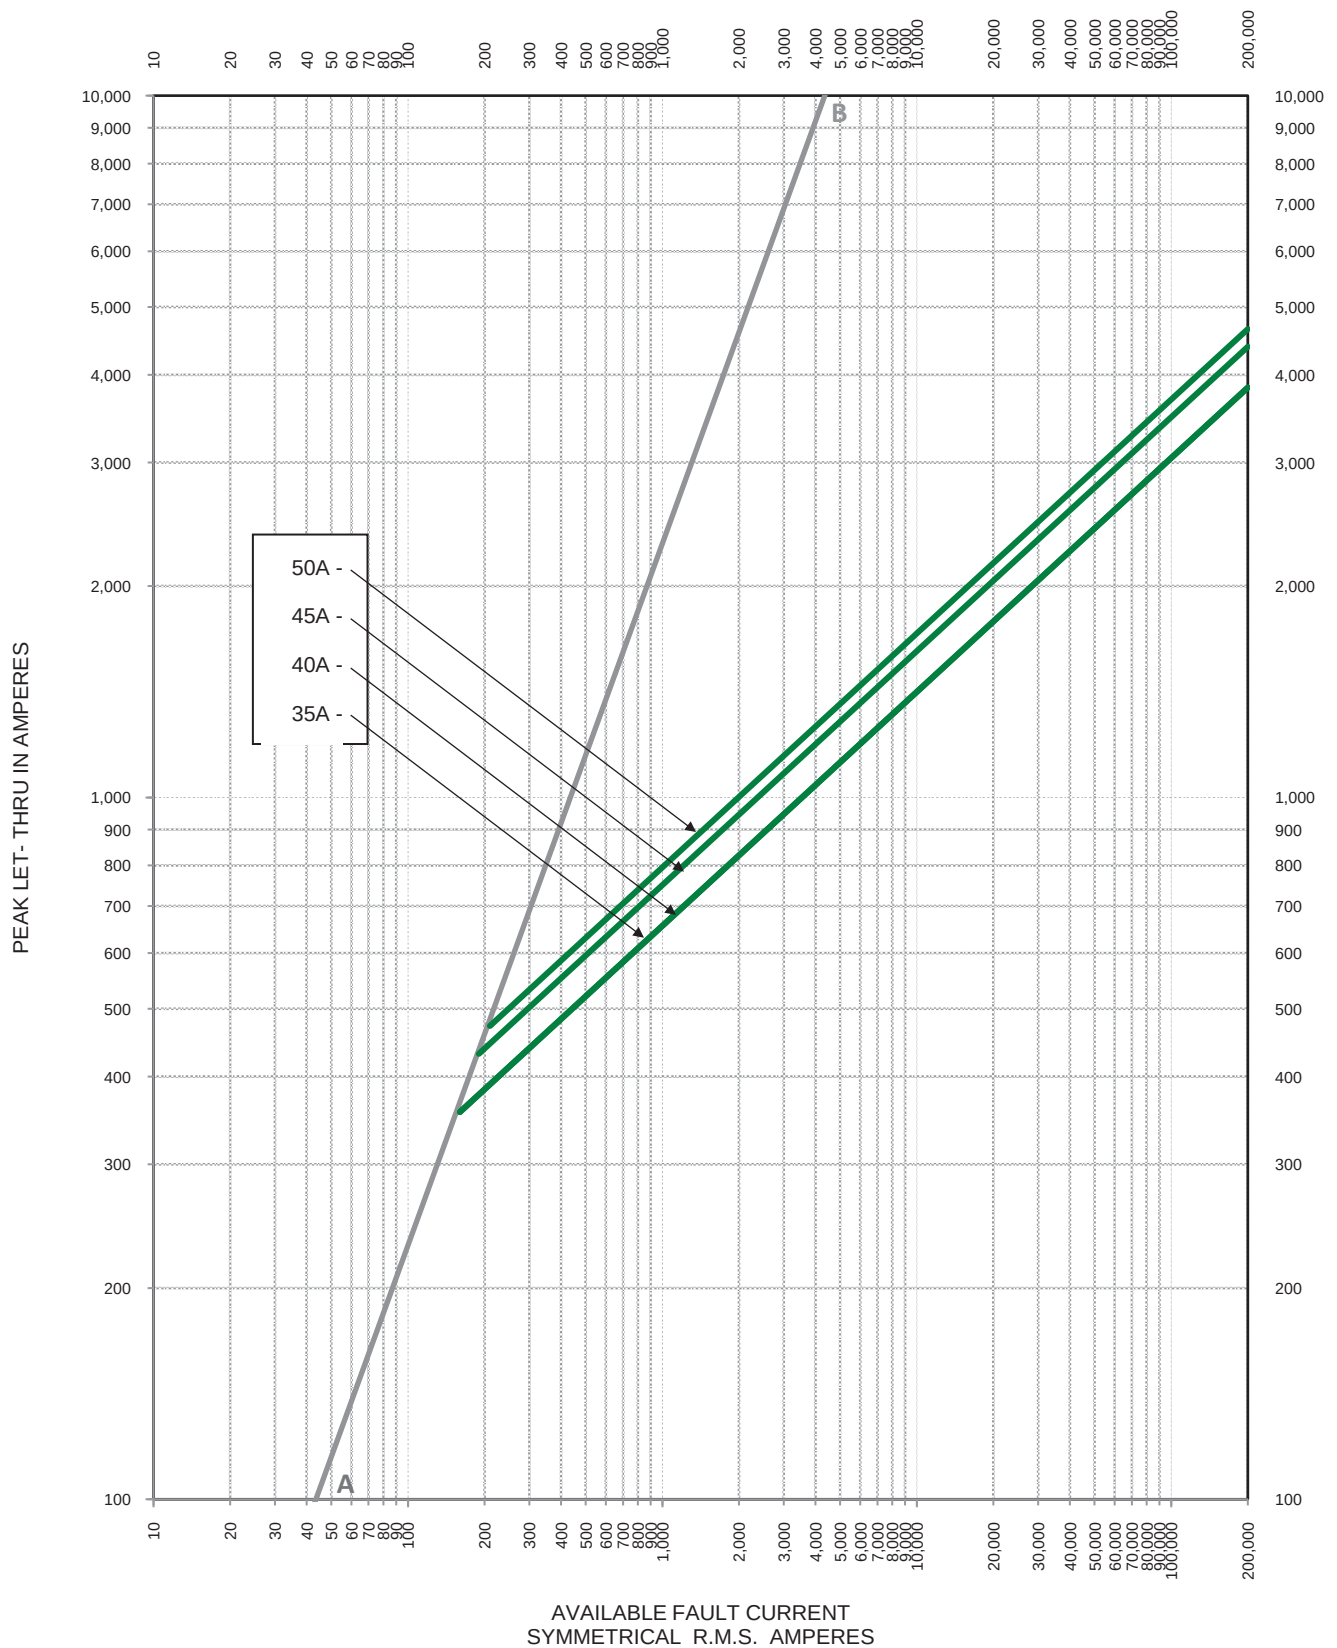

TEST VOLTAGE:		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA: AB = 15% Power Factor			L25S 35A - 50A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 11/27/2018	
PEAK LET-THRU CHARACTERISTIC CURVES		REVISION: A	
		DRAWING NO.:	SHEET 2 OF 2
		FCC05-L25S	

AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

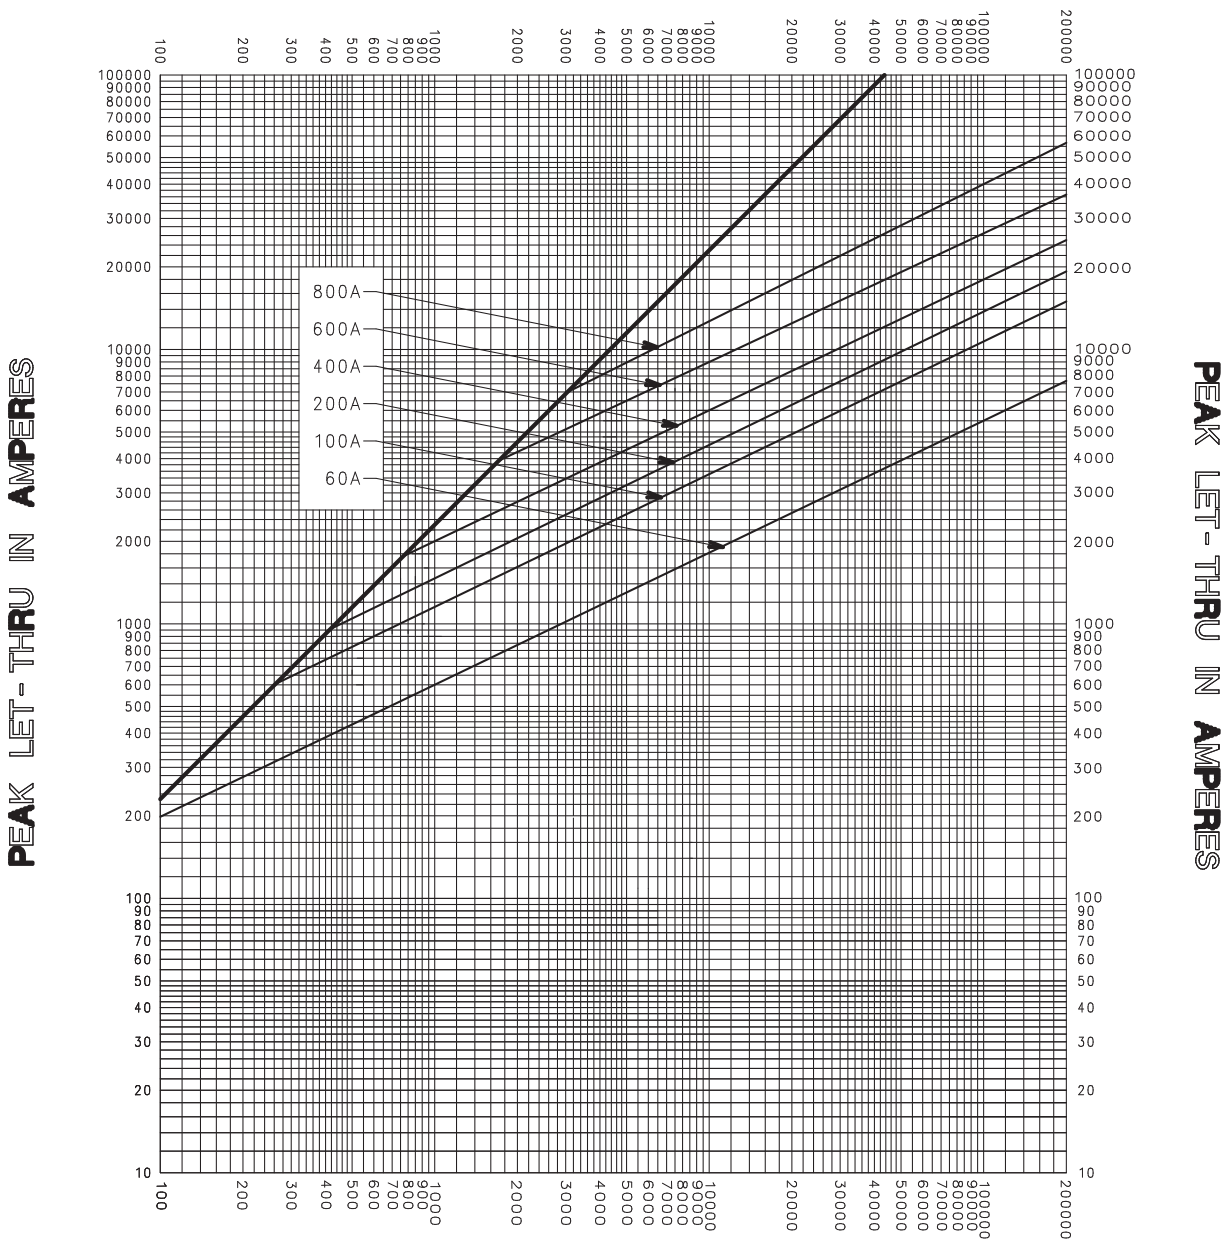

AVAILABLE FAULT CURRENT SYMMETRICAL R. M. S. AMPERES

TEST VOLTAGE <u>250V</u> TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____		FUSE CATALOG NUMBER L25S (60A - 800A)
 LITTELFUSE, INC. DES PLAINES, ILL. USA		DRAWN BY <u>LLL</u> DATE <u>05/17/06</u> CHECKED BY <u>MP</u>
PEAK LET-THRU CHARACTERISTIC CURVES		DRAWING NO. <u>A-FCC05-155-2</u>

- THIS DATA GENERATED ON CAD -

**UNCONTROLLED
DOCUMENT**