


**CURRENT IN AMPERES**



**CURRENT IN AMPERES**

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (1A - 30A)
BASIS FOR DATA _____		

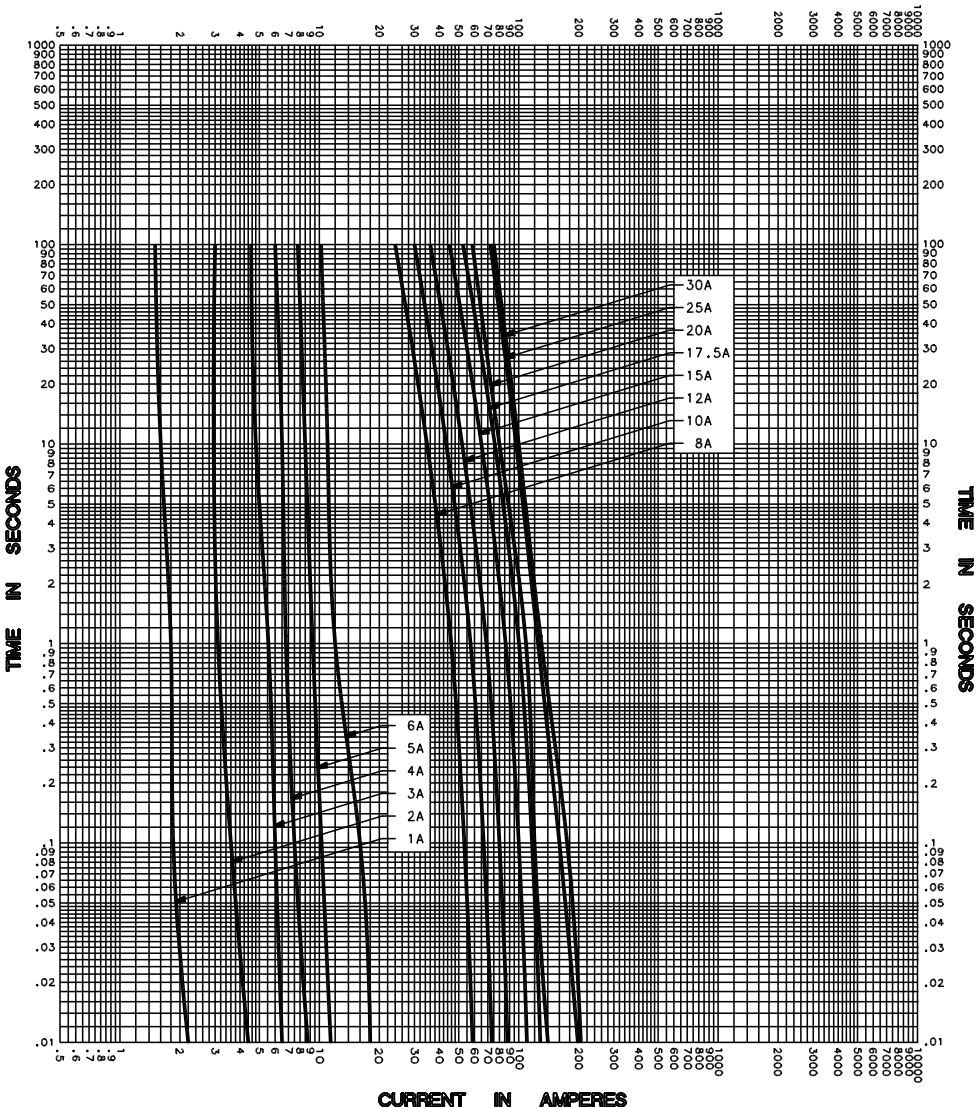


DRAWN BY BJJ
DATE 3/14/02
CHECKED BY _____
DRAWING NO. B - FCC01

**TIME CURRENT CHARACTERISTIC CURVES**

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

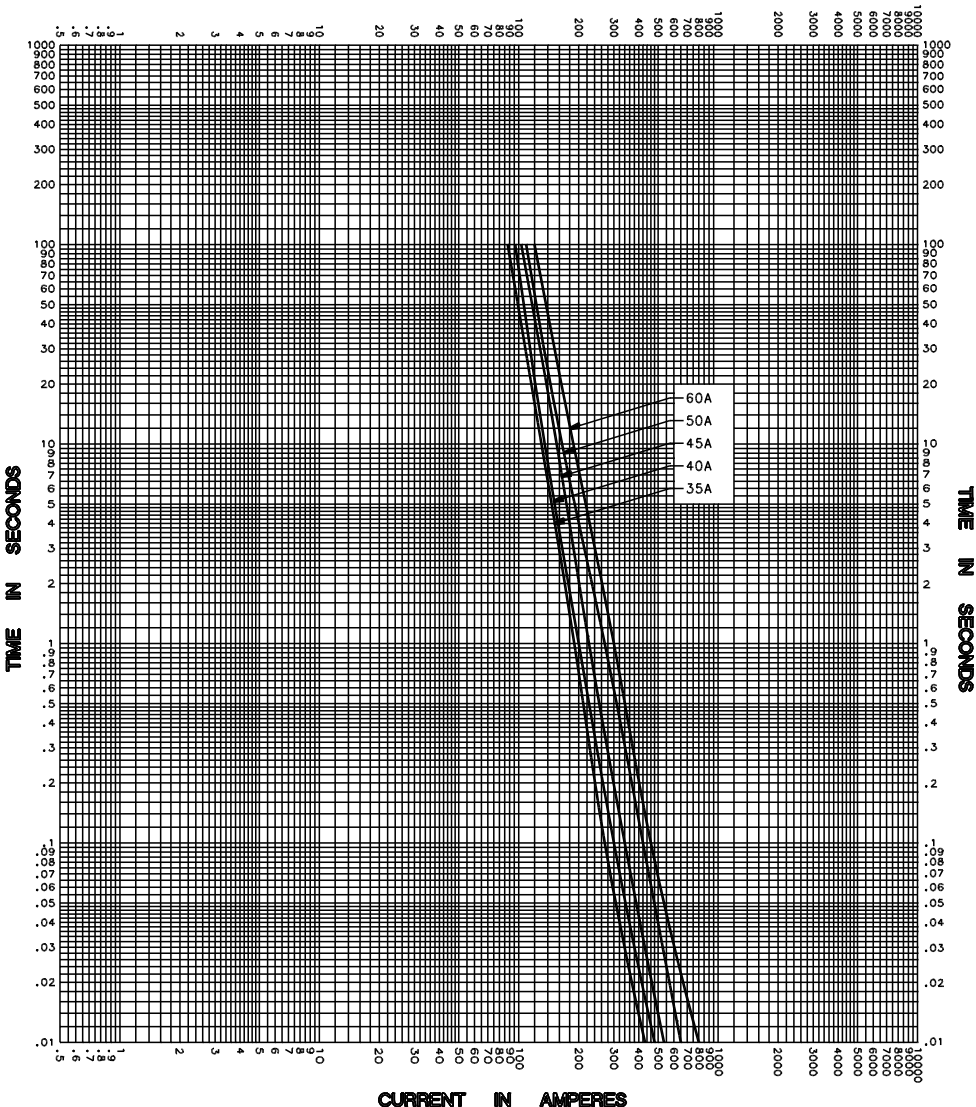

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (35A - 60A)
BASIS FOR DATA _____		


 DES PLAINES, ILLINOIS 60016	DRAWN BY LLL
	DATE 08/16/04
	CHECKED BY MP

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. A FCC01 08/02
---	---------------------------

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

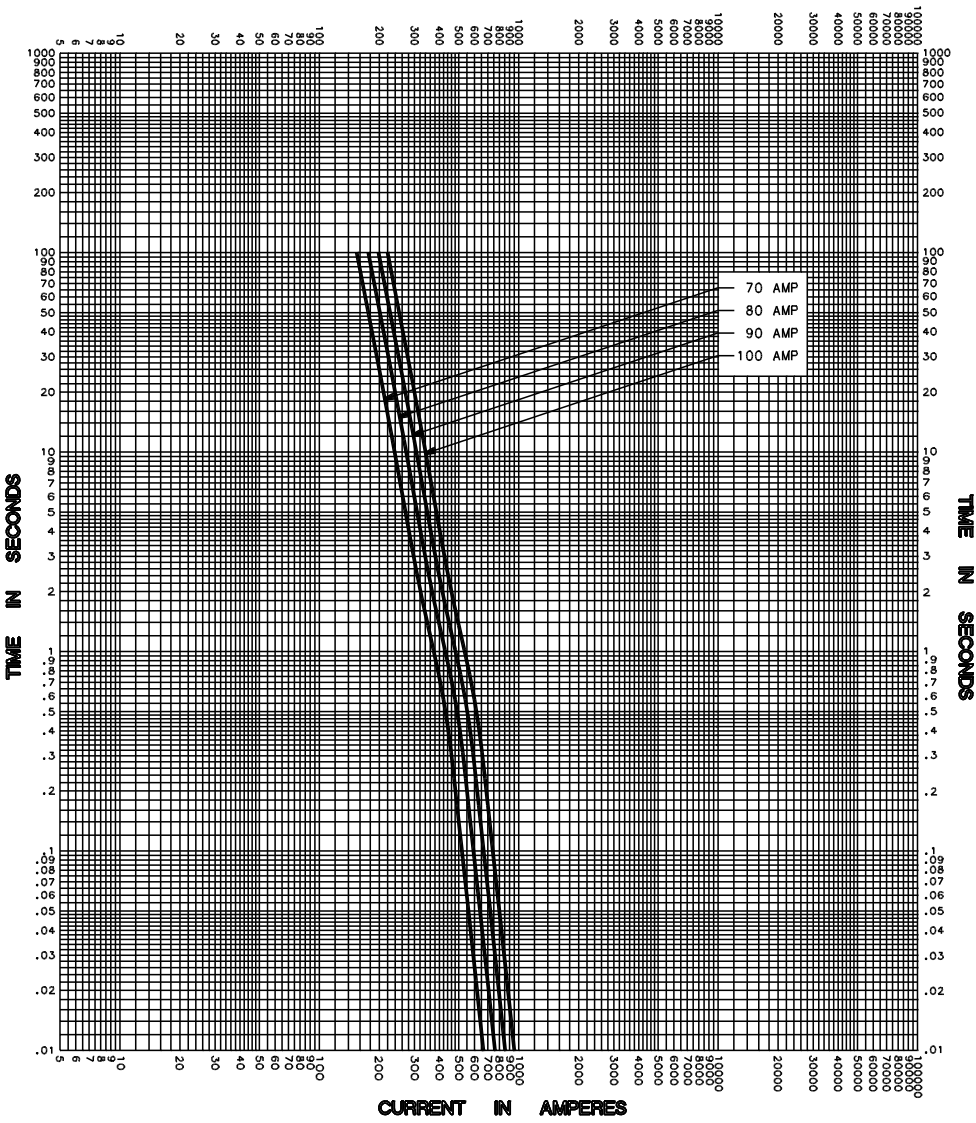


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (70A - 100A)
BASIS FOR DATA _____		

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>MRD</u>
	DATE <u>02/19/03</u>
	CHECKED BY <u>IN</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>B-FCC0003</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

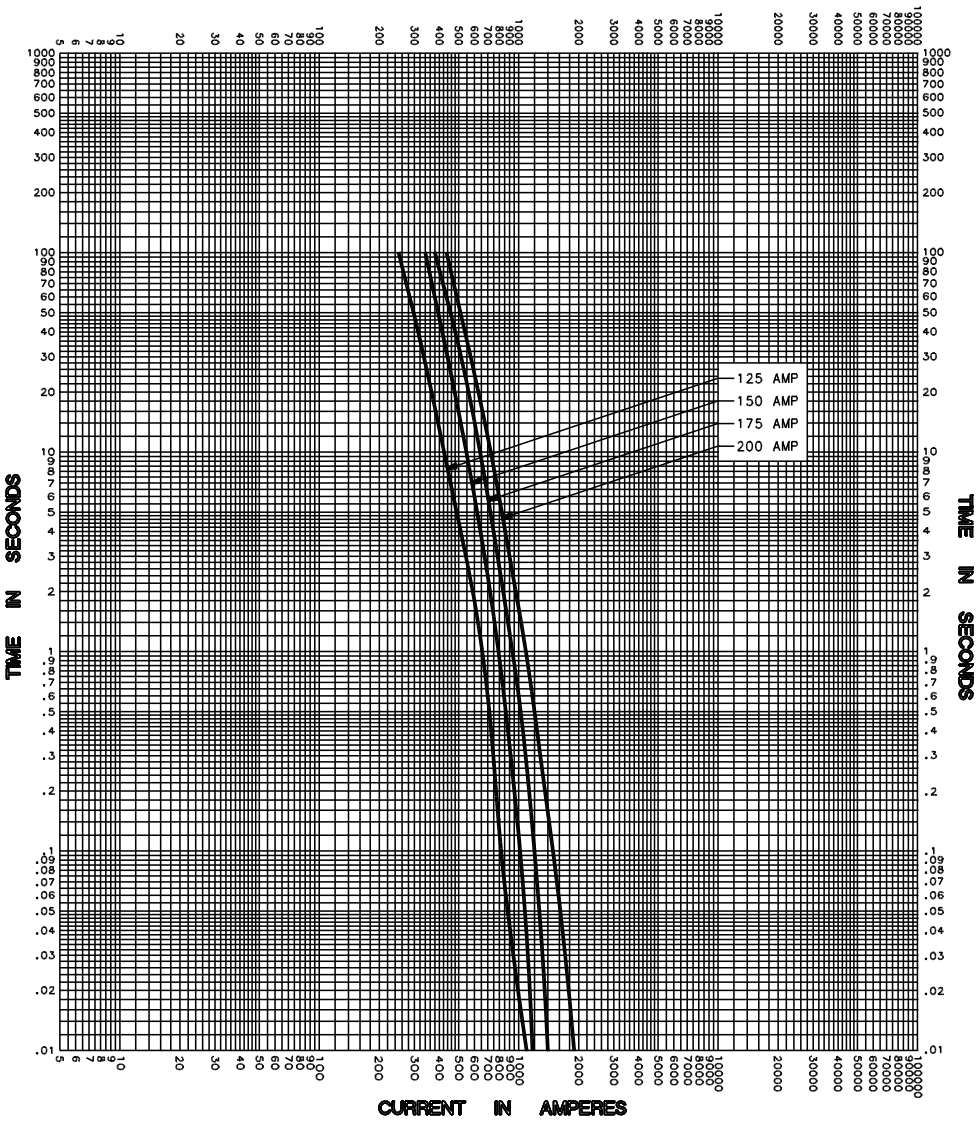


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER <b>L60S (125A - 200A)</b>
BASIS FOR DATA _____		

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>08/16/04</u>
	CHECKED BY <u>MP</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>A-FCC000004</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

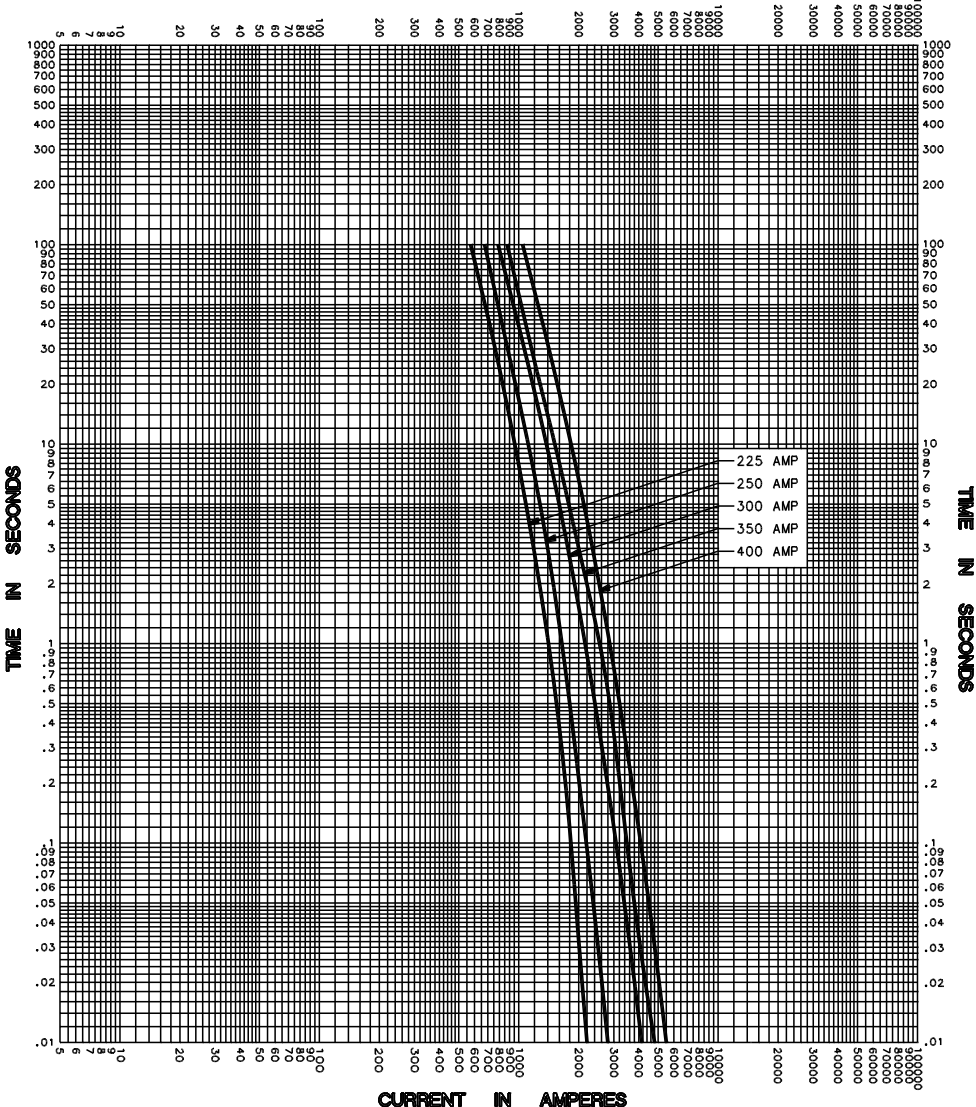

TEST VOLTAGE \_\_\_\_\_ TIME CONSTANT / POWER FACTOR \_\_\_\_\_  
 BASIS FOR DATA \_\_\_\_\_

FUSE CATALOG NUMBER  
 L60S (225A - 400A)



**LITTELFUSE, INC.**  
 DES PLAINES, ILL. USA

DRAWN BY LLL  
 DATE 08/16/04  
 CHECKED BY MP


**TIME CURRENT CHARACTERISTIC CURVES**

DRAWING NO. A-FCC000000005

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

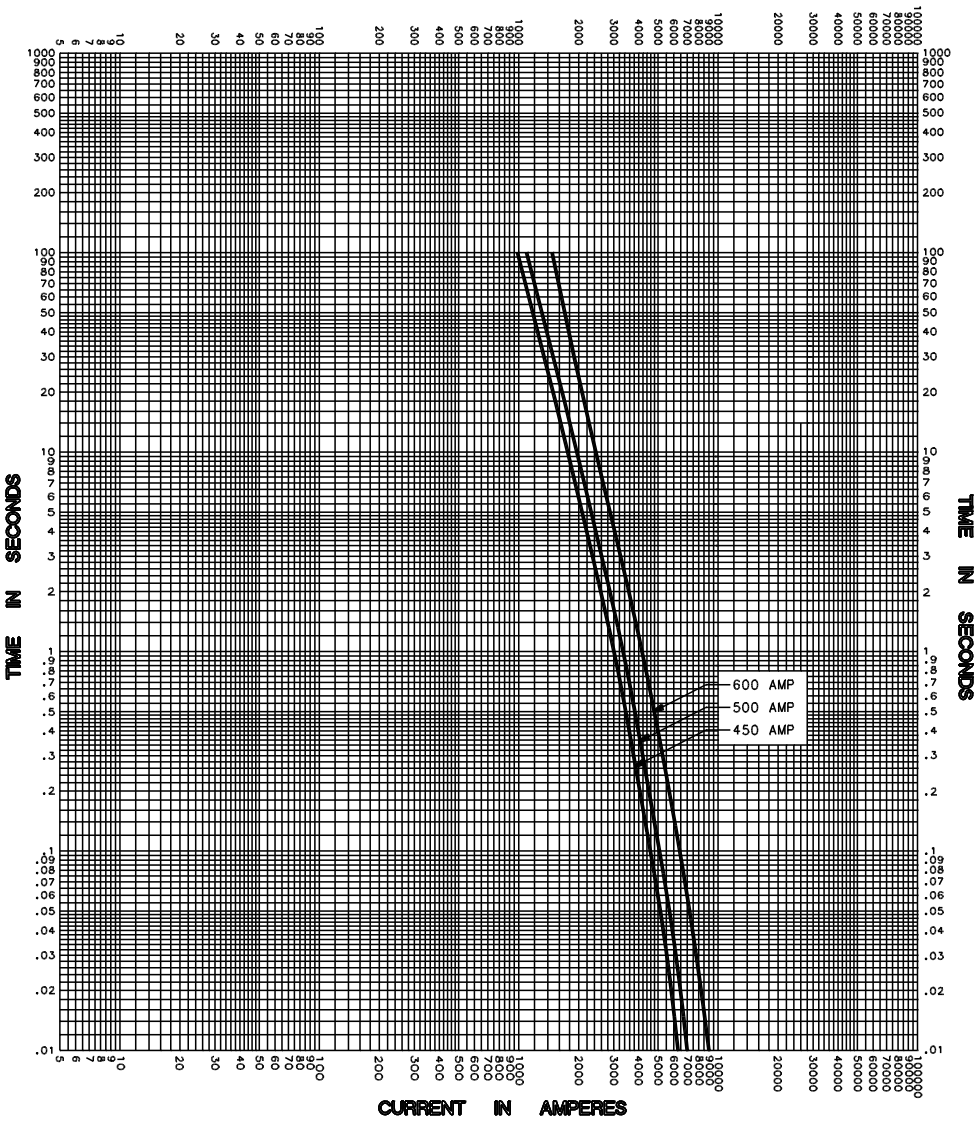

TEST VOLTAGE \_\_\_\_\_ TIME CONSTANT / POWER FACTOR \_\_\_\_\_  
 BASIS FOR DATA \_\_\_\_\_

FUSE CATALOG NUMBER  
 L60S (450A - 600A)



DRAWN BY LLL  
 DATE 08/16/04  
 CHECKED BY MP


**TIME CURRENT CHARACTERISTIC CURVES**

DRAWING NO. A-FCC006

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

**CURRENT IN AMPERES**

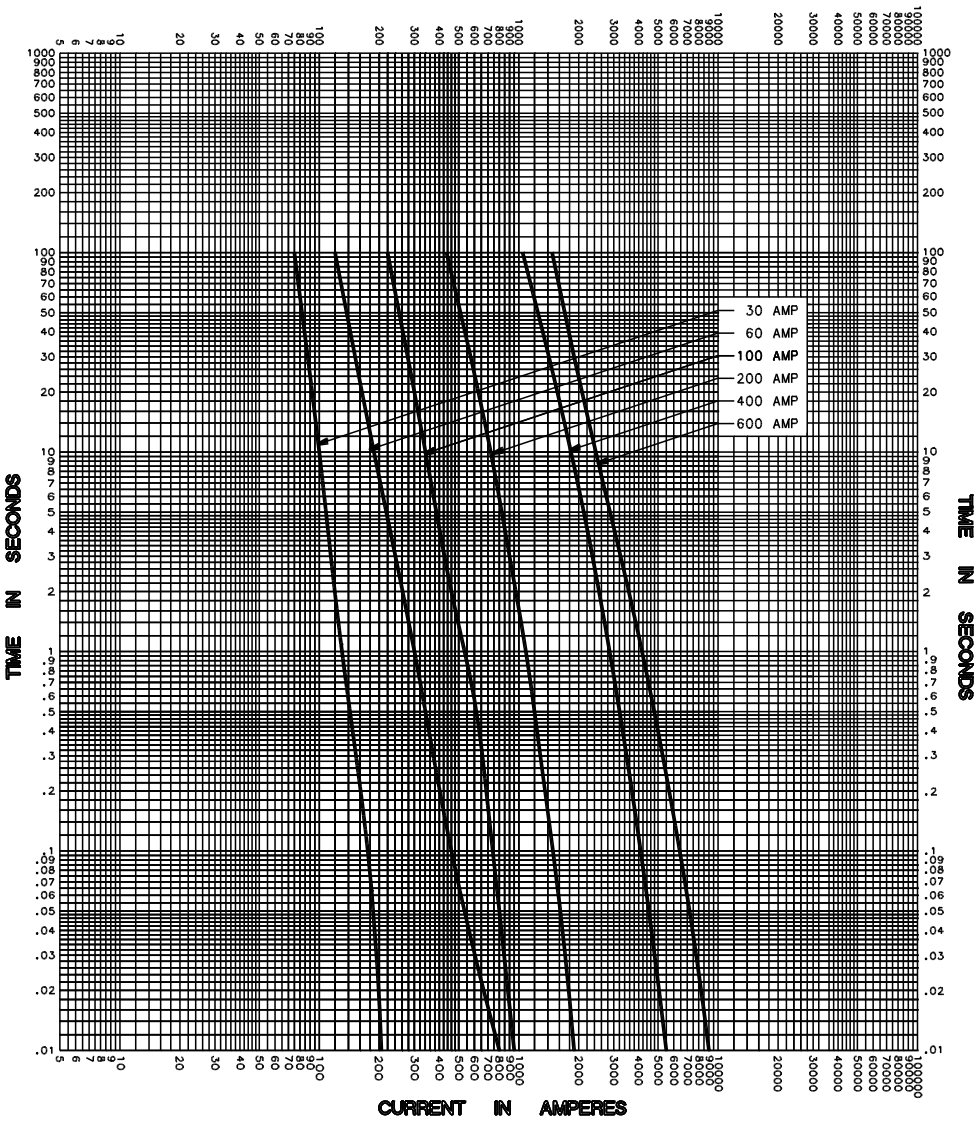

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER L60S (30A - 600A)
BASIS FOR DATA _____		

<b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>08/16/04</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	CHECKED BY <u>MP</u>
	DRAWING NO. <u>A-FCC0108</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT