


CURRENT IN AMPERES

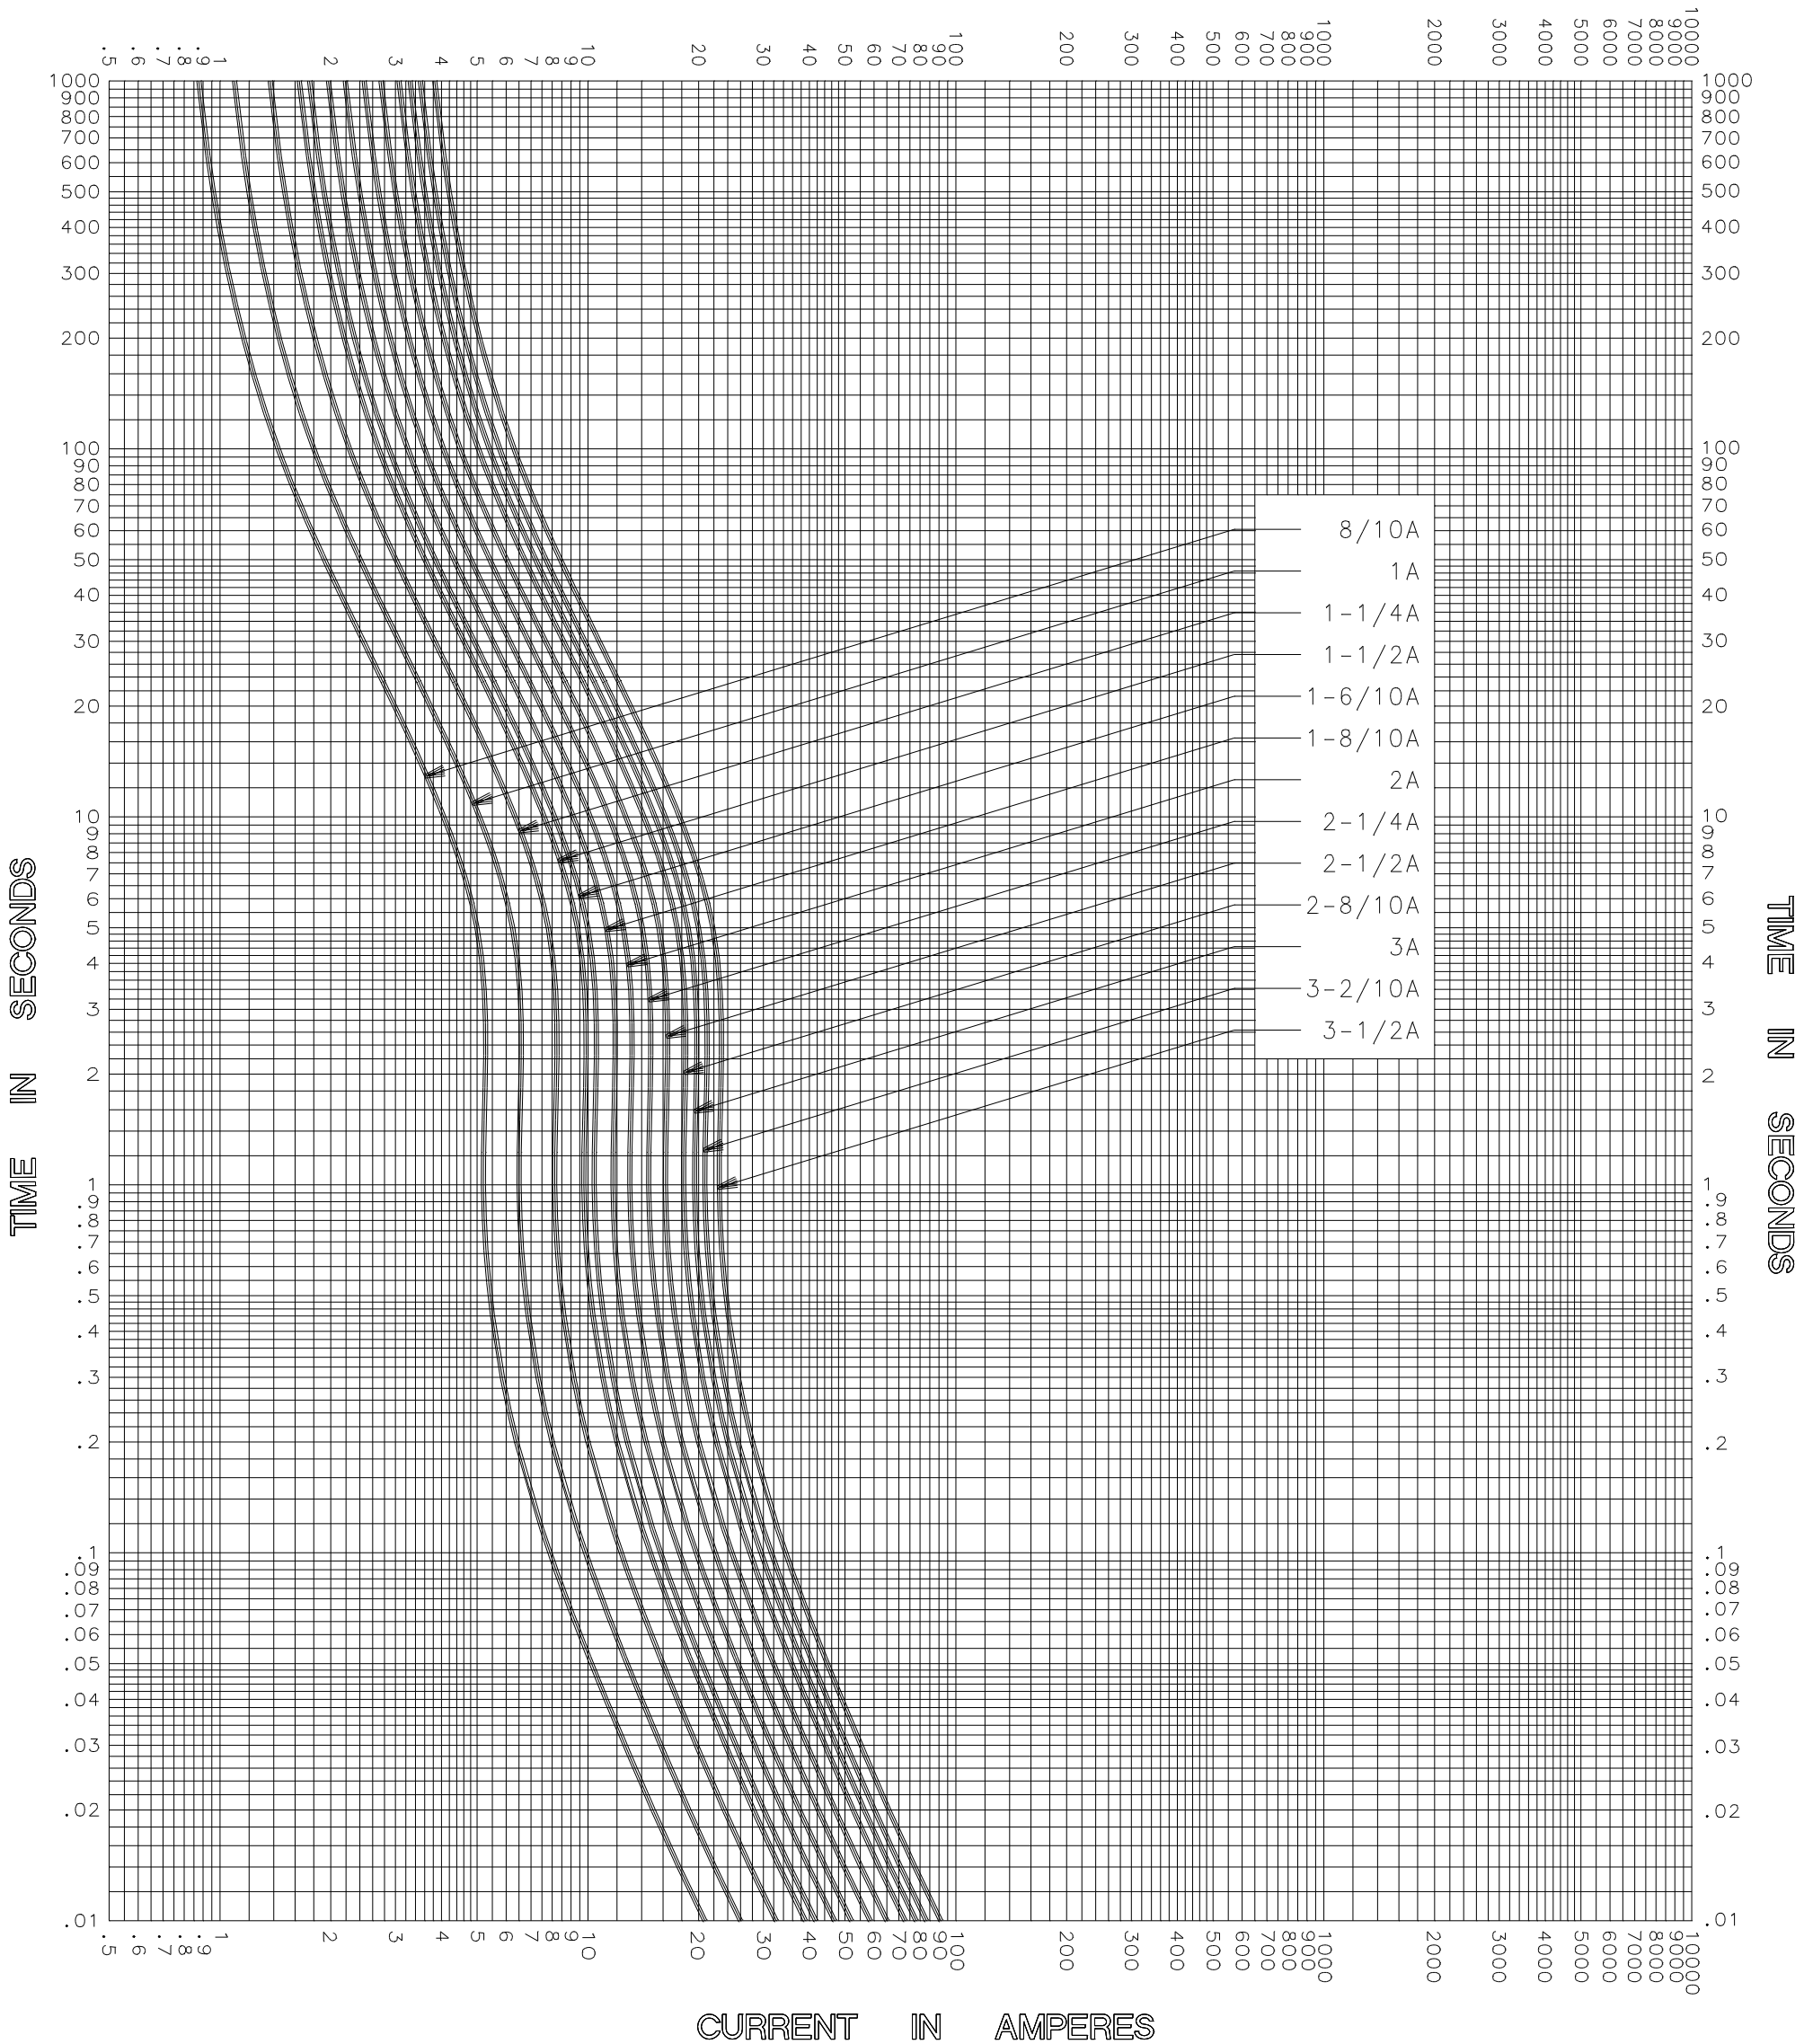

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		JTD (8/10A - 3-1/2A) ID


**LITTELFUSE, INC.**  
 DES PLAINES, ILL. USA

DRAWN BY LLL  
 DATE 01/07/05  
 CHECKED BY MP


TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO. A-FCC01-1013

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

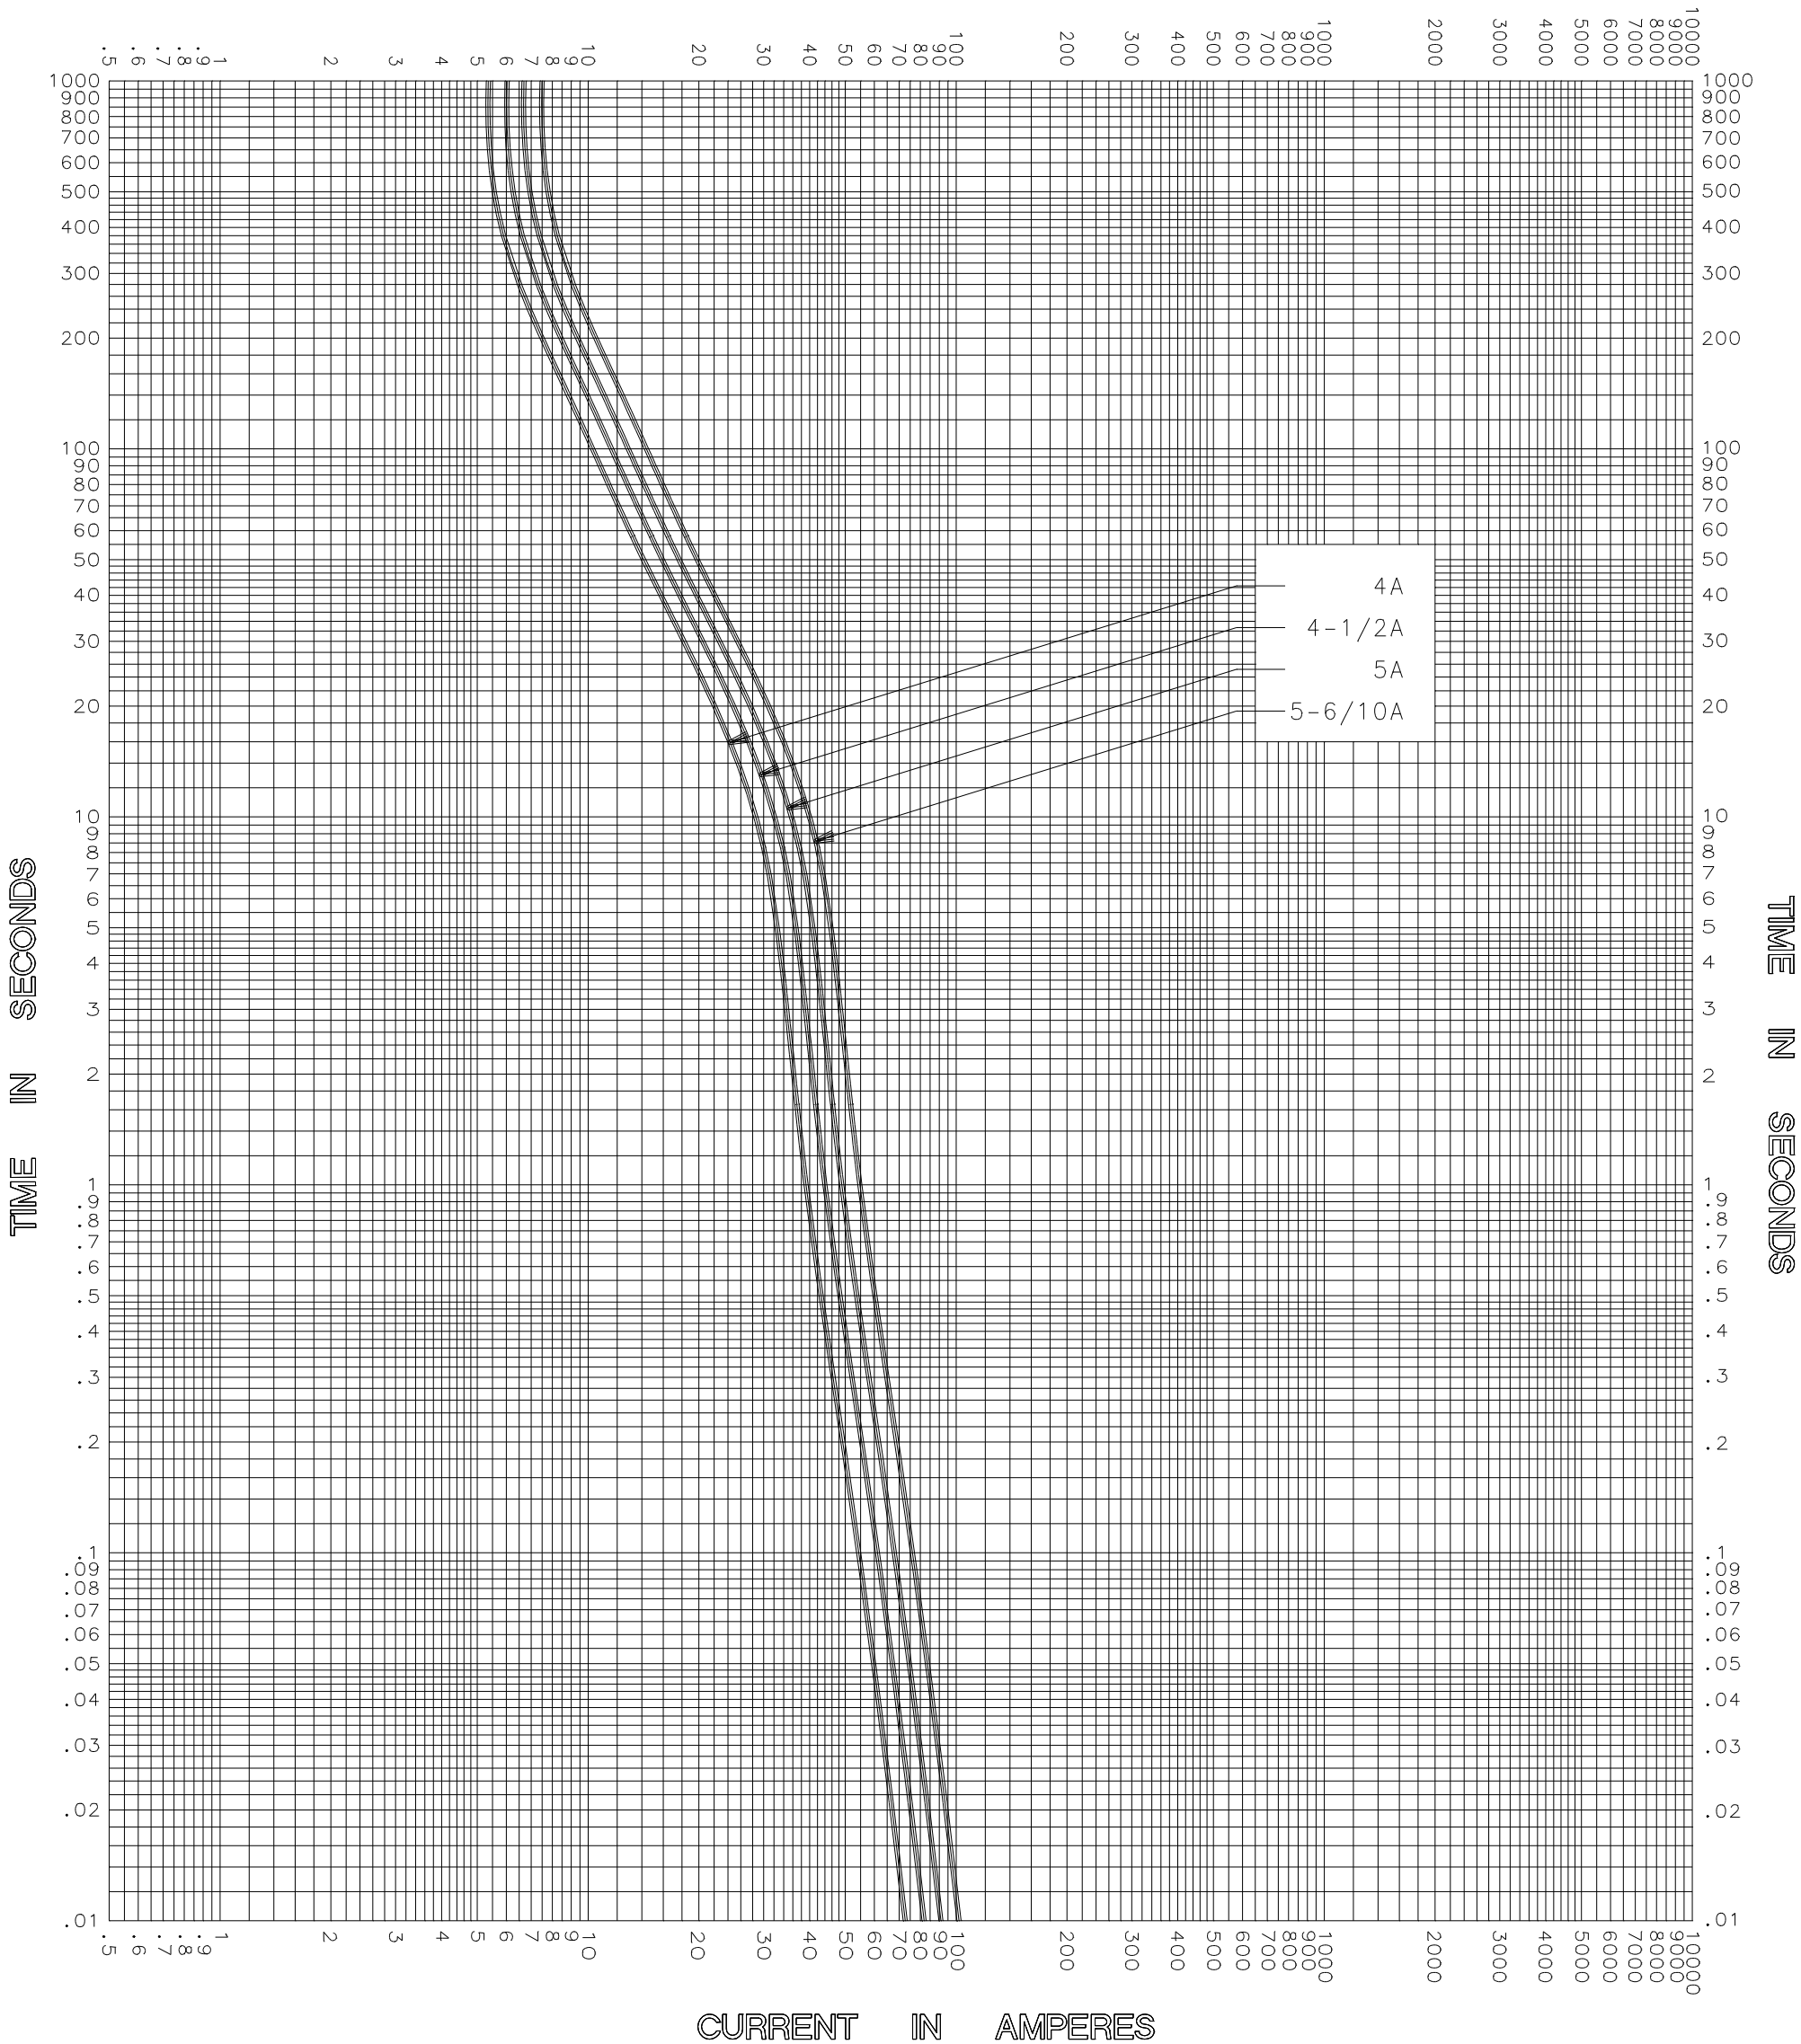

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	JTD (4A - 5-6/10A) ID


**LITTELFUSE, INC.**  
 DES PLAINES, ILL. USA

DRAWN BY LLL  
 DATE 01/07/05  
 CHECKED BY MP


**TIME CURRENT CHARACTERISTIC CURVES**

DRAWING NO. A-FCC01-102

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

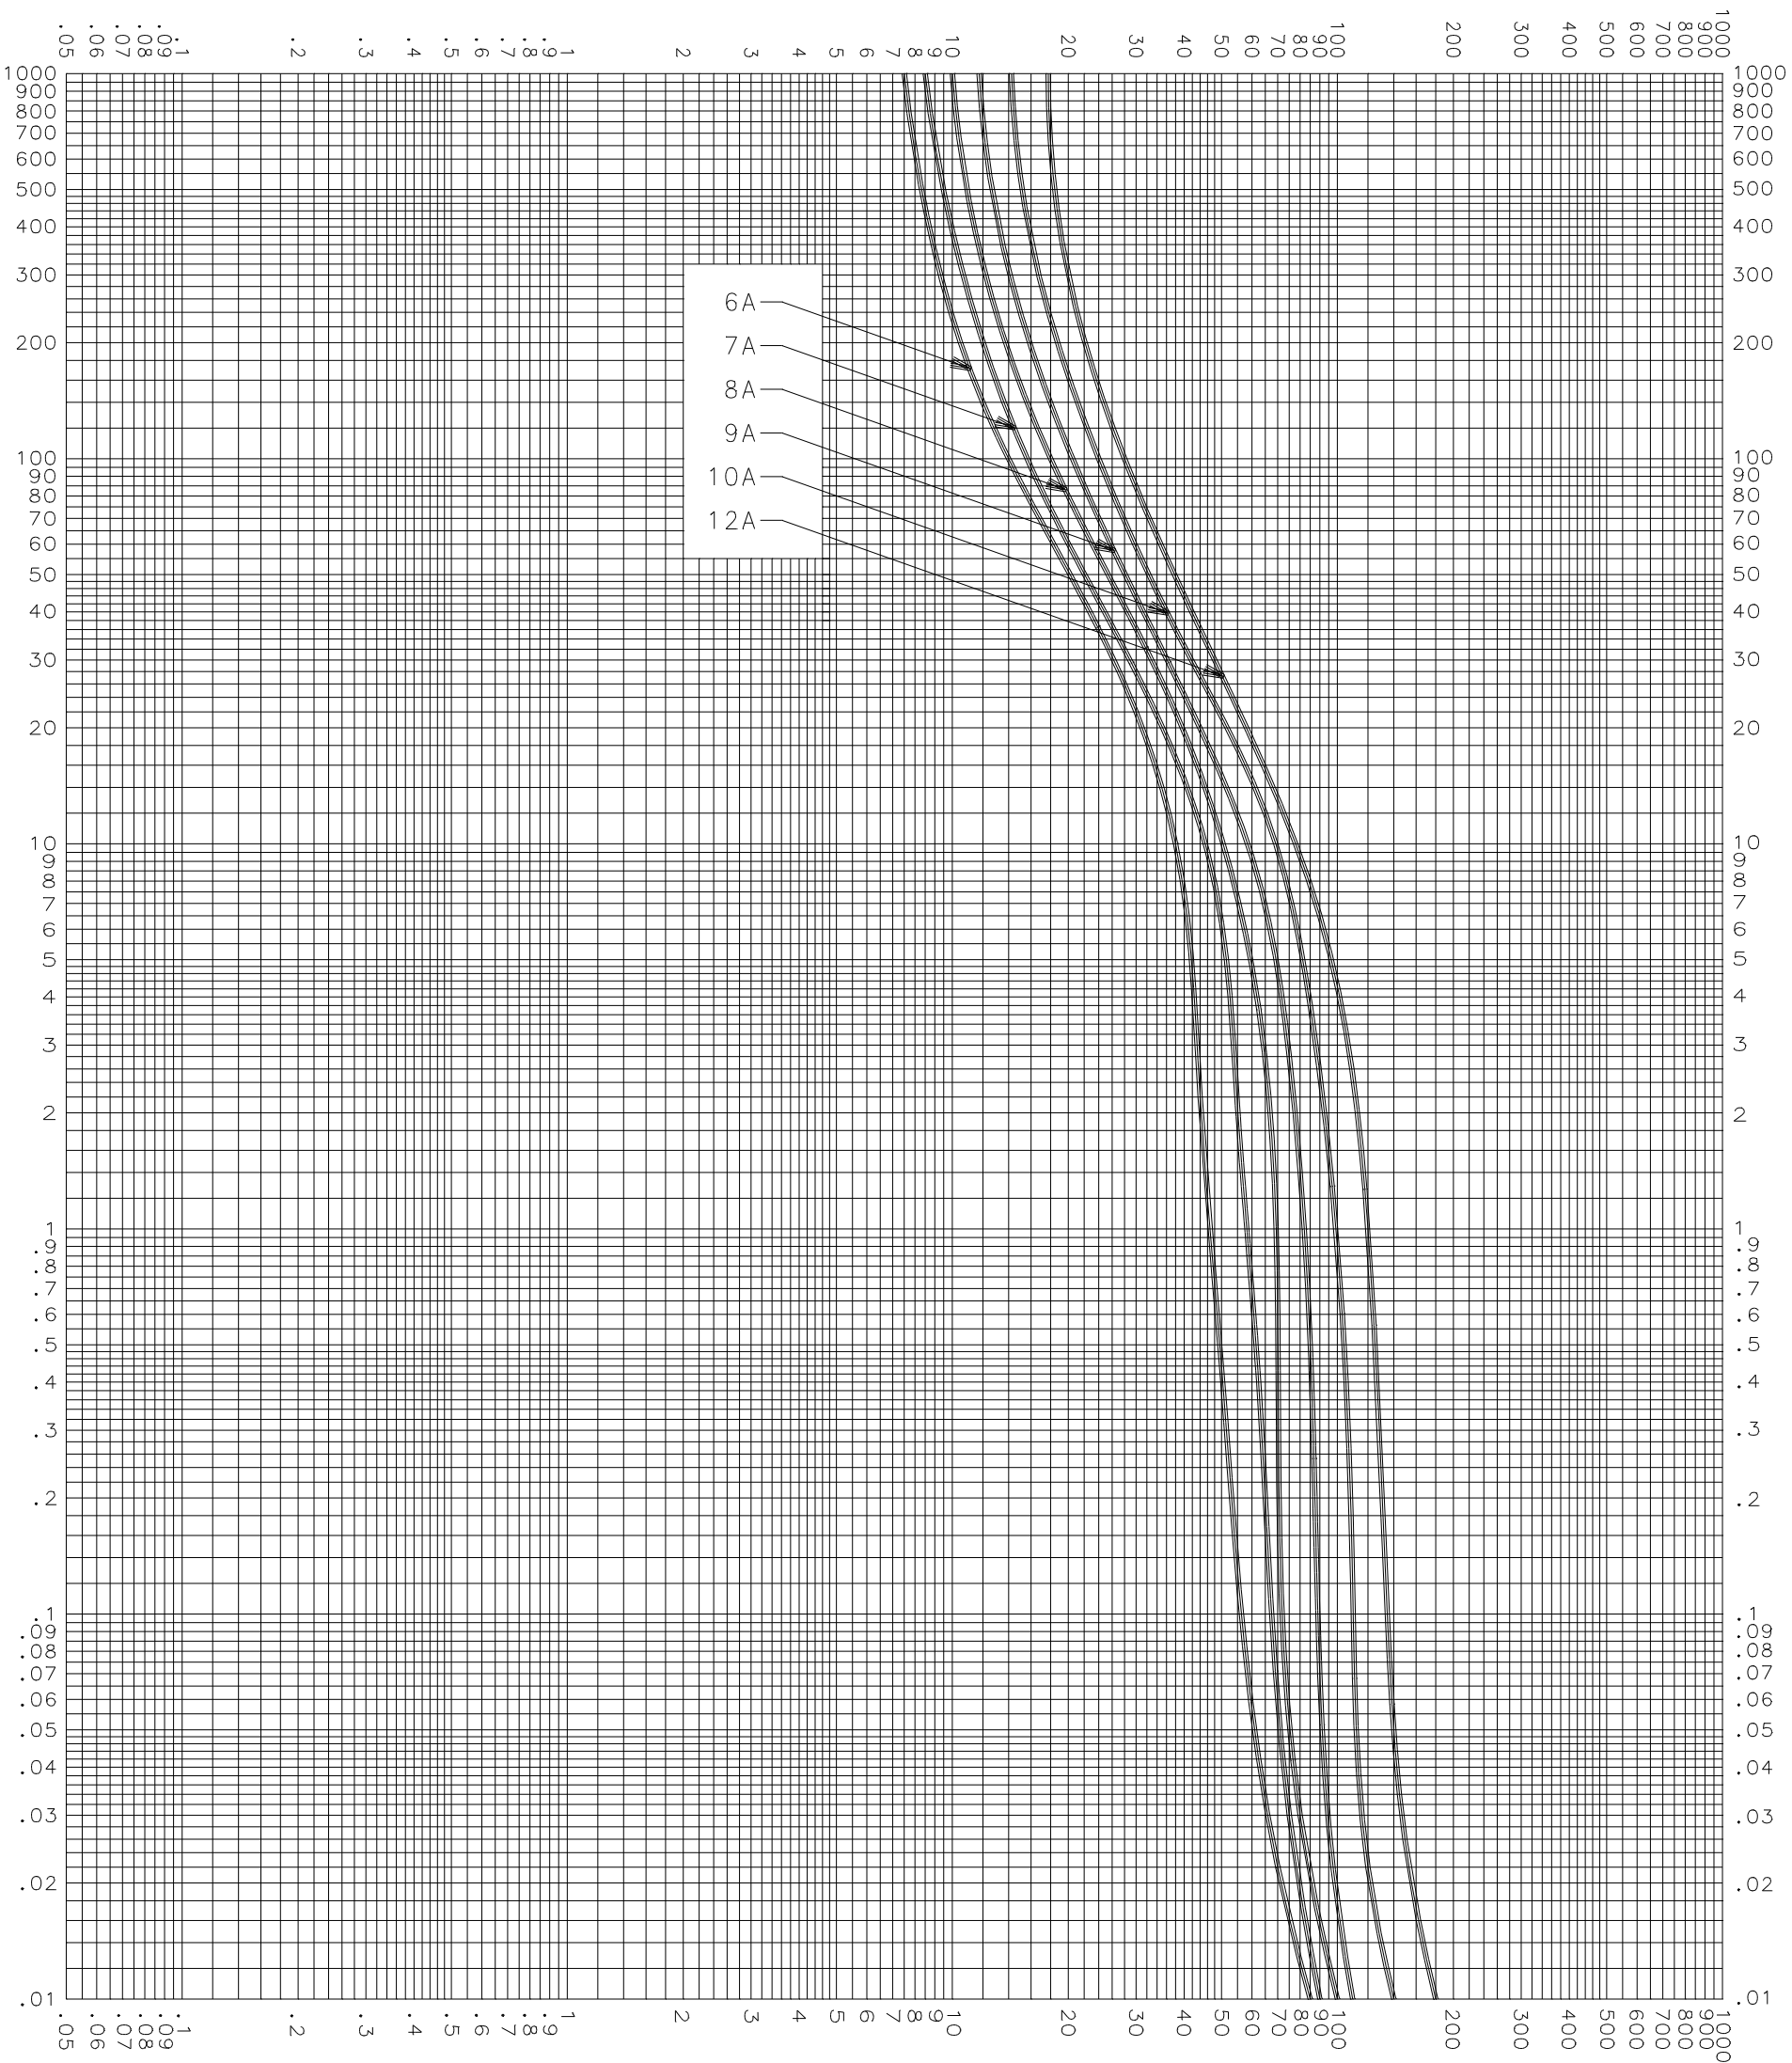


CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER JTD (6A - 12A) ID
BASIS FOR DATA _____		

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>

<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. A-FCC01-JTDID-003
-------------------------------------------	----------------------------------

CURRENT IN AMPERES

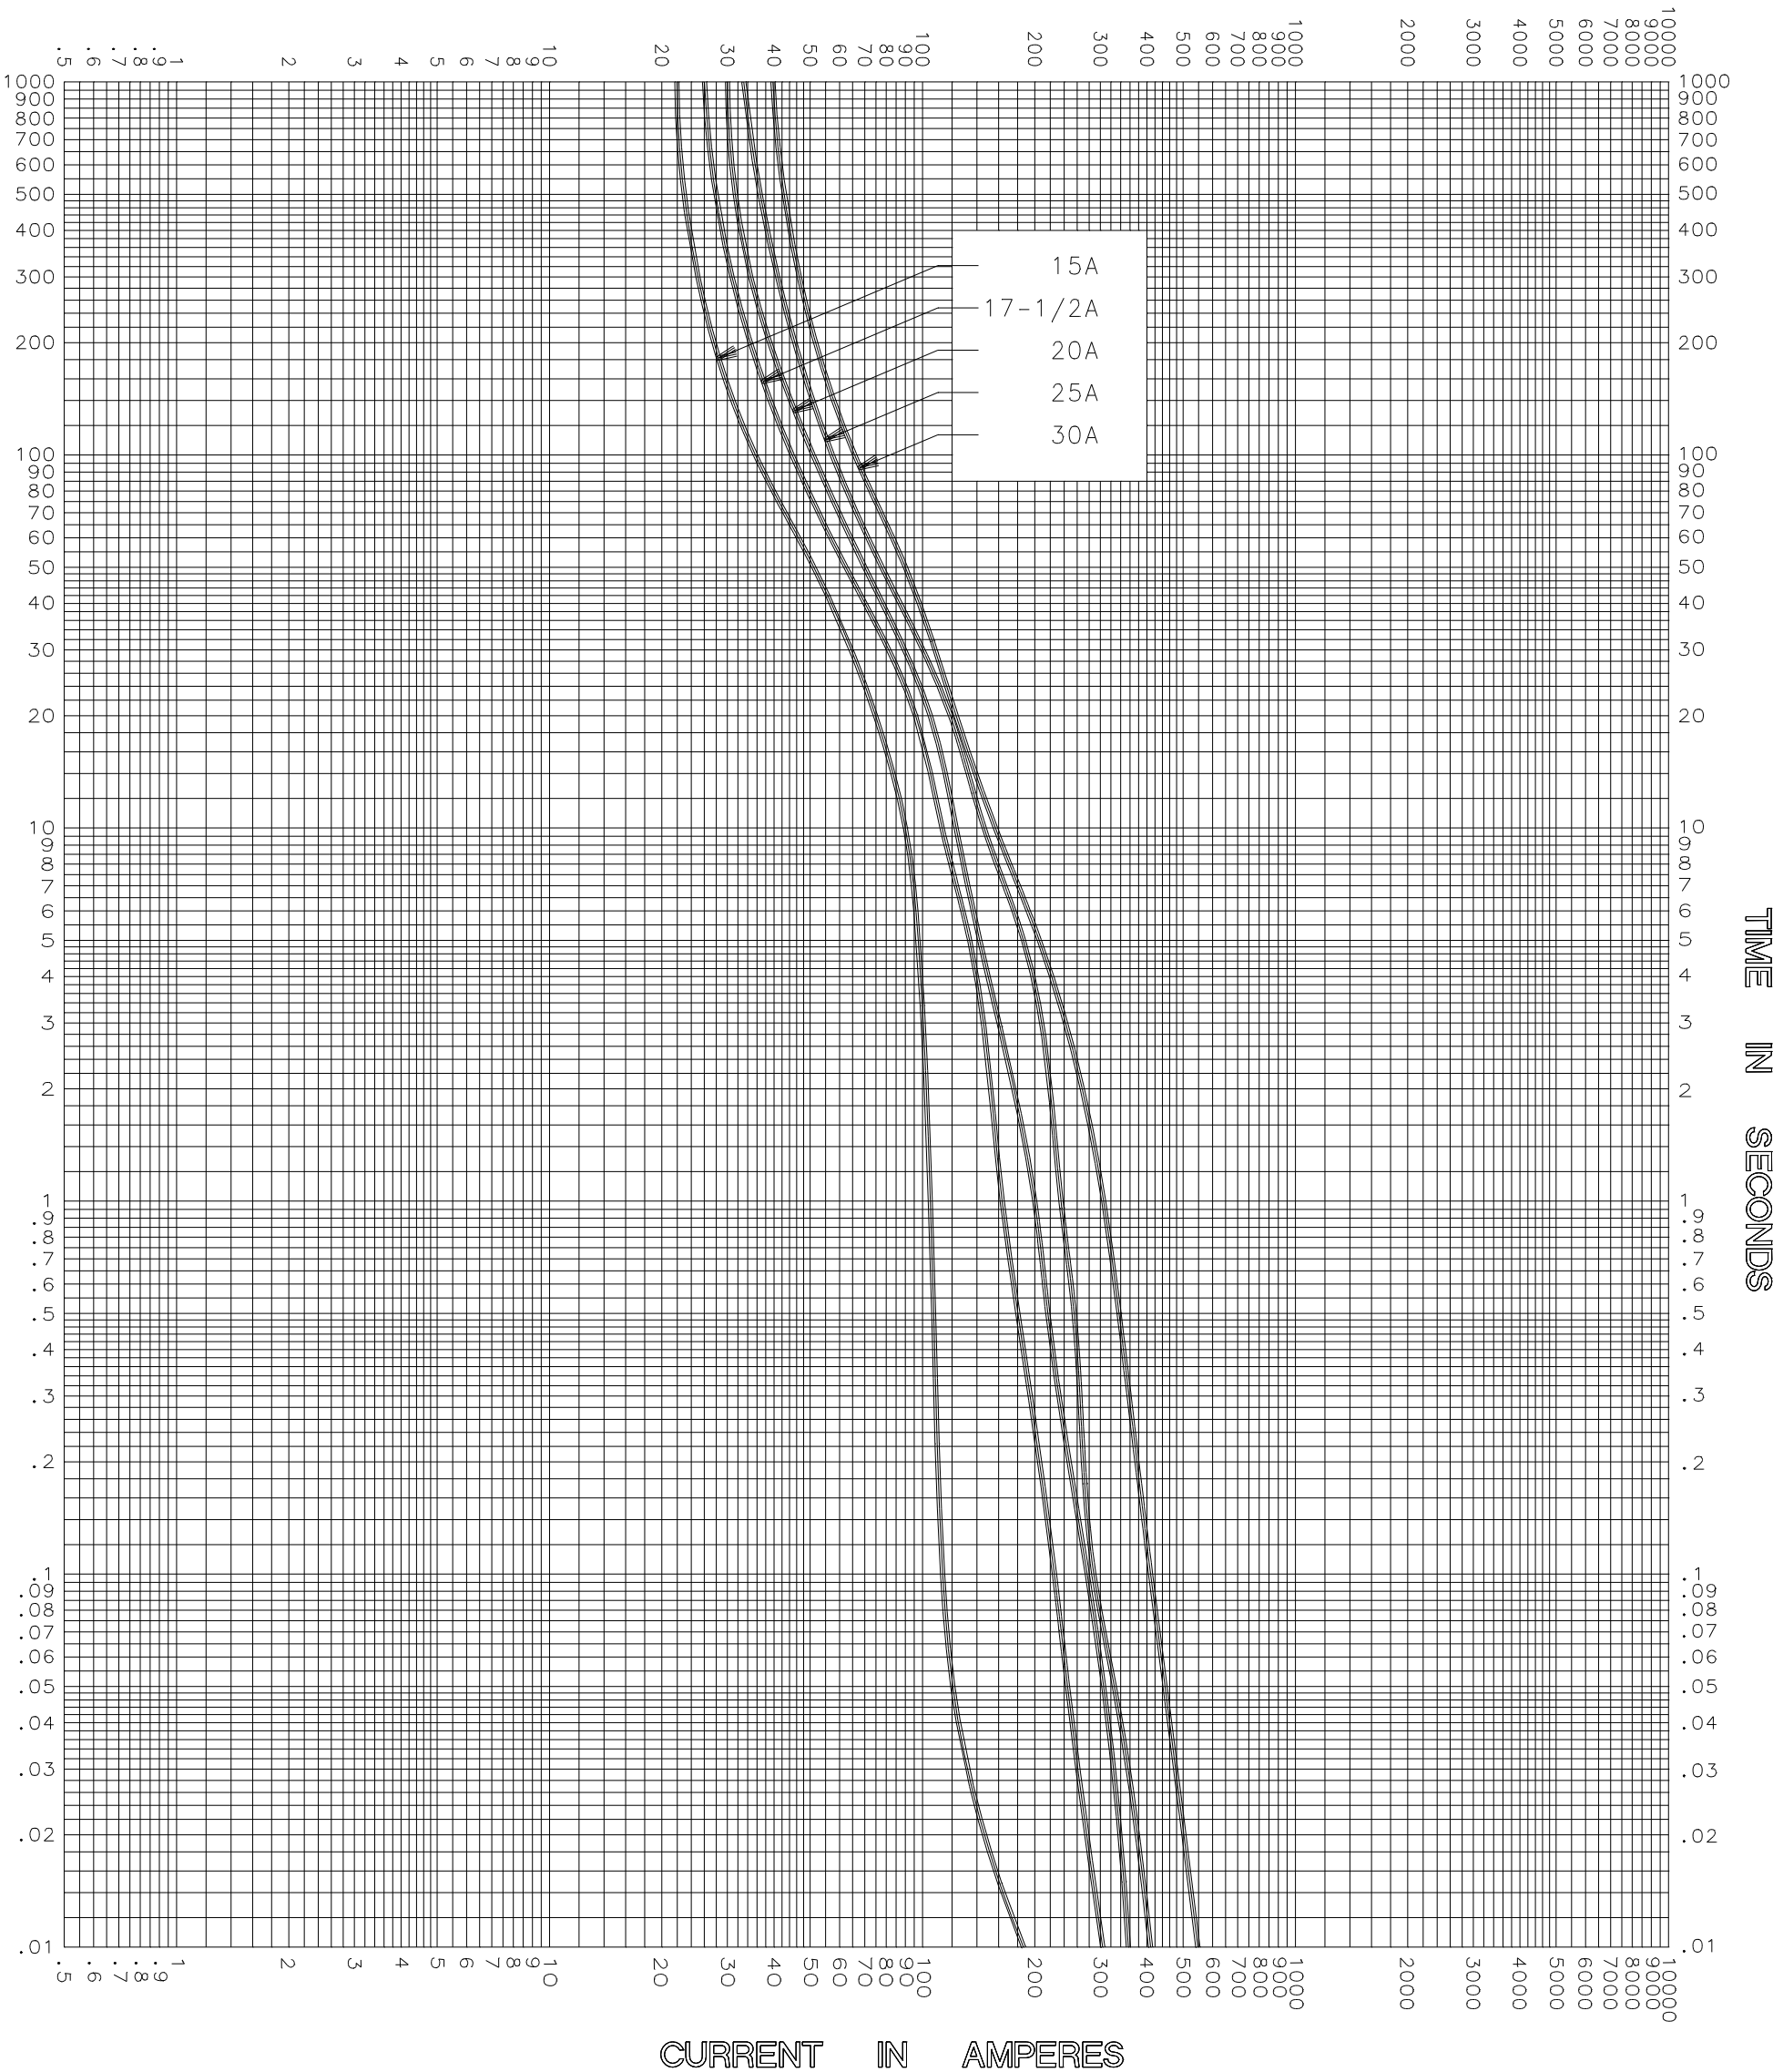

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	JTD (15A - 30A) ID




LITTELFUSE, INC.  
DES PLAINES, ILL. USA

DRAWN BY	LLL
DATE	01/07/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES

DRAWING NO.	A-FCC01-JTDID-004
-------------	-------------------

CURRENT IN AMPERES

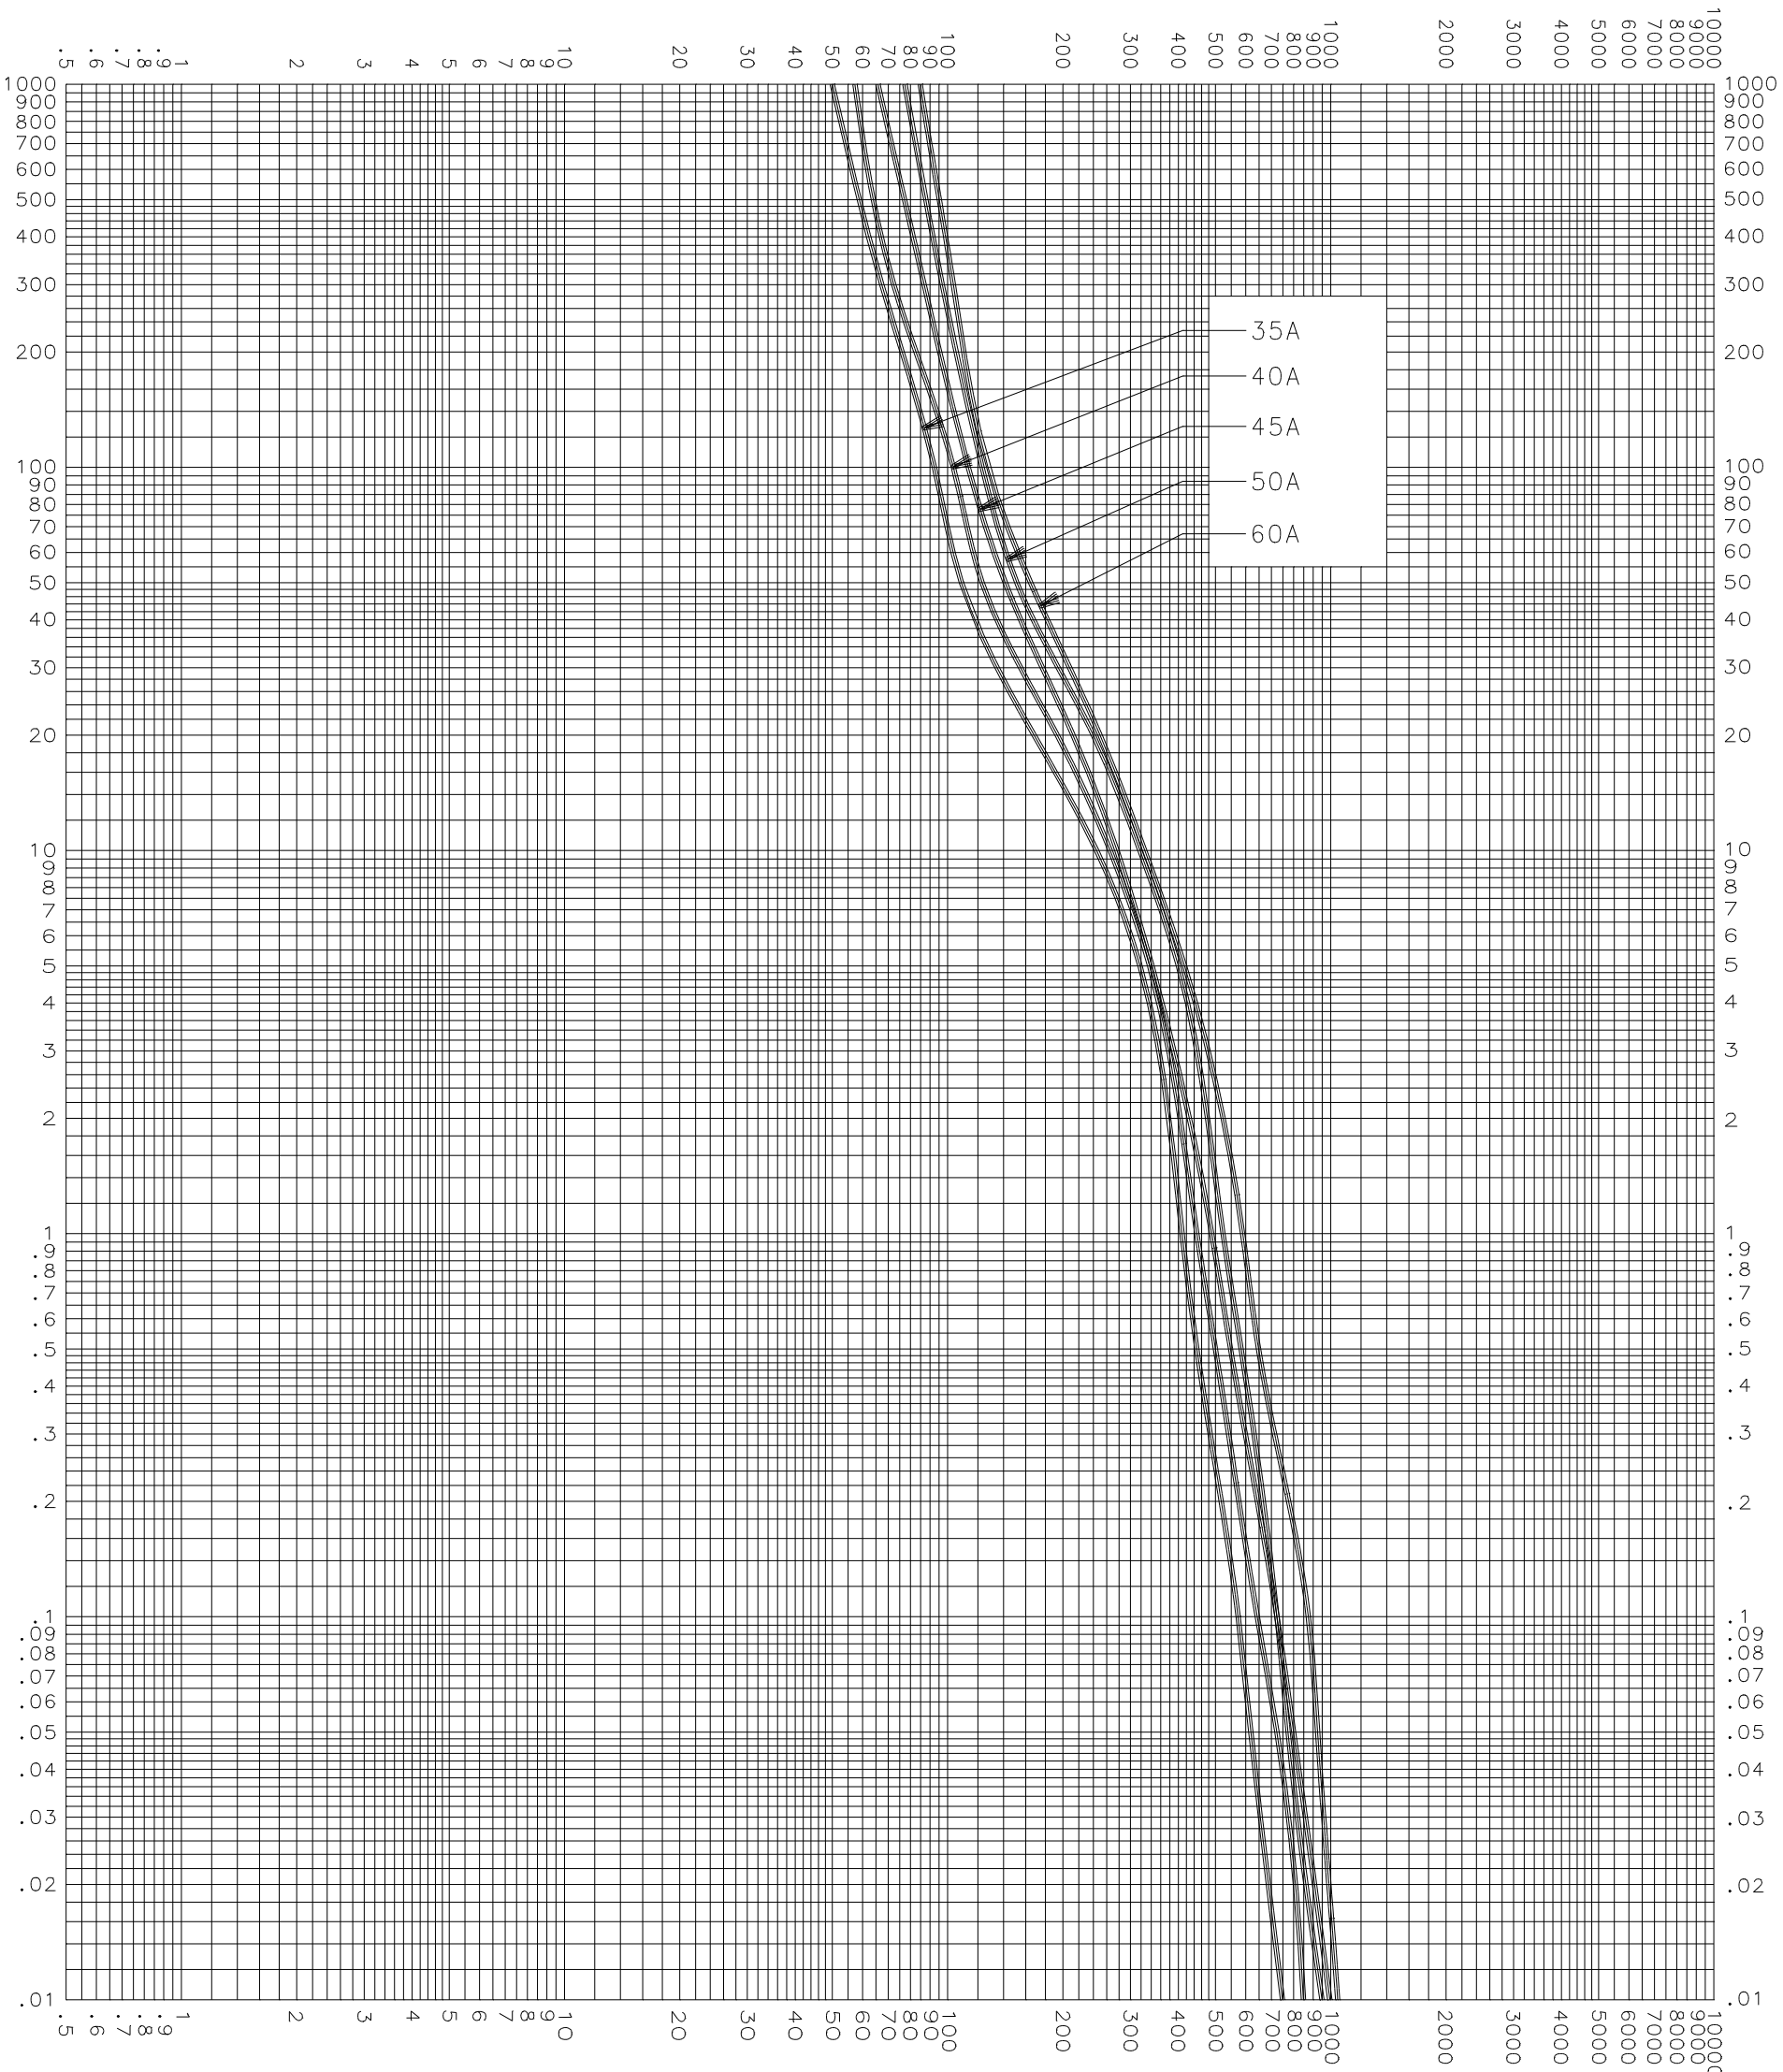


CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER JTD (35A - 60A) ID
BASIS FOR DATA _____		

 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-JTDID-005
------------------------------------	----------------------------------

CURRENT IN AMPERES

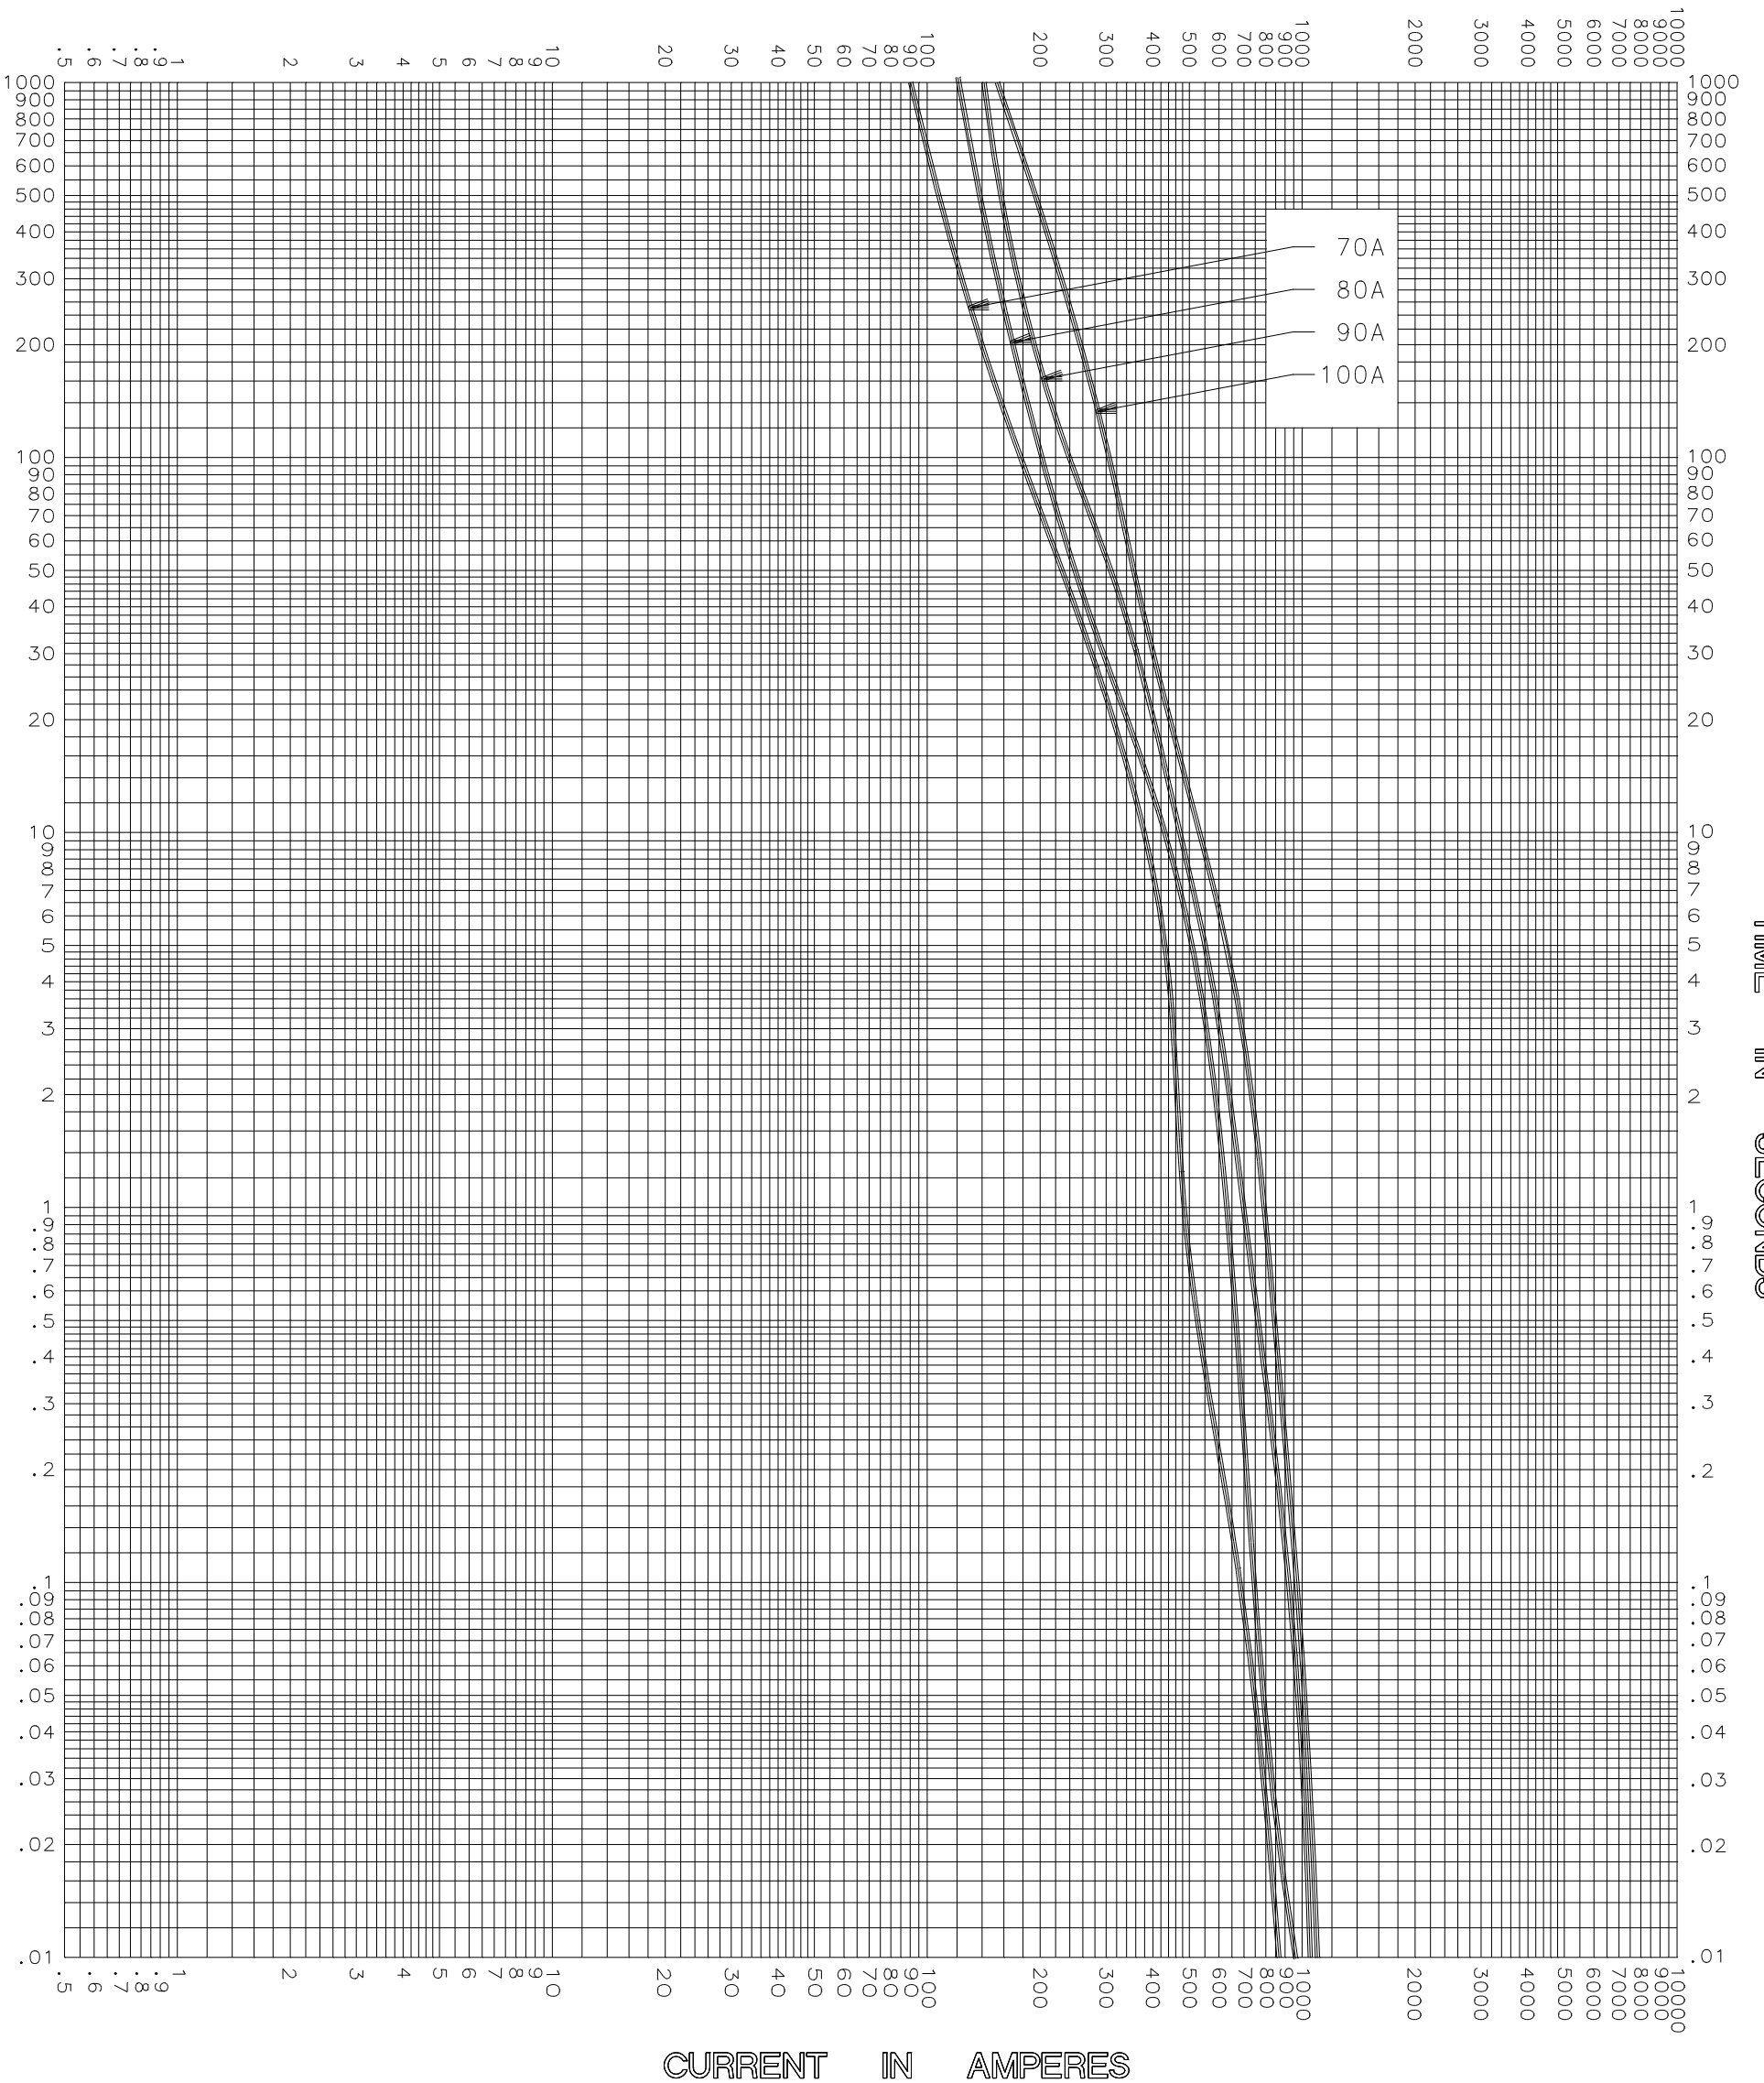

CURRENT IN AMPERES


TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER JTD (70A - 100A) ID
BASIS FOR DATA _____		

 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>
<b>TIME CURRENT CHARACTERISTIC CURVES</b>	DRAWING NO. <u>A-FCC01</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED DOCUMENT

CURRENT IN AMPERES

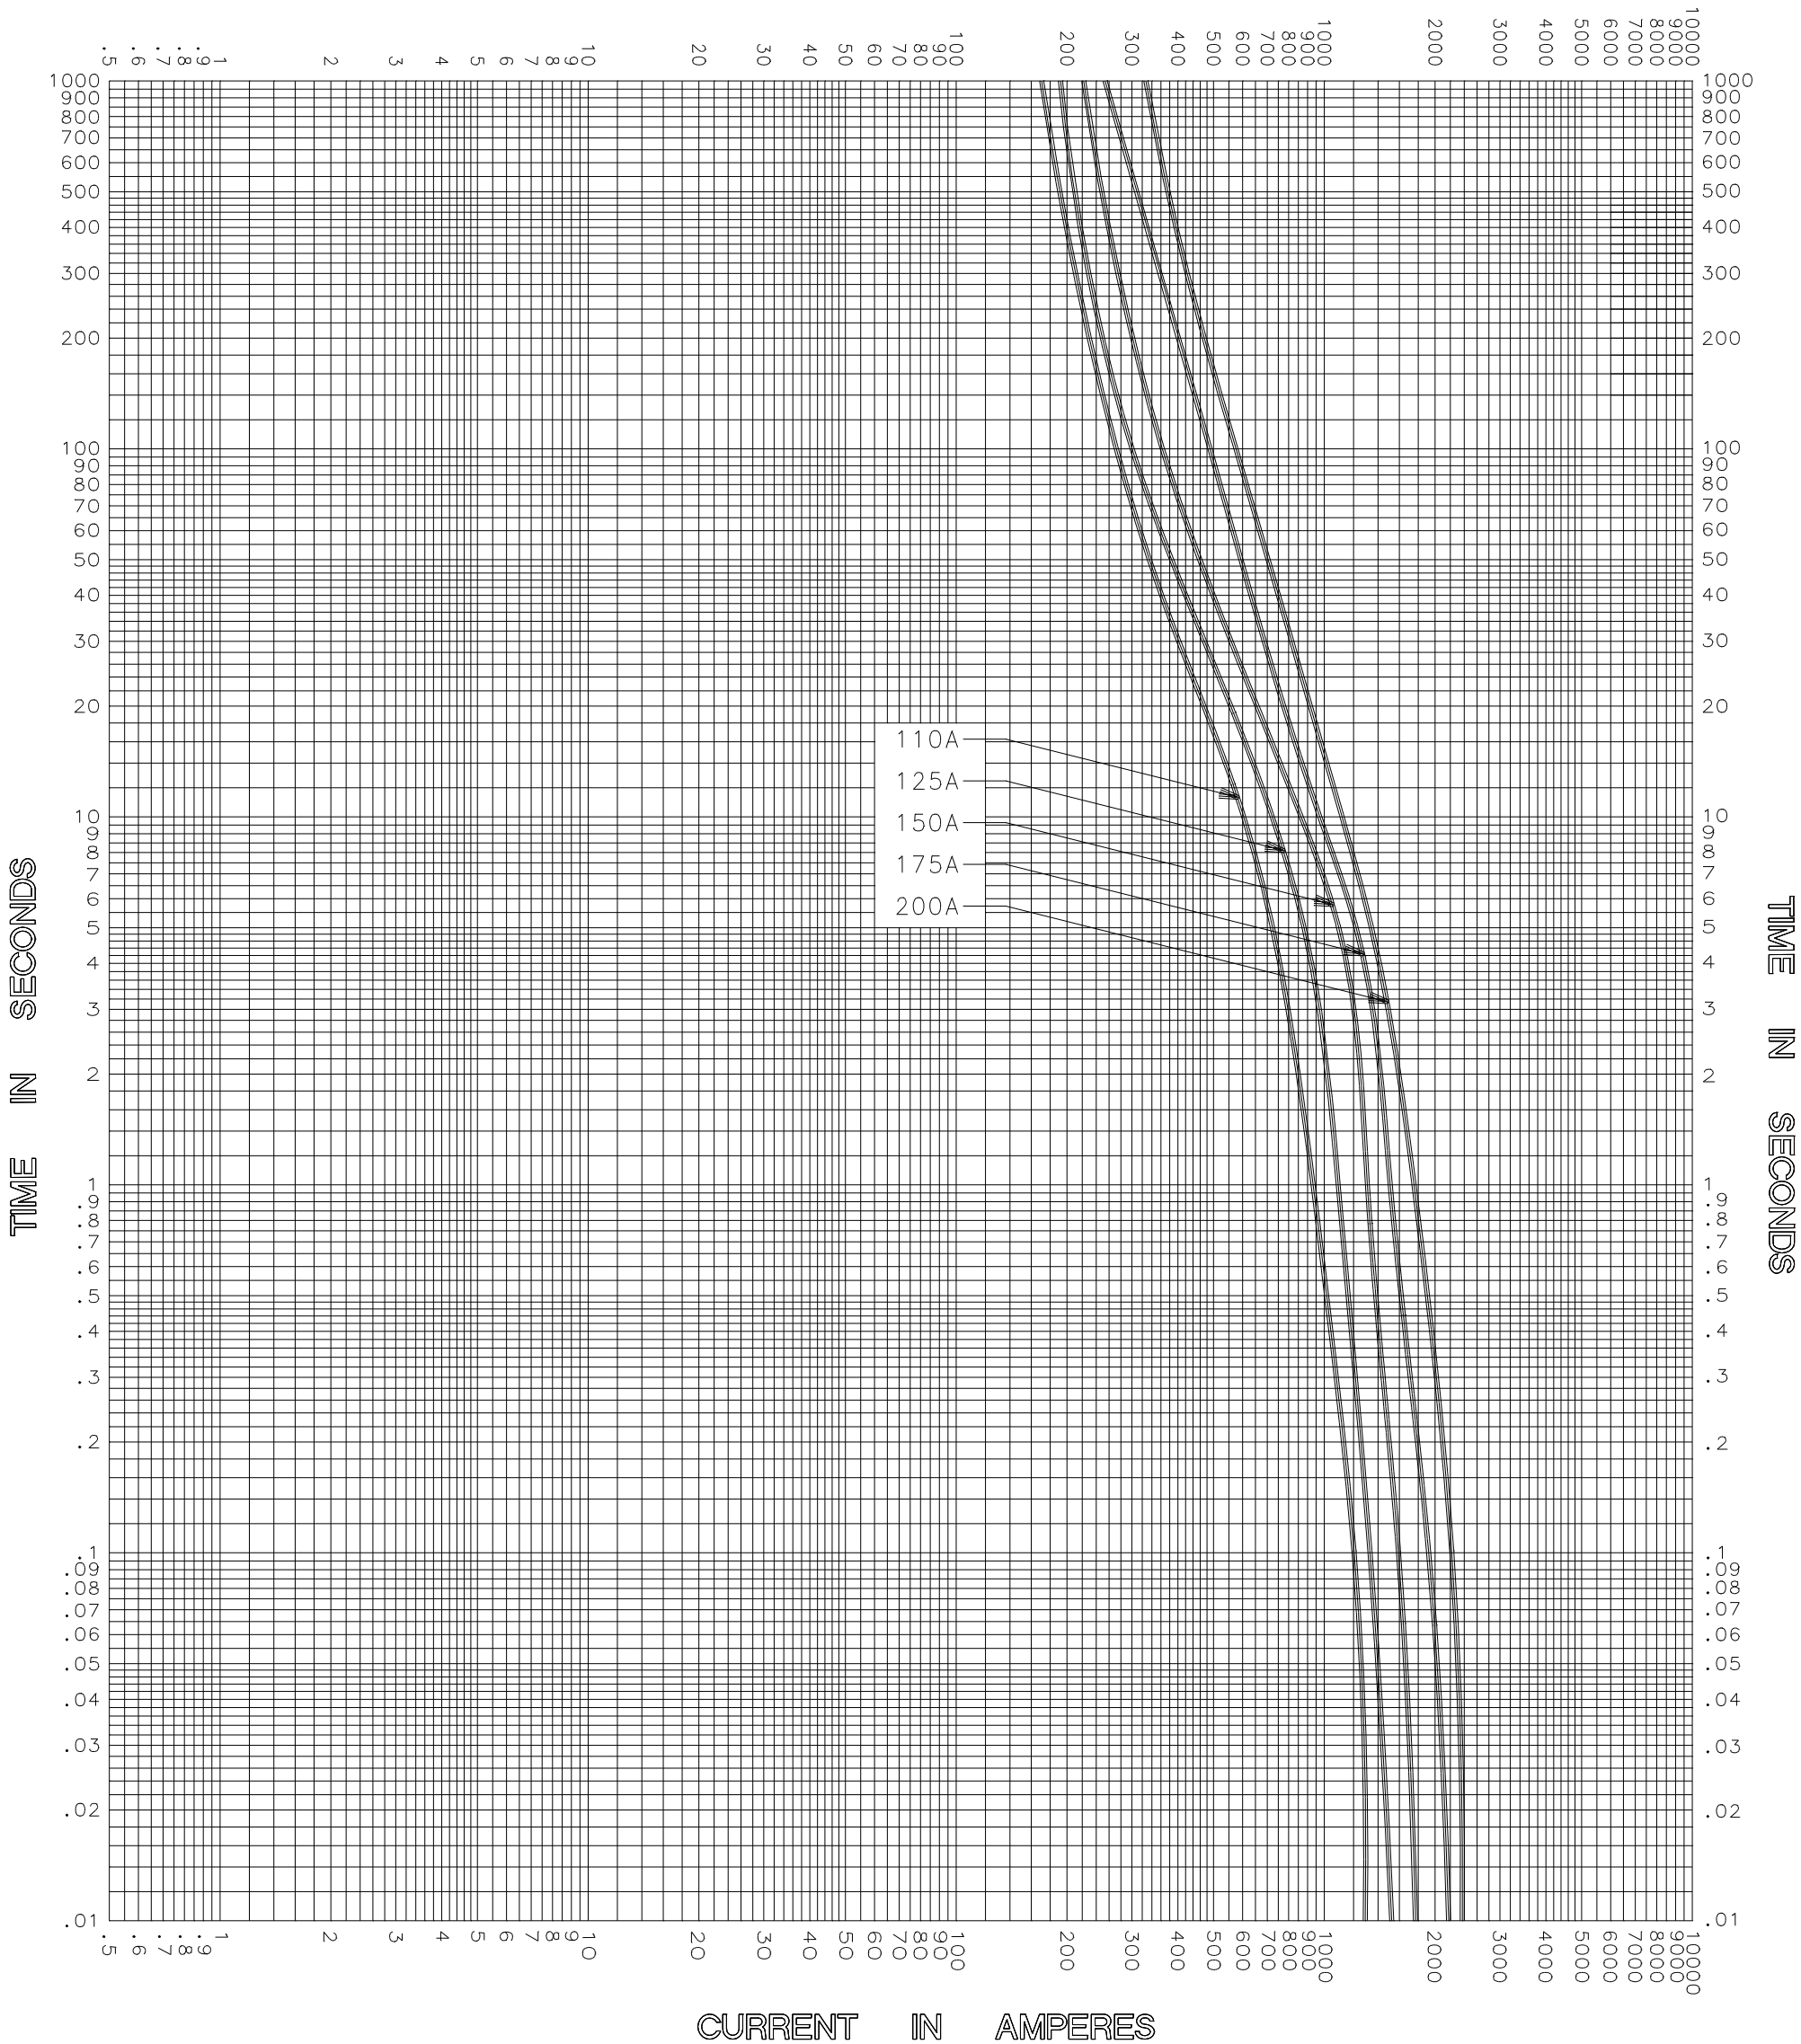


CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER JTD (110A -200A) ID
BASIS FOR DATA _____	

 <p>LITTELFUSE, INC. DES PLAINES, ILL. USA</p>	DRAWN BY <u>LLL</u>
	DATE <u>01/07/05</u>
	CHECKED BY <u>MP</u>

TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. A-FCC01-JTDID-007
------------------------------------	----------------------------------

CURRENT IN AMPERES

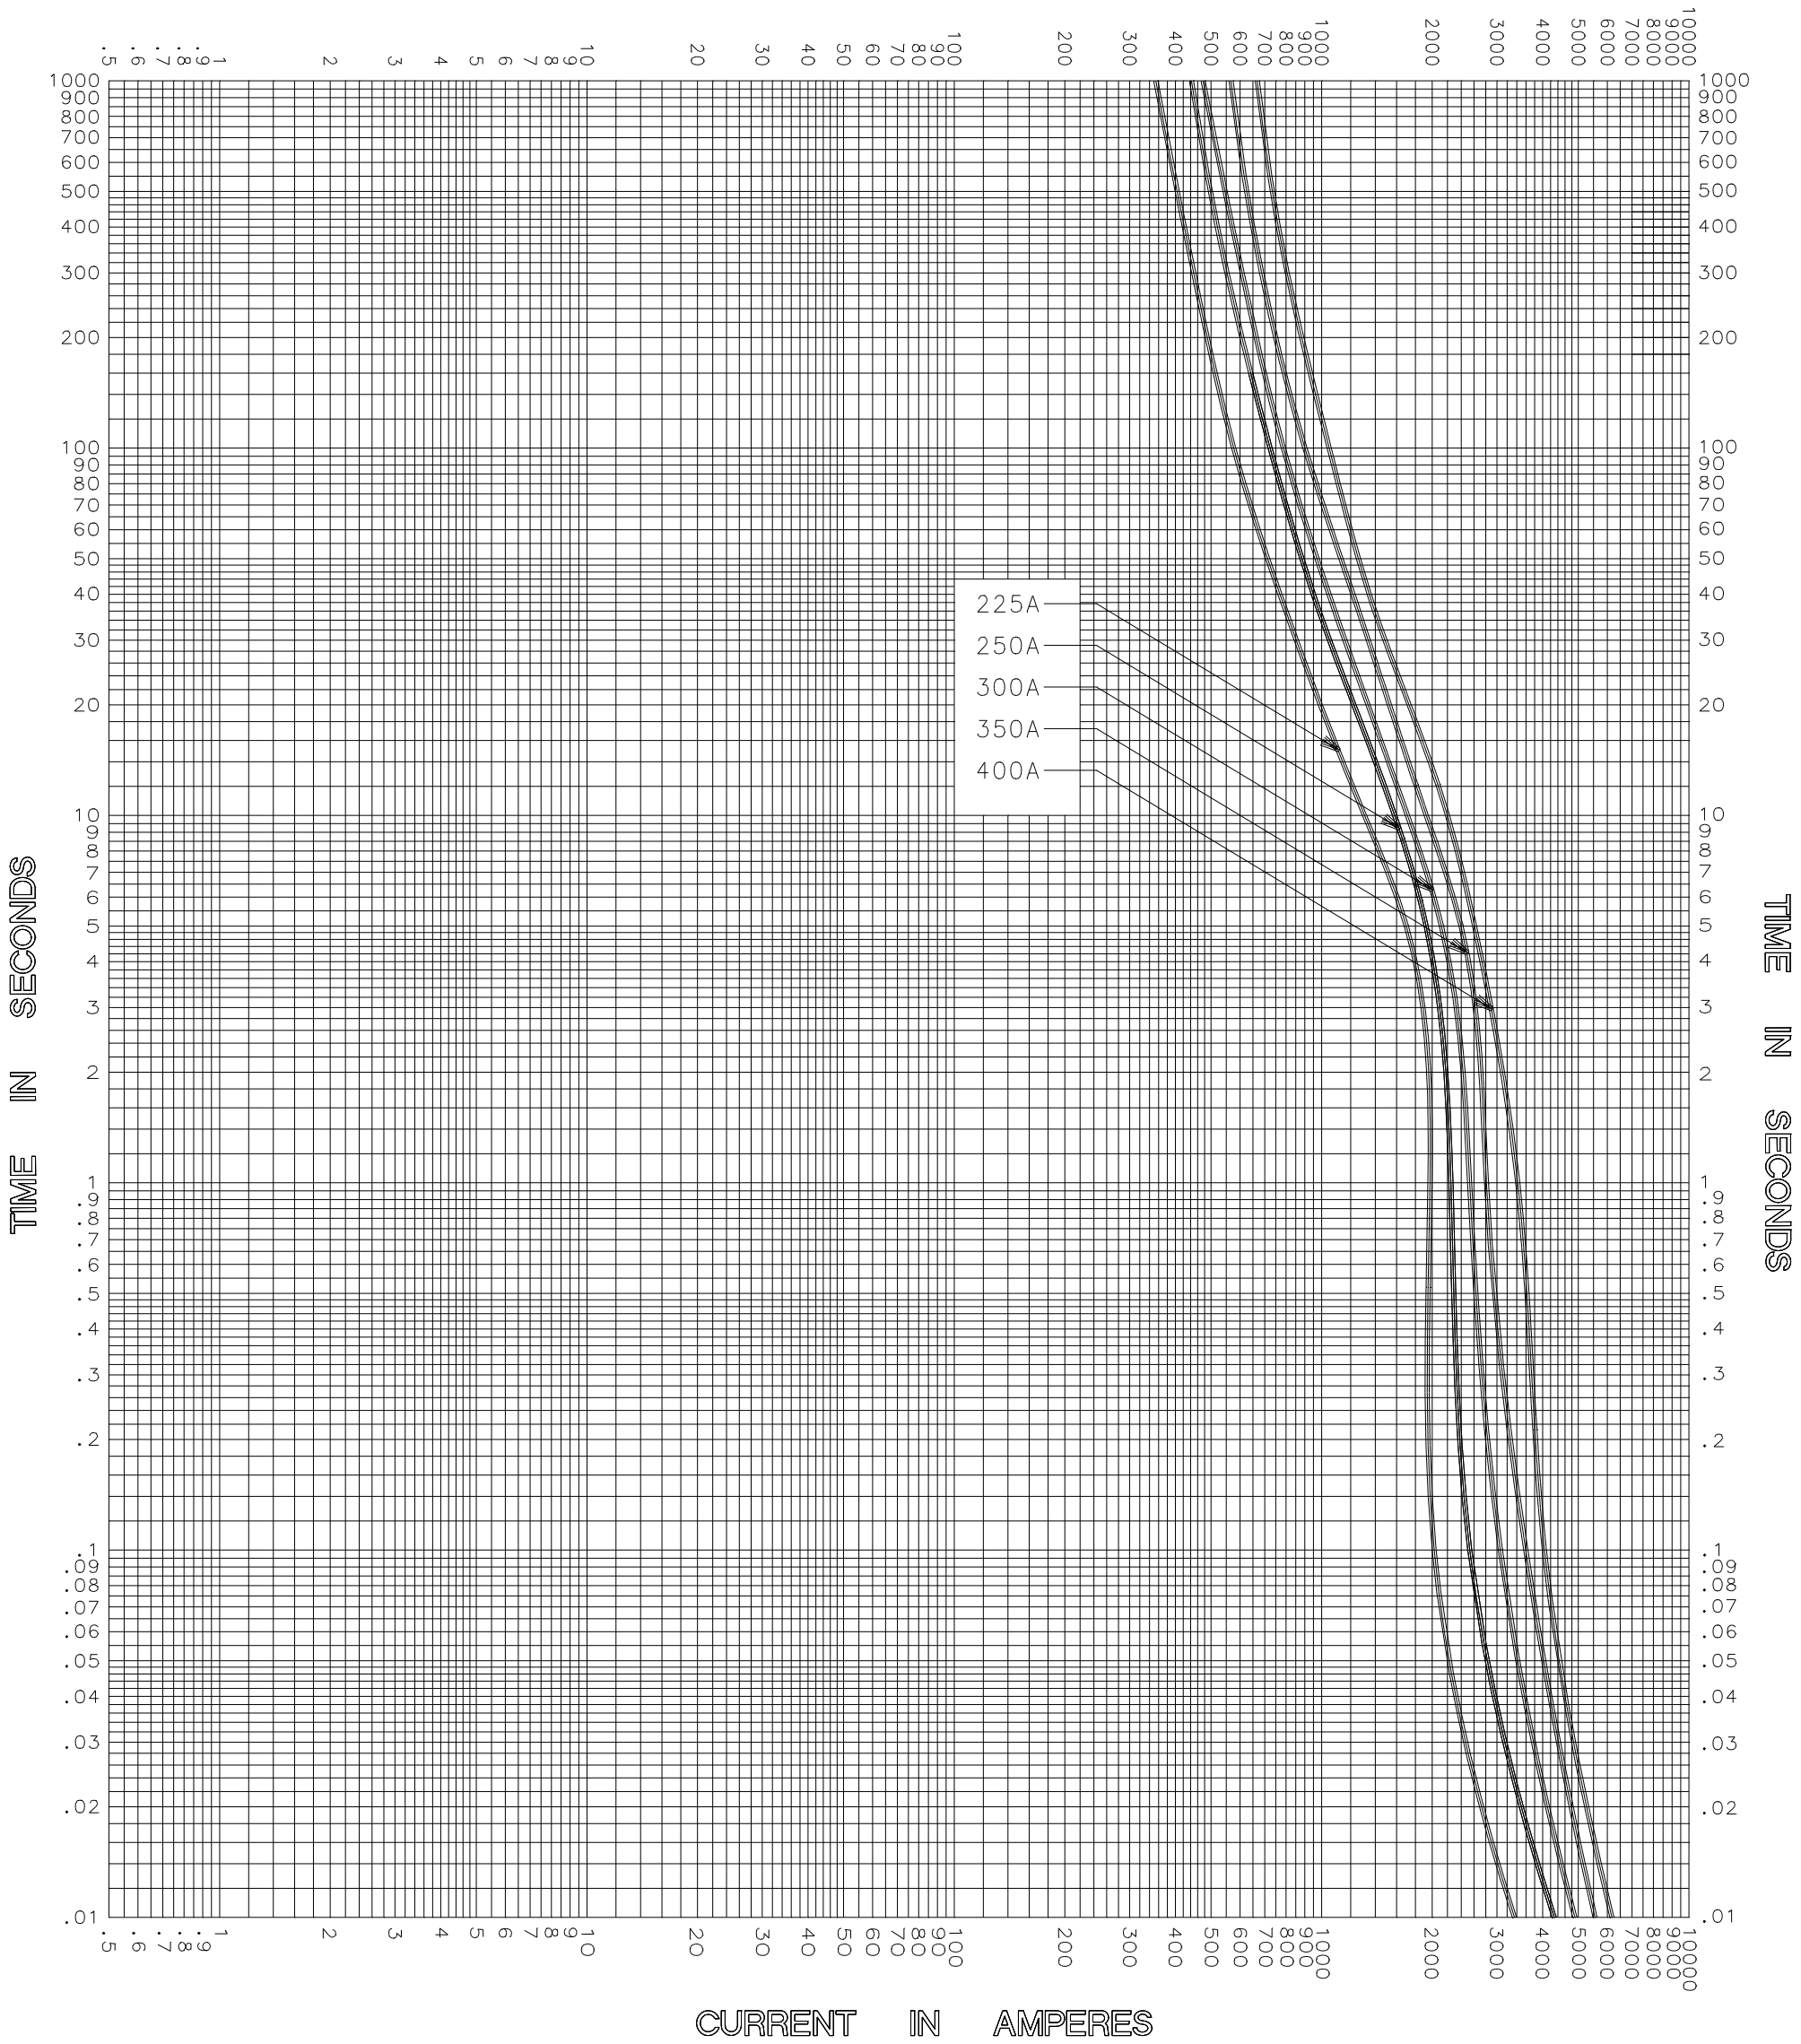

CURRENT IN AMPERES

TEST VOLTAGE _____	TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____		JTD (225A - 400A) ID



LITTELFUSE, INC.  
DES PLAINES, ILL. USA


DRAWN BY	LLL
DATE	01/07/05
CHECKED BY	MP

TIME CURRENT CHARACTERISTIC CURVES


DRAWING NO.	A-FCC01-JTDID-008
-------------	-------------------



CURRENT IN AMPERES

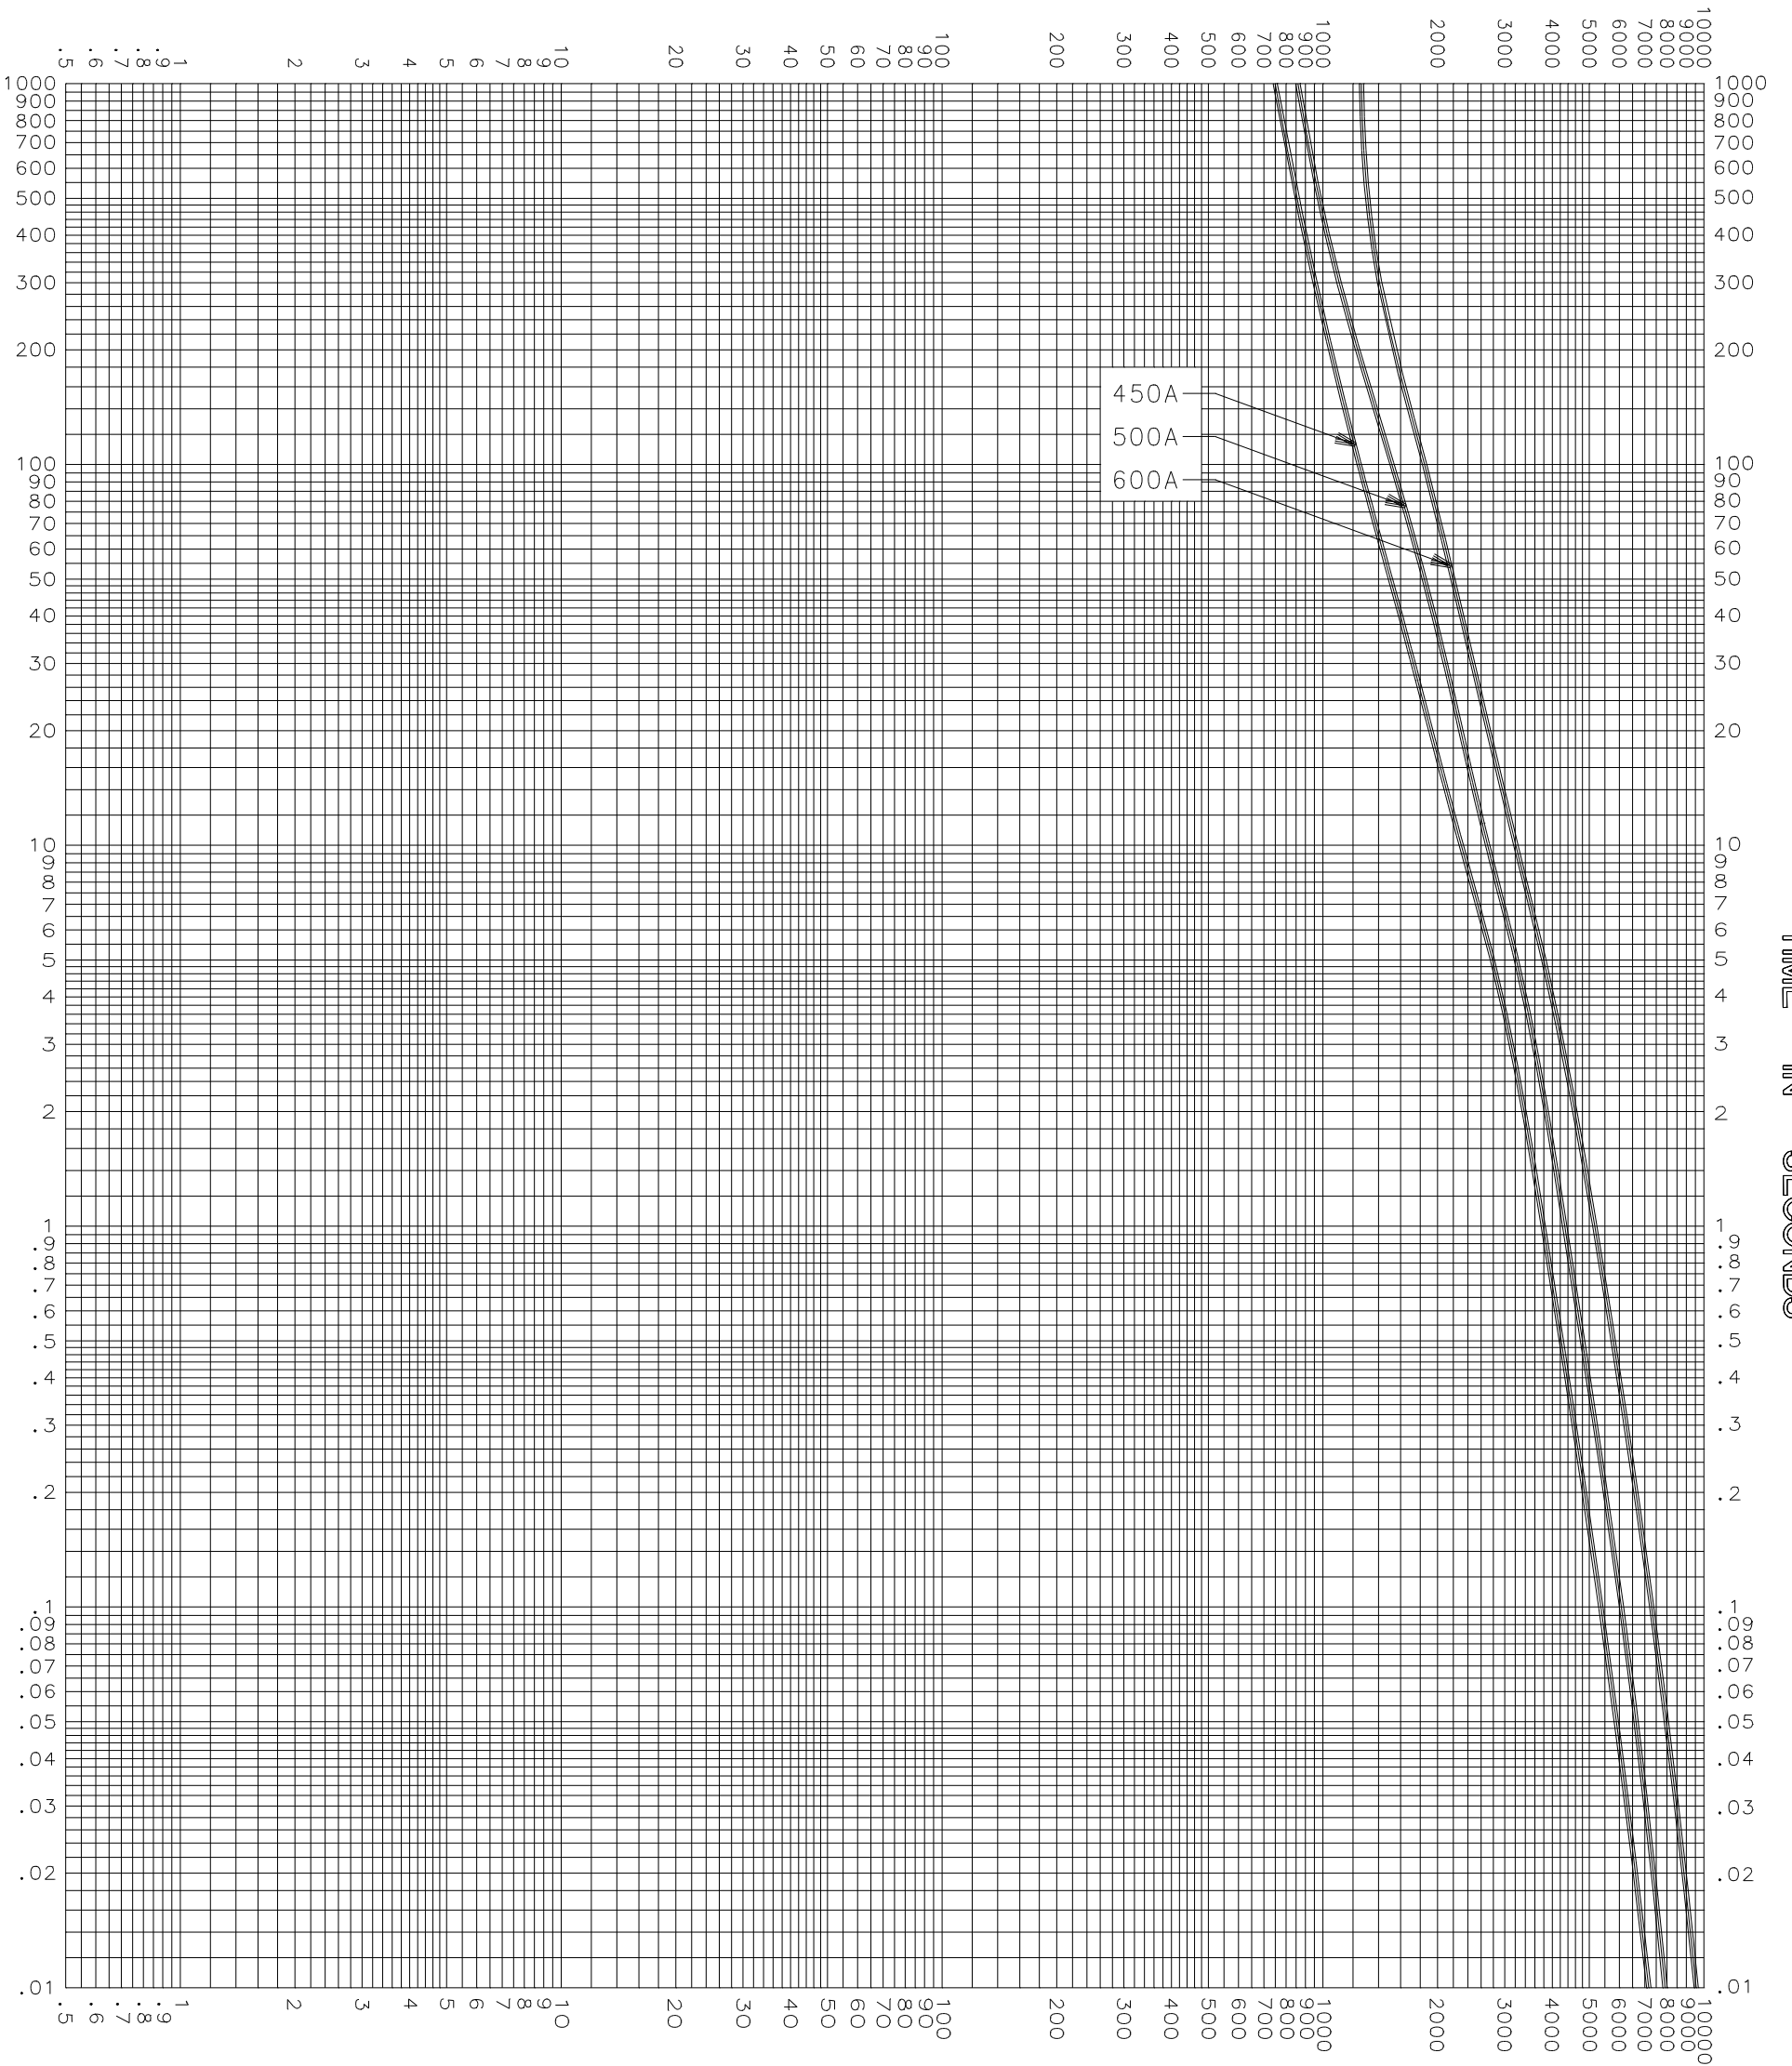

CURRENT IN AMPERES

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____ BASIS FOR DATA _____	FUSE CATALOG NUMBER JTD (450A - 600A) ID
 <b>LITTELFUSE, INC.</b> DES PLAINES, ILL. USA	DRAWN BY <u>LLL</u> DATE <u>01/07/05</u> CHECKED BY <u>MP</u>
	DRAWING NO. A-FCC01-JTDID-009

TIME CURRENT CHARACTERISTIC CURVES