


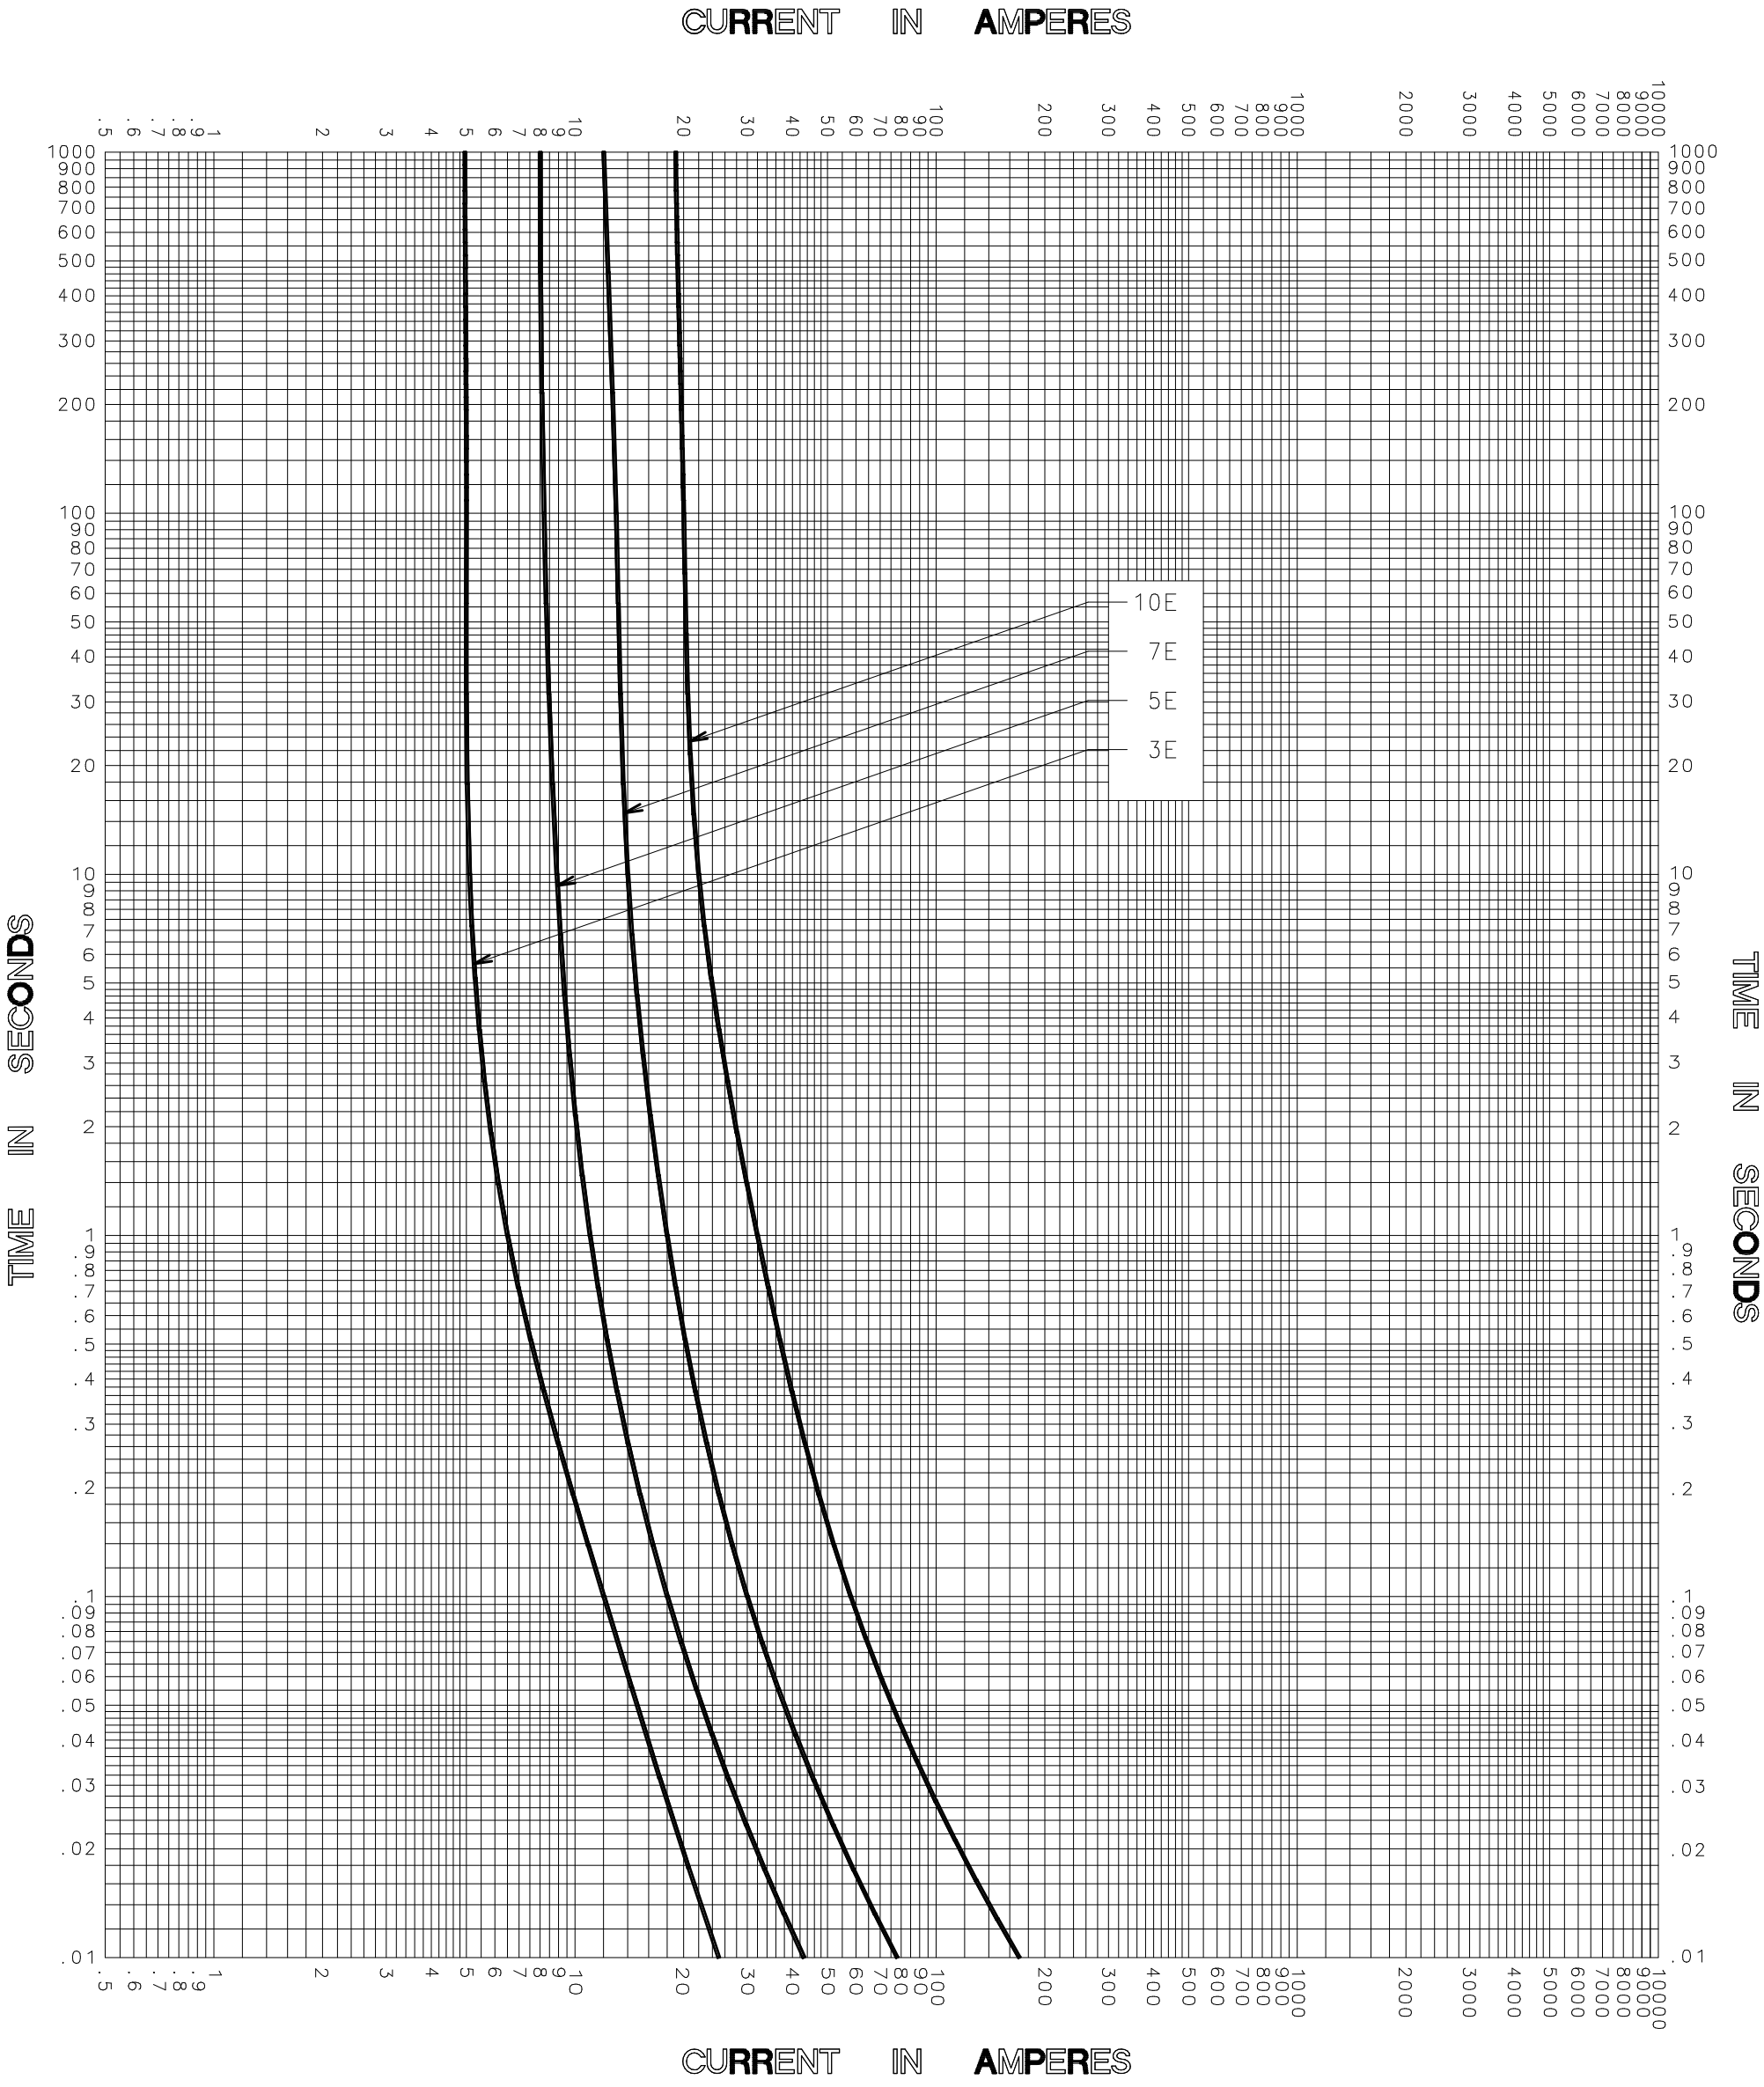

TEST VOLTAGE _____ TIME CONSTANT / POWER FACTOR _____	FUSE CATALOG NUMBER
BASIS FOR DATA _____	3E-4PT-.6 thru 10E-4PT-.6

 Littelfuse [®] DES PLAINES, ILLINOIS 60016	DRAWN BY <u>LLL</u> DATE <u>10/17/05</u> CHECKED BY <u>MP</u>
TIME CURRENT CHARACTERISTIC CURVES	DRAWING NO. <u>A FCC01-4PT-01</u>

-THIS DATA GENERATED ON CAD-

UNCONTROLLED
DOCUMENT