


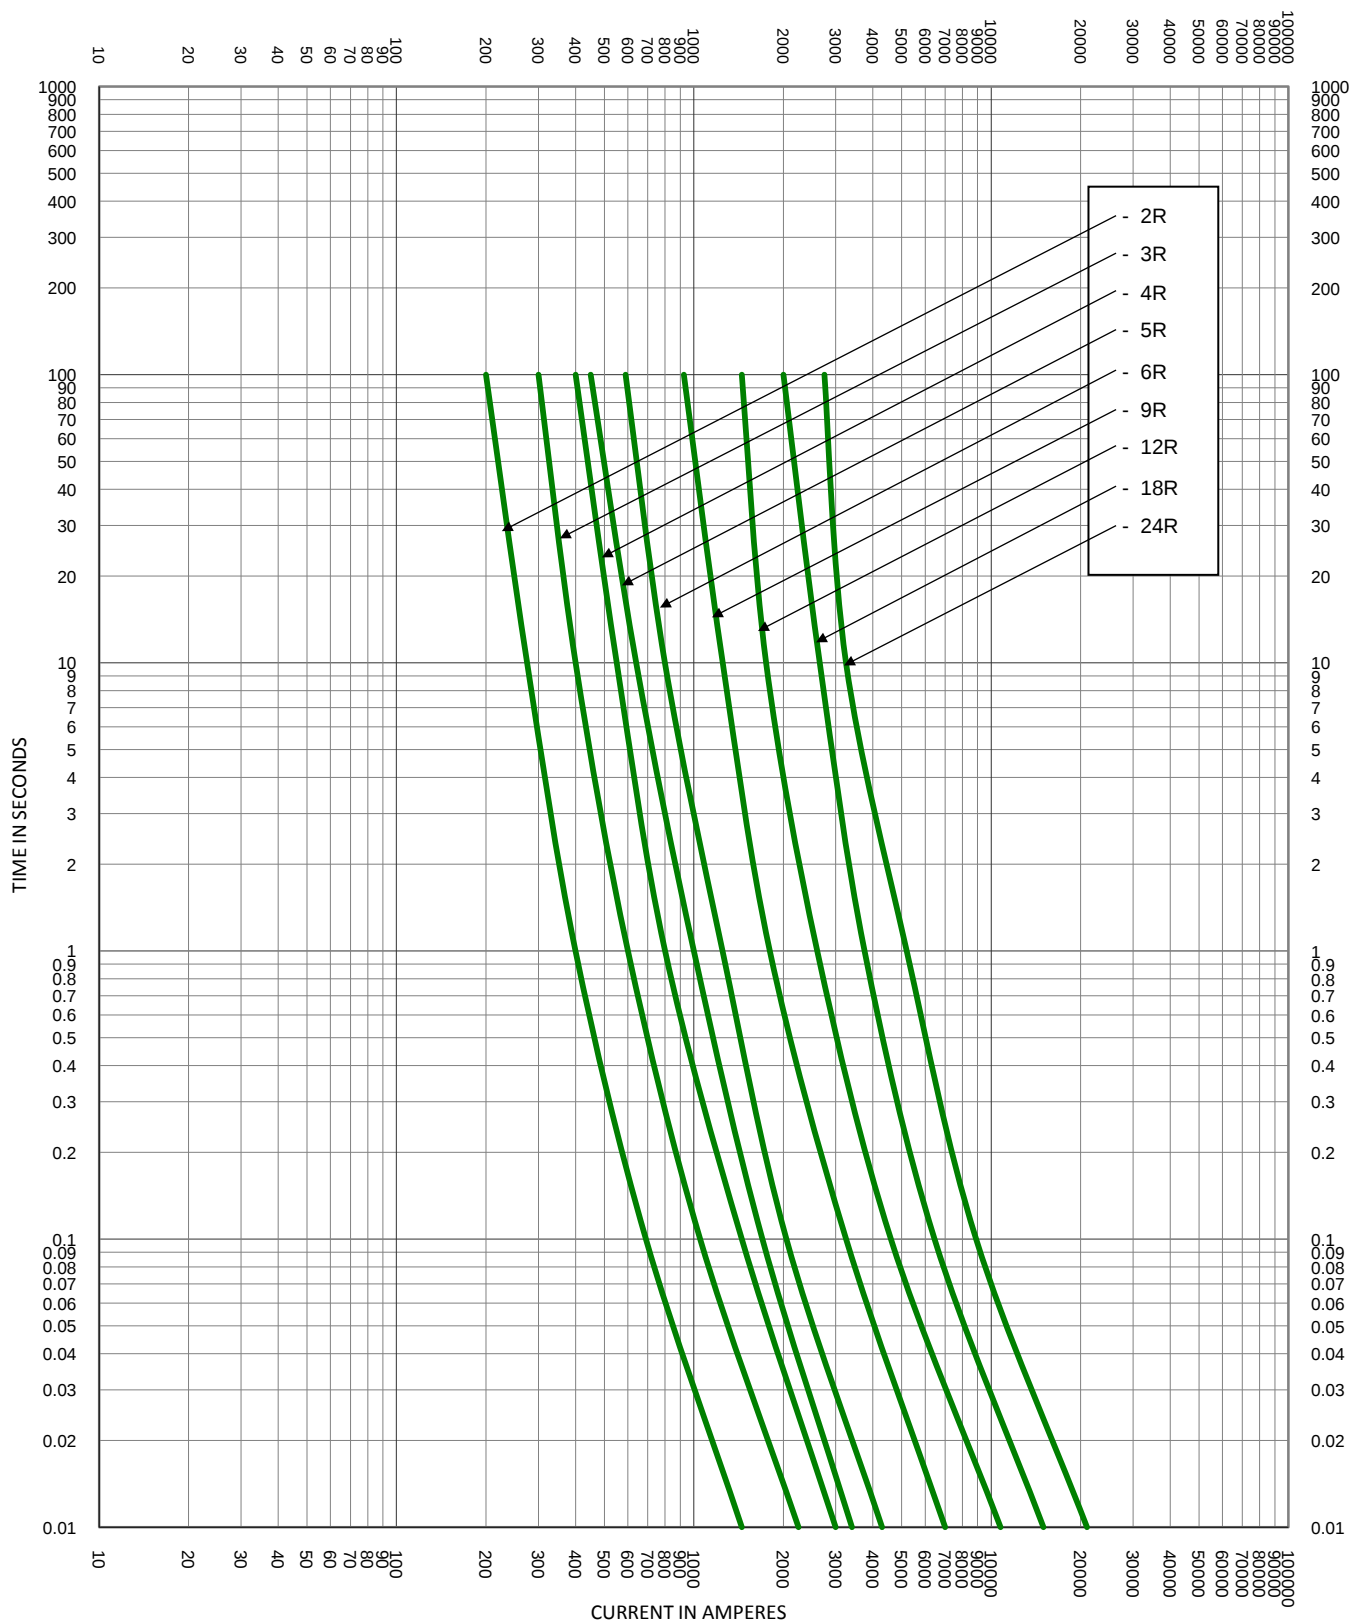

TEST VOLTAGE: 8.25kV		TIME CONSTANT/POWER FACTOR:	FUSE CATALOG NUMBER:
BASIS FOR DATA:			CLEARING CURVES
			8.25V R-RATED 2R - 24R
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL	
		DATE: 05/17/2013	
		REVISION: B	
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO.: SHEET 2 OF 2	
		FCC04-8.25R-002	